

# JOEL SMILOW CARE CENTER BRIDGEPORT RESCUE MISSION

## PHASE II: INTERIOR RENOVATIONS & NEW CONSTRUCTION

725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

---

04.16.2020 - C.M. BID

**THOMAS A.  
TORRENTI, P.C.**

STRUCTURAL  
ENGINEER

316 DOGBURN LANE  
P.O. BOX 1153  
ORANGE, CT 06477  
TEL (203) 891-9933  
FAX (203) 891-8299

**GENERAL  
DRAFTING  
& DESIGN**


M.E.P.FP. ENGINEER

140 WASHINGTON AVENUE  
3RD FLOOR  
NORTH HAVEN CT 06473  
TEL (203) 239-6818

**CABEZAS DEANGELIS  
ENGINEERS &  
SURVEYORS**

CIVIL ENGINEER &  
LANDSCAPE ARCHITECT

1450 BARNUM AVENUE  
SUITE 201  
BRIDGEPORT, CT 06610  
TEL (203) 330-8700  
www.cd-engineers.com

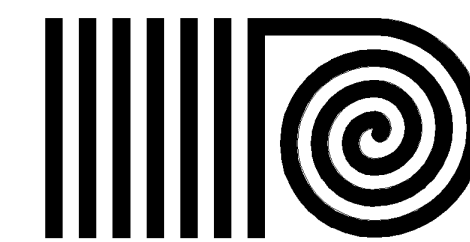

**ANTINOZZI ASSOCIATES**  
ARCHITECTURE & INTERIORS

271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
TEL (203) 377-1300 FAX (203) 378-3002  
www.antinozzi.com

**MANTAGNO  
CONSTRUCTION, INC.**

CONSTRUCTION  
MANAGEMENT


75 PROGRESS LANE  
WATERBURY CT 06705  
TEL (203) 597-9014  
www.montagno.com

**CROSSROAD  
SOLUTIONS, LLC**

OWNER'S  
REPRESENTATIVE


358 CROSS HILL ROAD.  
MONROE, CT. 06468  
(203) 885-4217  
crossroadsolutionsllc@gmail.com



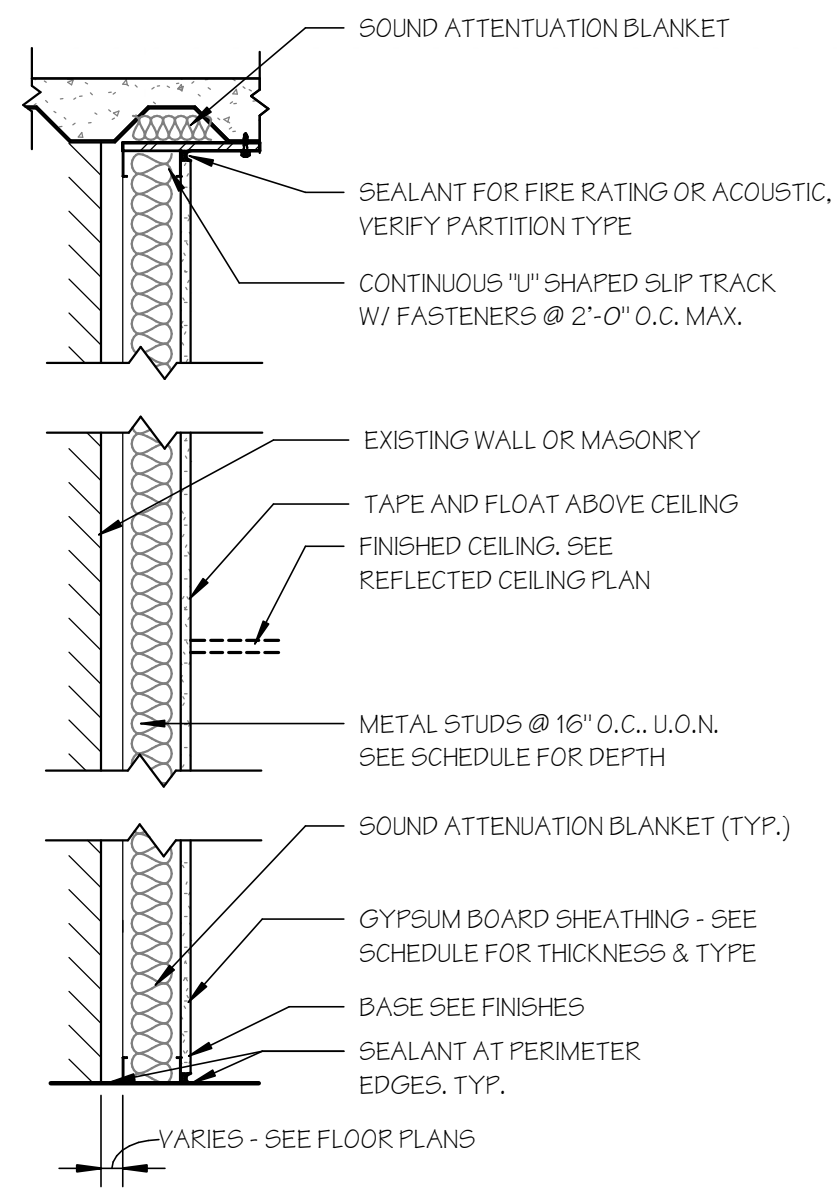


**PARTITION TYPE 4**

METAL STUD FURRING						
TYPE	STUD	WIDTH	FIRE RATING	UL #	STC	COMMENTS
4	3 5/8"	4 1/4"				(1) LAYER 5/8" ABUSE RESISTANT GYP. BD. ON 3-5/8" METAL STUDS
4A	3 5/8"	4 1/4"				(1) LAYER 5/8" MOISTURE & ABUSE RESISTANT GYP. BD. ON 3-5/8" METAL STUDS
4C	2 1/2"	3 1/8"				(1) LAYER 5/8" ABUSE RESISTANT GYP. BD. ON 2-1/2" METAL STUDS
4D	2 1/2"	3 1/8"				(1) LAYER 5/8" MOISTURE & ABUSE RESISTANT GYP. BD. ON 2-1/2" METAL STUDS
4E	6"	7 1/4"	1HR.	V497		(2) LAYERS 5/8" ABUSE RESISTANT TYPE "X" GYP. BD. ON TAG SIDE OF 6" COLD-FORMED STRUCTURAL METAL STUDS

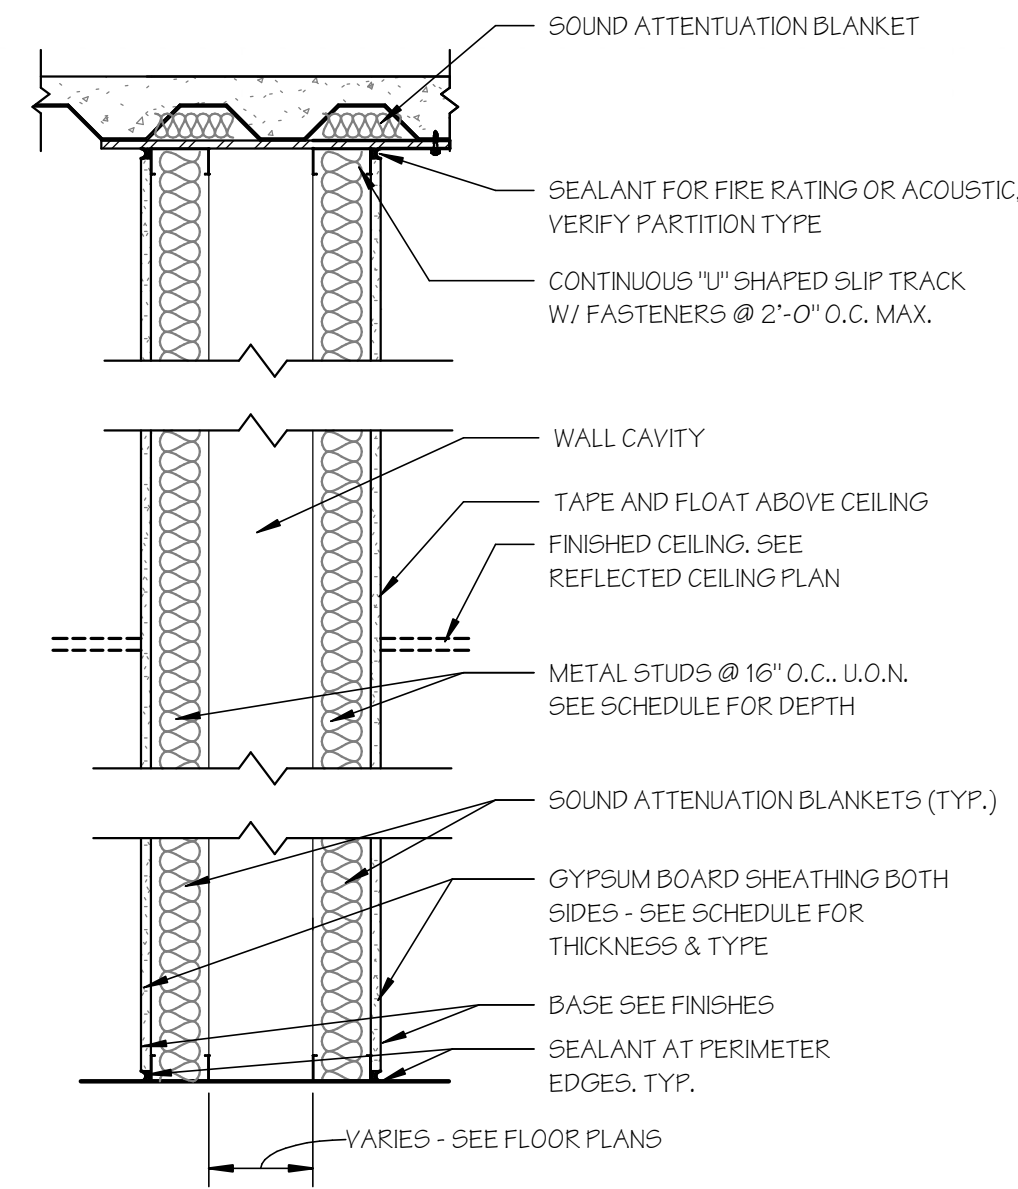


**PARTITION TYPE 5**

DOUBLE WALL METAL STUD PARTITIONS						
TYPE	STUD	TOTAL WIDTH	FIRE RATING	UL #	STC	COMMENTS
5	3 5/8"	VARIES - SEE PLAN				DOUBLE WALL WITH VARIABLE CAVITY WIDTH - (1) LAYER 5/8" ABUSE RESISTANT GYP. BD. ON 3-5/8" METAL STUDS BOTH SIDES
5A	3 5/8"	VARIES - SEE PLAN				DOUBLE WALL WITH VARIABLE CAVITY WIDTH - (1) LAYER 5/8" MOISTURE RESISTANT GYP. BD. ON 3-5/8" METAL STUDS BOTH SIDES
5B	3 5/8"	VARIES - SEE PLAN				DOUBLE WALL WITH VARIABLE CAVITY WIDTH - (1) LAYER 5/8" MOISTURE & ABUSE RESISTANT GYP. BD. ON 3-5/8" METAL STUDS ON TAG SIDE + (1) LAYER 5/8" ABUSE RESISTANT GYP. BD. ON OPPOSITE
5C	3 5/8"	VARIES - SEE PLAN	1HR.			DOUBLE WALL WITH VARIABLE CAVITY WIDTH - (2) LAYERS 5/8" MOISTURE & ABUSE RESISTANT TYPE "X" GYP. BD. ON 3-5/8" METAL STUDS ON TAG SIDE + (2) LAYERS 5/8" ABUSE RESISTANT TYPE "X" GYP. BD. ON OPPOSITE

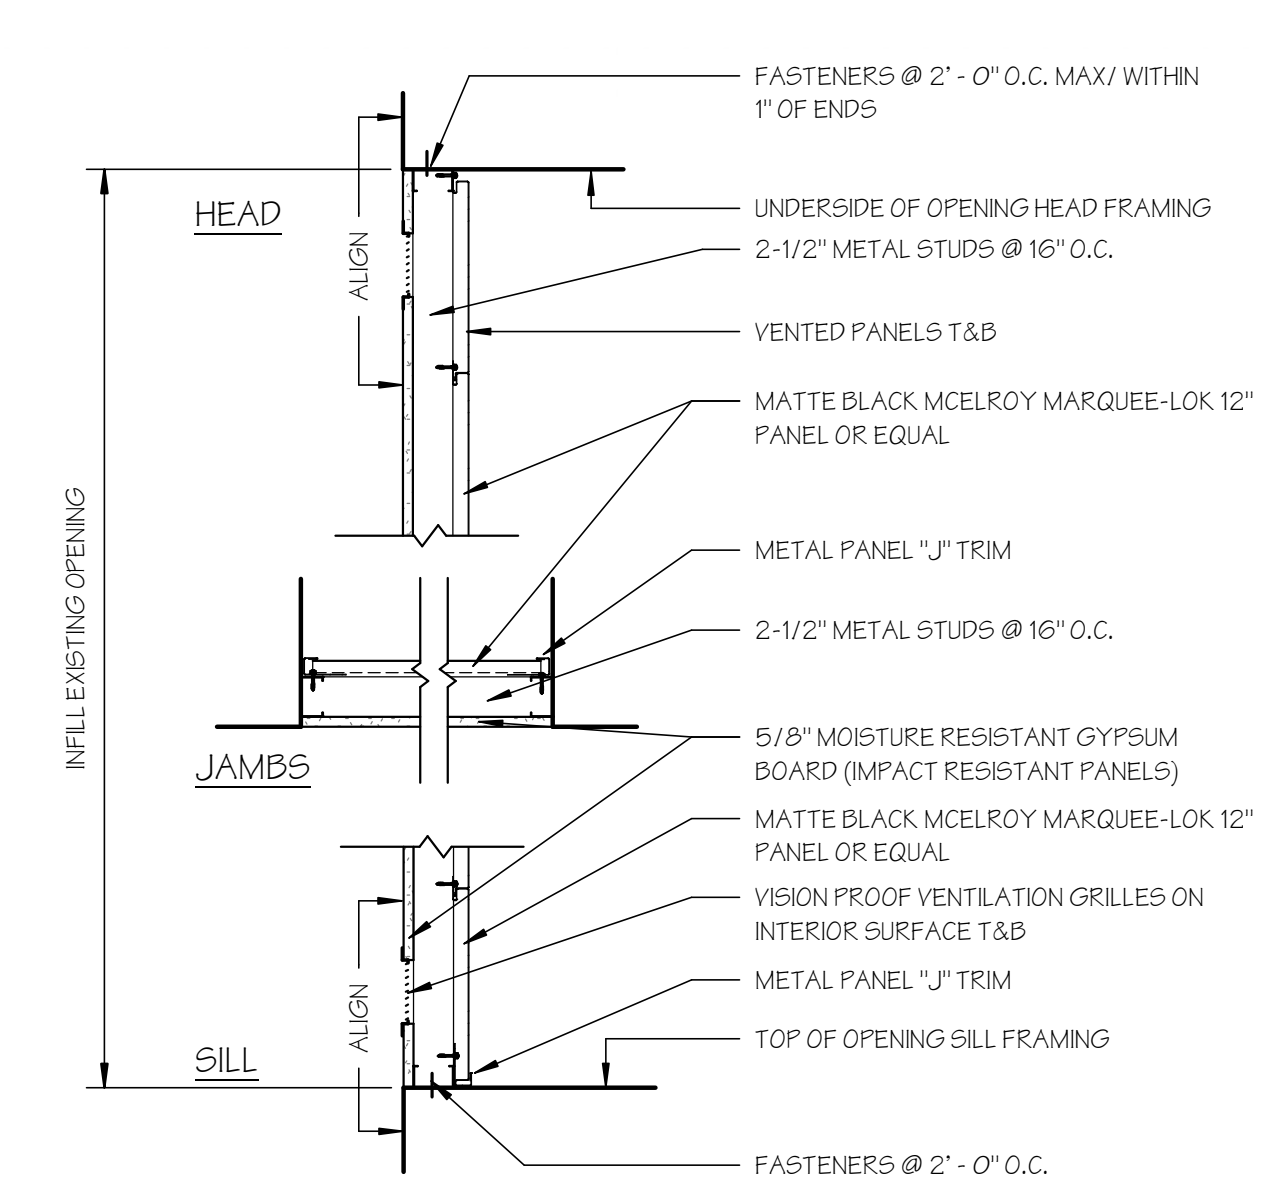


**PARTITION TYPE 6**

METAL PANEL WALL PARTITIONS			
TYPE	STUD	TOTAL WIDTH	COMMENTS
6	2-1/2"	4 1/8"	(1) LAYER 5/8" MOISTURE RESISTANT GYP. BD. ON 2-1/2" METAL STUDS WITH 1" MATTE BLACK 12" X 1" MCELROY MARQUEE-LOK PANELS OR EQUAL

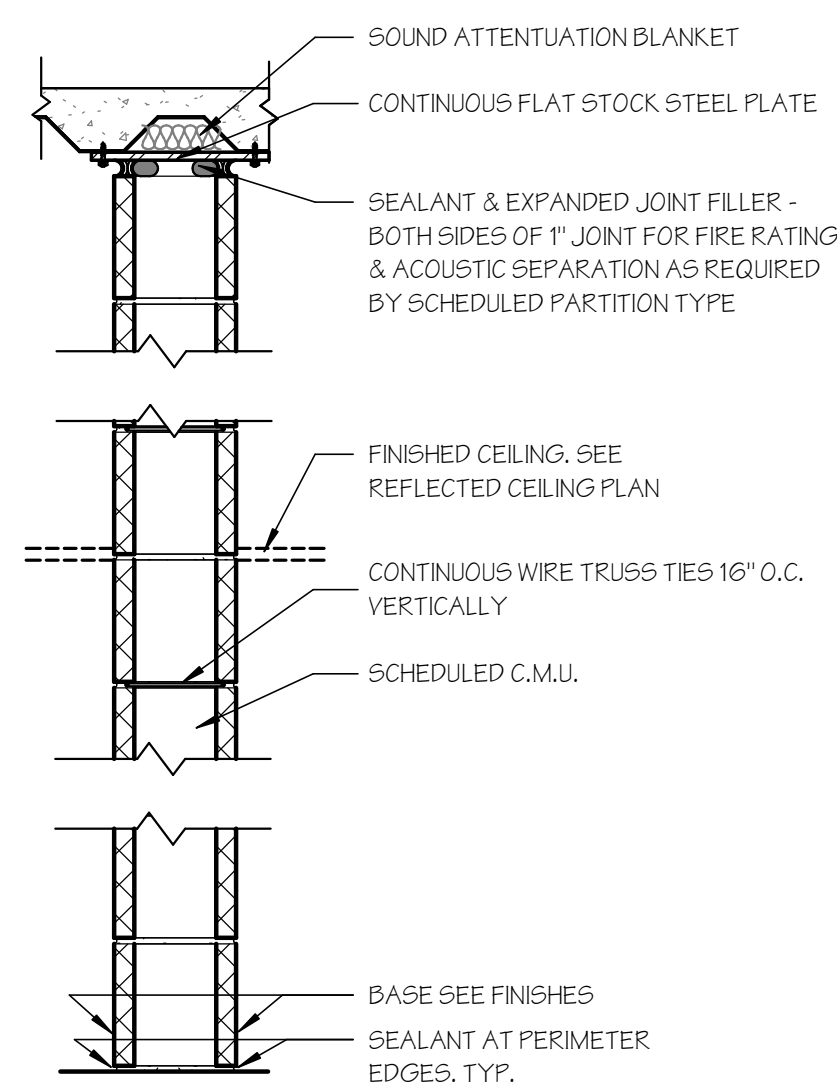


**PARTITION TYPE 1**

MASONRY PARTITIONS					
TYPE	C.M.U.	FIRE RATING	UL #	STC	COMMENTS
1	7 5/8"	2HR.	U905		NOMINAL 8" x 8" x 16" CONCRETE BLOCKS WITH APPROVED 2 HR. CLASSIFICATION IN RUNNING BOND PATTERN
1A	5-5/8"	1HR.			NOMINAL 6" x 8" x 16" CONCRETE BLOCKS IN RUNNING BOND PATTERN
1B	5-5/8"	2HR.	U906		NOMINAL 6" x 8" x 16" CONCRETE BLOCKS WITH APPROVED 2 HR. CLASSIFICATION IN RUNNING BOND PATTERN

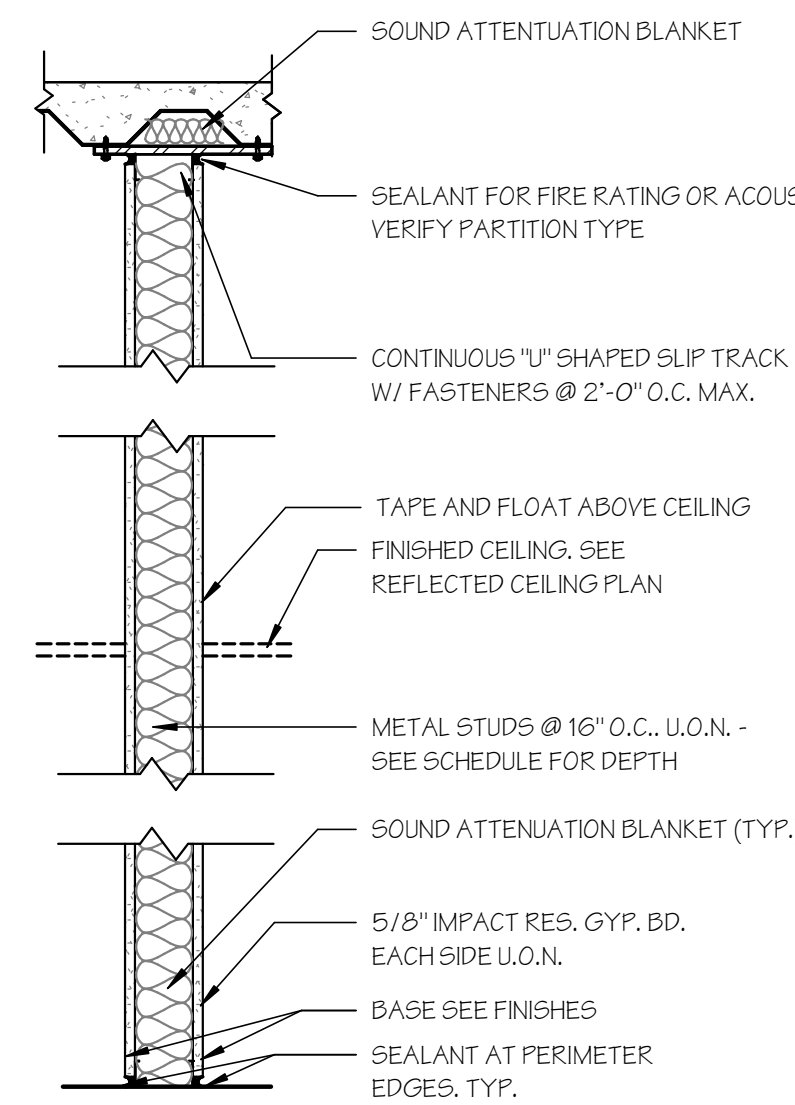

**PARTITION TYPE 2**

METAL STUD PARTITIONS						
TYPE	STUD	TOTAL WIDTH	FIRE RATING	UL #	STC	COMMENTS
2	3 5/8"	4 7/8"				(1) LAYER 5/8" ABUSE RESISTANT GYP. BD. EACH SIDE ON 3-5/8" 20 GA. METAL STUDS @ 16" O.C.
2A	3 5/8"	4 7/8"				(1) LAYER 5/8" MOISTURE RESISTANT GYP. BD. EACH SIDE ON 3-5/8" 20 GA. METAL STUDS @ 16" O.C.
2B	6"	7 1/4"				(1) LAYER 5/8" ABUSE RESISTANT GYP. BD. EACH SIDE ON 6" 20 GA. METAL STUDS @ 16" O.C.
2C	3 5/8"	4 7/8"				(1) LAYER 5/8" MOISTURE RESISTANT GYP. BD. ON TAG SIDE + (1) LAYER 5/8" ABUSE RESISTANT GYP. BD. ON OPPOSITE TAG WITH 3-5/8" 20 GA. METAL STUDS @ 16" O.C.
2D	6"	7 1/4"				(1) LAYER 5/8" ABUSE RESISTANT GYP. BD. EACH SIDE ON 6" 20 GA. METAL STUDS @ 16" O.C.
2E	6"	7 7/8"	1HR.	U423 (SIM.)		(2) LAYERS 5/8" ABUSE RESISTANT TYPE "X" GYP. BD. ON TAG SIDE + (1) LAYER 5/8" ABUSE RESISTANT TYPE "X" GYP. BD. ON OPPOSITE OF 6" COLD-FORMED STRUCTURAL METAL STUDS

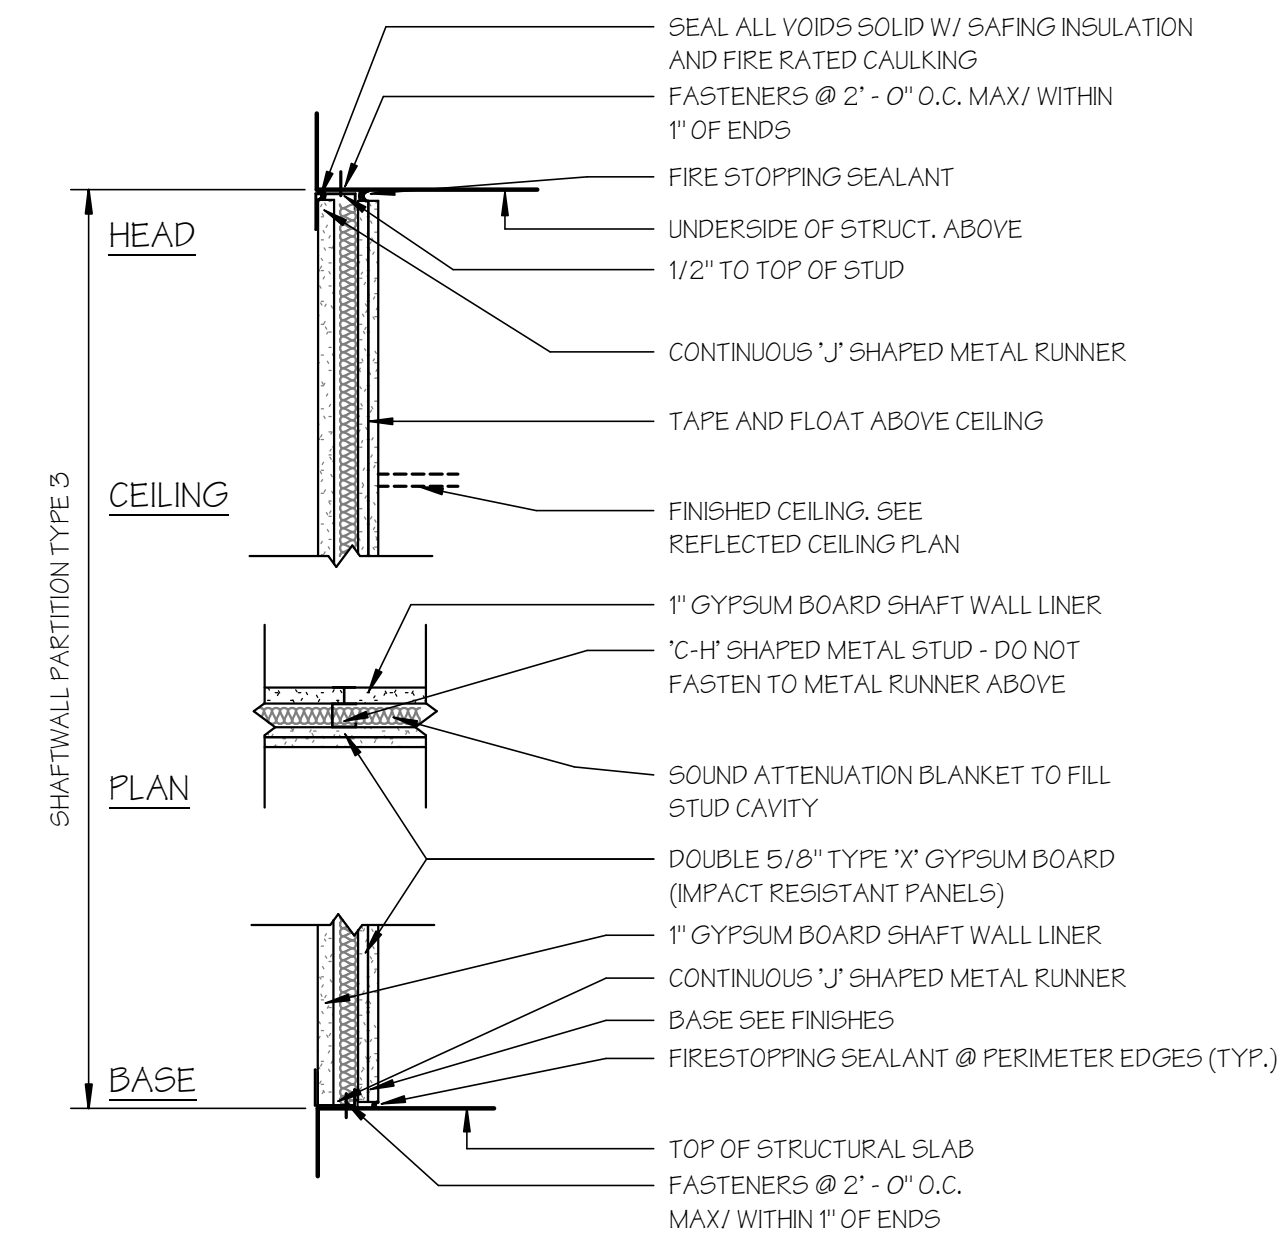

**PARTITION TYPE 3**

SHAFT WALL PARTITIONS						
TYPE	STUD	TOTAL WIDTH	FIRE RATING	UL #	STC	COMMENTS
3	2-1/2"	3 3/4"	2HR.	U415.B		(2) LAYERS TYPE "X" FIRE CODE GYP. BD. + (1) LAYER 1" GYP. BD. SHAFT LINER ON 2-1/2" 20 GA. C-H METAL STUDS @ 24" O.C.

**PARTITION TYPE GENERAL NOTES**

- ALL PARTITIONS TO EXTEND TO BOTTOM STRUCTURE ABOVE U.O.N.
- PARTITIONS THAT INTERSECT BEAMS, JOIST, ETC. SHALL BE CUT FIT AROUND SUCH OBSTRUCTIONS. PROVIDE ADDITIONAL BLOCKING FURRING, ETC. AS REQUIRED. ALL VOIDS SHALL BE SEALED WITH SAFING INSULATION & SEALANT SO AS TO MAINTAIN AN UNINTERRUPTED SMOKE BARRIER.
- AT STUD PARTITION USE 2" DEEP SLIP TRACK TO ALLOW FOR PARTITION DEFLECTION - DO NOT FASTEN TOP OF STUD TO SLIP TRACK.
- REFER TO SHEET CODE-1 FOR EXTENT OF SMOKE RESISTANT PARTITION CONSTRUCTION. ALL VOIDS AND PENETRATIONS THROUGH SMOKE RESISTANT PARTITIONS SHALL BE SEALED SMOKE TIGHT.
- ALL MASONRY PARTITIONS NOT DENOTED WITH A PARTITION TYPE, SHALL BE TYPE 1, U.O.N.
- ALL SHADED PARTITIONS NOT DENOTED WITH A PARTITION TYPE, SHALL BE TYPE 2, U.O.N.
- FOR PARTITIONS THAT ARE PARALLEL TO METAL DECK FLUTES, FILL CONTINUOUS FLUTE CAVITY WITH SOUND ATTENUATION BLANKETS. FOR PARTITIONS THAT ARE PERPENDICULAR TO METAL DECK FLUTES, USE NEOPRENE DECK CLOSURES FOR THE ENTIRE LENGTH OF PARTITION.
- REFER TO SPEC. SECTION 092100 FOR PROPER STUD GAUGE FOR ALL NON-STRUCTURAL METAL STUDS. STRUCTURAL OR COLD-ROLLED STEEL STUDS SHALL COMPLY WITH SPEC. SECTION 054000 AND AS ILLUSTRATED ON STRUCTURAL DRAWINGS.
- PROVIDE FIRESTOPPING AT ALL PENETRATIONS THRU RATED ASSEMBLIES PER THE PROJECT MANUAL.
- BUTT JOIN & ALIGN VERTICAL JOINTS BETWEEN CORRUGATED METAL PANELS WITH 1/8" GAP AND FRAME WITH DOUBLE C-CHANNEL STUDS MOUNTED WEB TO WEB.
- SEE FINISH PLAN & INTERIOR ELEVATIONS FOR WALL COVERINGS & MOLDINGS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Newark, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

**BID SET**  
JANUARY 2020  
04.16.2020 - CM BID  
NOT FOR CONSTRUCTION

REVISIONS		
NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

**JOEL SMILOW CARE CENTER**  
**BRIDGEPORT RESCUE MISSION**  
**PHASE II: INTERIOR RENOVATIONS**  
**& NEW CONSTRUCTION**  
**725 PARK AVENUE**  
**BRIDGEPORT, CONNECTICUT**

DRAWING TITLE:  
PARTITION TYPES

SCALE: As indicated  
DRAWN BY: KWG  
REVIEWED BY: DCF

DRAWING NO.:

**INFO-2**  
04.16.2020 - CM BID

DATE: 31 JANUARY 2020  
JOB NUMBER: 18052





ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS


GENERAL CODE NOTES

A. PERIMETER OF ALL STAIRS SHALL BE ENCLOSED BY 2 HOUR FIRE SEPARATION WITH 90 MINUTE FIRE CODE DOORS (TYP.)


**CODE LEGEND**

- AREA IN SQUARE FEET
- ROOM OCCUPANCY LOAD
- OCCUPANCY LOAD FACTOR
- ACTUAL EGRESS OCCUPANCY OF DOOR, STAIR OR CORRIDOR
- EXIT CAPACITY
- MAXIMUM ALLOWABLE EGRESS OCCUPANCY OF DOOR, STAIR OR CORRIDOR
- DIRECTION OF TRAVEL WITH ACCUMULATED OCCUPANCY LOAD
- MAXIMUM TRAVEL DISTANCE FROM FURTHEST POINT
- ACCESSIBLE AREA OR EXIT
- FLUSH FLOOR CONDITION
- ONE HOUR FIRE RATED WALL (TIGHT TO DECK)
- TWO HOUR FIRE RATED WALL (TIGHT TO DECK)
- SMOKE RESISTANT CONSTRUCTION
- SMOKE BARRIER (30 MIN.)

NOTE: KNOXBOX LOCATION SHOWN ON FIRST FLOOR CODE PLAN

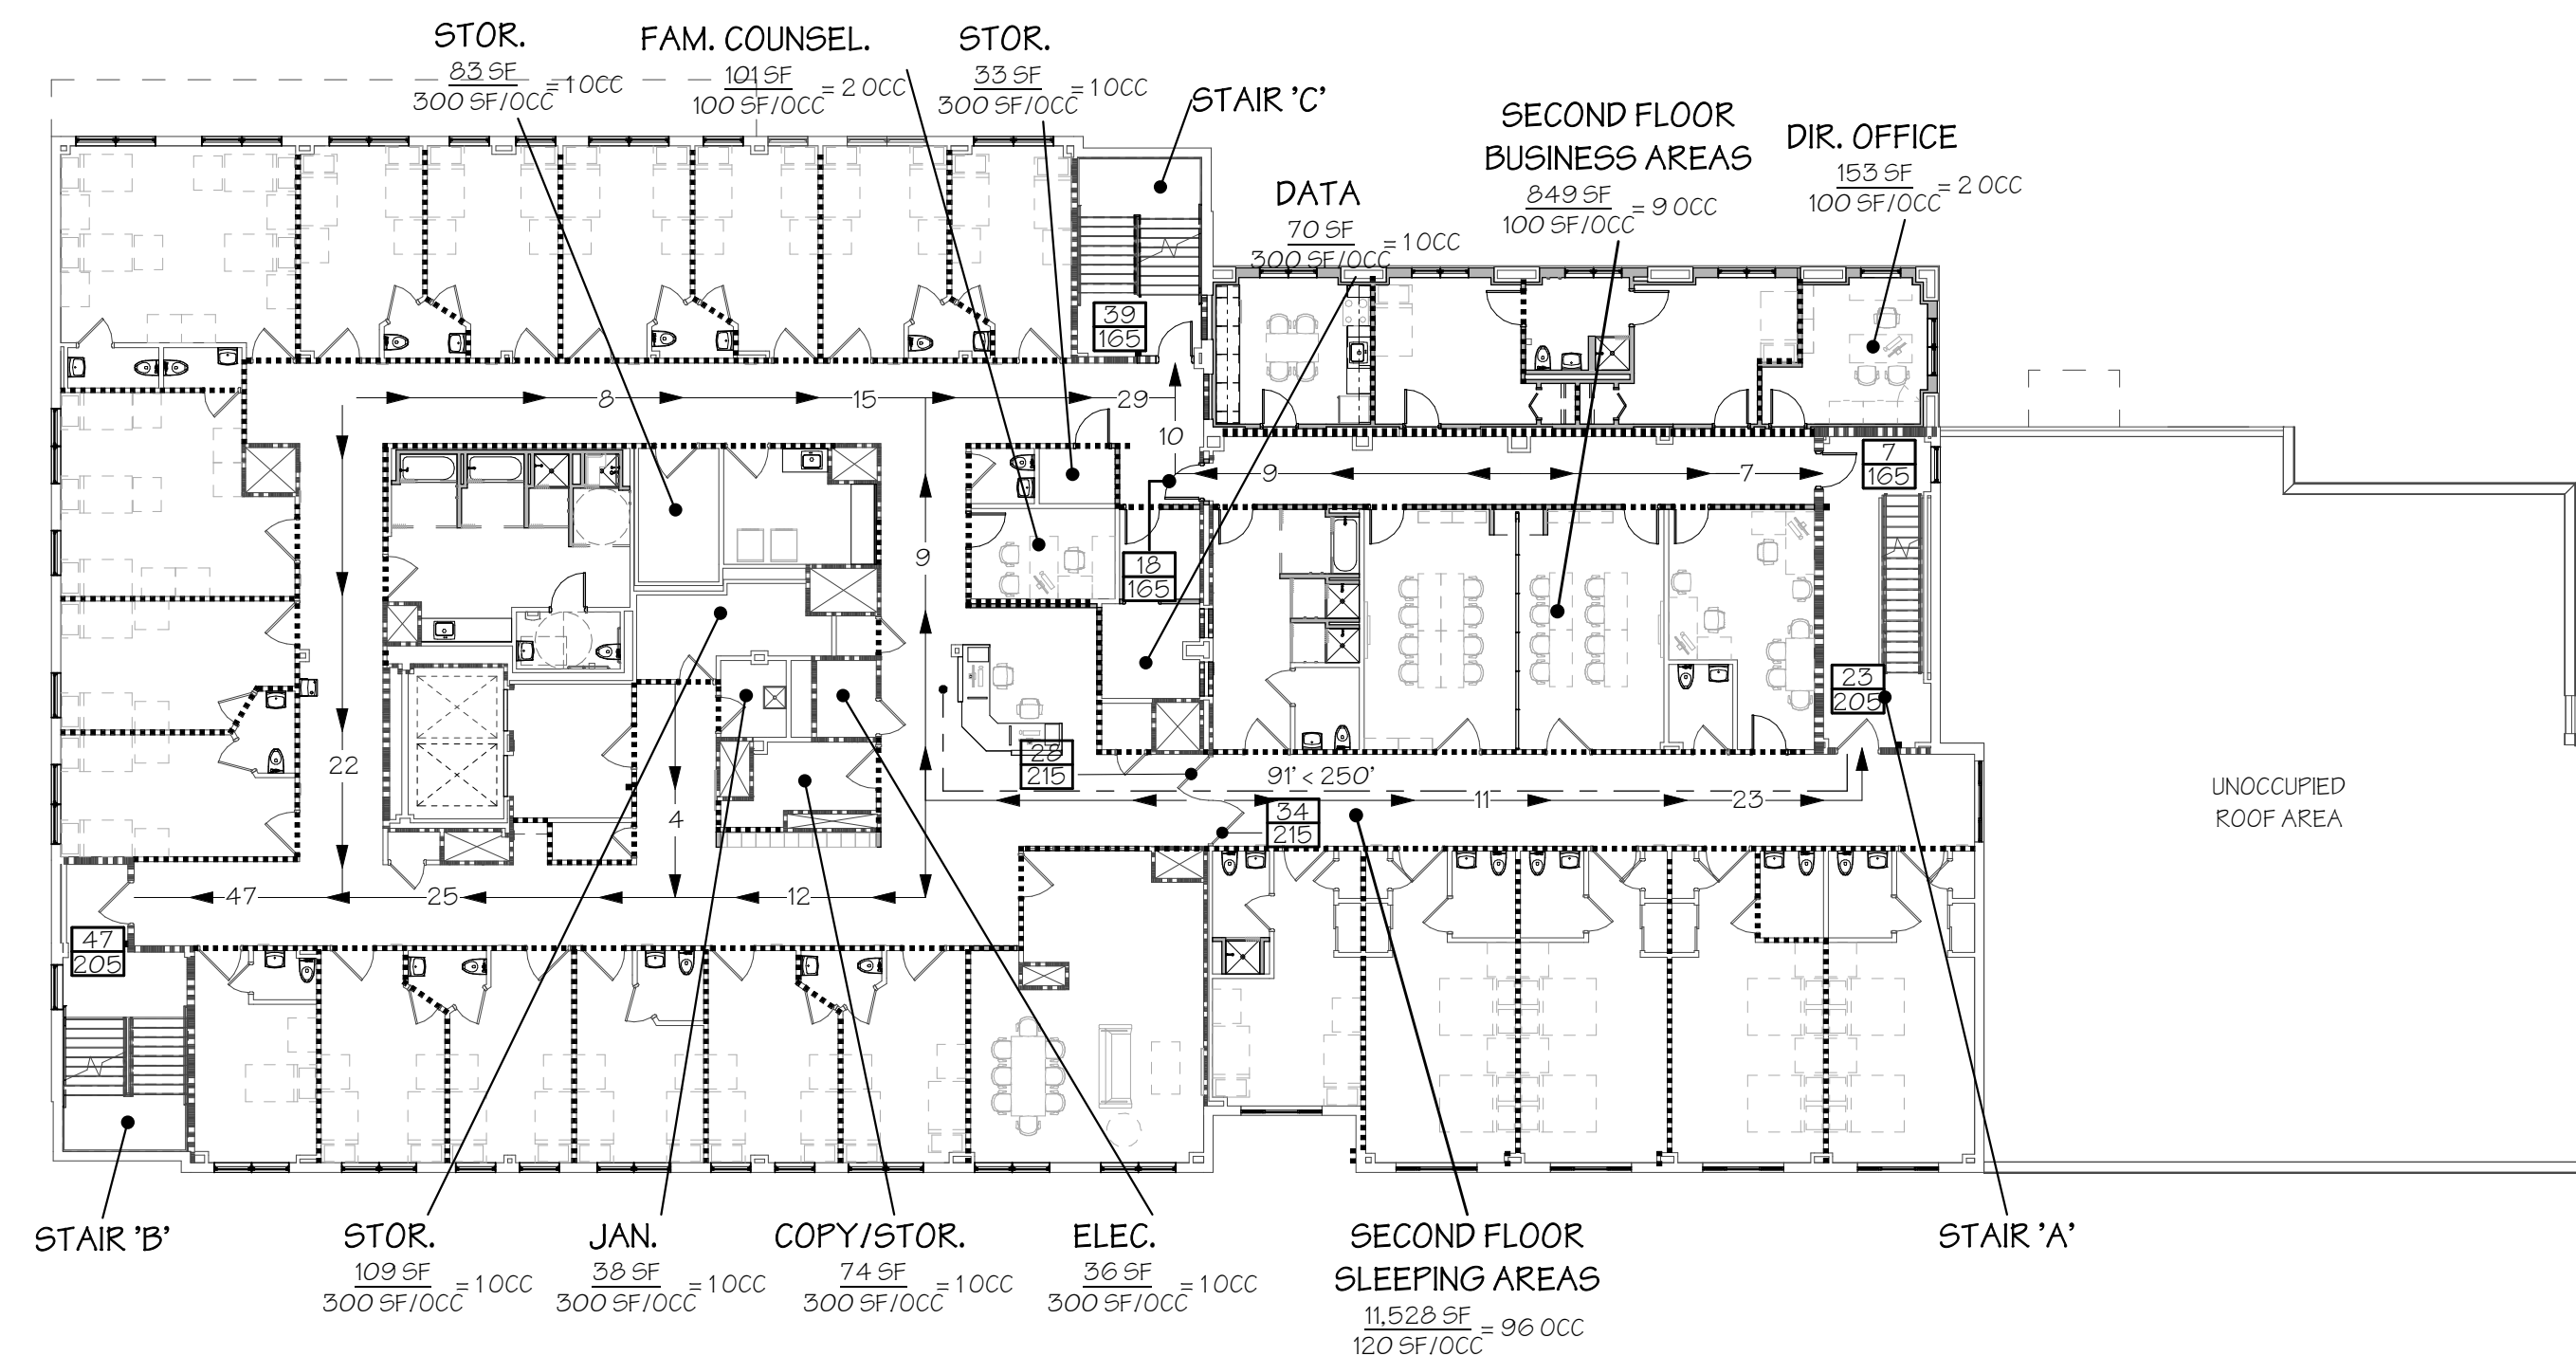

SECOND FLOOR OCCUPANCY & EGRESS PLAN **PHASE 2 WORK**  
SCALE: 1/16" = 1'-0"

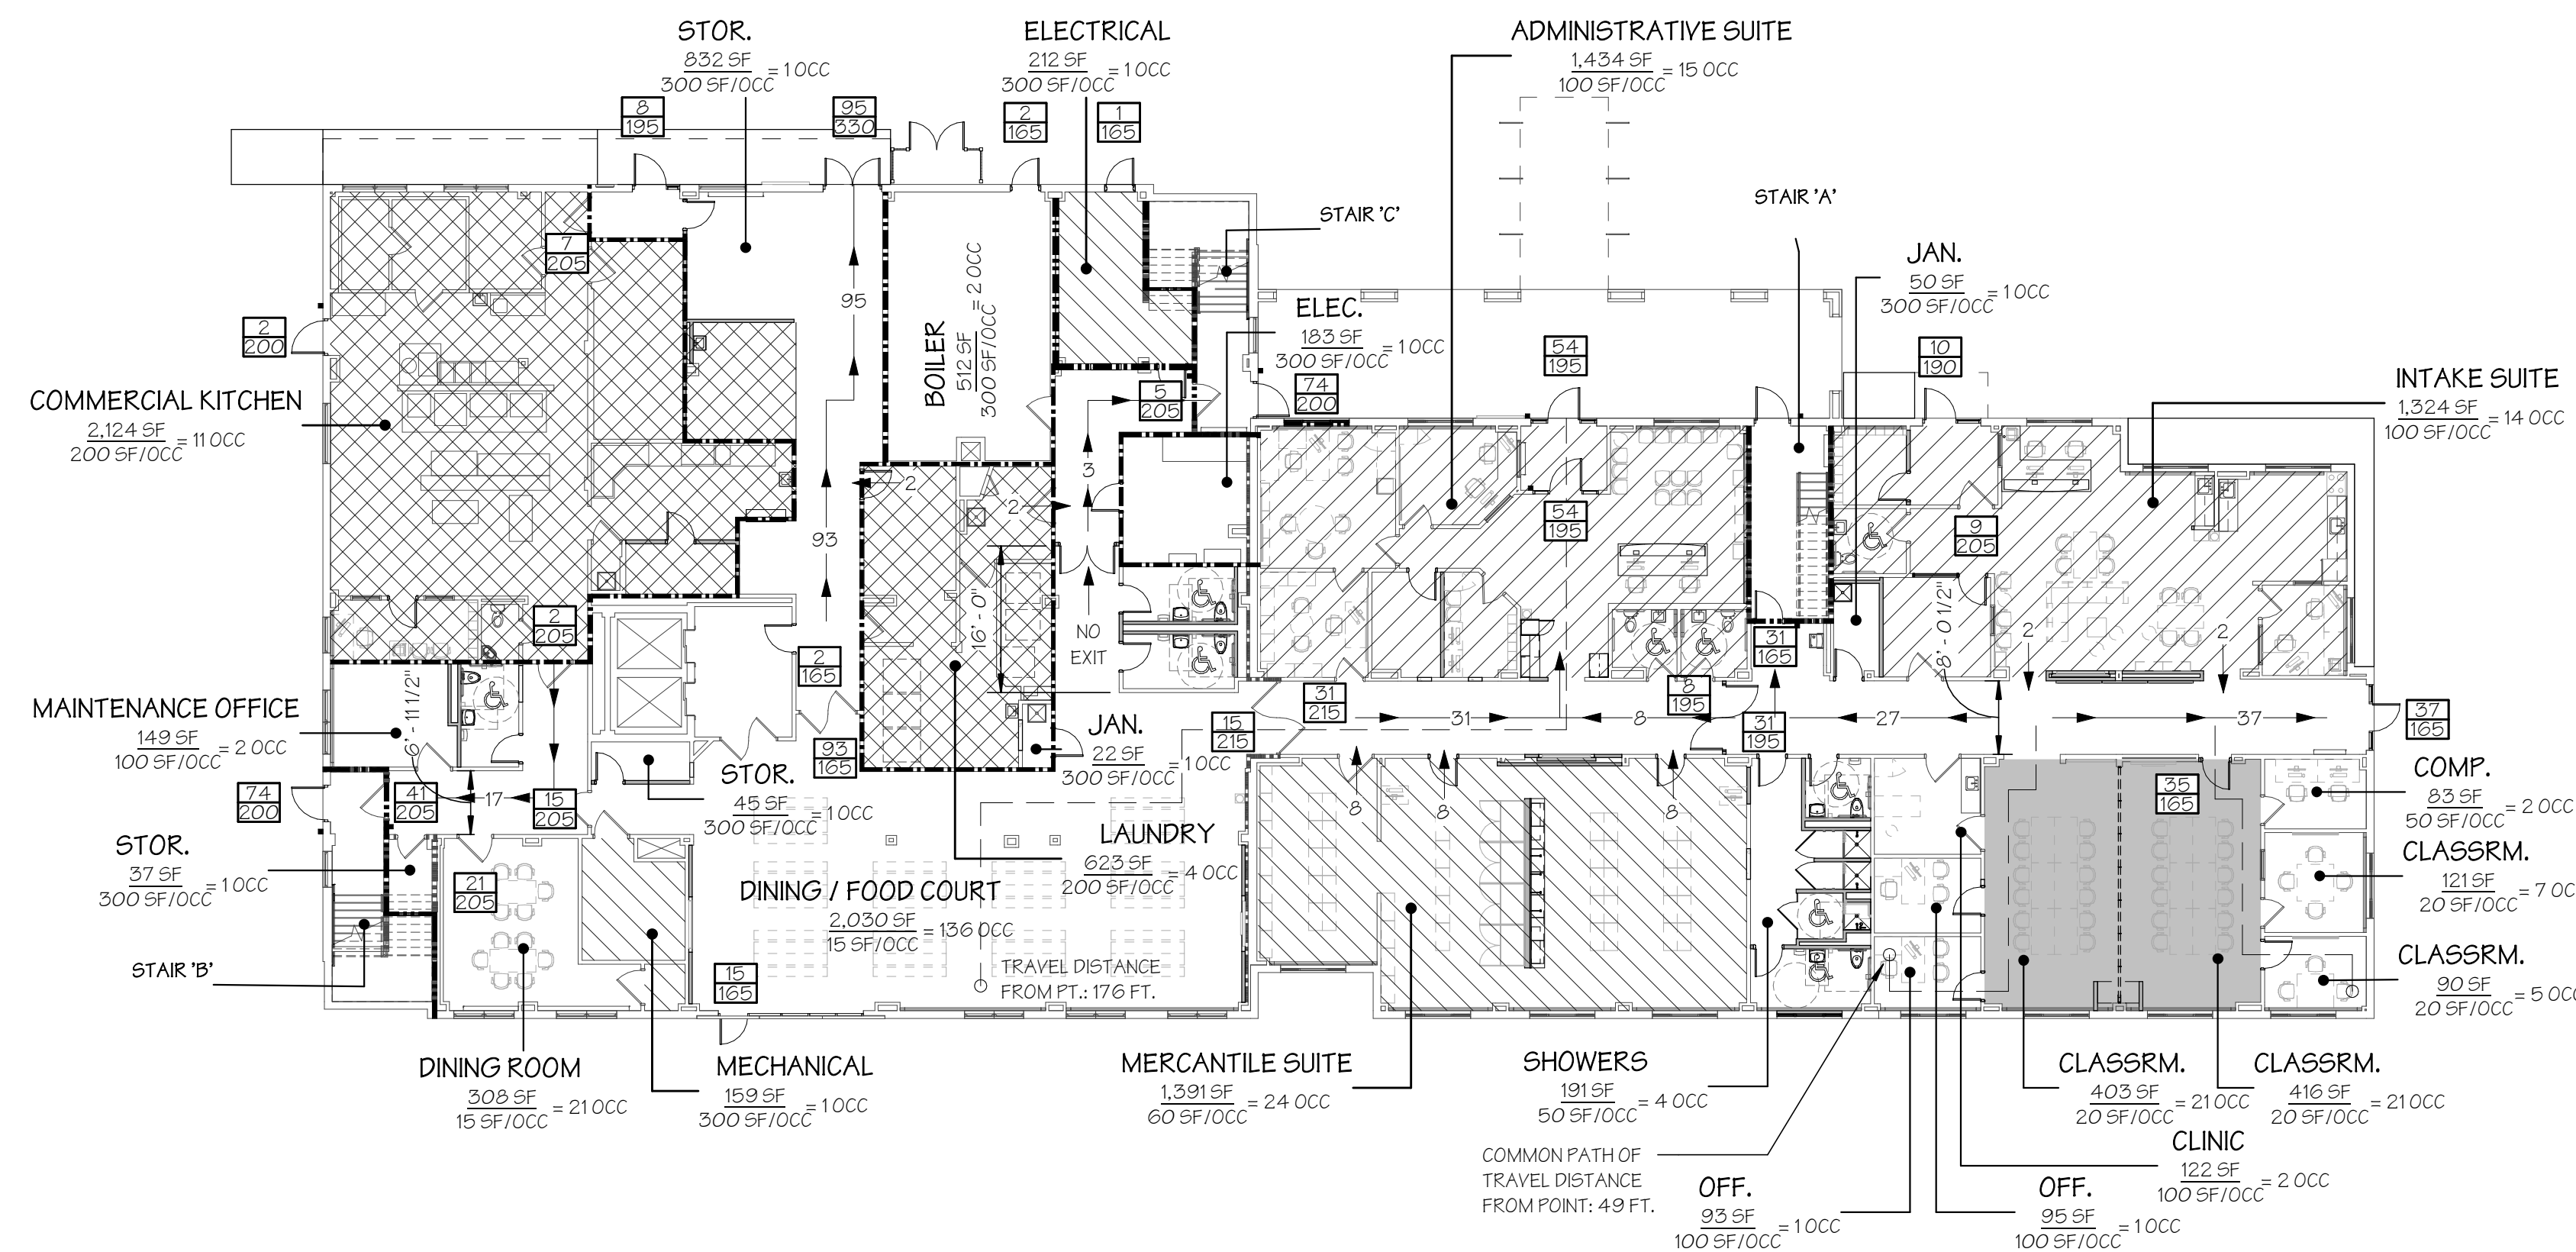

1 FIRST FLOOR OCCUPANCY & EGRESS PLAN **NOT IN CONTRACT - PHASE I INSTALLED WORK - FOR INFO ONLY**  
SCALE: 1/16" = 1'-0"

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:

**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
04.16.2020 - CM BID

REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
CODE OCCUPANCY & EGRESS PLANS

SCALE: As indicated  
DRAWN BY: RR  
REVIEWED BY: DCF/MM  
DRAWING NO.

**CODE-2**  
04.16.2020 - CM BID

DATE: 31 JANUARY 2020  
JOB NUMBER: 18052

GENERAL CODE NOTES

A. PERIMETER OF ALL STAIRS SHALL BE ENCLOSED BY 2 HOUR FIRE SEPARATION WITH 90 MINUTE FIRE CODE DOORS (TYP.)



ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:



REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
CODE OCCUPANCY & EGRESS PLAN

SCALE: As indicated DRAWN BY: RR REVIEWED BY: DCF/MM


DRAWING NO.

**CODE-3**  
04.16.2020 - CM BID


DATE: 31 JANUARY 2020 JOB NUMBER: 18052

**CODE LEGEND**


XX SF	AREA IN SQUARE FEET	XX' < XXX'	MAXIMUM TRAVEL DISTANCE FROM FURTHEST POINT
XX OCC	ROOM OCCUPANCY LOAD	♿	ACCESSIBLE AREA OR EXIT
XX	OCCUPANCY LOAD FACTOR	—●—●—	FLUSH FLOOR CONDITION
XX/XXX	ACTUAL EGRESS OCCUPANCY OF DOOR, STAIR OR CORRIDOR	—■■—■■—	ONE HOUR FIRE RATED WALL (TIGHT TO DECK)
XX/XXX	EXIT CAPACITY	—■■■■■■—	TWO HOUR FIRE RATED WALL (TIGHT TO DECK)
XX/XXX	MAXIMUM ALLOWABLE EGRESS OCCUPANCY OF DOOR, STAIR OR CORRIDOR	—■■■■■■—	SMOKE RESISTANT CONSTRUCTION
XX	DIRECTION OF TRAVEL WITH ACCUMULATED OCCUPANCY LOAD	⋯⋯⋯	SMOKE BARRIER (30 MIN)

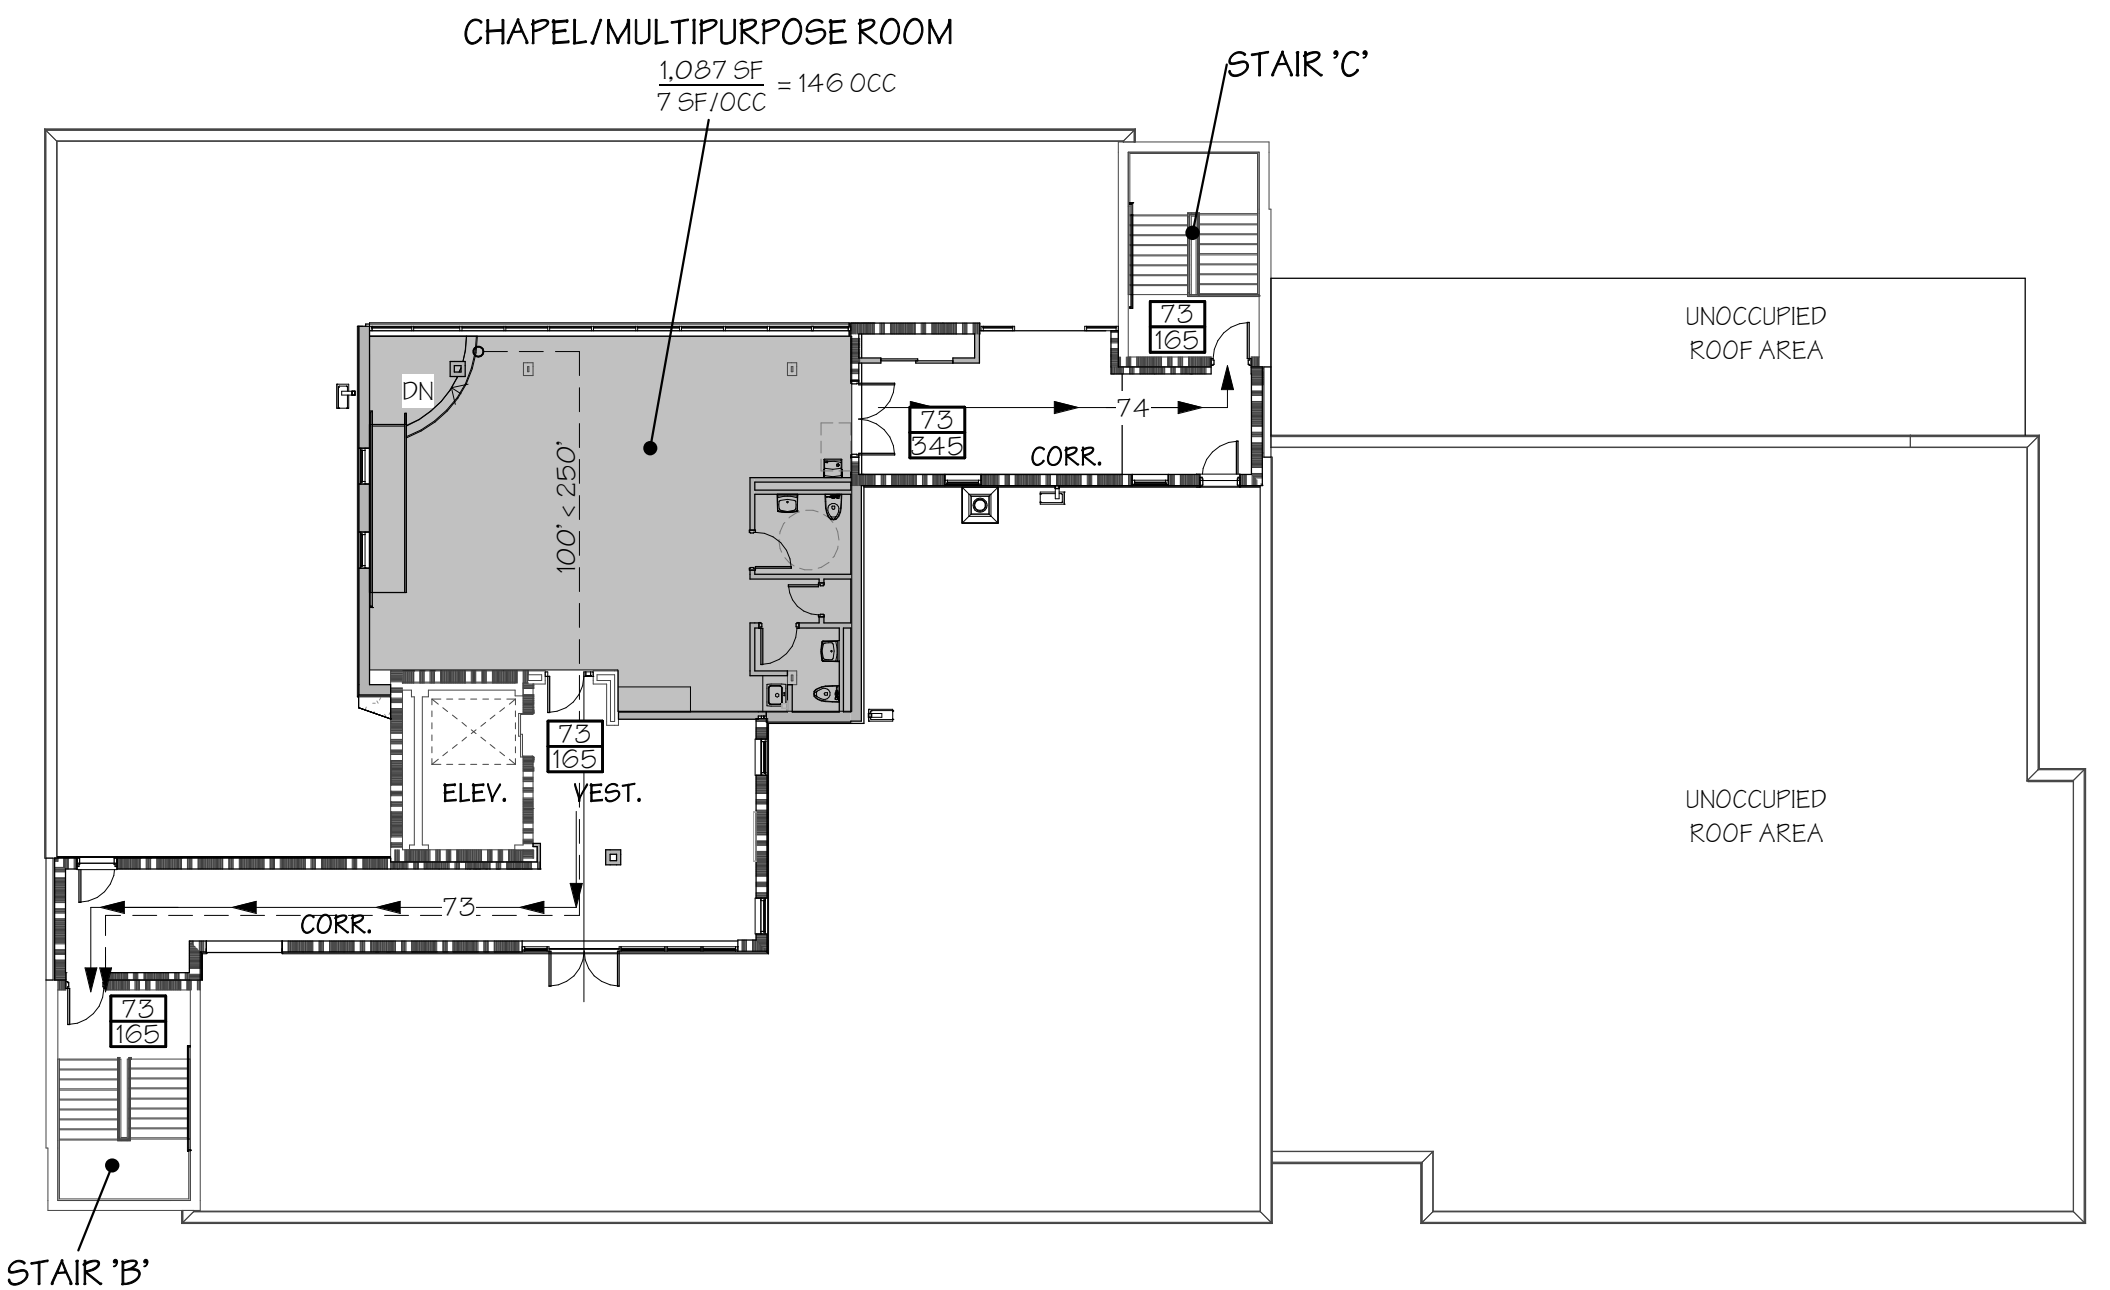

FIFTH FLOOR OCCUPANCY & EGRESS PLAN PHASE 2 WORK  
SCALE: 1/16" = 1'-0"

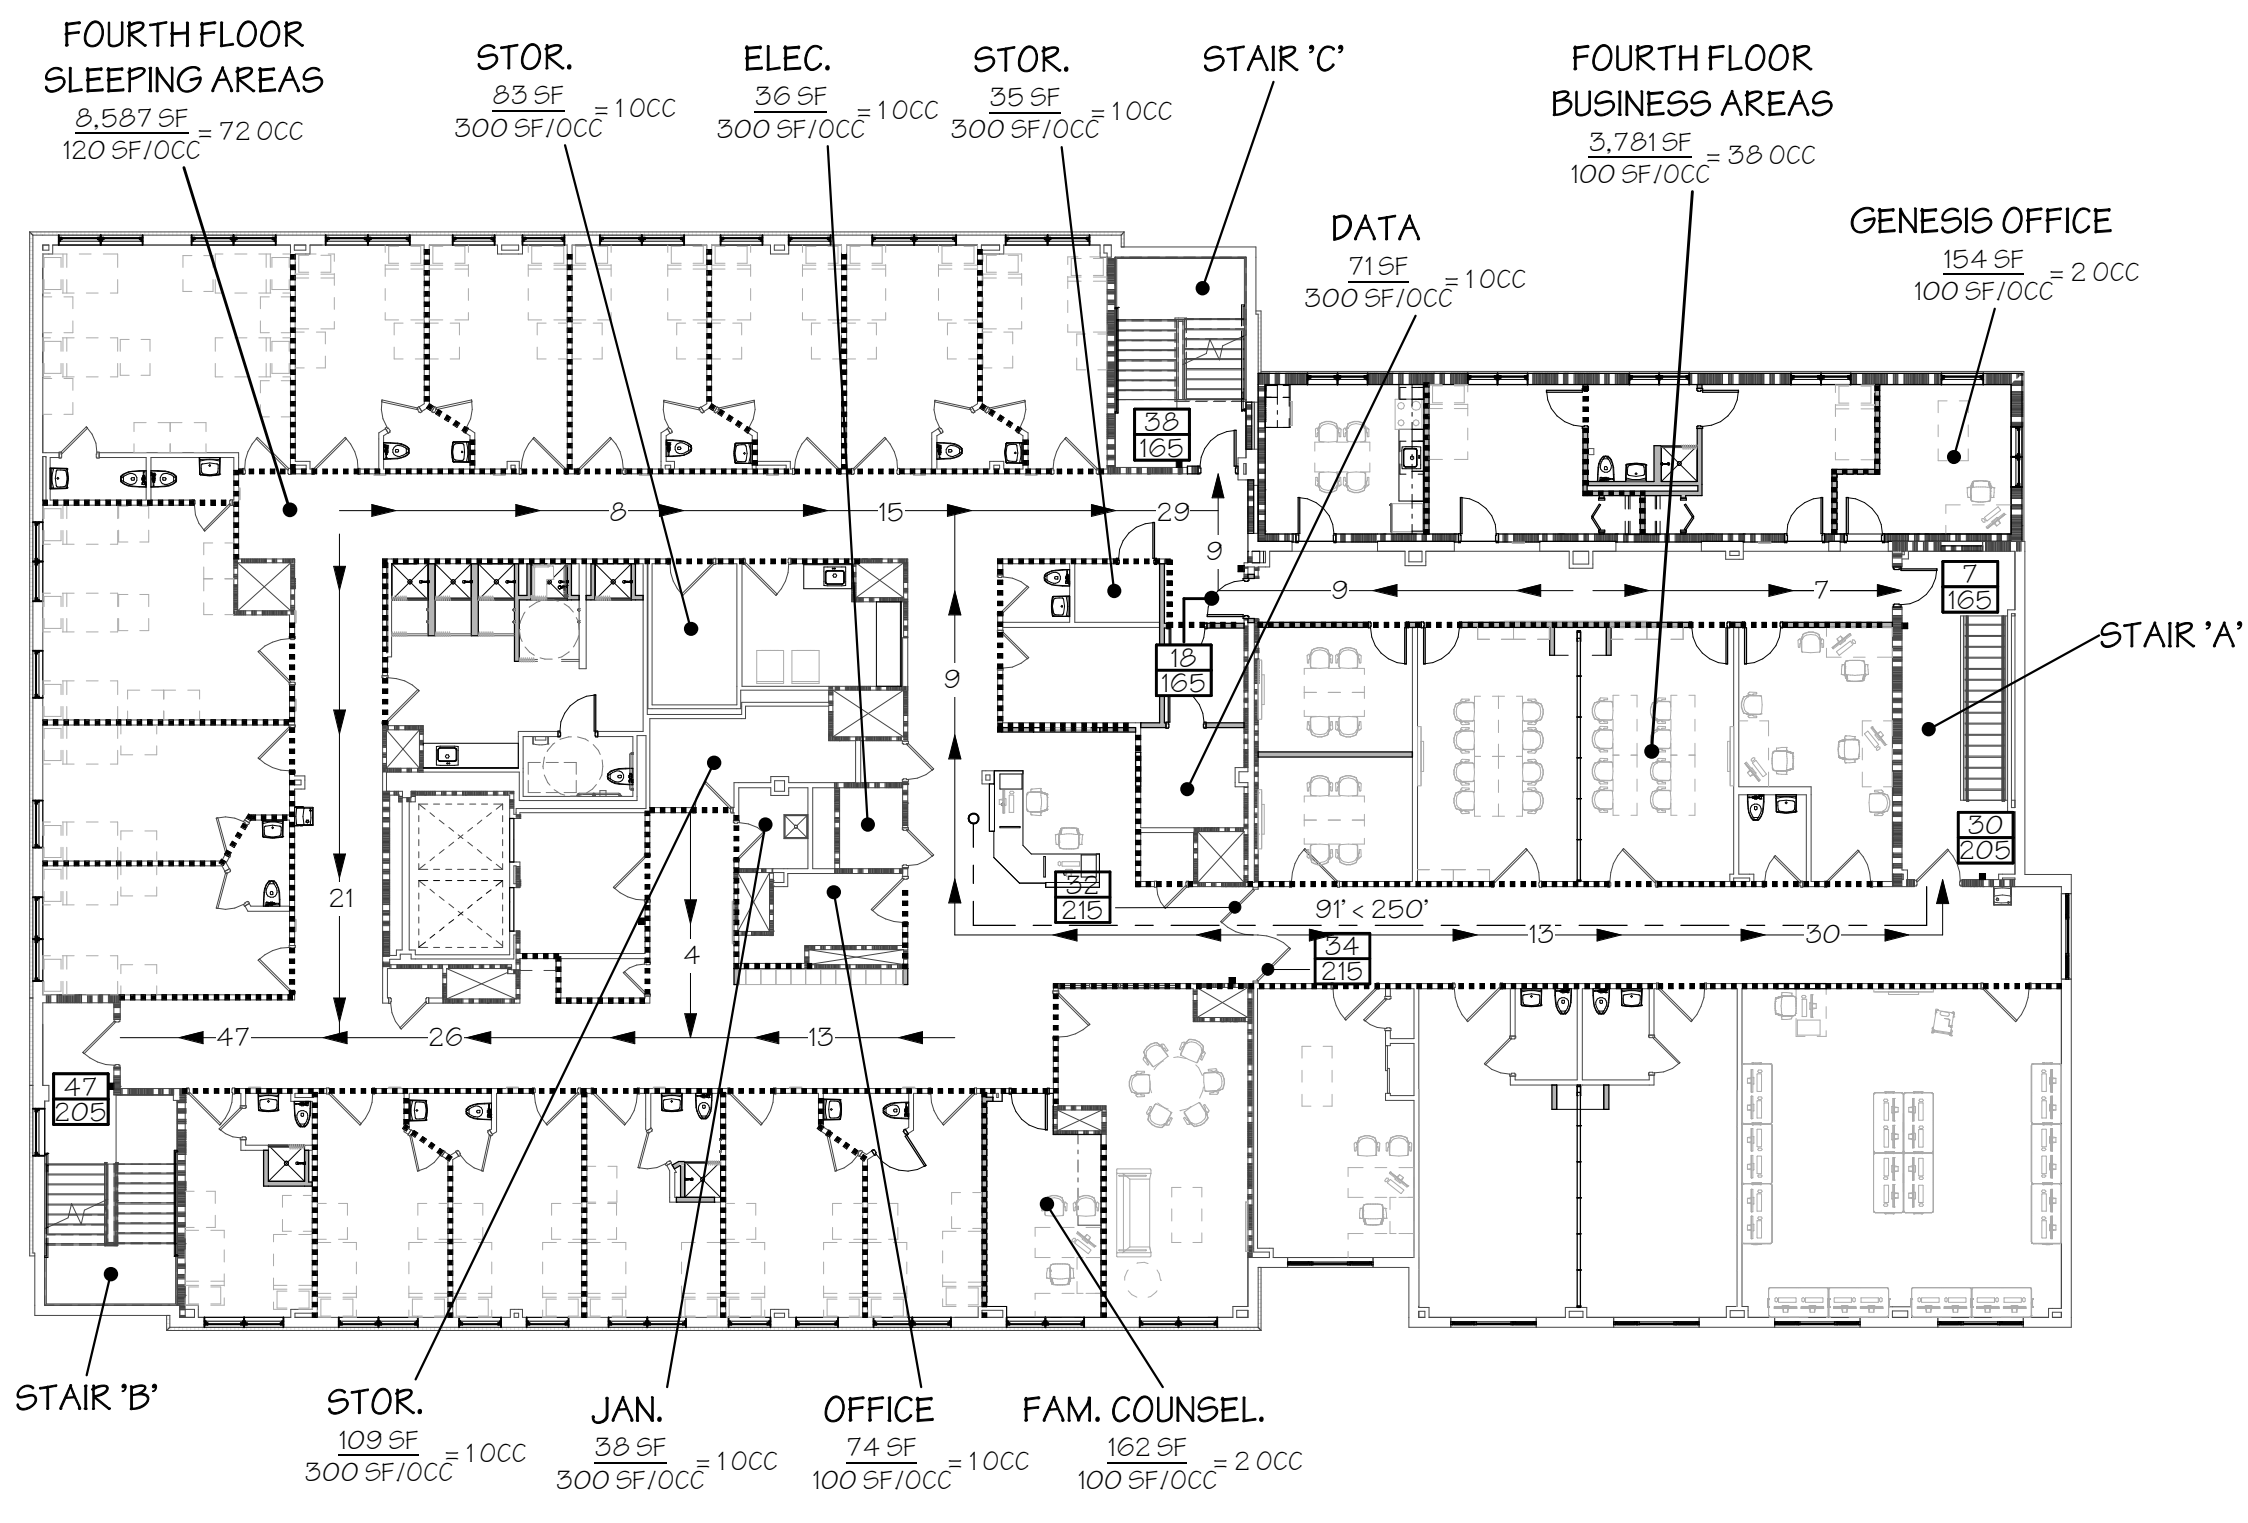

FOURTH FLOOR OCCUPANCY & EGRESS PLAN PHASE 2 WORK  
SCALE: 1/16" = 1'-0"

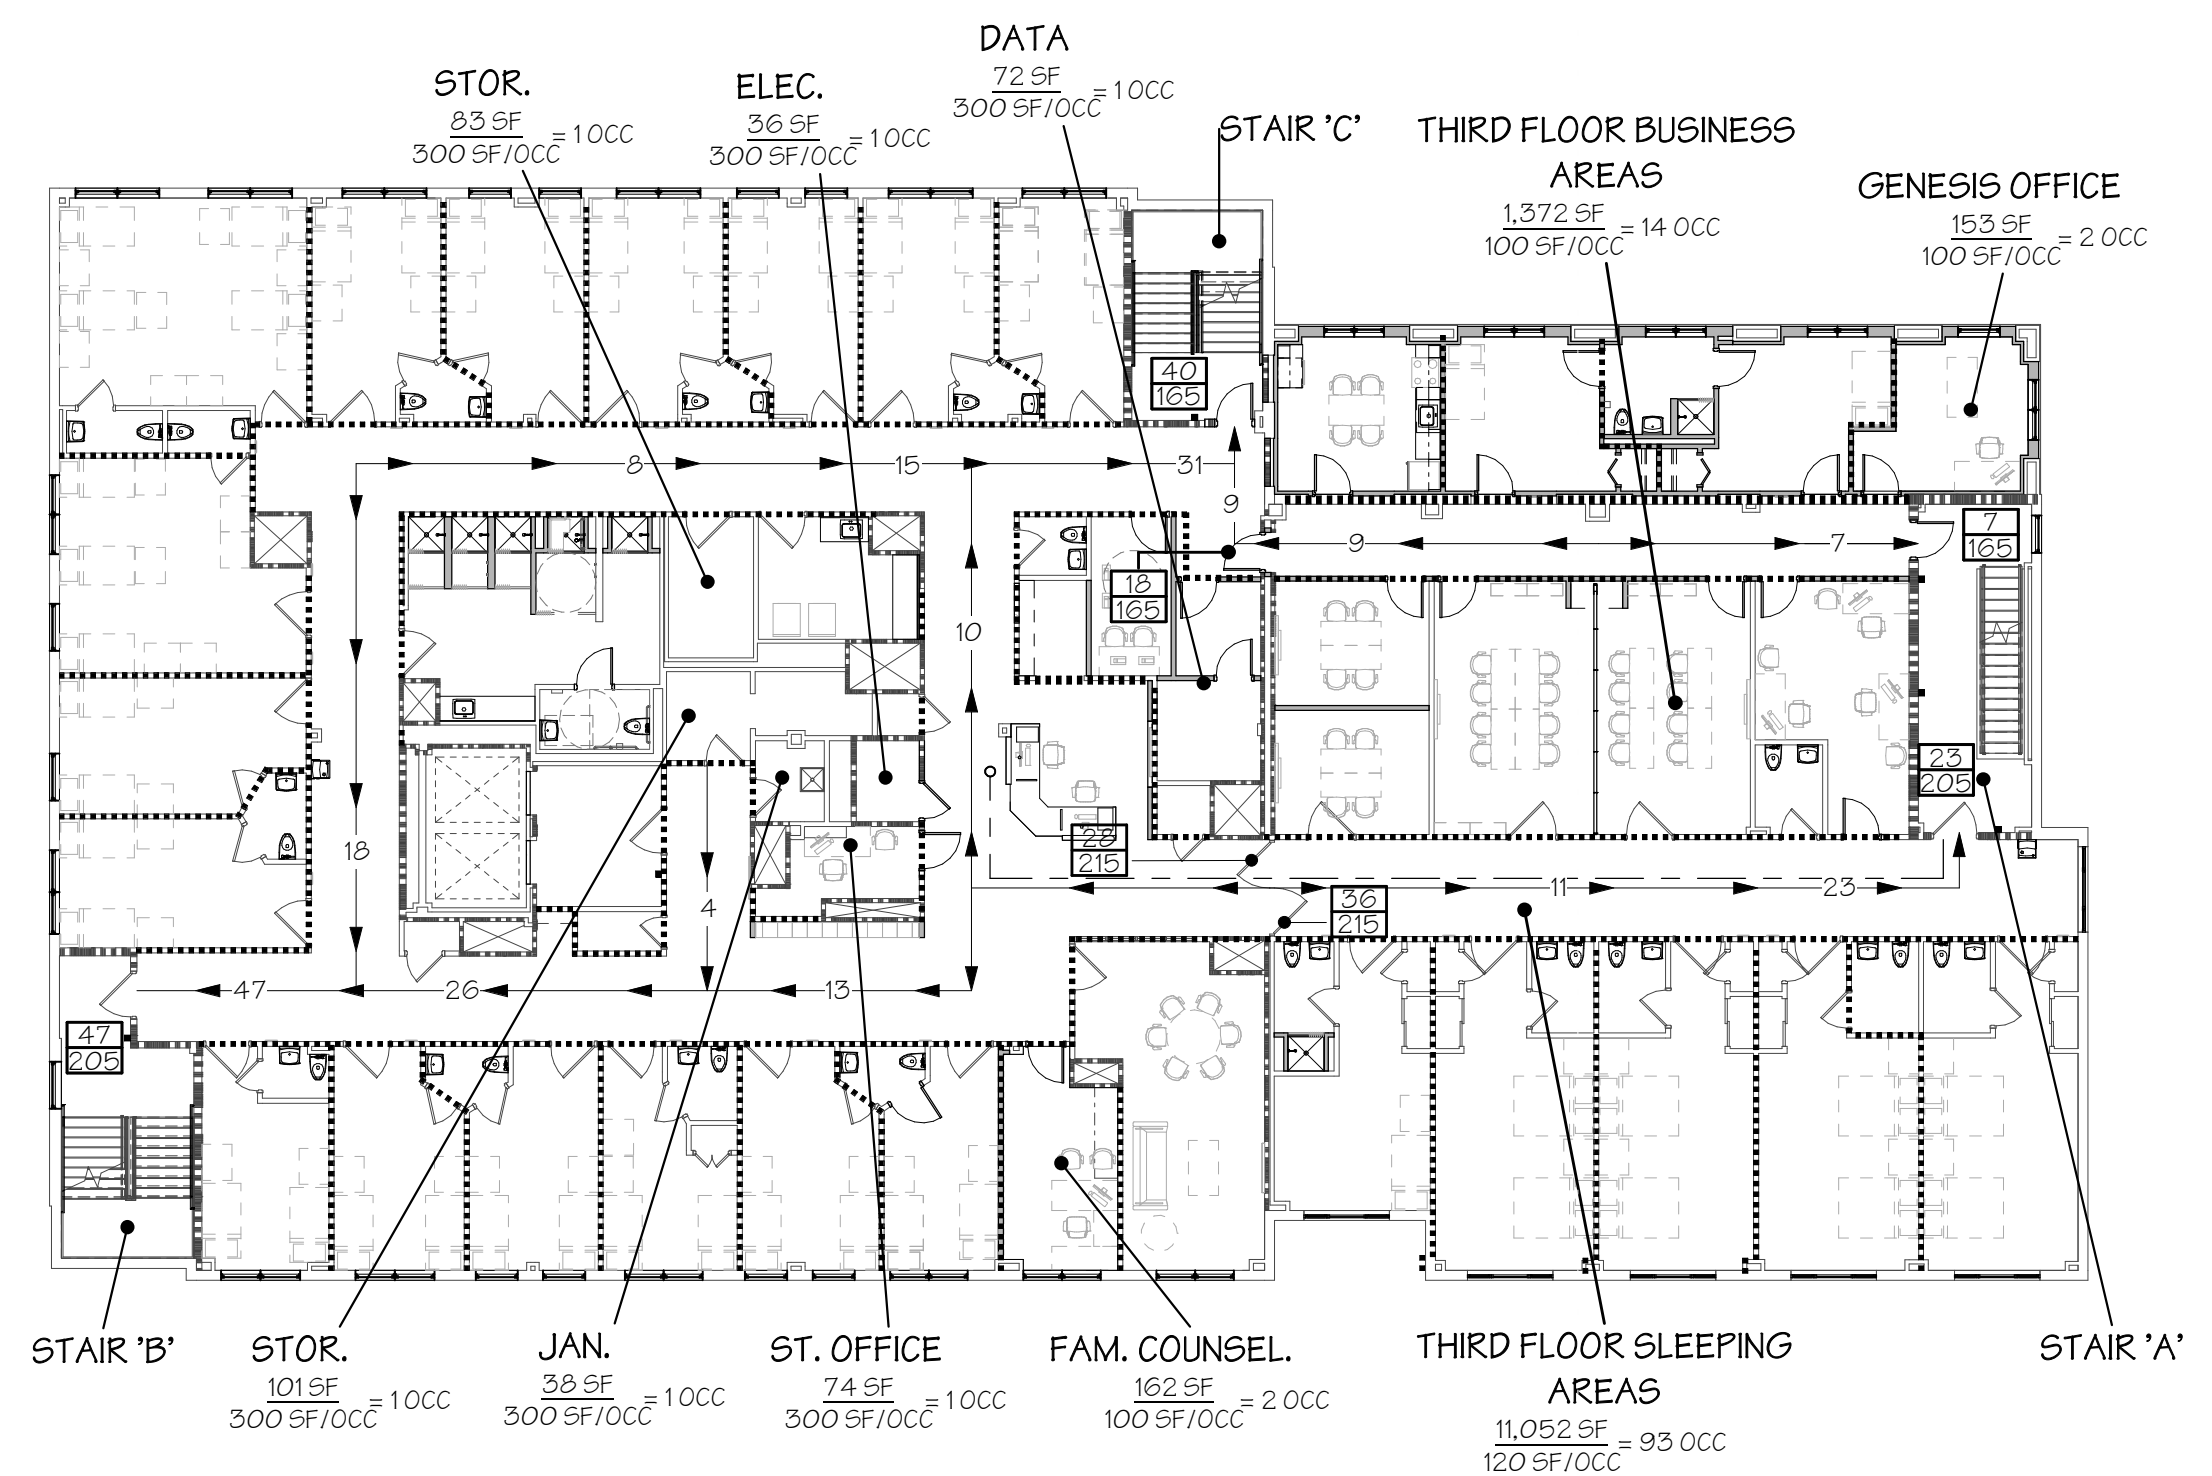

THIRD FLOOR OCCUPANCY & EGRESS PLAN PHASE 2 WORK  
SCALE: 1/16" = 1'-0"

2/27/2020 1:07:48 PM C:\Users\rosenthan\OneDrive\Documents\Rescue Mission\_Phase 2\_Architecture\_rosehan.rvt



**ANTINOZZI ASSOCIATES**  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:



REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

**JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION**  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
SECOND FLOOR DEMOLITION PLAN

SCALE: As indicated DRAWN BY: KWG REVIEWED BY: DCF

DRAWING NO.

**D-102**

DATE: 31 JANUARY 2020 JOB NUMBER: 18052

**GENERAL DEMOLITION NOTES**


- A. THESE NOTES ARE FOR INTENT PURPOSES ONLY. CONTRACTOR TO BE RESPONSIBLE FOR REMOVING ALL QUANTITIES OF ALL ITEMS AS REQUIRED TO COMPLETE THIS PROJECT AS SHOWN ON THE CONSTRUCTION DOCUMENTS.
- B. COORDINATE ALL DEMOLITION WITH ARCHITECTURAL, STRUCTURAL, MECHANICAL, PLUMBING & ELECTRICAL CONSTRUCTION. COORDINATE ALL CUTTING AND PATCHING WITH NEW WORK.
- C. ALL CUTTING, PATCHING & DEMOLITION REQUIRED BY ALL TRADES FOR THIS PROJECT IN NEW AND EXISTING AREAS SHALL BE PERFORMED BY THE CONTRACTOR.
- D. REMOVE ALL WALLS INCLUDING FINISH AND BRACING AS SHOWN DASHED - REQUIRED FOR NEW CONSTRUCTION - COORDINATE WITH NEW FLOOR PLANS AND STRUCTURAL DRAWINGS. REFER TO HAZARD DRAWINGS FOR ADDITIONAL ABATEMENT INFORMATION.
- E. DISCONNECT OR DISABLE ALL AFFECTED UTILITIES PRIOR TO COMMENCING WORK. ALL ABANDONED UTILITY LINES (PLUMBING, ELECTRICAL, DATA, ALARM) SHALL BE CUT & CAPPED BELOW FLOOR LINE OR BEHIND WALL LINE. FLOOR OR WALL SHALL BE FINISHED TO MATCH EXISTING ADJACENT SURFACES.
- F. COORDINATE ALL DEMOLITION WORK SHOWN ON THESE DRAWINGS WITH ASBESTOS, LEAD, & PCB ABATEMENT DRAWINGS. CERTAIN PLUMBING CHASES, WINDOWS, CEILING, ETC., MAY REQUIRE REMOVAL UNDER ACM, LEAD, OR PCB CONTAINMENT CONDITIONS. ALL WORK SHOWN ON ENVIRONMENTAL MUST BE COMPLETED IN COMPLIANCE WITH ALL APPLICABLE REGULATIONS OUTLINED IN ALL APPLICABLE SPECIFICATION.
- G. REMOVE ALL WOOD HANDRAILS AND ALL WALL COVERINGS IN CORRIDORS (TYP.)
- H. REMOVE FLOOR FINISHES INCLUDING UNDERLAYMENTS AND ADHESIVES DOWN TO CLEAN SUBSTRATE IN ALL ROOMS WHERE NEW FLOOR FINISHES ARE TO BE APPLIED - COORDINATE WITH FINISH FLOOR PLANS.
- I. REMOVE ALL EXISTING INTERIOR LIGHTING FIXTURES WITHIN THE SCOPE OF WORK AREA (FLOOR 2-5) TO BE REPLACED WITH NEW L.E.D. FIXTURES ON A 1 TO 1 BASIS - COORDINATE WITH ELECTRICAL ENGINEERING DRAWINGS.
- J. REMOVE ALL EXISTING EXTERIOR WALL & SITE MOUNTED LIGHT FIXTURES TO BE REPLACED BY NEW L.E.D. FIXTURES ON A 1 TO 1 BASIS - COORDINATE WITH ELECTRICAL ENGINEERING DRAWINGS.
- K. ALL WORK ON DEMOLITION PLAN SHOWN DASHED IS TO BE REMOVED IN ITS ENTIRETY, UNLESS OTHERWISE NOTED. SURFACES ARE TO BE REPAIRED, PATCHED AND MATCHED AS REQUIRED TO SUIT INSTALLATION OF NEW WORK TYPICAL.
- L. ANY EXISTING ITEMS THAT ARE NOT TO REMAIN, OR INTERFERING WITH NEW WORK (I.E. COAT HOOKS, WALL PLATES, ECT... ARE TO BE REMOVED PATCH AND MATCH AS REQUIRED.
- M. SEE DRAWING D-102.A FOR TYPICAL WORK IN ALL RESIDENT ROOMS.

**DEMOLITION NOTES**

- 1 REMOVE EXISTING DOOR, FRAME & HARDWARE. PREP OPENING FOR NEW WORK AS REQUIRED.
- 2 DISCONNECT & REMOVE EXISTING PLUMBING FIXTURES - SEE PLUMBING DRAWINGS FOR DEMOLITION NOTES.
- 3 REMOVE EXISTING MECHANICAL & PLUMBING EQUIPMENT INCLUDING, BUT NOT LIMITED TO: EXISTING VENTILATOR UNIT, FIN TUBE, EXHAUST, PIPING COVER, DUCTWORK, LEADERS AND ANY OTHER MECHANICAL & PLUMBING EQUIPMENT AS REQUIRED - COORDINATE WITH MECHANICAL & PLUMBING DRAWINGS.
- 4 REMOVE ALL EXISTING TOILET ROOM ACCESSORIES INCLUDING BUT NOT LIMITED TO GRAB BARS, DISPENSERS, MIRRORS AND CALL TO AID ALARM.
- 5 REMOVE PORTION OF EXISTING MASONRY WALL AS REQUIRED FOR NEW CONSTRUCTION - COORDINATE WITH NEW FLOOR PLANS AND STRUCTURAL DRAWINGS.
- 6 REMOVE PORTION OF INTERIOR PARTITION AS REQUIRED FOR NEW CONSTRUCTION - PATCH AND REPAIR EXISTING TO REMAIN - COORDINATE WITH NEW WORK.
- 7 REMOVE GUARDRAIL/HANDRAIL INCLUDING ALL ASSOCIATED HARDWARE & PATCH EXISTING TO REMAIN WHERE DAMAGE OCCURS
- 8 REMOVE EXISTING MILLWORK/CASEWORK CABINETRY/SHELVING DOORS, LEDGES/CAPS, BLOCKING FASTENERS, ETC
- 9 REMOVE EXISTING WINDOW UNIT IN IT'S ENTIRETY, INCLUDING JAMBS ACCESSORIES, INTERIOR APRONS/SILLS, ETC. REVIEW CONDITION OF EXISTING ROUGH OPENING FRAMING AND NOTIFY OWNER AND ARCHITECT OF ANY DAMAGED. PREP ROUGH OPENING AS REQUIRED TO SUIT INSTALLATION OF NEW WINDOW UNITS.
- 12 REMOVE ALL EXISTING CEILING, U.O.N., INCLUDING BUT NOT LIMITED TO: SOFFITS, ACOUSTICAL CEILING TILES, SUSPENDED GRIDS, GWB AND CEILING PANELS UP TO THE EXISTING ROOF DECK REMOVE ASSOCIATED SUPPORT STRUCTURES ALONG WITH ATTACHED CEILING DEVICES, LIGHT FIXTURES, HVAC DIFFUSERS AND RETURNS. SEE MEP FOR COORDINATION.
- 15 REMOVE DOOR LEAF AND HARDWARE - REPAIR EXISTING FRAME TO REMAIN AS NEEDED
- 16 REMOVE EXISTING WALL MOUNTED HANDRAILS IN STAIRS FROM FIRST FLOOR TO SECOND FLOOR LANDING
- 19 REMOVE PORTION OF KNEE WALL BELOW STOREFRONT GLAZING - COORDINATE WITH NEW CONSTRUCTION PLANS
- 20 REMOVE PORTION OF EXISTING MEMBRANE ROOFING AND INSULATION DOWN TO CLEAN CONCRETE DECKING
- 21 REMOVE PORTION OF EXISTING WALL CAP & COORDINATE WITH NEW CONSTRUCTION
- 22 REMOVE PORTION OF EXTERIOR MASONRY WALL BELOW WINDOW TO BE REMOVED
- 23 REMOVE ALUMINUM STOREFRONT GLAZING & FRAME
- 24 DEMOLISH PORTION OF PROJECTING BRICKWORK SILL
- 25 REMOVE SOFFIT FASCIA PANELS & FRAMING ABOVE OPENING
- 26 REMOVE RAISED CONCRETE SILL OR STEP UNDER DOOR TO BE REMOVED
- 27 REMOVE ALUMINUM STOREFRONT, PANELS AND FURRED WALL BEHIND
- 28 REMOVE WALL MOUNTED HANDRAILS IN STAIRS FROM SECOND FLOOR TO TOP OF STAIRWAY
- 29 EXISTING ROOF OPENING TO BE FILLED IN. INFILL EXISTING ROOF STRUCTURE AS FOLLOWS: PROVIDE STEEL PLATE TO FILL EXISTING OPENING. STEEL PLATE SHALL BE SUPPORTED ON 4 SIDES BY STEEL ANGLES. TACK WELD STEEL PLATE TO NEW SUPPORTING ANGLES. INFILL REMAINING OPENING WITH RIGID INSULATION TO MATCH TOP OF EXISTING ROOF DECK. WHERE OPENINGS ARE LESS THAN 8" SCREW ATTACHED STEEL PLATE TO UNDERSIDE OF EXISTING DECK AND SOLID GROUT FILL TO MATCH EXISTING TOP OF ROOF LEVEL TYPICAL.
- 30 REMOVE EXISTING CHIMNEY TO BELOW EXISTING DECK
- 31 REMOVE EXISTING CEILING TRACKS
- 32 REMOVE ALL WALL MOUNTED FIXTURES, INTERCOM COVER AND WALLPAPER. TYPICAL FOR ALL ROOMS. PREP WALL FOR NEW FINISH. COORDINATE WITH NEW FLOOR PLANS & FINISH PLANS
- 33 REMOVE ALL EXISTING BASEBOARD COVERS TYPICAL
- 34 REMOVE PORTION OF CHAIR RAIL AS NEEDED TO ACCOMMODATE NEW PARTITIONS - COORDINATE WITH NEW FLOOR PLAN
- 35 REMOVE EXISTING INTERIOR WINDOW BLINDS AND SUPPORTS IN THEIR ENTIRETY. PATCH WALLS AS REQUIRED AND PREP FOR INSTALLATION OF NEW WINDOWS SHAPES / BLINDS TYPICAL
- 37 REMOVE EXISTING ELEVATOR CAB AND ALL ASSOCIATED ACCESSORIES AND OR COMPONENTS, INCLUDING BUT NOT LIMITED TO: HOISTWAY DOORS, SILL, LADDER, BUFFER ASSEMBLY, HOISTWAY, AND SILL. PROTECT EXISTING CMU WALLS & FOUNDATION/ELEVATOR PIT TO REMAIN.
- 38 REMOVE PORTION OF EXISTING CEILING AS INDICATED ON PLAN. COORDINATE WITH ARCHITECTURAL & MEP CEILING PLANS.
- 39 REMOVE EXISTING DRINKING FOUNTAINS AND ASSOCIATED PLUMBING LINES WHERE EXIST, U.O.N. TO REMAIN.

**ELEVATOR SHAFTS WORK:**

- 1. Remove all existing work interfering with proposed. Prep as required for installation of new work. Review with Architect any questionable items.
- 2. Field verify all dimensions. Report discrepancies to architect.
- 3. Coordinate all work with Elevator Installer and mfr instructions.
- 4. The elevator shaft extension, which we understand to be on the order of (5) feet high, shall be constructed of 8" CMU reinforced with #5 verticals @ 2'-8" o.c. full height. Vertical bars shall extend 2'-0" into the existing CMU shaft with all new and existing CMU cells filled solid at vertical reinforcing. There shall be a continuous bond beam with 2-#5 all around the periphery of the top of the shaft.
- 5. The roof of the shaft shall be 3" x 16 gage galvanized Type N deep rib metal deck spanning in the 8'-11" direction. Metal deck shall be anchored to a 3/8" x 4" wide plate which shall be anchored to the bond beam in item 1 above with 5/8" diameter x 8" long welded anchors @ 2'-8" o.c. all around the periphery of the shaft.
- 6. At the existing guide rail beams to be relocated, grout two courses x 1'-4" long solid below new beam pocket locations and provide solid brick or grout all around beam pocket. Existing bricked in beam pockets to be abandoned shall be patched with grout.
- 7. At new elevator cab doors to be relocated, provide 2-#5 full height bars at each new jamb and fill solid with grout. At abandoned door locations, provide #5 @ 16" o.c. full height and fill reinforced cells solid with grout. New door lintels shall be (2) L 6 x 3 1/2 x 3/8, long leg vertical, and bear a minimum of 6" onto each jamb.
- 8. All altered masonry openings shall be properly toothed back to maintain the integrity of the existing elevator shaft.

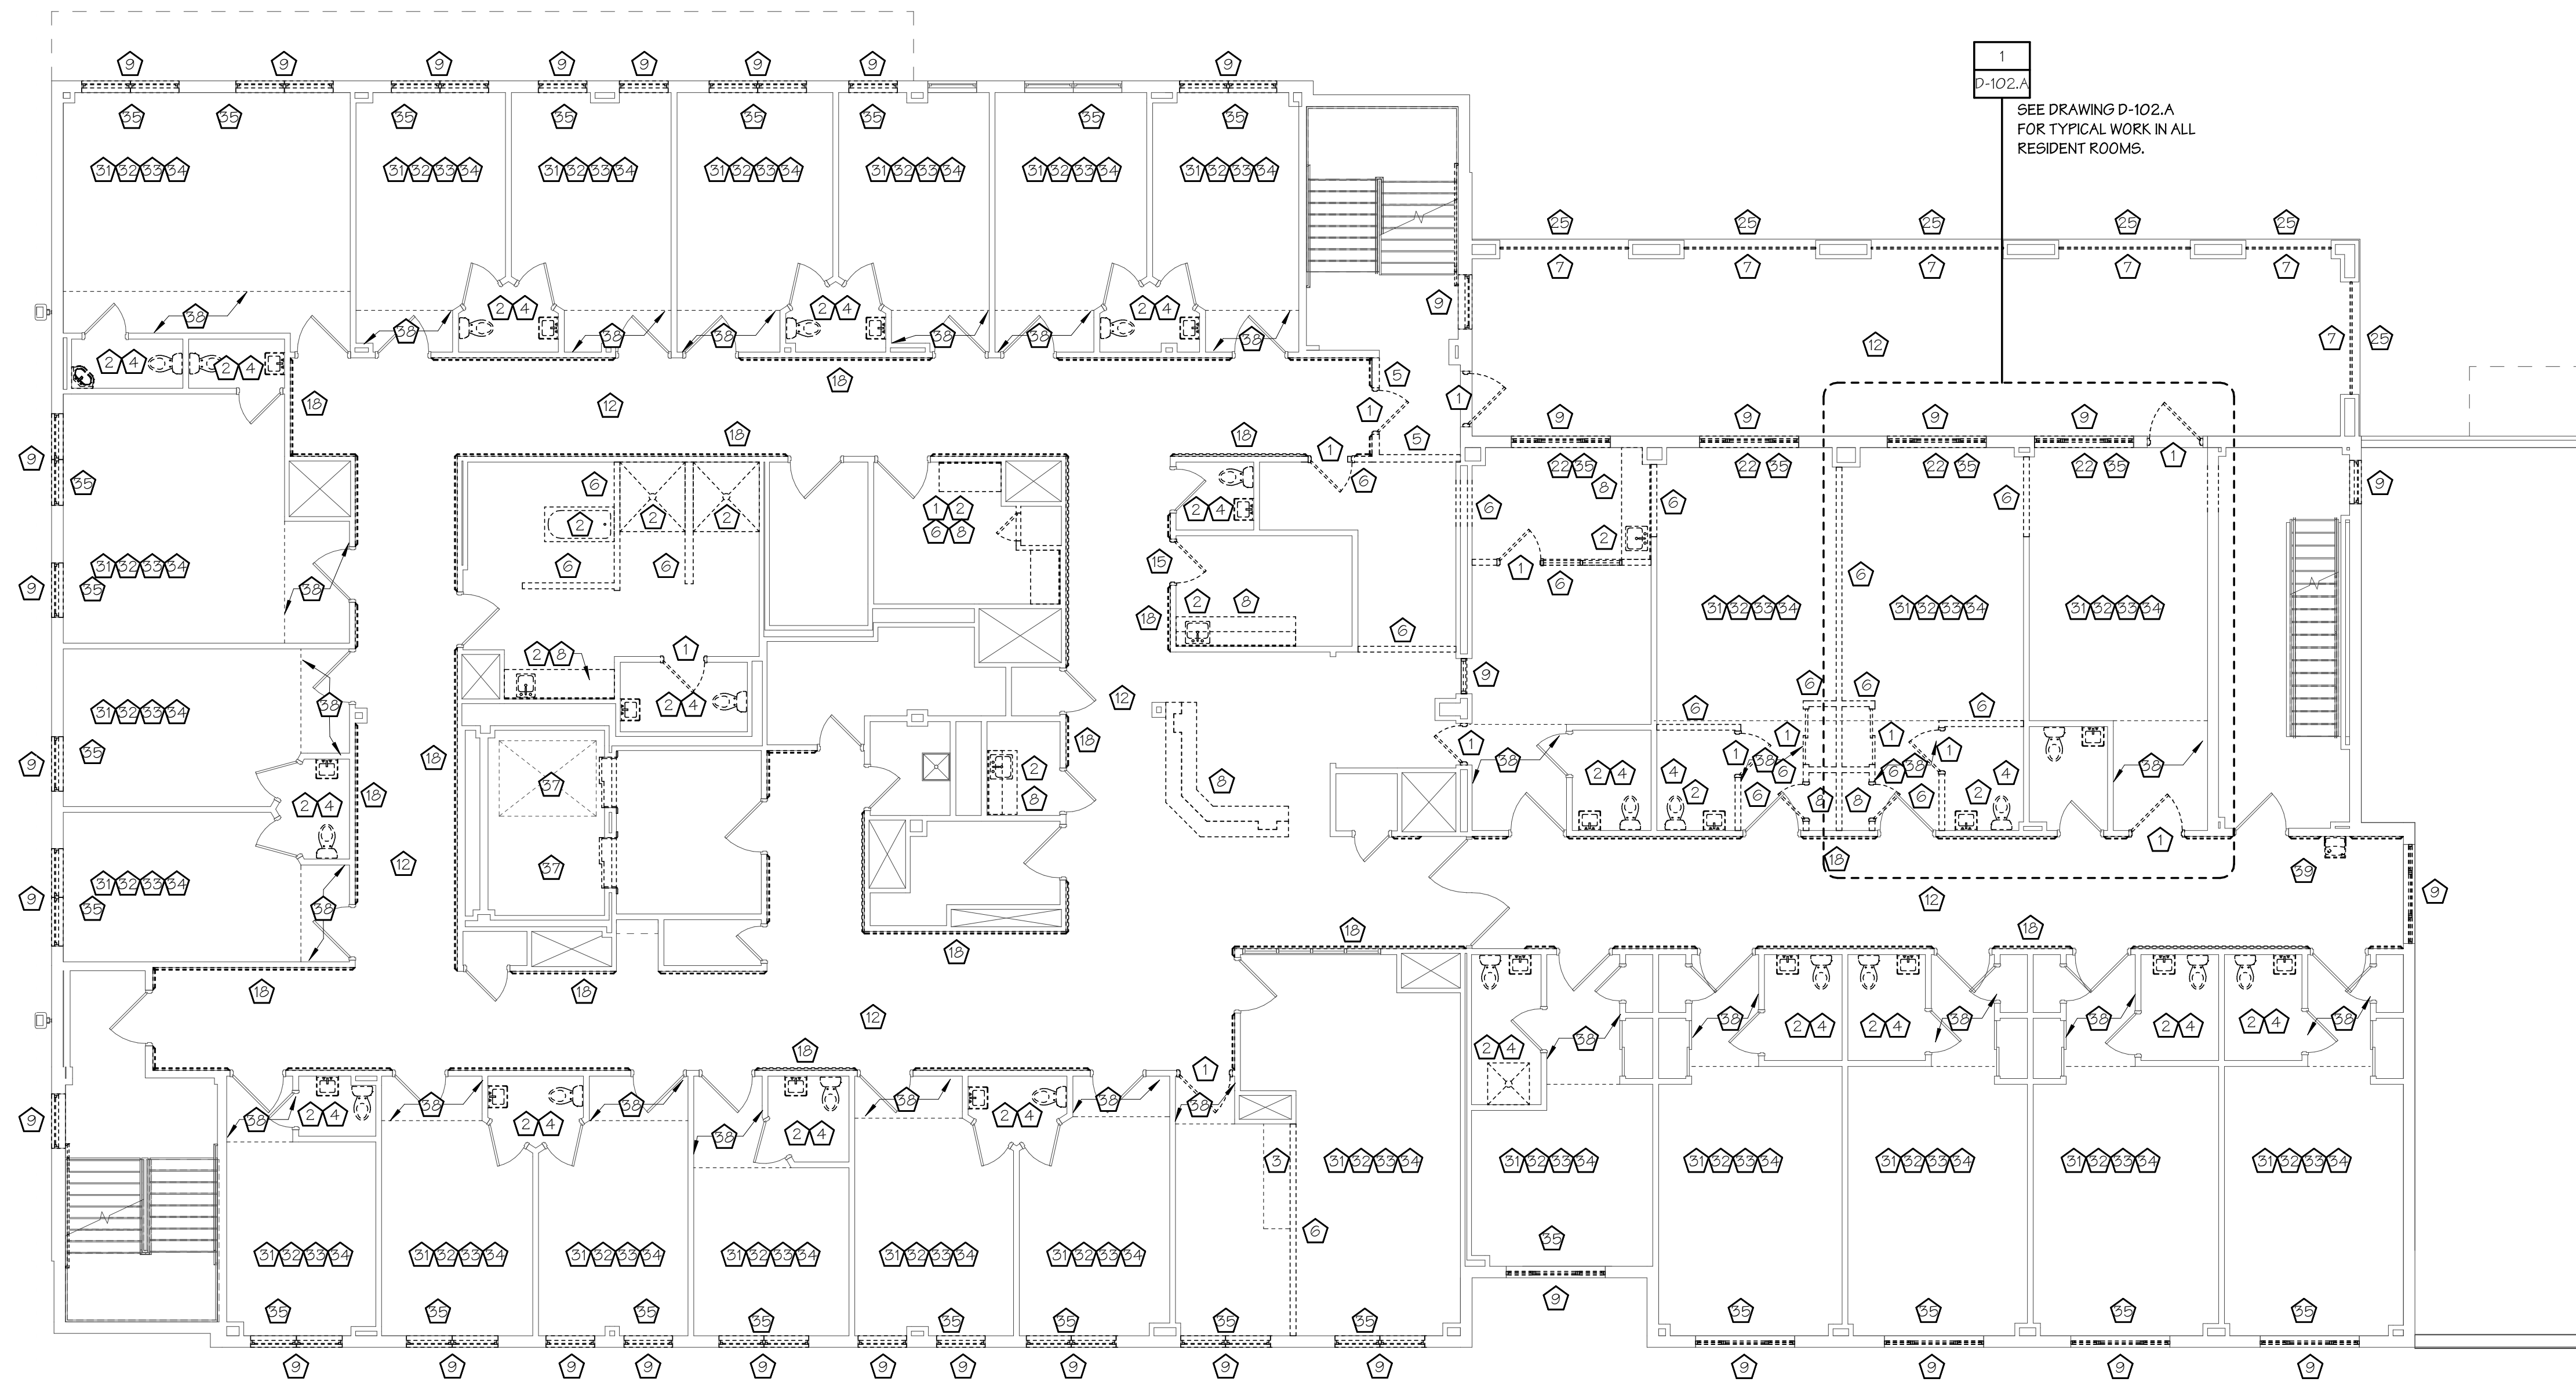

**SECOND FLOOR DEMOLITION PLAN**  
SCALE: 1/8" = 1'-0"







ANTINAZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINAZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Meritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinazzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:



REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

**JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION**  
**PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION**  
**725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT**

DRAWING TITLE:  
THIRD FLOOR DEMOLITION PLAN

SCALE: As indicated	DRAWN BY: RMR	REVIEWED BY: DCF
------------------------	------------------	---------------------

DRAWING NO.

# D-103

04.16.2020 - CM BID


DATE: 31 JANUARY 2020	JOB NUMBER: 18052
--------------------------	----------------------

### GENERAL DEMOLITION NOTES

- A. THESE NOTES ARE FOR INTENT PURPOSES ONLY. CONTRACTOR TO BE RESPONSIBLE FOR REMOVING ALL QUANTITIES OF ALL ITEMS AS REQUIRED TO COMPLETE THIS PROJECT AS SHOWN ON THE CONSTRUCTION DOCUMENTS.
- B. COORDINATE ALL DEMOLITION WITH ARCHITECTURAL, STRUCTURAL, MECHANICAL, PLUMBING & ELECTRICAL CONSTRUCTION. COORDINATE ALL CUTTING AND PATCHING WITH NEW WORK.
- C. ALL CUTTING, PATCHING & DEMOLITION REQUIRED BY ALL TRADES FOR THIS PROJECT IN NEW AND EXISTING AREAS SHALL BE PERFORMED BY THE CONTRACTOR.
- D. REMOVE ALL WALLS INCLUDING FINISH AND BRACING AS SHOWN DASHED - REQUIRED FOR NEW CONSTRUCTION - COORDINATE WITH NEW FLOOR PLANS AND STRUCTURAL DRAWINGS. REFER TO HAZARD DRAWINGS FOR ADDITIONAL ABATEMENT INFORMATION
- E. DISCONNECT OR DISABLE ALL AFFECTED UTILITIES PRIOR TO COMMENCING WORK. ALL ABANDONED UTILITY LINES (PLUMBING, ELECTRICAL, DATA, ALARM) SHALL BE CUT & CAPPED BELOW FLOOR LINE OR BEHIND WALL LINE. FLOOR OR WALL SHALL BE FINISHED TO MATCH EXISTING ADJACENT SURFACES.
- F. COORDINATE ALL DEMOLITION WORK SHOWN ON THESE DRAWINGS WITH ASBESTOS, LEAD, & PCB ABATEMENT DRAWINGS. CERTAIN PLUMBING CHASES, WINDOWS, CEILINGS, ETC., MAY REQUIRE REMOVAL UNDER ACM, LEAD, OR PCB CONTAINMENT CONDITIONS. ALL WORK SHOWN ON ENVIRONMENTAL MUST BE COMPLETED IN COMPLIANCE WITH ALL APPLICABLE REGULATIONS OUTLINED IN ALL APPLICABLE SPECIFICATION.
- G. REMOVE ALL WOOD HANDRAILS AND ALL WALL COVERINGS IN CORRIDORS (TYP.)
- H. REMOVE FLOOR FINISHES INCLUDING UNDERLAYMENTS AND ADHESIVES DOWN TO CLEAN SUBSTRATE IN ALL ROOMS WHERE NEW FLOOR FINISHES ARE TO BE APPLIED - COORDINATE WITH FINISH FLOOR PLANS.
- I. REMOVE ALL EXISTING INTERIOR LIGHTING FIXTURES WITHIN THE SCOPE OF WORK AREA (FLOOR 2-5) TO BE REPLACED WITH NEW L.E.D. FIXTURES ON A 1 TO 1 BASIS - COORDINATE WITH ELECTRICAL ENGINEERING DRAWINGS.
- J. REMOVE ALL EXISTING EXTERIOR WALL & SITE MOUNTED LIGHT FIXTURES TO BE REPLACED BY NEW L.E.D. FIXTURES ON A 1 TO 1 BASIS - COORDINATE WITH ELECTRICAL ENGINEERING DRAWINGS.
- K. ALL WORK ON DEMOLITION PLAN SHOWN DASHED IS TO BE REMOVED IN ITS ENTIRETY, UNLESS OTHERWISE NOTED. SURFACES ARE TO BE REPAIRED, PATCHED AND MATCHED AS REQUIRED TO SUIT INSTALLATION OF NEW WORK TYPICAL.
- L. ANY EXISTING ITEMS THAT ARE NOT TO REMAIN, OR INTERFERING WITH NEW WORK (I.E. COAT HOOKS, WALL PLATES, ECT... ARE TO BE REMOVED PATCH AND MATCH AS REQUIRED.
- M. SEE DRAWING D-102.A FOR TYPICAL WORK IN ALL RESIDENT ROOMS.

### ELEVATOR SHAFTS WORK:

- 1. Remove all existing work interfering with proposed. Prep as required for installation of new work. Review with Architect any questionable items.
- 2. Field verify all dimensions. Report discrepancies to architect.
- 3. Coordinate all work with Elevator Installer and mfr instructions.
- 4. The elevator shaft extension, which we understand to be on the order of (5) feet high, shall be constructed of 8" CMU reinforced with #5 verticals @ 2'-8" o.c. full height. Vertical bars shall extend 2'-0" into the existing CMU shaft with all new and existing CMU cells filled solid at vertical reinforcing. There shall be a continuous bond beam with 2-#5 all around the periphery of the top of the shaft.
- 5. The roof of the shaft shall be 3" x 16 gage galvanized Type N deep rib metal deck spanning in the 8'-11" direction. Metal deck shall be anchored to a 3/8" x 4" wide plate which shall be anchored to the bond beam in item 1 above with 5/8" diameter x 8" long welded anchors @ 2'-8" o.c. all around the periphery of the shaft.
- 6. At the existing guide rail beams to be relocated, grout two courses x 1'-4" long solid below new beam pocket locations and provide solid brick or grout all around beam pocket. Existing bricked in beam pockets to be abandoned shall be patched with grout.
- 7. At new elevator cab doors to be relocated, provide 2-#5 full height bars at each new jamb and fill solid with grout. At abandoned door locations, provide #5 @ 16" o.c. full height and fill reinforced cells solid with grout. New door lintels shall be (2) L 6 x 3 1/2 x 3/8, long leg vertical, and bear a minimum of 6" onto each jamb.
- 8. All altered masonry openings shall be properly toothed back to maintain the integrity of the existing elevator shaft.

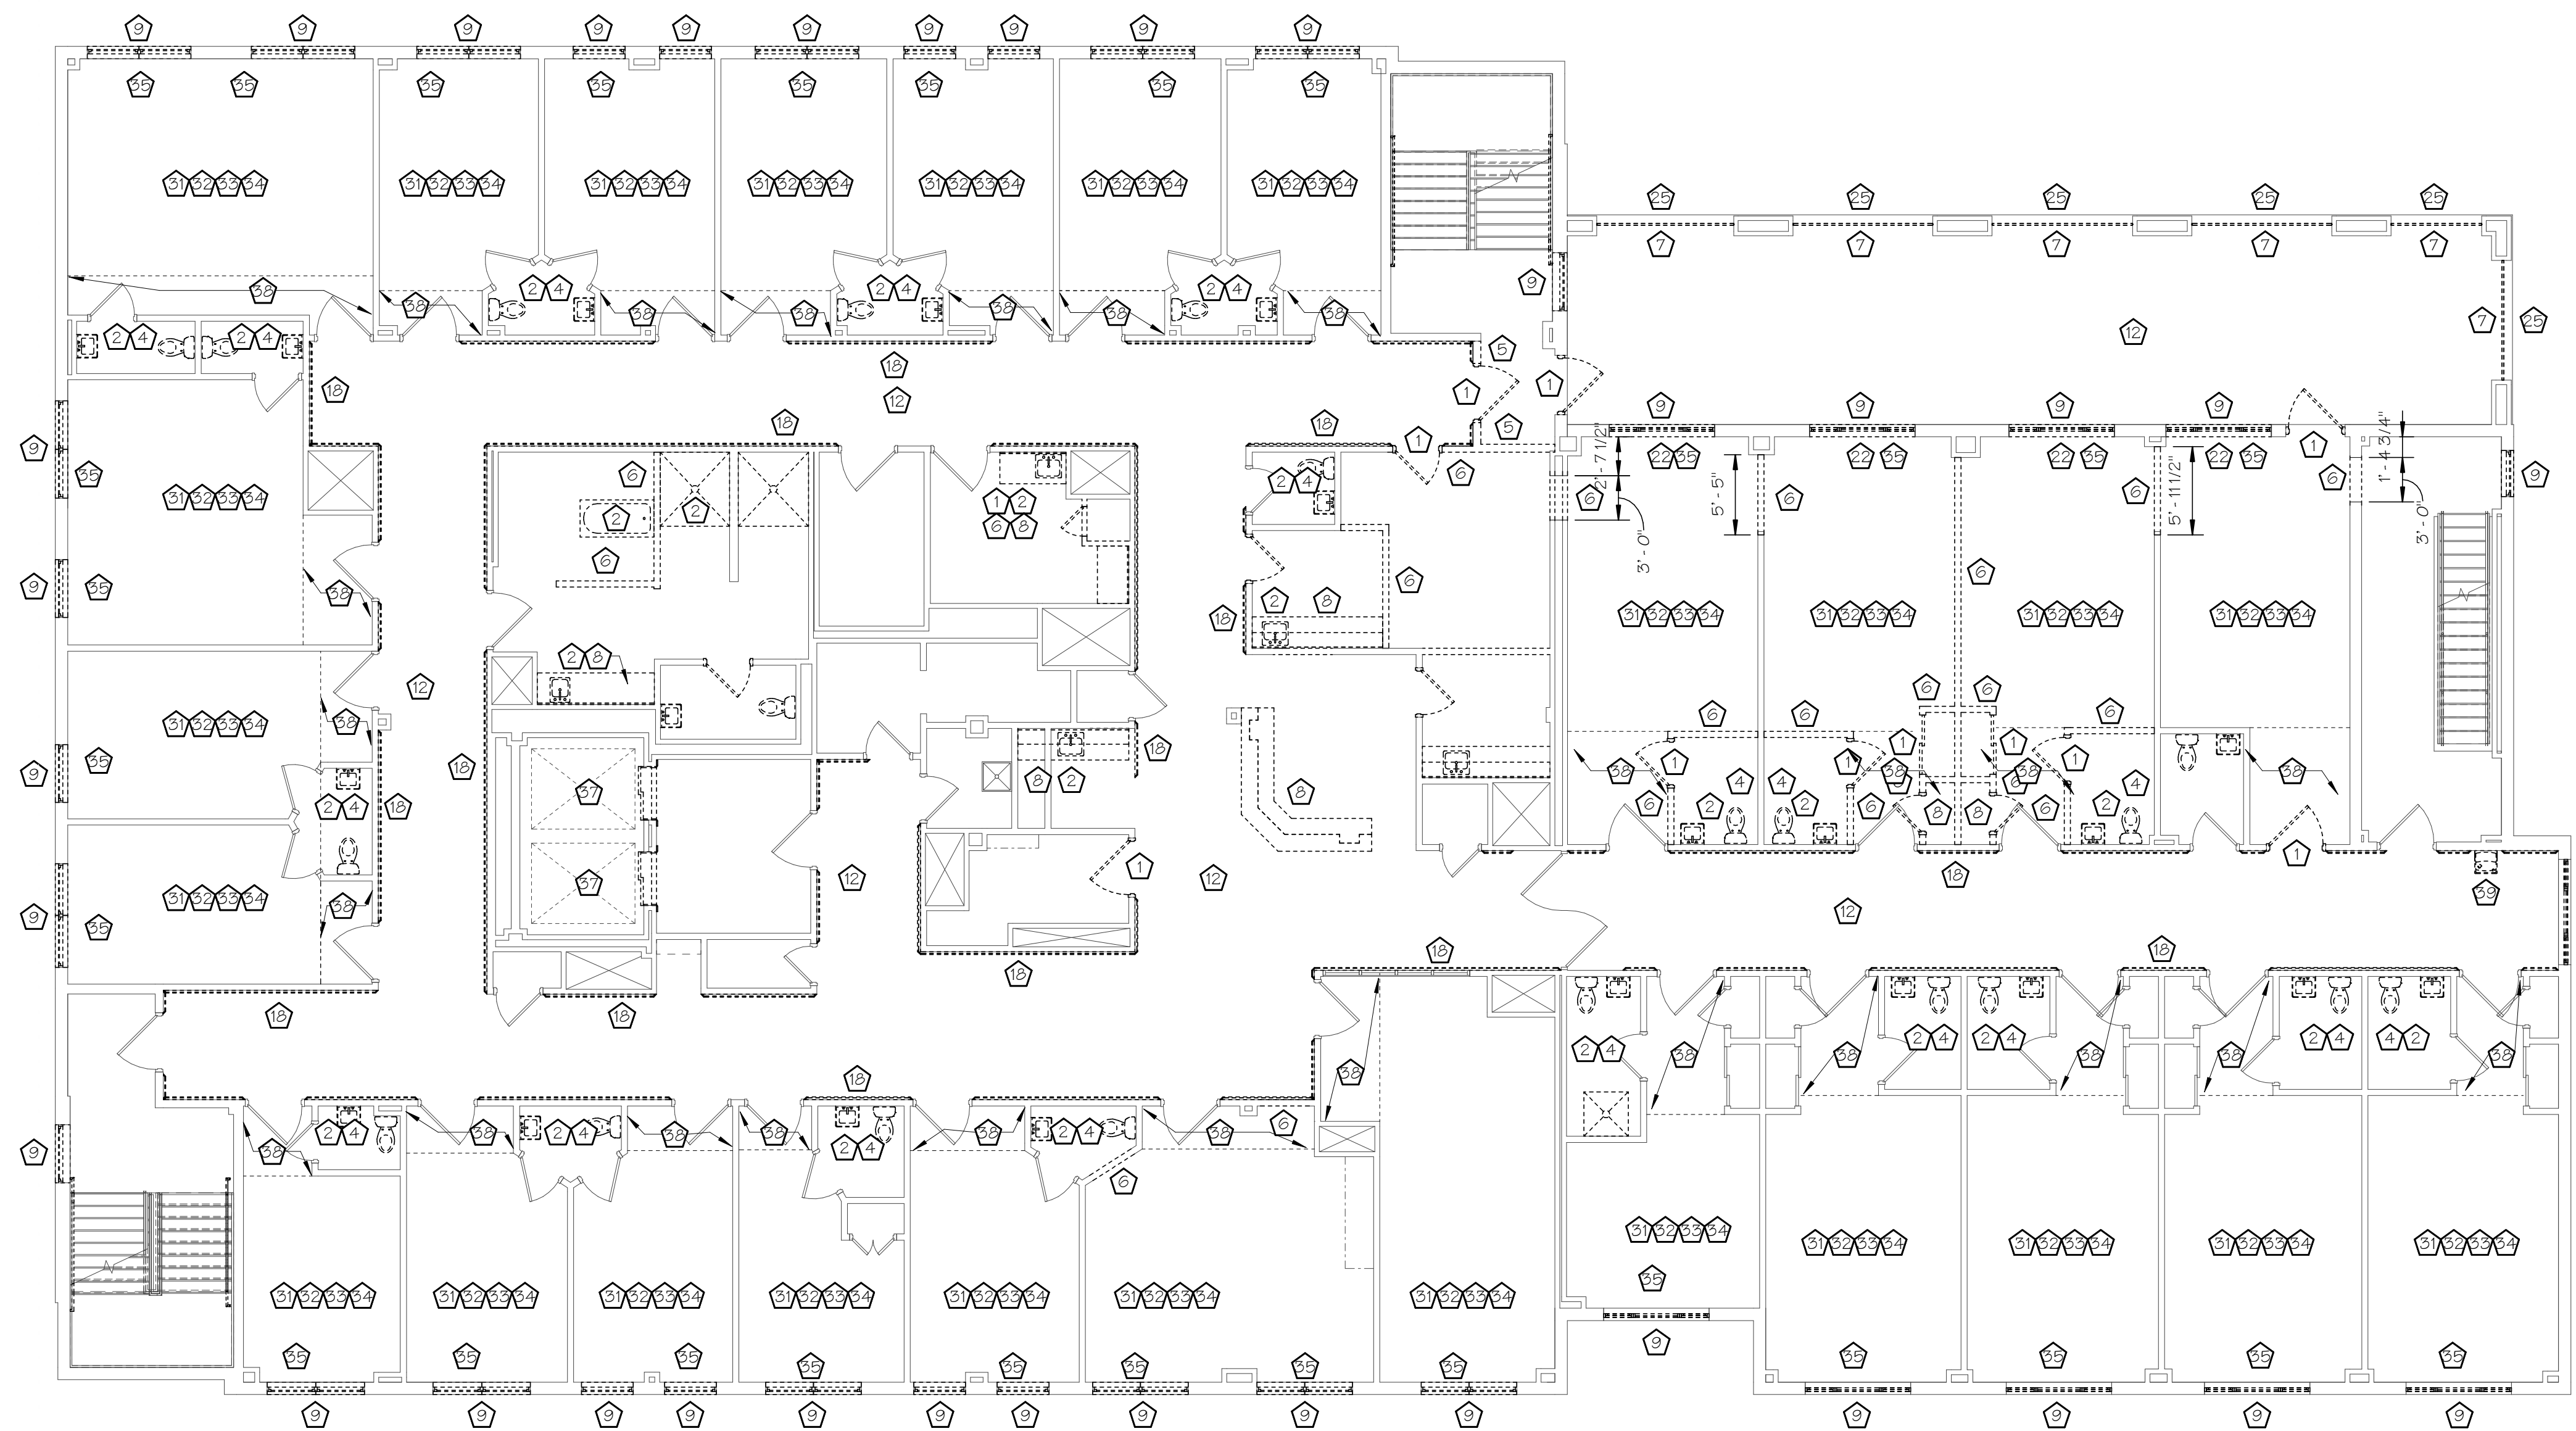

THIRD FLOOR DEMOLITION PLAN

SCALE: 1/8" = 1'-0"





**ANTINOZZI ASSOCIATES**  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:

**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
**04.16.2020 - CM BID**

**REVISIONS**

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

**JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION**  
**PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION**  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
FIFTH FLOOR DEMOLITION PLAN

SCALE: As indicated  
DRAWN BY: KWG  
REVIEWED BY: DCF

DRAWING NO.

**D-105**  
**04.16.2020 - CM BID**

DATE: 31 JANUARY 2020  
JOB NUMBER: 18052

**GENERAL DEMOLITION NOTES**


- A. THESE NOTES ARE FOR INTENT PURPOSES ONLY. CONTRACTOR TO BE RESPONSIBLE FOR REMOVING ALL QUANTITIES OF ALL ITEMS AS REQUIRED TO COMPLETE THIS PROJECT AS SHOWN ON THE CONSTRUCTION DOCUMENTS.
- B. COORDINATE ALL DEMOLITION WITH ARCHITECTURAL, STRUCTURAL, MECHANICAL, PLUMBING & ELECTRICAL CONSTRUCTION. COORDINATE ALL CUTTING AND PATCHING WITH NEW WORK.
- C. ALL CUTTING, PATCHING & DEMOLITION REQUIRED BY ALL TRADES FOR THIS PROJECT IN NEW AND EXISTING AREAS SHALL BE PERFORMED BY THE CONTRACTOR.
- D. REMOVE ALL WALLS INCLUDING FINISH AND BRACING AS SHOWN DASHED - REQUIRED FOR NEW CONSTRUCTION - COORDINATE WITH NEW FLOOR PLANS AND STRUCTURAL DRAWINGS. REFER TO HAZARD DRAWINGS FOR ADDITIONAL ABATEMENT INFORMATION.
- E. DISCONNECT OR DISABLE ALL AFFECTED UTILITIES PRIOR TO COMMENCING WORK. ALL ABANDONED UTILITY LINES (PLUMBING, ELECTRICAL, DATA, ALARM) SHALL BE CUT & CAPPED BELOW FLOOR LINE OR BEHIND WALL LINE. FLOOR OR WALL SHALL BE FINISHED TO MATCH EXISTING ADJACENT SURFACES.
- F. COORDINATE ALL DEMOLITION WORK SHOWN ON THESE DRAWINGS WITH ASBESTOS, LEAD, & PCB ABATEMENT DRAWINGS. CERTAIN PLUMBING CHASES, WINDOWS, CEILINGS, ETC., MAY REQUIRE REMOVAL UNDER ACM, LEAD, OR PCB CONTAINMENT CONDITIONS. ALL WORK SHOWN ON ENVIRONMENTAL MUST BE COMPLETED IN COMPLIANCE WITH ALL APPLICABLE REGULATIONS OUTLINED IN ALL APPLICABLE SPECIFICATION. "
- G. REMOVE ALL WOOD HANDRAILS AND ALL WALLCOVERINGS IN CORRIDORS (TYP.)
- H. REMOVE FLOOR FINISHES INCLUDING UNDERLAYMENTS AND ADHESIVES DOWN TO CLEAN SUBSTRATE IN ALL ROOMS WHERE NEW FLOOR FINISHES ARE TO BE APPLIED - COORDINATE WITH FINISH FLOOR PLANS.
- I. REMOVE ALL EXISTING INTERIOR LIGHTING FIXTURES WITHIN THE SCOPE OF WORK AREA (FLOOR 2 - 5 ) TO BE REPLACED WITH NEW L.E.D. FIXTURES ON A 1 TO 1 BASIS - COORDINATE WITH ELECTRICAL ENGINEERING DRAWINGS.
- J. REMOVE ALL EXISTING EXTERIOR WALL & SITE MOUNTED LIGHT FIXTURES TO BE REPLACED BY NEW L.E.D. FIXTURES ON A 1 TO 1 BASIS - COORDINATE WITH ELECTRICAL ENGINEERING DRAWINGS.
- K. ALL WORK ON DEMOLITION PLAN SHOWN DASHED IS TO BE REMOVED IN ITS ENTIRETY, UNLESS OTHERWISE NOTED. SURFACES ARE TO BE REPAIRED, PATCHED AND MATCHED AS REQUIRED TO SUIT INSTALLATION OF NEW WORK TYPICAL.
- L. ANY EXISTING ITEMS THAT ARE NOT TO REMAIN, OR INTERFERING WITH NEW WORK (I.E. COAT HOOKS, WALL PLATES, ECT...) ARE TO BE REMOVED PATCH AND MATCH AS REQUIRED.
- M. SEE DRAWING D-102.A FOR TYPICAL WORK IN ALL RESIDENT ROOMS.

**DEMOLITION NOTES**

- 1 REMOVE EXISTING DOOR, FRAME & HARDWARE. PREP OPENING FOR NEW WORK AS REQUIRED.
- 2 DISCONNECT & REMOVE EXISTING PLUMBING FIXTURES - SEE PLUMBING DRAWINGS FOR DEMOLITION NOTES.
- 3 REMOVE EXISTING MECHANICAL & PLUMBING EQUIPMENT INCLUDING, BUT NOT LIMITED TO: EXISTING VENTILATOR UNIT, FIN TUBE, EXHAUST, PIPING COVER, DUCTWORK, LEADERS AND ANY OTHER MECHANICAL & PLUMBING EQUIPMENT AS REQUIRED - COORDINATE WITH MECHANICAL & PLUMBING DRAWINGS.
- 4 REMOVE ALL EXISTING TOILET ROOM ACCESSORIES INCLUDING BUT NOT LIMITED TO GRAB BARS, DISPENSERS, MIRRORS AND CALL TO AID ALARM
- 5 REMOVE PORTION OF EXISTING MASONRY WALL AS REQUIRED FOR NEW CONSTRUCTION - COORDINATE WITH NEW FLOOR PLANS AND STRUCTURAL DRAWINGS.
- 6 REMOVE PORTION OF INTERIOR PARTITION AS REQUIRED FOR NEW CONSTRUCTION - PATCH AND REPAIR EXISTING TO REMAIN - COORDINATE WITH NEW WORK.
- 7 REMOVE GUARDRAIL/HANDRAIL INCLUDING ALL ASSOCIATED HARDWARE & PATCH EXISTING TO REMAIN WHERE DAMAGE OCCURS
- 8 REMOVE EXISTING MILLWORK/CASEWORK CABINETS/SHELVING DOORS, LEDGES/CAPS, BLOCKING FASTENERS, ETC
- 9 REMOVE EXISTING WINDOW UNIT IN ITS ENTIRETY, INCLUDING JAMBS ACCESSORIES, INTERIOR APRONS/SILLS, ETC. REVIEW CONDITION OF EXISTING ROUGH OPENING FRAMING AND NOTIFY OWNER AND ARCHITECT OF ANY DAMAGED. PREP ROUGH OPENING AS REQUIRED TO SUIT INSTALLATION OF NEW WINDOW UNITS.
- 12 REMOVE ALL EXISTING CEILINGS, U.O.N., INCLUDING BUT NOT LIMITED TO: SOFFITS, ACOUSTICAL CEILING TILES, SUSPENDED GRIDS, GWB AND CEILING PANELS UP TO THE EXISTING ROOF DECK. REMOVE ASSOCIATED SUPPORT STRUCTURES ALONG WITH ATTACHED CEILING DEVICES, LIGHT FIXTURES, HVAC DIFFUSERS AND RETURNS. SEE MEP FOR COORDINATION.
- 15 REMOVE DOOR LEAF AND HARDWARE - REPAIR EXISTING FRAME TO REMAIN AS NEEDED
- 16 REMOVE EXISTING WALL MOUNTED HANDRAILS IN STAIRS FROM FIRST FLOOR TO SECOND FLOOR LANDING
- 19 REMOVE PORTION OF KNEE WALL BELOW STOREFRONT GLAZING - COORDINATE WITH NEW CONSTRUCTION PLANS
- 20 REMOVE PORTION OF EXISTING MEMBRANE ROOFING AND INSULATION DOWN TO CLEAN CONCRETE DECKING
- 21 REMOVE PORTION OF EXISTING WALL CAP & COORDINATE WITH NEW CONSTRUCTION
- 22 REMOVE PORTION OF EXTERIOR MASONRY WALL BELOW WINDOW TO BE REMOVED
- 23 REMOVE ALUMINUM STOREFRONT GLAZING & FRAME
- 24 DEMOLISH PORTION OF PROJECTING BRICKWORK SILL
- 25 REMOVE SOFFIT FASCIA PANELS & FRAMING ABOVE OPENING
- 26 REMOVE RAISED CONCRETE SILL OR STEP UNDER DOOR TO BE REMOVED
- 27 REMOVE ALUMINUM STOREFRONT, PANELS AND FURRED WALL BEHIND
- 28 REMOVE WALL MOUNTED HANDRAILS IN STAIRS FROM SECOND FLOOR TO TOP OF STAIRWAY
- 29 EXISTING ROOF OPENING TO BE FILLED IN. INFILL EXISTING ROOF STRUCTURE AS FOLLOWS: PROVIDE STEEL PLATE TO FILL EXISTING OPENING. STEEL PLATE SHALL BE SUPPORTED ON 4 SIDES BY STEEL ANGLES. TACK WELD STEEL PLATE TO NEW SUPPORTING ANGLES. INFILL REMAINING OPENING WITH RIGID INSULATION TO MATCH TOP OF EXISTING ROOF DECK. WHERE OPENINGS ARE LESS THAN 8" SCREW ATTACHED STEEL PLATE TO UNDERSIDE OF EXISTING DECK AND SOLID GROUT FILL TO MATCH EXISTING TOP OF ROOF LEVEL. TYPICAL.
- 30 REMOVE EXISTING CHIMNEY TO BELOW EXISTING DECK
- 31 REMOVE EXISTING CEILING TRACKS
- 32 REMOVE ALL WALL MOUNTED FIXTURES, INTERCOM COVER AND WALLPAPER. TYPICAL FOR ALL ROOMS. PREP WALL FOR NEW FINISH. COORDINATE WITH NEW FLOOR PLANS & FINISH PLANS
- 33 REMOVE ALL EXISTING BASEBOARD COVERS TYPICAL
- 34 REMOVE PORTION OF CHAIR RAIL AS NEEDED TO ACCOMMODATE NEW PARTITIONS - COORDINATE WITH NEW FLOOR PLAN
- 35 REMOVE EXISTING INTERIOR WINDOW BLINDS AND SUPPORTS IN THEIR ENTIRETY. PATCH WALLS AS REQUIRED AND PREP FOR INSTALLATION OF NEW WINDOWS SHADES / BLINDS. TYPICAL
- 37 REMOVE EXISTING ELEVATOR CAB AND ALL ASSOCIATED ACCESSORIES AND OR COMPONENTS, INCLUDING BUT NOT LIMITED TO: HOISTWAY DOORS, SILL, LADDER, BUFFER ASSEMBLY, HOISTWAY, AND SILL. PROTECT EXISTING CMU WALLS & FOUNDATION/ELEVATOR PIT TO REMAIN.
- 38 REMOVE PORTION OF EXISTING CEILING AS INDICATED ON PLAN. COORDINATE WITH ARCHITECTURAL & MEP CEILING PLANS.
- 39 REMOVE EXISTING DRINKING FOUNTAINS AND ASSOCIATED PLUMBING LINES WHERE EXIST, U.O.N. TO REMAIN.

**ELEVATOR SHAFTS WORK:**

1. Remove all existing work interfering with proposed. Prep as required for installation of new work. Review with Architect any questionable items.
2. Field verify all dimensions. Report discrepancies to architect.
3. Coordinate all work with Elevator Installer and mfr instructions.
4. The elevator shaft extension, which we understand to be on the order of (5) feet high, shall be constructed of 8" CMU reinforced with #5 verticals @ 2'-8" o.c. full height. Vertical bars shall extend 2'-0" into the existing CMU shaft with all new and existing CMU cells filled solid at vertical reinforcing. There shall be a continuous bond beam with 2-#5 all around the periphery of the top of the shaft.
5. The roof of the shaft shall be 3' x 16 gage galvanized Type N deep rib metal deck spanning in the 8'-11" direction. Metal deck shall be anchored to a 3/8" x 4" wide plate which shall be anchored to the bond beam in item 1 above with 5/8" diameter x 8" long welded anchors @ 2'-8" o.c. all around the periphery of the shaft.
6. At the existing guide rail beams to be relocated, grout two courses x 1'-4" long solid below new beam pocket locations and provide solid brick or grout all around beam pocket. Existing bricked in beam pockets to be abandoned shall be patched with grout.
7. At new elevator cab doors to be relocated, provide 2-#5 full height bars at each new jamb and fill solid with grout. At abandoned door locations, provide #5 @ 16" o.c. full height and fill reinforced cells solid with grout. New door lintels shall be (2) L 6 x 3 1/2 x 3/8, long leg vertical, and bear a minimum of 6" onto each jamb.
8. All altered masonry openings shall be properly toothed back to maintain the integrity of the existing elevator shaft.

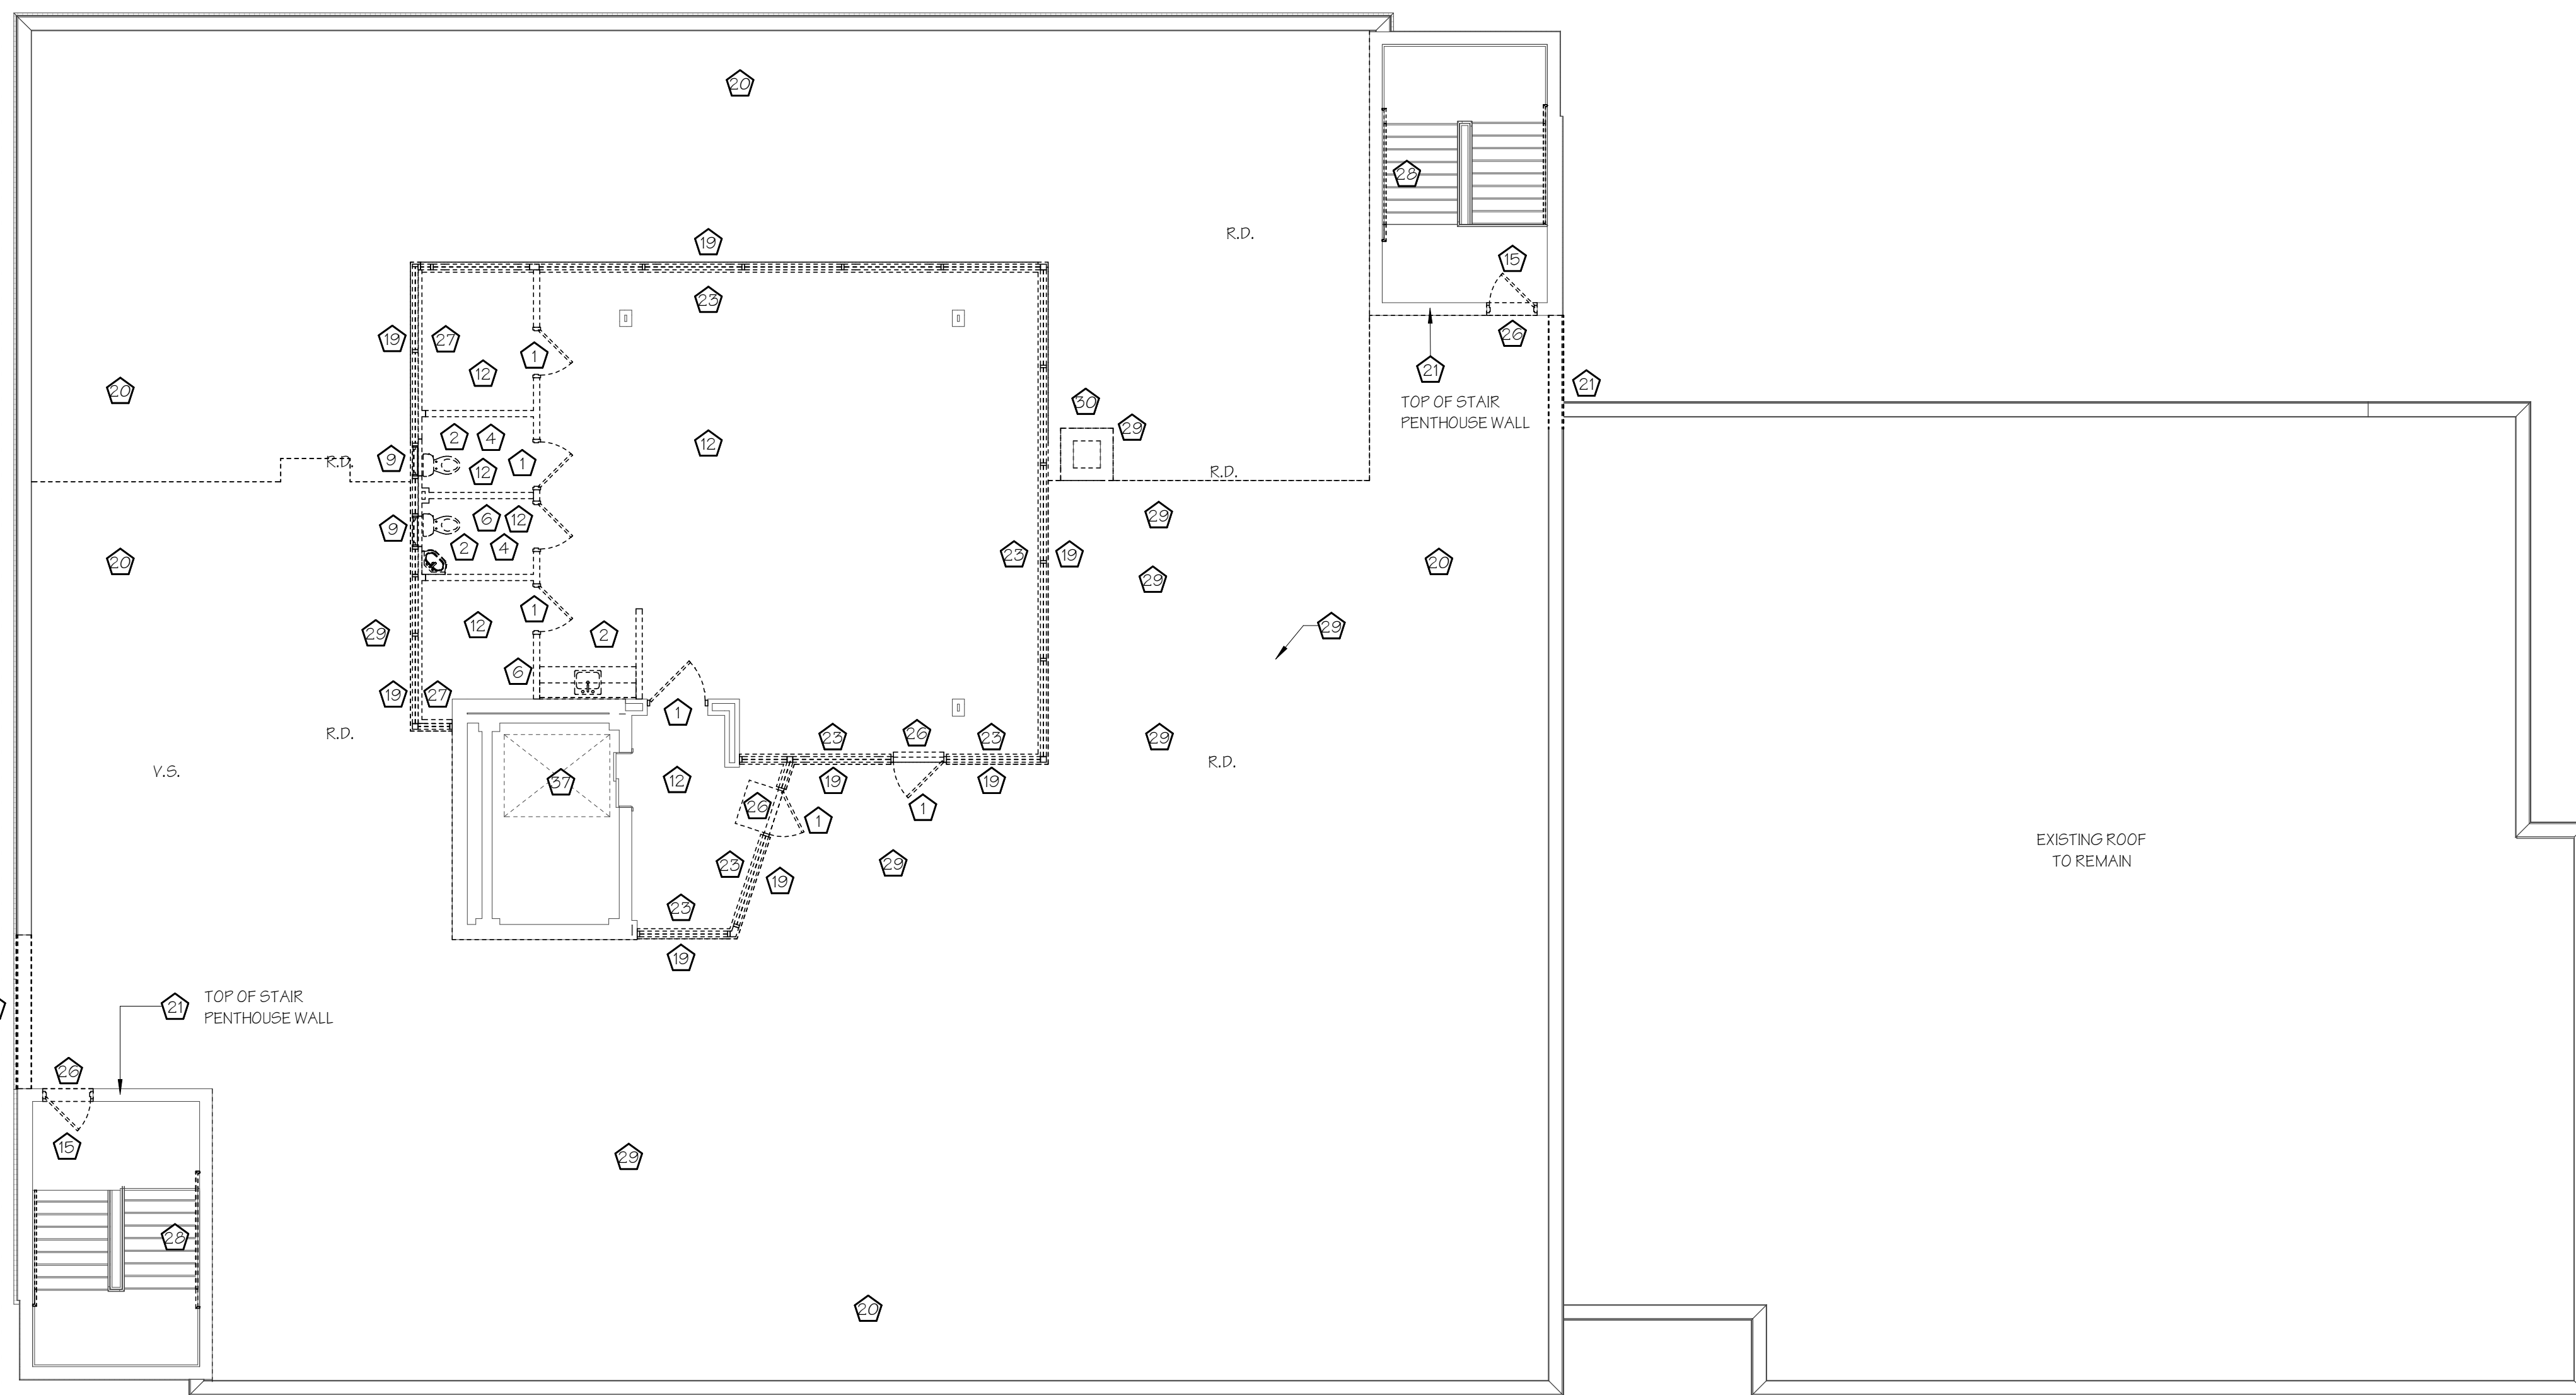

**FIFTH FLOOR DEMOLITION PLAN**  
SCALE: 1/8" = 1'-0"

2/27/2020 1:08:07 PM  
C:\Users\rosenthan\OneDrive\Documents\18052\_Bridgeport\_Rescue Mission\_Phase 2\_Architecture\_rosesthan.rvt



ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002  
301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:  
**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
**04.16.2020 - CM BID**

REVISIONS

NO.	DATE	DESCRIPTION
1	5.22.2019	Ceiling Symbol Legend
00	04.16.20	CM BID

**JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION**  
**PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION**  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
SECOND FLOOR PLAN


SCALE: As indicated  
DRAWN BY: KWG  
REVIEWED BY: DCF  
DRAWING NO.

**A-102**  
04.16.2020 - CM BID

DATE: 31 JANUARY 2020  
JOB NUMBER: 18052

CONSTRUCTION NOTES

- INFILL OPENING FROM REMOVAL OF DOOR OR WINDOW WITH ABUSE RESISTANT GYP. BD. ON BOTH SIDES OF METAL STUD FRAMING - CONSTRUCT TO MATCH THICKNESS OF EXISTING WALL TO REMAIN
- FOLDING PAIR MOVEABLE PARTITION SYSTEM WITH CEILING MOUNTED TRACK - CENTER UNDER EXISTING STRUCTURAL BEAM ABOVE
- VERIFY DIMENSIONS OF PARTITIONS ON EITHER SIDE OF STACK WITH MANUFACTURER'S SHOP DRAWINGS
- NEW REPLACEMENT WINDOW WITH INSULATED GLASS & THERMALLY BROKEN ALUMINUM FRAME WITH FIXED DOUBLE-HUNG LOOK UNITS AND/OR PICTURE UNITS TO MATCH APPEARANCE AND DIMENSIONS OF EXISTING WINDOW
- NEW WALL MOUNTED PAINTED STEEL PIPE HANDRAIL - SEE TYPICAL WALL MOUNTED HANDRAIL DETAIL C1/A-102
- MOTION ACTIVATED TRIP SENSOR W/ AUDIBLE & VISUAL ALARM AT RECEPTION DESK
- NEW A.D.A. DRINKING FOUNTAIN WITH CHILLER & BOTTLE FILLER
- FOUR LIGHT WEIGHT CONCRETE OVER EXISTING DECK AND FINISH FLUSH TO MATCH EXISTING SUBSTRATE LEVEL
- NEW TRACTION ELEVATOR CABS, CORRDINATE MASONRY AT FRONT HOISTWAY WALL W/ ELEVATOR MANUFACTURER. REFER TO SPECIFICATIONS.
- NEW SCREEN AND OR FENCE ENCLOSURE FOR PLAYScape AREA.
- ALTERNATE # A1 - COMPLETE BUILD OUT OF 2ND FLOOR TERRACE. SHELL ONLY SEE BID SPECS FOR PHASING NOTES
- ALTERNATE # A2 - COMPLETE BUILD OUT OF 3RD FLOOR TERRACE
- ALTERNATE # A3 - COMPLETE BUILD OUT OF 4TH FLOOR TERRACE
- COMPLETE CONSTRUCTION OF THE 5TH FLOOR CHAPEL AND CORRIDORS IN ACCORDANCE WITH PLANS AND SPECIFICATIONS.
- NEW SLAB INFILL, COORDINATE WITH STRUCTURAL DETAIL.
- FLOOR DRAIN. SEE SPECIFICATIONS, COORDINATE WITH PLUMBING DRAWINGS
- NEW TOILETS TO BE FLOOR MOUNTED AND OR ADA WHERE REQ'D SEE PLUMBING PLANS
- NEW TOILETS TO BE FLOOR MOUNTED AND OR ADA WHERE REQ'D SEE PLUMBING PLANS

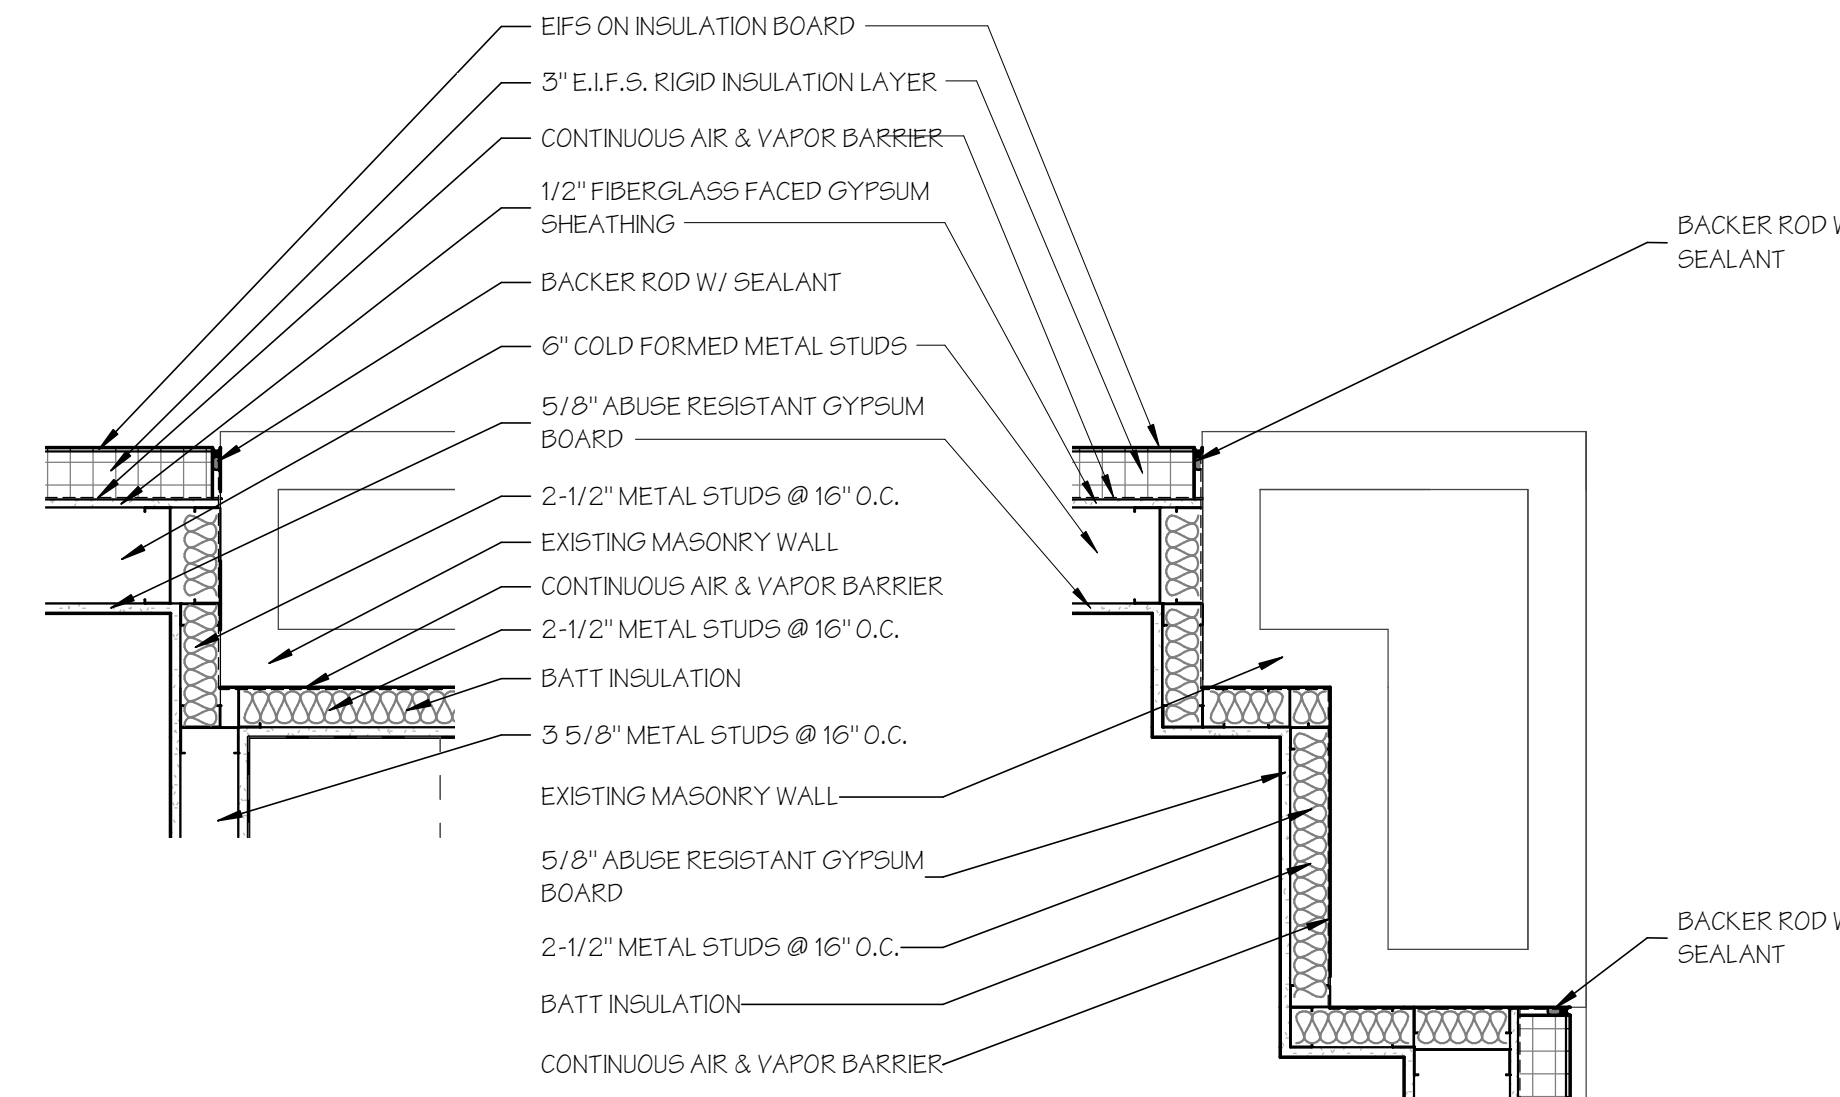


C3 PLAN DETAIL  
SCALE: 1" = 1'-0"


C4 PLAN DETAIL  
SCALE: 1" = 1'-0"

ELEVATOR SHAFTS WORK

- Remove all existing work interfering with proposed. Prep as required for installation of new work. Review with Architect any questionable items.
- Field verify all dimensions. Report discrepancies to architect.
- Coordinate all work with Elevator Installer and mfr instructions.
- The elevator shaft extension, which we understand to be on the order of (5) feet high, shall be constructed of 8" CMU reinforced with #5 verticals @ 2'-8" o.c. full height. Vertical bars shall extend 2'-0" into the existing CMU shaft with all new and existing CMU cells filled solid at vertical reinforcing. There shall be a continuous bond beam with 2-#5 all around the periphery of the top of the shaft.
- The roof of the shaft shall be 3" x 16 gage galvanized Type N deep rib metal deck spanning in the 8'-11" direction. Metal deck shall be anchored to a 3/8" x 4" wide plate which shall be anchored to the bond beam in item 1 above with 5/8" diameter x 8" long welded anchors @ 2'-8" o.c. all around the periphery of the shaft.
- At the existing guide rail beams to be relocated, grout two courses x 1'-4" long solid below new beam pocket locations and provide solid brick or grout all around beam pocket. Existing bricked in beam pockets to be abandoned shall be patched with grout.
- At new elevator cab doors to be relocated, provide 2-#5 full height bars at each new jamb and fill solid with grout. At abandoned door locations, provide #5 @ 16" o.c. full height and fill reinforced cells solid with grout. New door lintels shall be (2) L 6 x 3 1/2 x 3/8, long leg vertical, and bear a minimum of 6" onto each jamb.
- All altered masonry openings shall be properly toothed back to maintain the integrity of the existing elevator shaft.

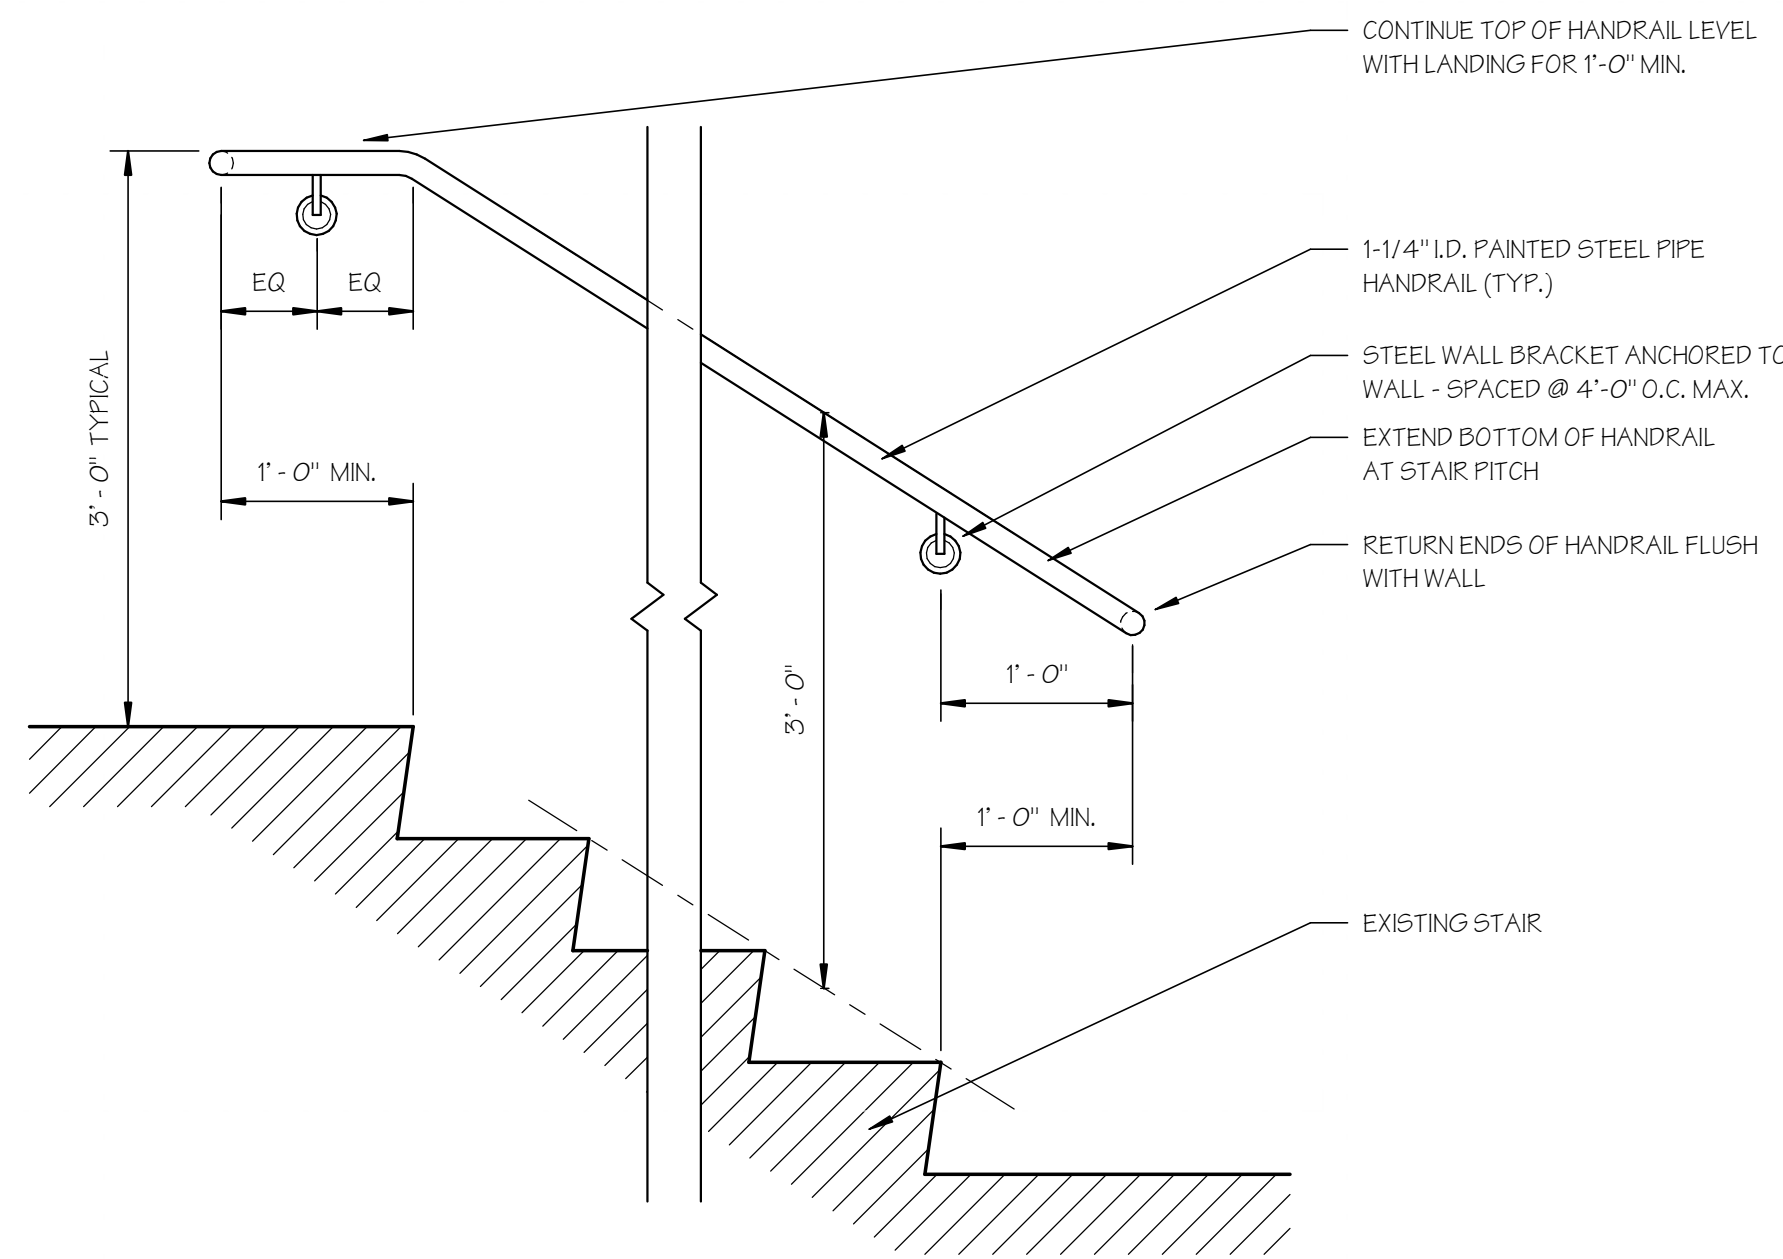

C1 TYP. WALL MOUNTED HANDRAIL  
SCALE: 1" = 1'-0"

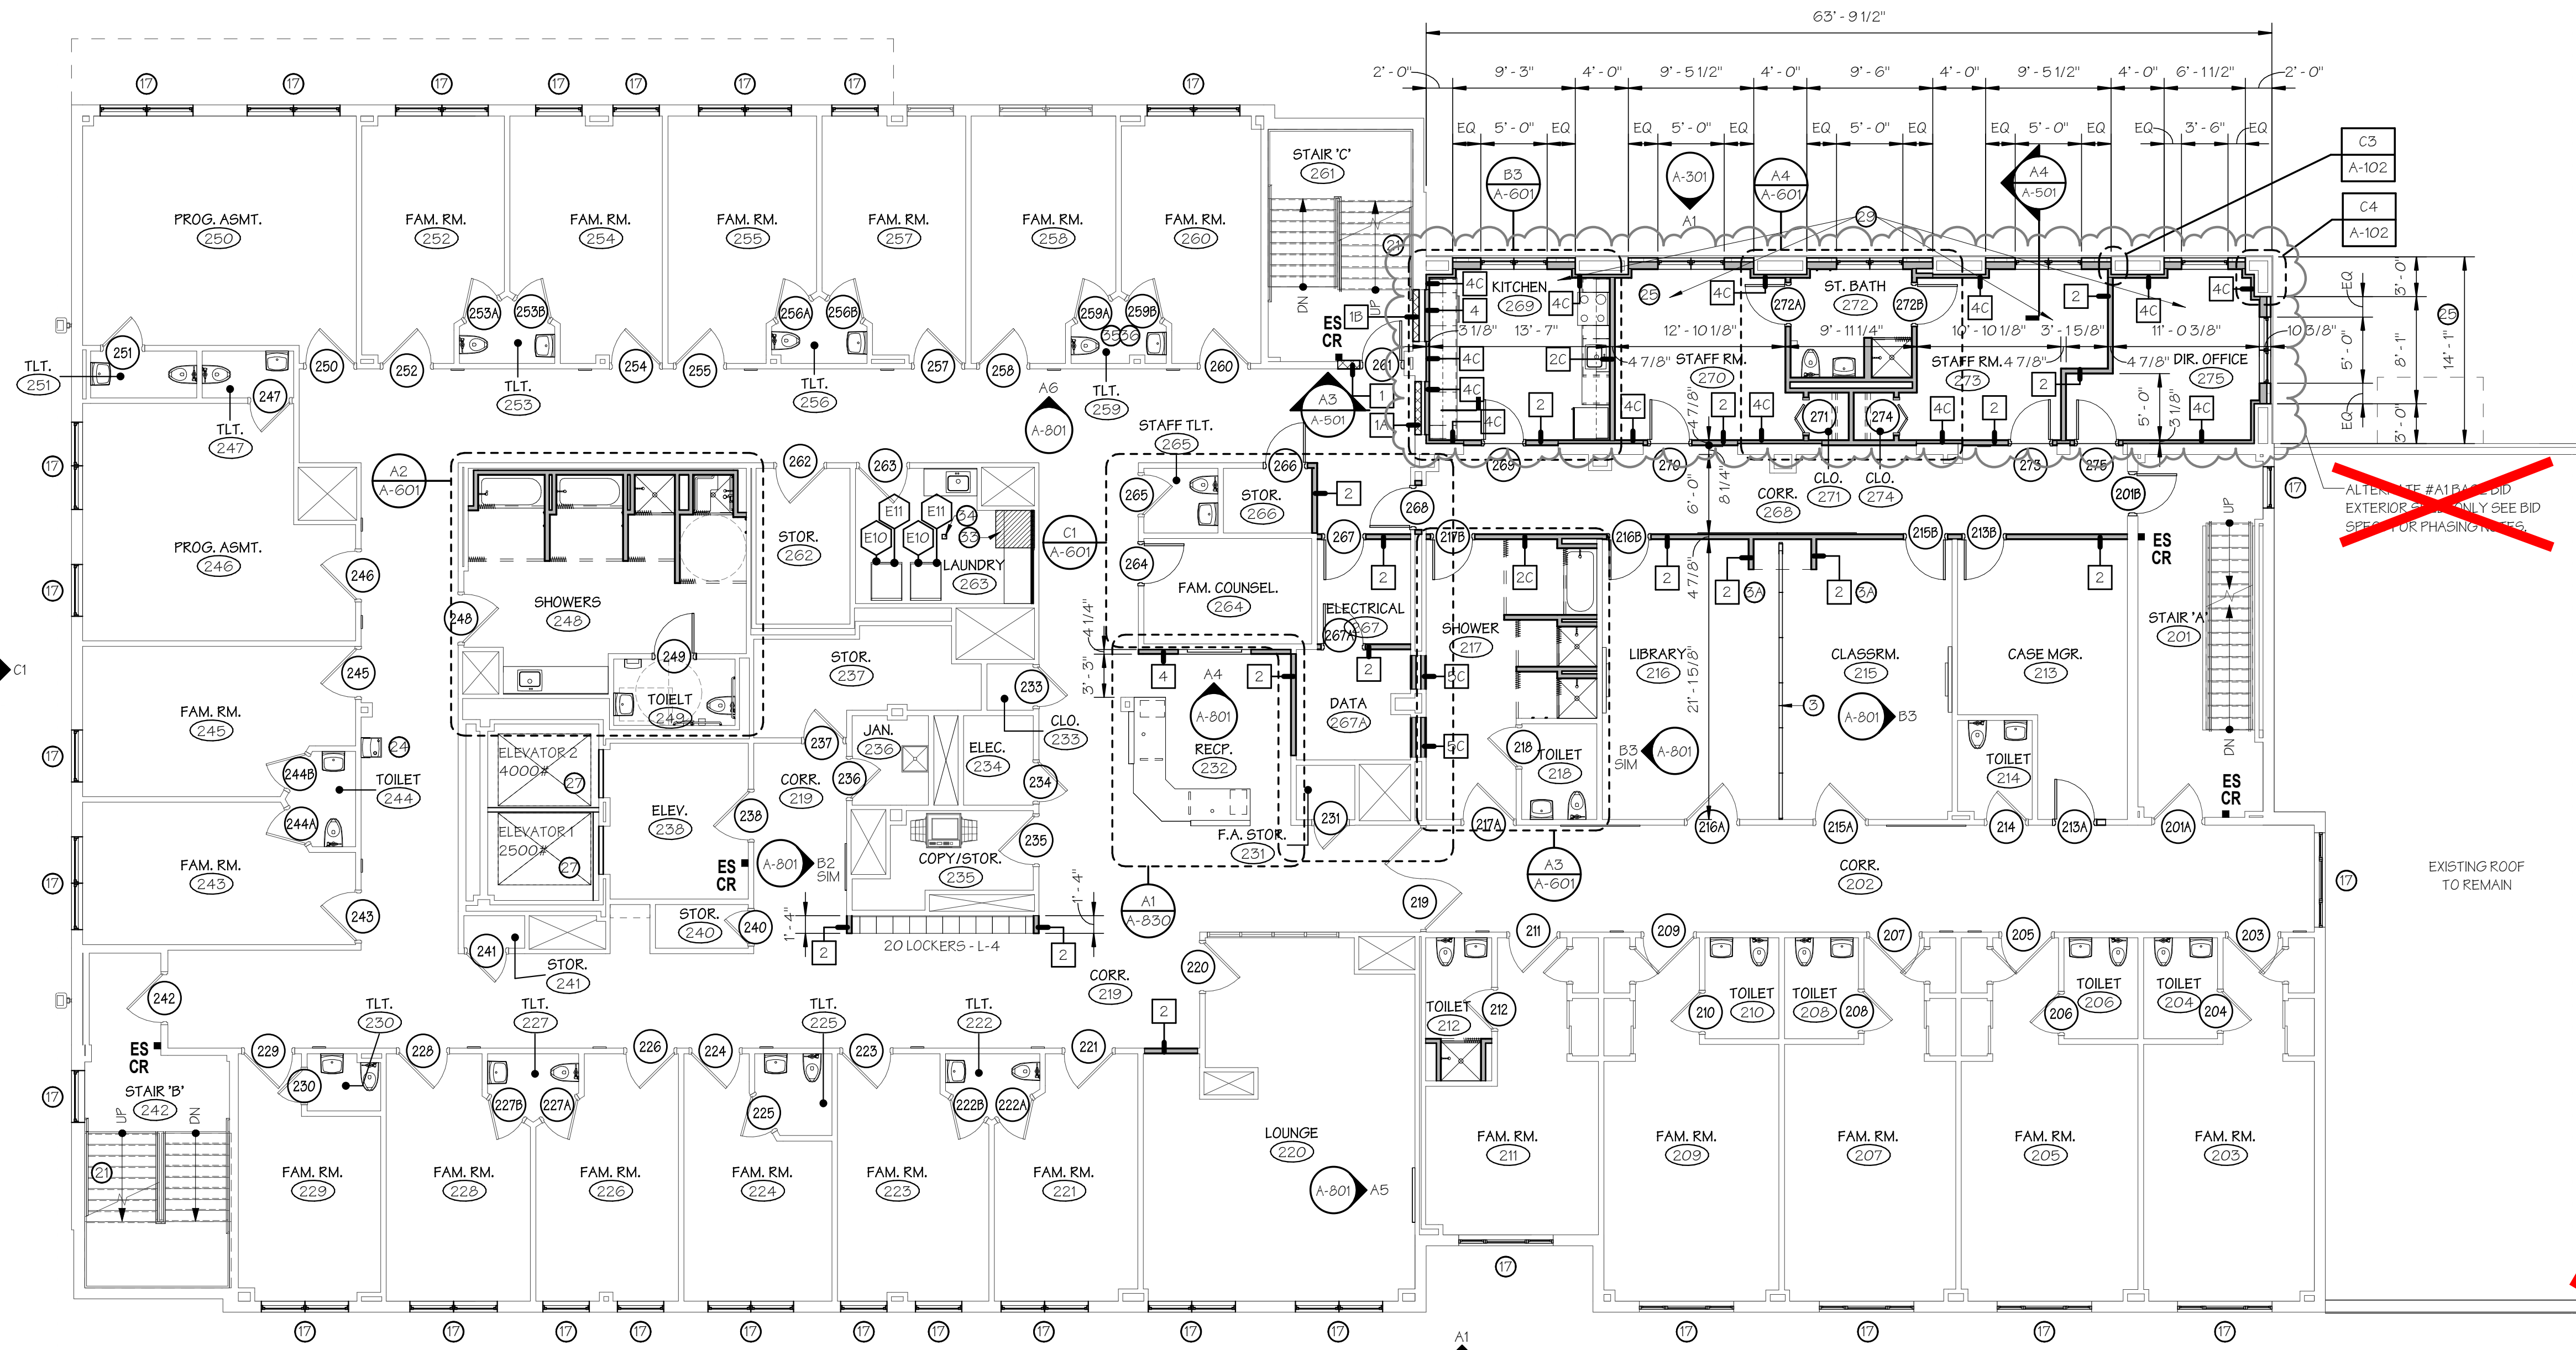

PHASE II ALTERNATE LIST

- BASE BID: FLOORS 2-4: ENCLOSE TERRACES WITH NO INTERIOR FINISHES. PROVIDE BASIC MEP ROUGH-IN SO SPACE CAN BE COMPLETED AT A LATER DATE WITH MINIMAL DISRUPTION OF ACTIVITIES AND USAGE OF ADJACENT SPACES. CONSIDER INSTALL OF METAL STUDS IN THIS PHASE TO MIN. NOISE TO ADJACENT SPACES IN FUTURE)
- ALT. #A1 (NOTE 29) - COMPLETE BUILD OUT OF 2ND FLOOR TERRACE
- ALT. #A2 (NOTE 30) - COMPLETE BUILD OUT OF 3RD FLOOR TERRACE
- ALT. #A3 (NOTE 31) - COMPLETE BUILD OUT OF 4TH FLOOR TERRACE
- BASE BID: FIFTH FLOOR: NO INTERIOR FINISHES, COMPLETE EXTERIOR CONSTRUCTION, ROUGH IN PLUMBING, INSTALQ E.P.O.F TOP HVAC UNIT IN ACCORDANCE WITH SPECIFICATIONS, INSTALL DUCTWORK THROUGH ROOF AND TERMINATE, INSTALL GAS SERVICE TO UNIT, INSTALL ELECTRICAL SERVICE, INSTALL CONTROLS, INSTALL NEW SPRINKLES, PROVIDE BASIC ELECTRICAL ROUGH-IN FOR BALANCE OF THE SPACE
- ALT. #A4 - (NOTE 32) - COMPLETE CONSTRUCTION OF THE 5TH FLOOR CHAPEL AND CORRIDORS IN ACCORDANCE WITH PLANS AND SPECIFICATIONS.
- BASE BID: REMOVE EXISTING WINDOW AND PREP ROUGH OPENING FOR NEW WAUSAU GLAZED UNIT PREP BY G.C. INSTALLED. FLASHING TRIM & ACCESSORIES BY G.C.
- ADD ALT. #A5 - REMOVE EXISTING WINDOW AND PREP ROUGH OPENING FOR NEW ANDERSEN WINDOW UNIT PREP BY G.C. INSTALLED. FLASHING TRIM & ACCESSORIES BY G.C.
- BASE BID: IN LIEU OF REPLACING BASEBOARDS RADIATION, REMOVE COVERS AND INSTALL NEW EZ SNAP REPLACEMENT COVERS ON EXISTING BACKPLATES
- ALT. #A6: REMOVE EXISTING BASEBOARD RADIATION AS SHOWN ON PLANS AND INSTALL NEW SLANT FIN OR APPROVED EQUAL, BASEBOARD RADIATION WITH BEMO CONTROLS TO MATCH EXISTING CONTROLS.
- ALT. #A7 REMOVE EXISTING BEMO AND HONEYWELL CONTROL VALVES INSTALLED ON WALL MOUNTED AND BASEBOARD RADIATION. REPLACE ALL CONTROL VALVES WITH TACO CONTROL VALVES TO MATCH 1ST FLOOR RADIATION CONTROL VALVES.
- BASE BID: WALL MOUNTED FIN TUBE RADIATION AND CONVECTORS; REMOVE COVERS, THOROUGHLY CLEAN BACKPLATE HANGERS AND FIN TUBE ELEMENTS. LIGHTLY SAND COVERS, SPRAY HIGH TEMPERATURE PRIMER. FRONT AND BACK AND SPRAY WITH EGG SHELL OR SEMI GLOSS FINISH COLOR AS SELECTED BY ARCHITECT.

04.16.2020 - NO ALTERNATES - ALL WORK = BASE BID, TYPICAL

2/27/2020 1:25:08 PM  
C:\Users\mrobinson\OneDrive\Documents\Rescue Mission\_Phase 2\_Architecture\_rosehanahy

SECOND FLOOR PLAN  
SCALE: 1/8" = 1'-0"



2/27/2020 1:25:09 PM C:\Users\rosentha\OneDrive\Documents\Rescue Mission\_Phase 2\_Architecture\_rosehanth

**ELEVATOR SHAFTS WORK:**

1. Remove all existing work interfering with proposed. Prep as required for installation of new work. Review with Architect any questionable items.
2. Field verify all dimensions. Report discrepancies to architect.
3. Coordinate all work with Elevator Installer and mfr instructions.
4. The elevator shaft extension, which we understand to be on the order of (5) feet high, shall be constructed of 8" CMU reinforced with #5 verticals @ 2'-8" o.c. full height. Vertical bars shall extend 2'-0" into the existing CMU shaft with all new and existing CMU cells filled solid at vertical reinforcing. There shall be a continuous bond beam with 2-#5 all around the periphery of the top of the shaft.
5. The roof of the shaft shall be 3" x 16 gauge galvanized Type N deep rib metal deck spanning in the 8'-11" direction. Metal deck shall be anchored to a 3/8" x 4" wide plate which shall be anchored to the bond beam in item 1 above with 5/8" diameter x 8" long welded anchors @ 2'-8" o.c. all around the periphery of the shaft.
6. At the existing guide rail beams to be relocated, grout two courses x 1'-4" long solid below new beam pocket locations and provide solid brick or grout all around beam pocket. Existing bricked in beam pockets to be abandoned shall be patched with grout.
7. At new elevator cab doors to be relocated, provide 2-#5 full height bars at each new jamb and fill solid with grout. At abandoned door locations, provide #5 @ 16" o.c. full height and fill reinforced cells solid with grout. New door lintels shall be (2) L 6 x 3 1/2 x 3/8, long leg vertical, and bear a minimum of 6" onto each jamb.
8. All altered masonry openings shall be properly toothed back to maintain the integrity of the existing elevator shaft.

**CONSTRUCTION NOTES**

- 1 INFILL OPENING FROM REMOVAL OF DOOR OR WINDOW WITH ABUSE RESISTANT GYP. BD. ON BOTH SIDES OF METAL STUD FRAMING - CONSTRUCT TO MATCH THICKNESS OF EXISTING WALL TO REMAIN
- 3 FOLDING PAIR MOVEABLE PARTITION SYSTEM WITH CEILING MOUNTED TRACK - CENTER UNDER EXISTING STRUCTURAL BEAM ABOVE
- 3A - VERIFY DIMENSIONS OF PARTITIONS ON EITHER SIDE OF STACK WITH MANUFACTURER'S SHOP DRAWINGS
- 17 NEW REPLACEMENT WINDOW WITH INSULATED GLASS & THERMALLY BROKEN ALUMINUM FRAME WITH FIXED DOUBLE-HUNG LOOK UNITS AND/OR PICTURE UNITS TO MATCH APPEARANCE AND DIMENSIONS OF EXISTING WINDOW
- 21 NEW WALL MOUNTED PAINTED STEEL PIPE HANDRAIL - SEE TYPICAL WALL MOUNTED HANDRAIL DETAIL C1/A-102
- 23 MOTION ACTIVATED TRIP SENSOR W/ AUDIBLE & VISUAL ALARM AT RECEPTION DESK
- 24 NEW A.D.A. DRINKING FOUNTAIN WITH CHILLER & BOTTLE FILLER
- 25 POUR LIGHT WEIGHT CONCRETE OVER EXISTING DECK AND FINISH FLUSH TO MATCH EXISTING SUBSTRATE LEVEL
- 27 NEW TRACTION ELEVATOR CABS, CORRDINATE MASONRY AT FRONT HOISTWAY WALL W/ ELEVATOR MANUFACTURER. REFER TO SPECIFICATIONS.
- 28 NEW SCREEN AND OR FENCE ENCLOSURE FOR PLAYScape AREA.
- 29 ALTERNATE # A1 - COMPLETE BUILD OUT OF 2ND FLOOR TERRACE. SHELL ONLY SEE BID SPECS FOR PHASING NOTES
- 30 ALTERNATE # A2 - COMPLETE BUILD OUT OF 3RD FLOOR TERRACE
- 31 ALTERNATE # A3 - COMPLETE BUILD OUT OF 4TH FLOOR TERRACE
- 32 COMPLETE CONSTRUCTION OF THE 5TH FLOOR CHAPEL AND CORRIDORS IN ACCORDANCE WITH PLANS AND SPECIFICATIONS.
- 33 NEW SLAB INFILL CORRDINATE WITH STRUCTURAL DETAIL.
- 34 FLOOR DRAIN. SEE SPECIFICATIONS. COORDINATE WITH PLUMBING DRAWINGS
- 35 NEW TOILETS TO BE FLOOR MOUNTED AND OR ADA WHERE REQ'D SEE PLUMBING PLANS
- 36 NEW TOILETS TO BE FLOOR MOUNTED AND OR ADA WHERE REQ'D SEE PLUMBING PLANS



**ANTINOZZI ASSOCIATES**  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002  
  
301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com


These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect

CERTIFICATION:

**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
**04.16.2020 - CM BID**

**REVISIONS**

NO.	DATE	DESCRIPTION
1	5.22.2019	Ceiling Symbol Legend
00	04.16.20	CM BID

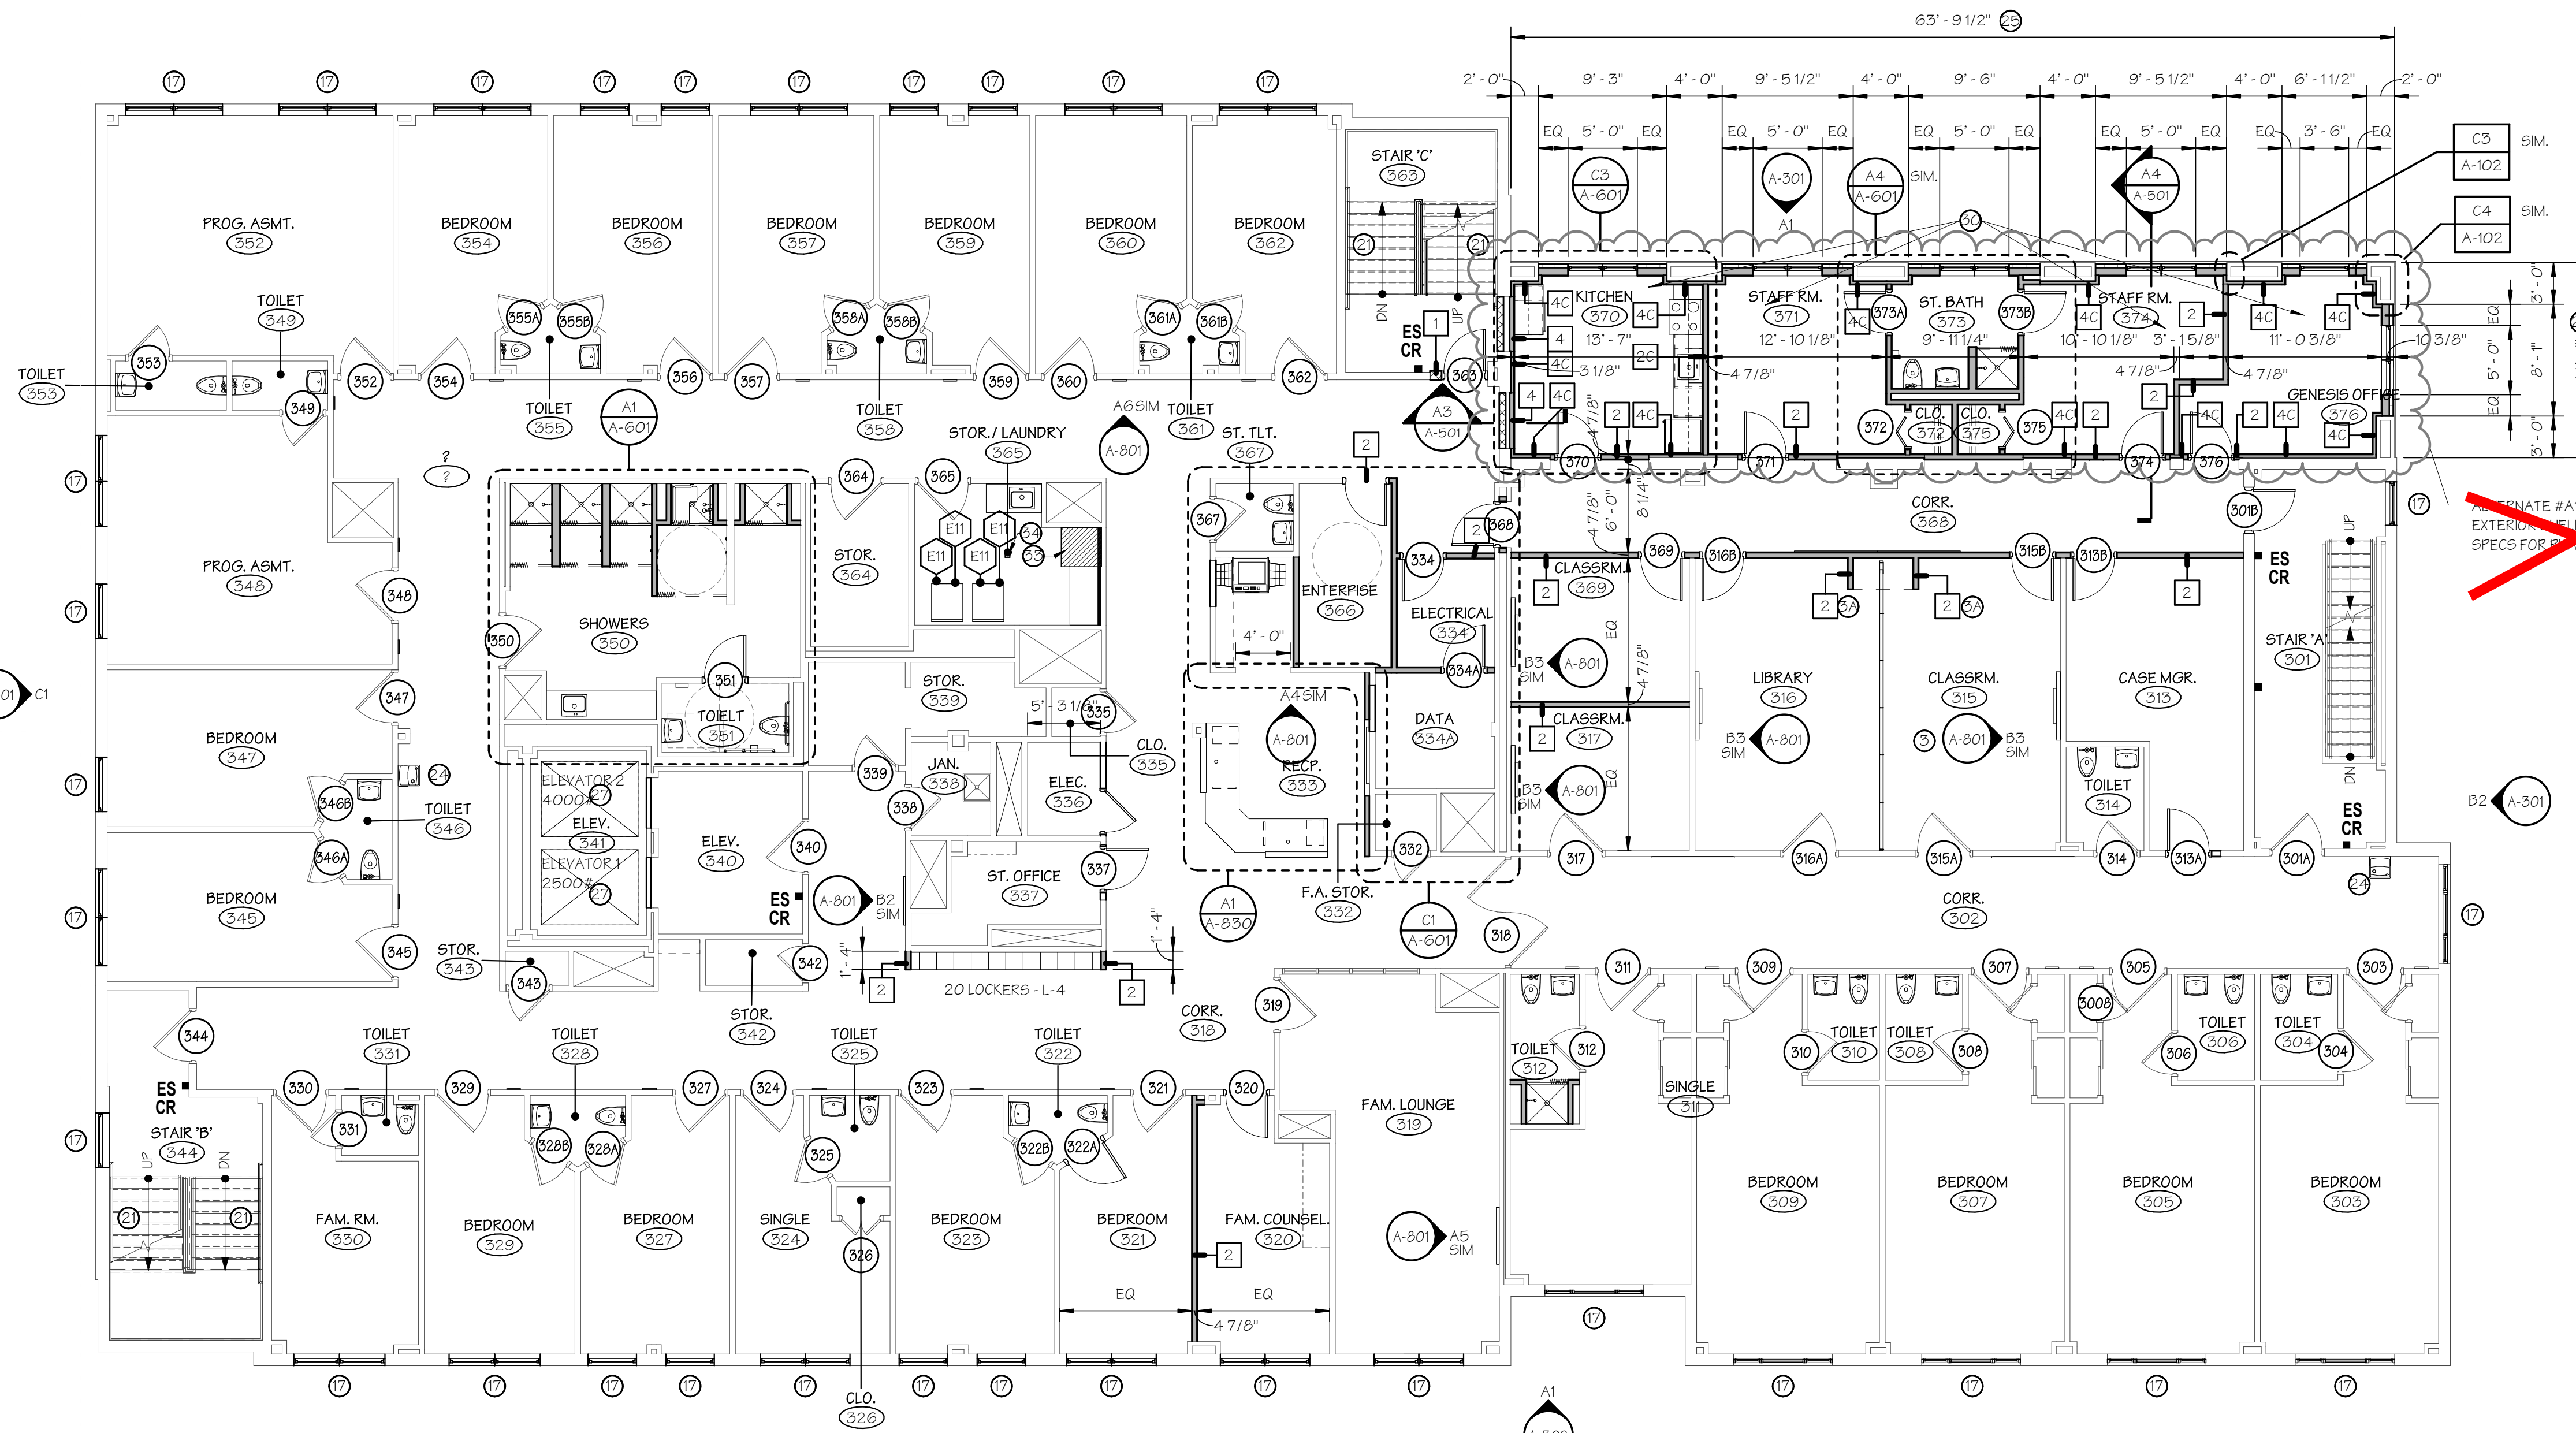


**PHASE II ALTERNATE LIST**

- ~~BASE BID: FLOORS 2-4: ENCLOSE TERRACES WITH NO INTERIOR FINISHES. PROVIDE BASIC MEP ROUGH-IN SO SPACE CAN BE COMPLETED AT A LATER DATE WITH MINIMAL DISRUPTION OF ACTIVITIES AND USAGE OF ADJACENT SPACES. CONSIDER INSTALL OF METAL STUDS IN THIS PHASE TO MIN. NOISE TO ADJACENT SPACES IN FUTURE)~~
- ~~ALT. #A1 (NOTE 29) - COMPLETE BUILD OUT OF 2ND FLOOR TERRACE  
ALT. #A2 (NOTE 30) - COMPLETE BUILD OUT OF 3RD FLOOR TERRACE  
ALT. #A3 (NOTE 31) - COMPLETE BUILD OUT OF 4TH FLOOR TERRACE~~
- ~~BASE BID: FIFTH FLOOR: NO INTERIOR FINISHES. COMPLETE EXTERIOR CONSTRUCTION, ROUGH IN PLUMBING, INSTALL ROOF TOP HVAC UNIT IN ACCORDANCE WITH SPECIFICATIONS, INSTALL DUCTWORK THROUGH ROOF AND TERMINATE, INSTALL GAS SERVICE TO UNIT, INSTALL ELECTRICAL SERVICE, INSTALL CONTROLS, INSTALL NEW SPRINKLERS, PROVIDE BASIC ELECTRICAL ROUGH-IN FOR BALANCE OF THE SPACE~~
- ~~ALT. #A4 - (NOTE 32) - COMPLETE CONSTRUCTION OF THE 5TH FLOOR CHAPEL AND CORRIDORS IN ACCORDANCE WITH PLANS AND SPECIFICATIONS.~~
- ~~BASE BID: REMOVE EXISTING WINDOW AND PREP ROUGH OPENING FOR NEW WAUSAU GLAZED UNIT PREP BY G.C. INSTALLED. FLASHING TRIM & ACCESSORIES BY G.C.~~
- ~~ADD ALT. #A5 - REMOVE EXISTING WINDOW AND PREP ROUGH OPENING FOR NEW ANDERSEN WINDOW UNIT PREP BY G.C. INSTALLED. FLASHING TRIM & ACCESSORIES BY G.C.~~
- ~~BASE BID: IN LIEU OF REPLACING BASEBOARD RADIATION, REMOVE COVERS AND INSTALL NEW "Z SNAP" REPLACEMENT COVERS ON EXISTING BACKPLATES~~
- ~~ALT. #A6: REMOVE EXISTING BASEBOARD RADIATION AS SHOWN ON PLANS AND INSTALL NEW SLANT /FIN OR APPROVED EQUAL, BASEBOARD RADIATION WITH BELMONT CONTROLS TO MATCH EXISTING CONTROL VALVES~~
- ~~ALT. #A7: REMOVE EXISTING BELMONT AND HONEYWELL CONTROL VALVES INSTALLED ON WALL MOUNTED AND BASEBOARD RADIATION. REPLACE ALL CONTROL VALVES WITH TACO CONTROL VALVES TO MATCH EXISTING FLOOR RADIATION CONTROL VALVES.~~
- ~~BASE BID: WALL MOUNTED FIN TUBE RADIATION AND CONVECTORS. REMOVE COVERS, THOROUGHLY CLEAN BACKPLATE HANGERS AND FIN TUBE ELEMENTS. LIGHTLY SAND COVERS, SPRAY HIGH TEMPERATURE PRIMER. FRONT AND BACK AND SPRAY WITH EGGSHELL OR SEMI GLOSS FINISH COLOR AS SELECTED BY ARCHITECT.~~

**04.16.2020 - NO ALTERNATES - ALL WORK = BASE BID, TYPICAL**

**THIRD FLOOR PLAN**

SCALE: 1/8" = 1'-0"



PROJECT NORTH

**JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION**  
  
**PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION**  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
THIRD FLOOR PLAN

SCALE: As indicated  
DRAWN BY: KWG  
REVIEWED BY: DCF

DRAWING NO.

**A-103**

04.16.2020 - CM BID

DATE: 31 JANUARY 2020  
JOB NUMBER: 18052





These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:

**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
**04.16.2020 - CM BID**

REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

**JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION**  
**PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION**  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
FIFTH FLOOR PLAN

SCALE: As indicated  
DRAWN BY: KWG  
REVIEWED BY: DCF

DRAWING NO.

**A-105**

04.16.2020 - CM BID

DATE: 31 JANUARY 2020  
JOB NUMBER: 18052

**ELEVATOR SHAFTS WORK:**

1. Remove all existing work interfering with proposed. Prep as required for installation of new work. Review with Architect any questionable items.
2. Field verify all dimensions. Report discrepancies to architect.
3. Coordinate all work with Elevator Installer and mfr instructions.
4. The elevator shaft extension, which we understand to be on the order of (5) feet high, shall be constructed of 8" CMU reinforced with #5 verticals @ 2'-8" o.c. full height. Vertical bars shall extend 2'-0" into the existing CMU shaft with all new and existing CMU cells filled solid at vertical reinforcing. There shall be a continuous bond beam with 2-#5 all around the periphery of the top of the shaft.
5. The roof of the shaft shall be 3" x 16 gage galvanized Type N deep rib metal deck spanning in the 8'-11" direction. Metal deck shall be anchored to a 3/8" x 4" wide plate which shall be anchored to the bond beam in item 1 above with 5/8" diameter x 8" long welded anchors @ 2'-8" o.c. all around the periphery of the shaft.
6. At the existing guide rail beams to be relocated, grout two courses x 1'-4" long solid below new beam pocket locations and provide solid brick or grout all around beam pocket. Existing bricked in beam pockets to be abandoned shall be patched with grout.
7. At new elevator cab doors to be relocated, provide 2-#5 full height bars at each new jamb and fill solid with grout. At abandoned door locations, provide #5 @ 16" o.c. full height and fill reinforced cells solid with grout. New door lintels shall be (2) L 6 x 3 1/2 x 3/8, long leg vertical, and bear a minimum of 6" onto each jamb.
8. All altered masonry openings shall be properly toothed back to maintain the integrity of the existing elevator shaft.

**CONSTRUCTION NOTES**

- 1 INFILL OPENING FROM REMOVAL OF DOOR OR WINDOW WITH ABUSE RESISTANT GYP. BD. ON BOTH SIDES OF METAL STUD FRAMING - CONSTRUCT TO MATCH THICKNESS OF EXISTING WALL TO REMAIN
- 3 FOLDING PAIR MOVEABLE PARTITION SYSTEM WITH CEILING MOUNTED TRACK - CENTER UNDER EXISTING STRUCTURAL BEAM ABOVE
- 3A - VERIFY DIMENSIONS OF PARTITIONS ON EITHER SIDE OF STACK WITH MANUFACTURER'S SHOP DRAWINGS
- 17 NEW REPLACEMENT WINDOW WITH INSULATED GLASS & THERMALLY BROKEN ALUMINUM FRAME WITH FIXED DOUBLE-HUNG LOOK UNITS AND/OR PICTURE UNITS TO MATCH APPEARANCE AND DIMENSIONS OF EXISTING WINDOW
- 21 NEW WALL MOUNTED PAINTED STEEL PIPE HANDRAIL - SEE TYPICAL WALL MOUNTED HANDRAIL DETAIL C1/A-102
- 23 MOTION ACTIVATED TRIP SENSOR W/ AUDIBLE & VISUAL ALARM AT RECEPTION DESK
- 24 NEW A.D.A. DRINKING FOUNTAIN WITH CHILLER & BOTTLE FILLER
- 25 POUR LIGHT WEIGHT CONCRETE OVER EXISTING DECK AND FINISH FLUSH TO MATCH EXISTING SUBSTRATE LEVEL
- 27 NEW TRACTION ELEVATOR CABS. CORRDINATE MASONRY AT FRONT HOISTWAY WALL W/ ELEVATOR MANUFACTURER. REFER TO SPECIFICATIONS.
- 28 NEW SCREEN AND OR FENCE ENCLOSURE FOR PLAYScape AREA.
- 29 ALTERNATE # A1 - COMPLETE BUILD OUT OF 2ND FLOOR TERRACE. SHELL ONLY SEE BID SPECS FOR PHASING NOTES
- 30 ALTERNATE # A2 - COMPLETE BUILD OUT OF 3RD FLOOR TERRACE
- 31 ALTERNATE # A3 - COMPLETE BUILD OUT OF 4TH FLOOR TERRACE
- 32 COMPLETE CONSTRUCTION OF THE 5TH FLOOR CHAPEL AND CORRIDORS IN ACCORDANCE WITH PLANS AND SPECIFICATIONS.
- 33 NEW SLAB INFILL.CORRDINATE WITH STRUCTURAL DETAIL.
- 34 FLOOR DRAIN. SEE SPECIFICATIONS. CORRDINATE WITH PLUMBING DRAWINGS
- 35 NEW TOILETS TO BE FLOOR MOUNTED AND OR ADA WHERE REQ'D SEE PLUMBING PLANS
- 36 NEW TOILETS TO BE FLOOR MOUNTED AND OR ADA WHERE REQ'D SEE PLUMBING PLANS

**PHASE II ALTERNATE LIST**

~~BASE BID: FLOORS 2-4: ENCLOSE TERRACES WITH NO INTERIOR FINISHES. PROVIDE BASIC MEP ROUGH-IN SO SPACE CAN BE COMPLETED AT A LATER DATE WITH MINIMAL DISRUPTION OF ACTIVITIES AND USAGE OF ADJACENT SPACES. CONSIDER INSTALL OF METAL STUDS IN THIS PHASE TO MIN. INTERFERE TO ADJACENT SPACES IN FUTURE)~~

~~ALT. #A1 (NOTE 29) - COMPLETE BUILD OUT OF 2ND FLOOR TERRACE  
ALT. #A2 (NOTE 30) - COMPLETE BUILD OUT OF 3RD FLOOR TERRACE  
ALT. #A3 (NOTE 31) - COMPLETE BUILD OUT OF 4TH FLOOR TERRACE~~

~~BASE BID: FIFTH FLOOR: NO INTERIOR FINISHES. COMPLETE EXTERIOR CONSTRUCTION. ROUGH IN PLUMBING, INSTAOLL ROOF TOP HVAC UNIT IN ACCORDANCE WITH SPECIFICATIONS, INSTALL DUCTWORK THROUGH ROOF AND TERMINATE, INSTALL GAS SERVICE TO UNIT, INSTAL ELECTRICAL SERVICE, INSTALL CONTROLS, INSTALL NEW SPRINKLERS, PROVIDE BASIC ELECTRICAL ROUGH-IN FOR BALANCE OF THE SPACE~~

~~ALT. #A4 - (NOTE 32) - COMPLETE CONSTRUCTION OF THE 5TH FLOOR CHAPEL AND CORRIDORS IN ACCORDANCE WITH PLANS AND SPECIFICATIONS.~~

~~BASE BID: REMOVE EXISTING WINDOW AND PREP ROUGH OPENING FOR NEW WAUSAU GLAZED UNIT PREP BY G.C., INSTALLED, FLASHING TRIM & ACCESSORIES BY G.C.~~

~~ADD ALT. #A5 - REMOVE EXISTING WINDOW AND PREP ROUGH OPENING FOR NEW ANDERSEN WINDOW UNIT PREP BY G.C., INSTALLED, FLASHING TRIM & ACCESSORIES BY G.C.~~


~~BASE BID: IN LIEU OF REPLACING BASEBOARD RADIATION, REMOVE COVERS AND INSTALL NEW "EZ SNAP" REPLACEMENT COVERS ON EXISTING BACKPLATES~~

~~ALT. #A6: REMOVE EXISTING BASEBOARD RADIATION AS SHOWN ON PLANS AND INSTALL NEW SLANT /FIN OR APPROVED EQUAL, BASEBOARD RADIATION WITH BELIMO CONTROLS TO MATCH EXISTING CONTROL~~

~~ALT. #A7: REMOVE EXISTING BELIMO AND HONEYWELL CONTROL VALVES INSTALLED ON WALL MOUNTED AND BASEBOARD RADIATION. REPLACE ALL CONTROL VALVES WITH TACO CONTROL VALVES TO MATCH W/ FLOOR RADIATION CONTROL VALVES.~~


~~BASE BID: WALL MOUNTED FIN TUBE RADIATION AND CONVECTORS. REMOVE COVERS, THOROUGHLY CLEAN BACKPLATE HANGERS AND FIN TUBE ELEMENTS. LIGHTLY SAND COVERS, SPRAY HIGH TEMPERATURE PRIMER FRONT AND BACK AND SPRAY WITH EGG SHELL OR SEMI GLOSS FINISH COLOR AS SELECTED BY ARCHITECT.~~

**04.16.2020 - NO ALTERNATES - ALL WORK = BASE BID, TYPICAL**

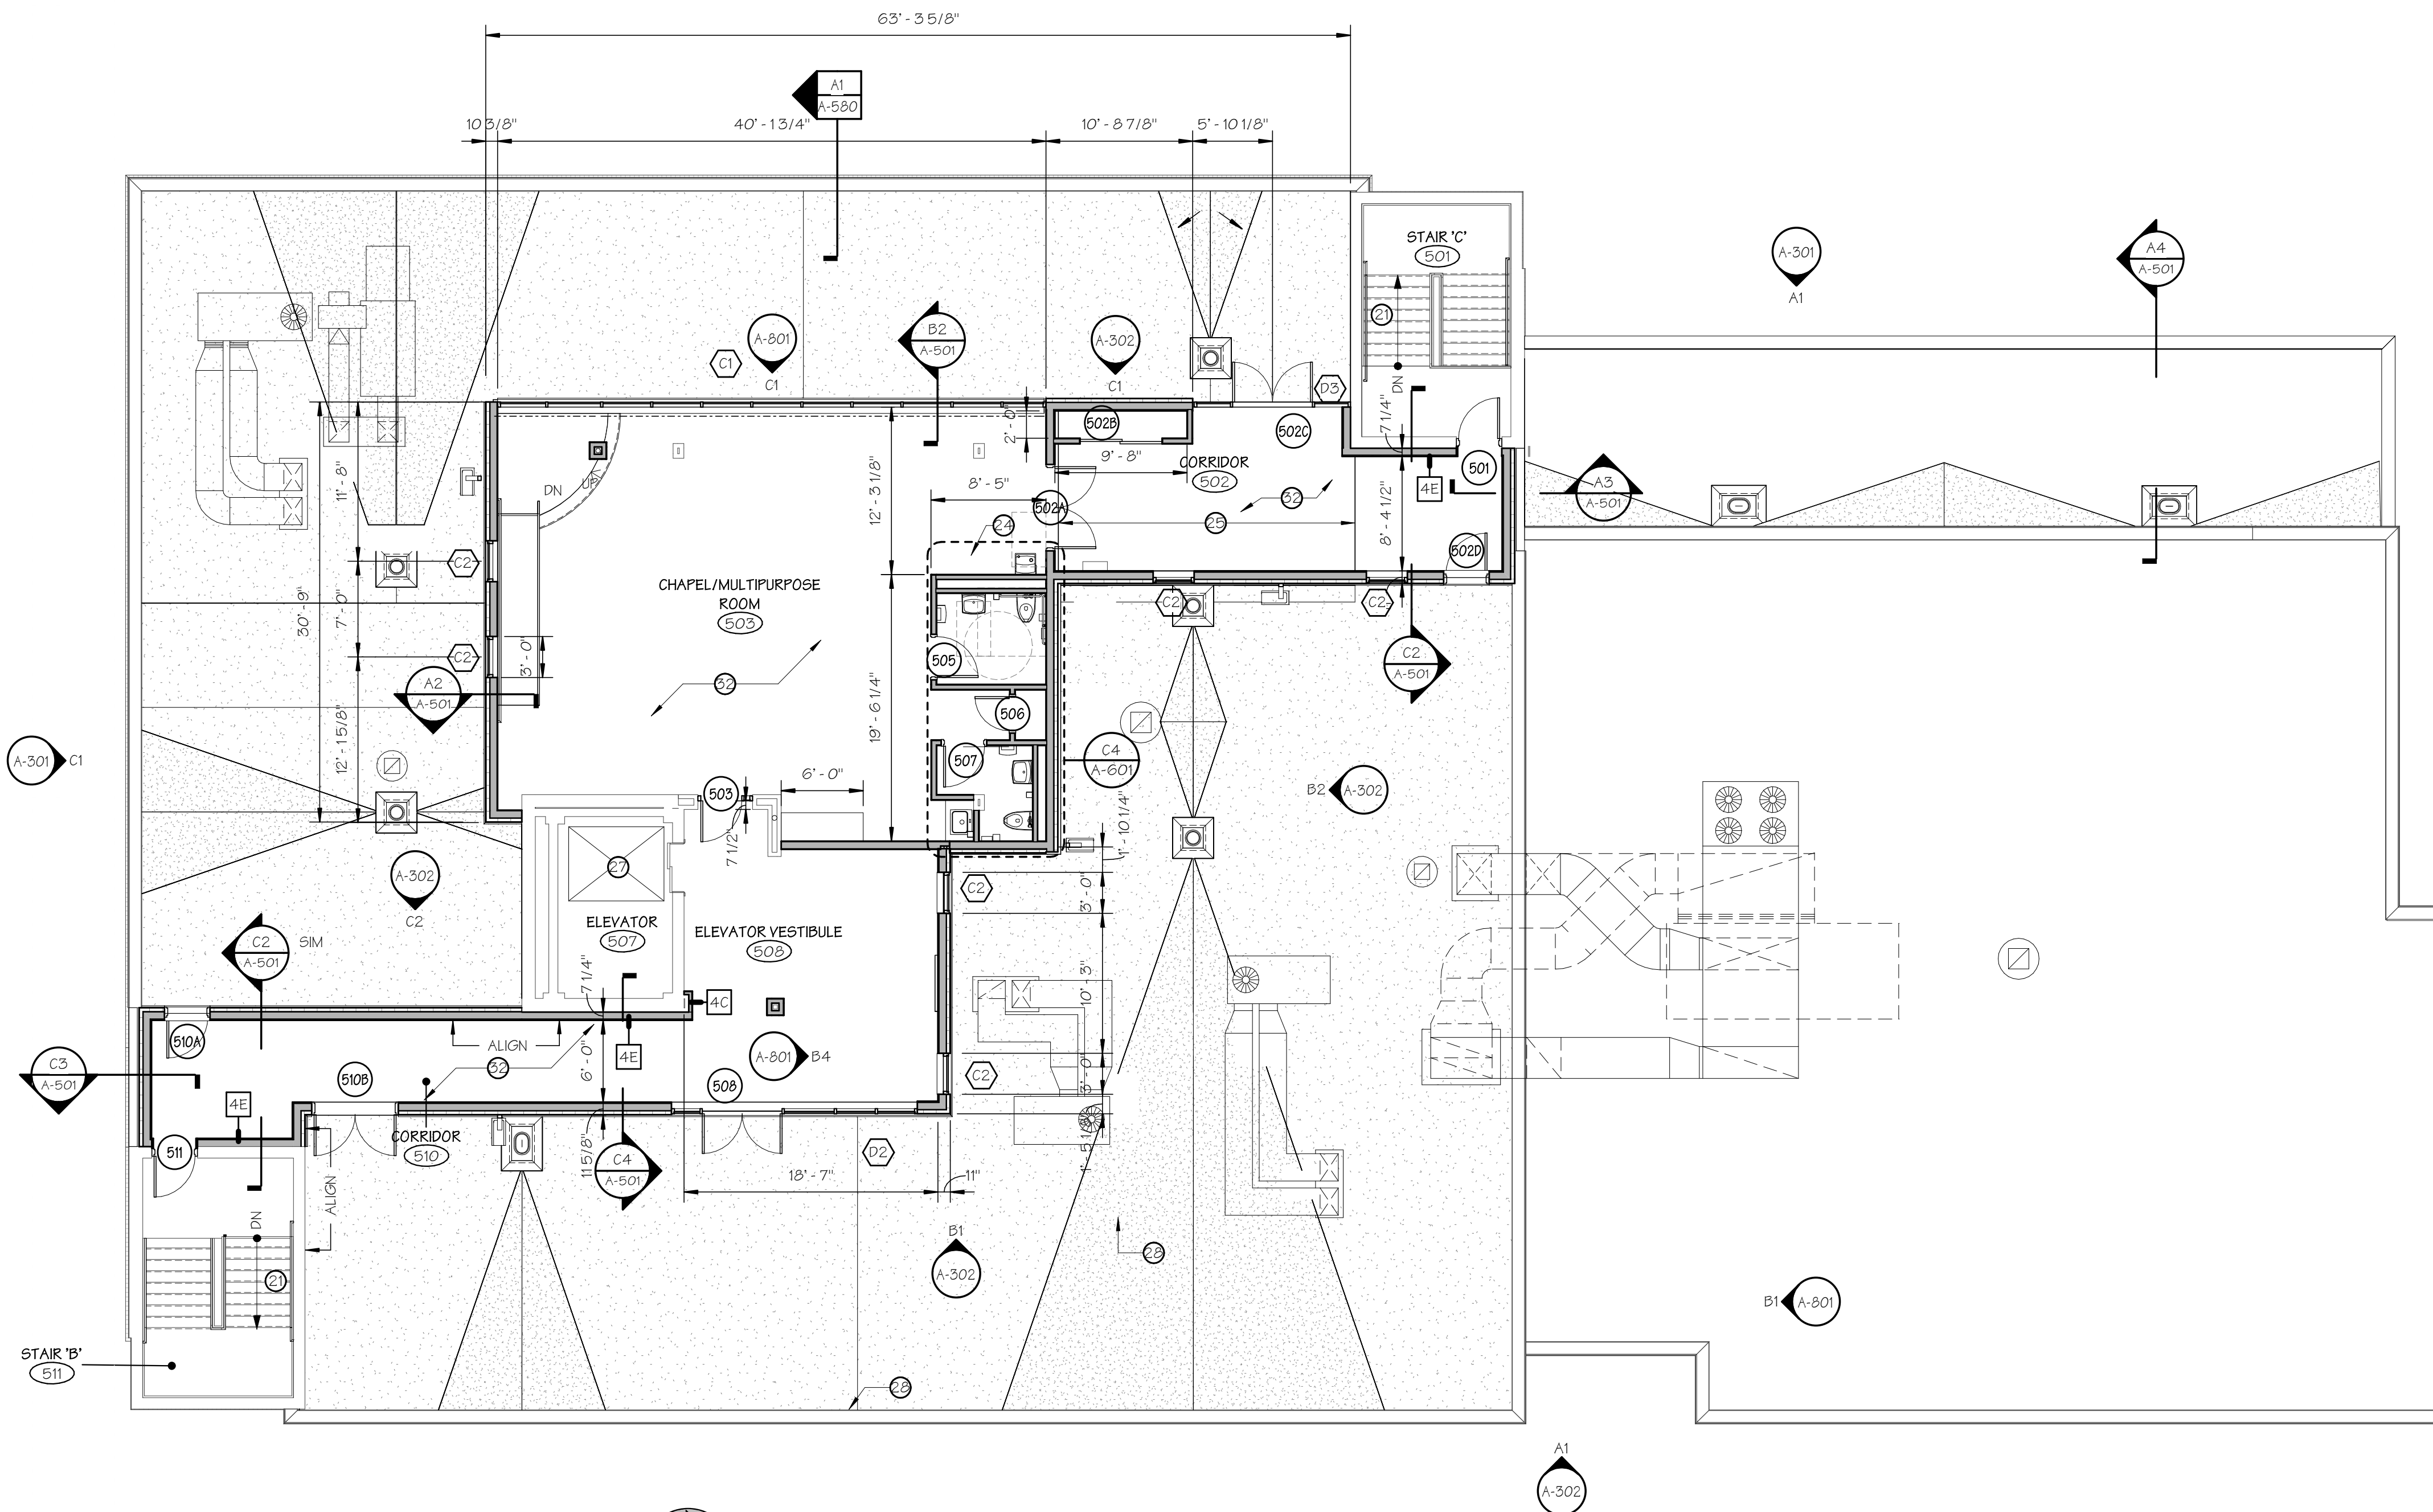

FIFTH FLOOR & ROOF PLAN

SCALE: 1/8" = 1'-0"

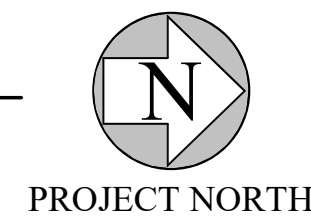



ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:

**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
04.16.2020 - CM BID

REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
ROOF PLAN

SCALE: As indicated  
DRAWN BY: KWG  
REVIEWED BY: DCF

DRAWING NO.

**A-1R1**

04.16.2020 - CM BID

DATE: 31 JANUARY 2020  
JOB NUMBER: 18052

ROOF CONSTRUCTION NOTES


- THROUGH WALL SCUPPER & RAIN LEADER TO ROOF LEVEL BELOW
- RAIN LEADER & PRECAST CONCRETE SPLASH BLOCK
- FLASH NEW ROOFING TO CURBS AND PENETRATIONS AS REQUIRED PER MANUFACTURER'S DETAILS
- EXISTING ROOF OPENING TO BE FILLED IN. INFILL EXISTING ROOF STRUCTURE AS FOLLOWS: PROVIDE STEEL PLATE TO FILL EXISTING OPENING. STEEL PLATE SHALL BE SUPPORTED ON 4 SIDES BY STEEL ANGLES. TACK WELD STEEL PLATE TO NEW SUPPORTING ANGLES. INFILL REMAINING OPENING WITH RIGID INSULATION TO MATCH TOP OF EXISTING ROOF DECK. WHERE OPENINGS ARE LESS THAN 8" SCREW ATTACHED STEEL PLATE TO UNDERSIDE OF EXISTING DECK AND SOLID GROUT FILL TO MATCH EXISTING TOP OF ROOF LEVEL. TYPICAL.
- EXISTING CONDENSOR UNIT TO BE RAISED AND PLACED ON NEW TREATED WOOD SLEEPERS TO MATCH EXISTING
- FLASH EXISTING VENT STACK PER DETAIL THIS SHEET
- CHANGE IN STRUCTURAL DECK ELEVATION - USE TAPERED INSULATION TO PROVIDE A SMOOTH TRANSITION WHERE ABRUPT CHANGES IN ROOFING ELEVATION OCCUR
- NEW SCREEN AND OR FENCE ENCLOSURE FOR PLAYSCAPE AREA
- ALL NEW ROOF DRAIN SUMP WITH OVERFLOW DRAIN SHALL HAVE HEAT TAPE AT ROOF DRAINS. TYPICAL
- EXISTING ROOF OPENING TO BE FILLED IN. INFILL EXISTING ROOF STRUCTURE AS FOLLOWS: PROVIDE STEEL PLATE TO FILL EXISTING OPENING. STEEL PLATE SHALL BE SUPPORTED ON 4 SIDES BY STEEL ANGLES. TACK WELD STEEL PLATE TO NEW SUPPORTING ANGLES. INFILL REMAINING OPENING WITH RIGID INSULATION TO MATCH TOP OF EXISTING ROOF DECK. WHERE OPENINGS ARE LESS THAN 8" SCREW ATTACHED STEEL PLATE TO UNDERSIDE OF EXISTING DECK AND SOLID GROUT FILL TO MATCH EXISTING TOP OF ROOF LEVEL. TYPICAL. SEE DETAIL 54/5550

ROOFING SCHEDULE


- RF-1 FULLY ADHERED E.P.D.M. MEMBRANE ROOF ASSEMBLY ON NEW PITCHED STRUCTURAL METAL DECK
- 1/2" THICK HIGH DENSITY FOAM PROTECTION BOARD
  - (2) CONTINUOUS LAYERS OF 3" RIGID INSULATION
  - FULLY ADHERED AIR & VAPOR BARRIER
  - 1/2" FIBERGLASS FACED GYPSUM COVER BOARD
- RF-2 FULLY ADHERED E.P.D.M. MEMBRANE ROOF ASSEMBLY ON EXISTING LEVEL STRUCTURAL CONCRETE DECK
- 1/2" THICK HIGH DENSITY FOAM PROTECTION BOARD
  - 1/4" PER FOOT TAPERED RIGID INSULATION
  - (2) CONTINUOUS LAYERS OF 3" RIGID INSULATION
  - FULLY ADHERED AIR & VAPOR BARRIER

ROOF GRAPHICS LEGEND


- ROOF DRAIN SUMP WITH OVERFLOW DRAIN. SEE PLUMBING DRAWINGS & SPECIFICATIONS FOR PRODUCT INFORMATION.
- ROOF DRAIN SUMP. SEE PLUMBING DRAWINGS & SPECS. FOR PRODUCT INFORMATION.
- ROOF DRAIN SUMP TO THROUGH WALL SCUPPER DRAIN, WITH CONDUCTOR HEAD AND DOWNSPOUT.
- B.O.M.D. BOTTOM OF METAL DECK
- L.P. ROOF LOW POINT
- H.P. ROOF HIGH POINT
- TAPERED INSULATION CRICKET AT 1/2" PER FOOT
- 1/4" FT DIRECTION OF TAPERED INSULATION
- TAPERED INSULATION AT 1/2" PER FOOT
- DIRECTION OF STRUCTURAL SLOPE.
- ROOF TOP UNIT. SEE MECHANICAL DRAWINGS.
- EXHAUST FAN. SEE MECHANICAL DRAWINGS FOR SIZE AND LOCATIONS.
- WALK PADS

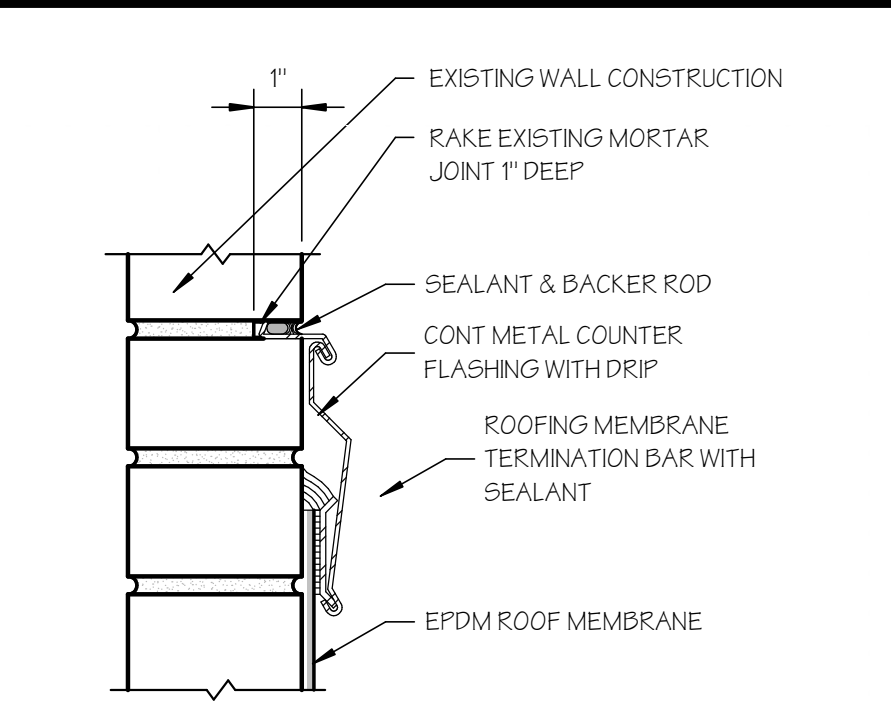


C4 COUNTERFLASHING DETAIL  
SCALE: 3" = 1'-0"

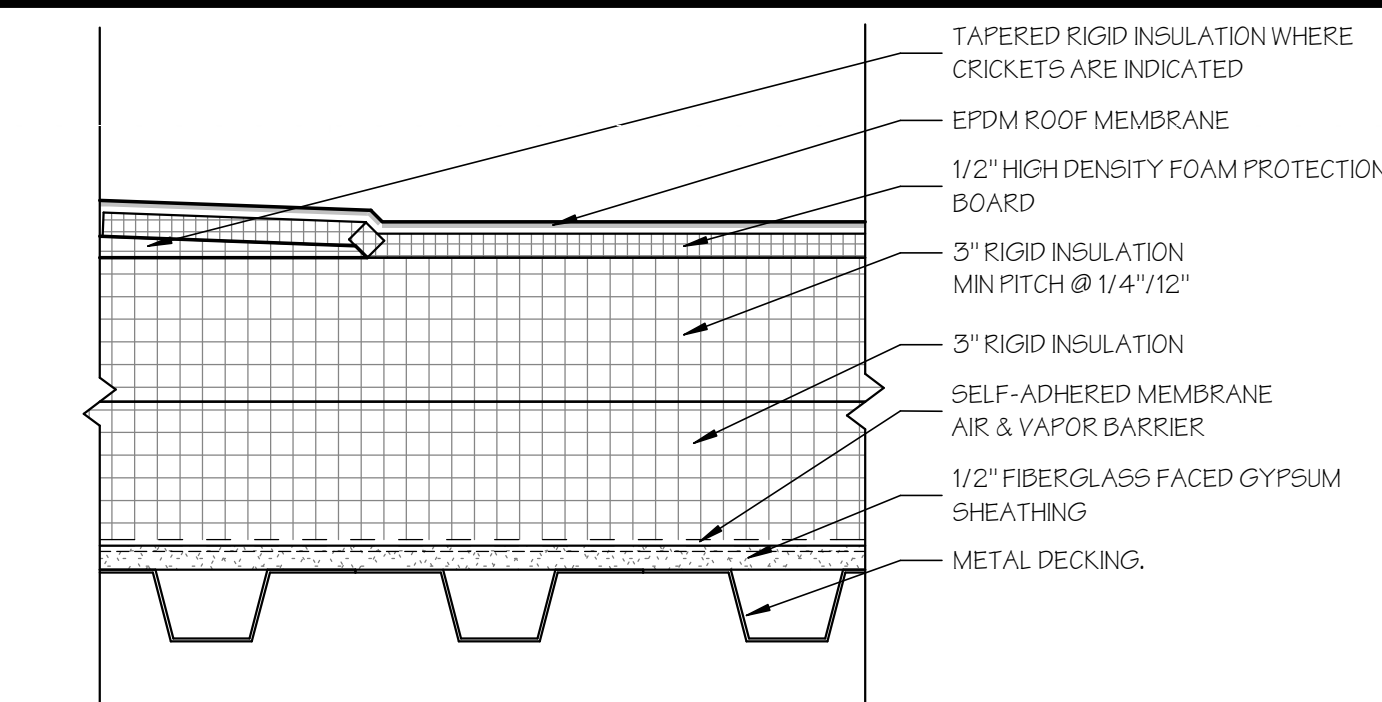


C3 ROOF TYPE RF-1 ASSEMBLY  
SCALE: 3" = 1'-0"

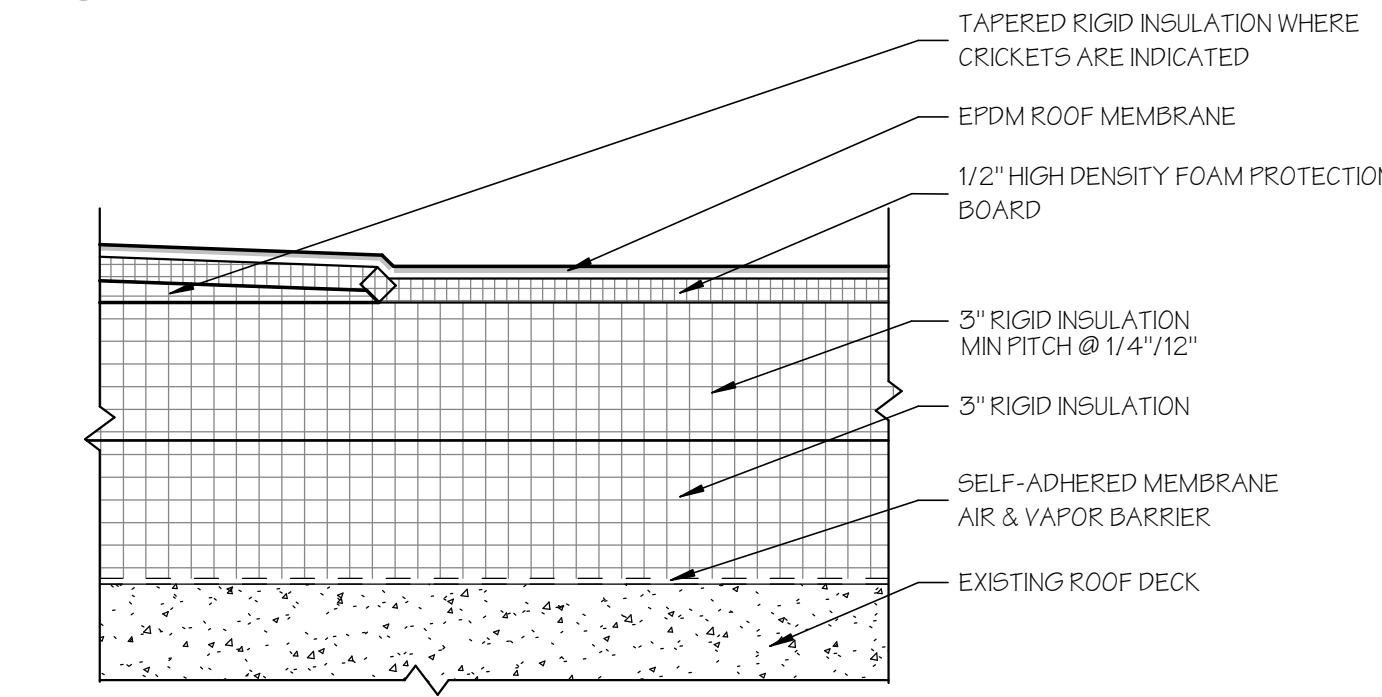


B3 ROOF TYPE RF-2 ASSEMBLY  
SCALE: 3" = 1'-0"

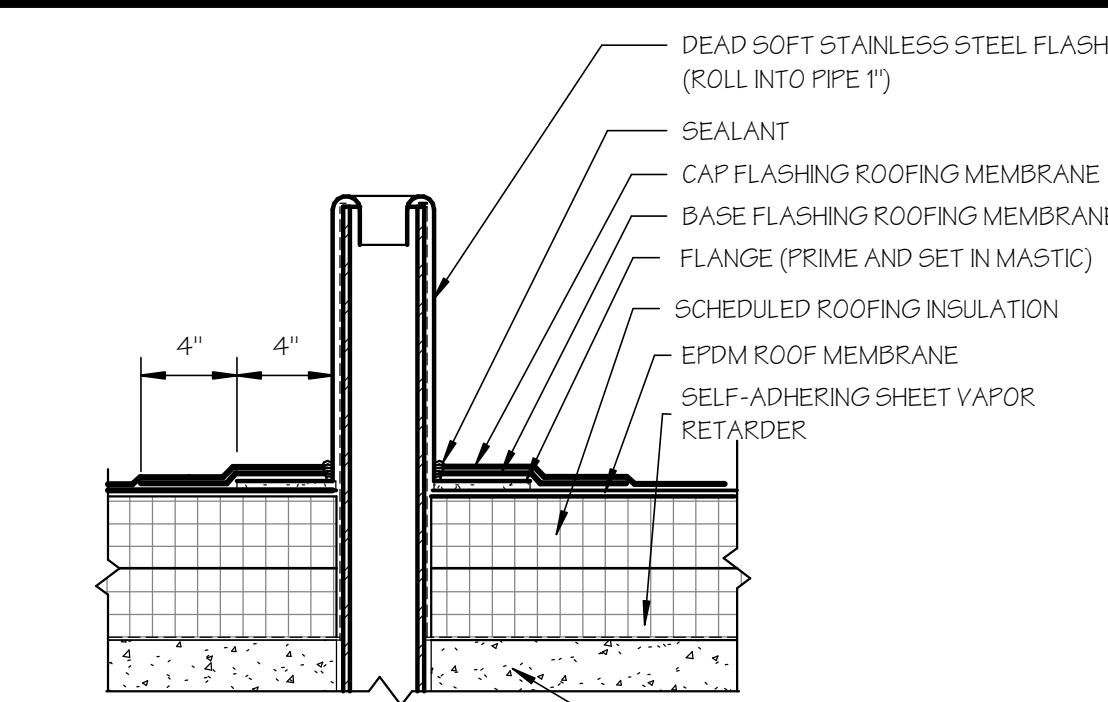


C2 VENT STACK DETAIL  
SCALE: 1 1/2" = 1'-0"

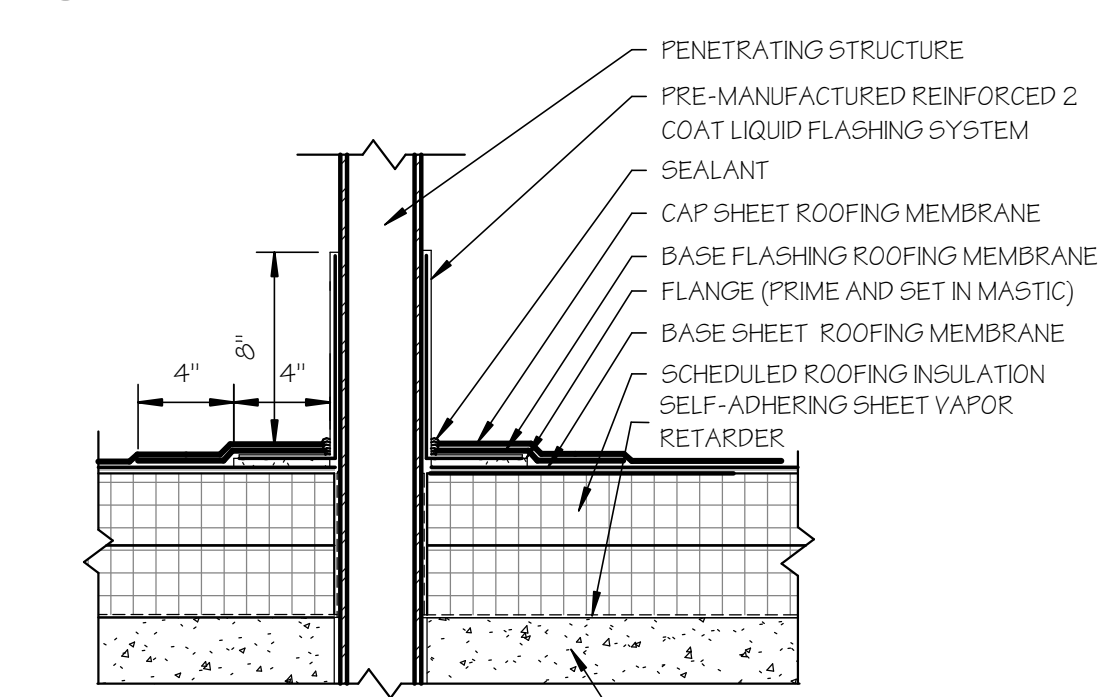


B2 PENETRATION DETAIL  
SCALE: 1 1/2" = 1'-0"

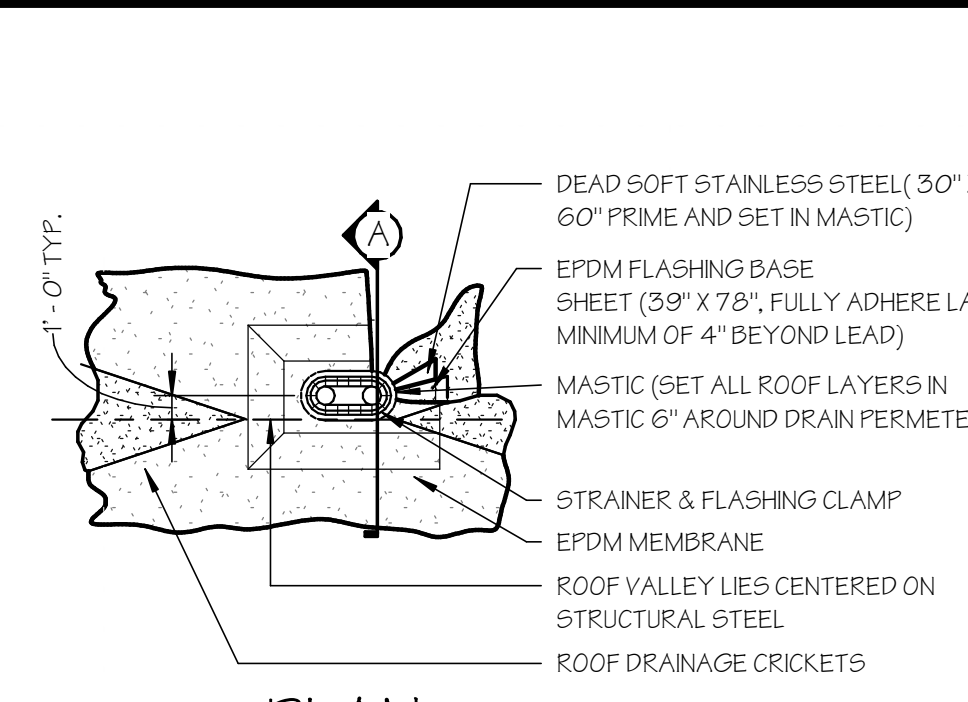

B1 TYPICAL ROOF DRAIN DETAIL  
SCALE: 1 1/2" = 1'-0"

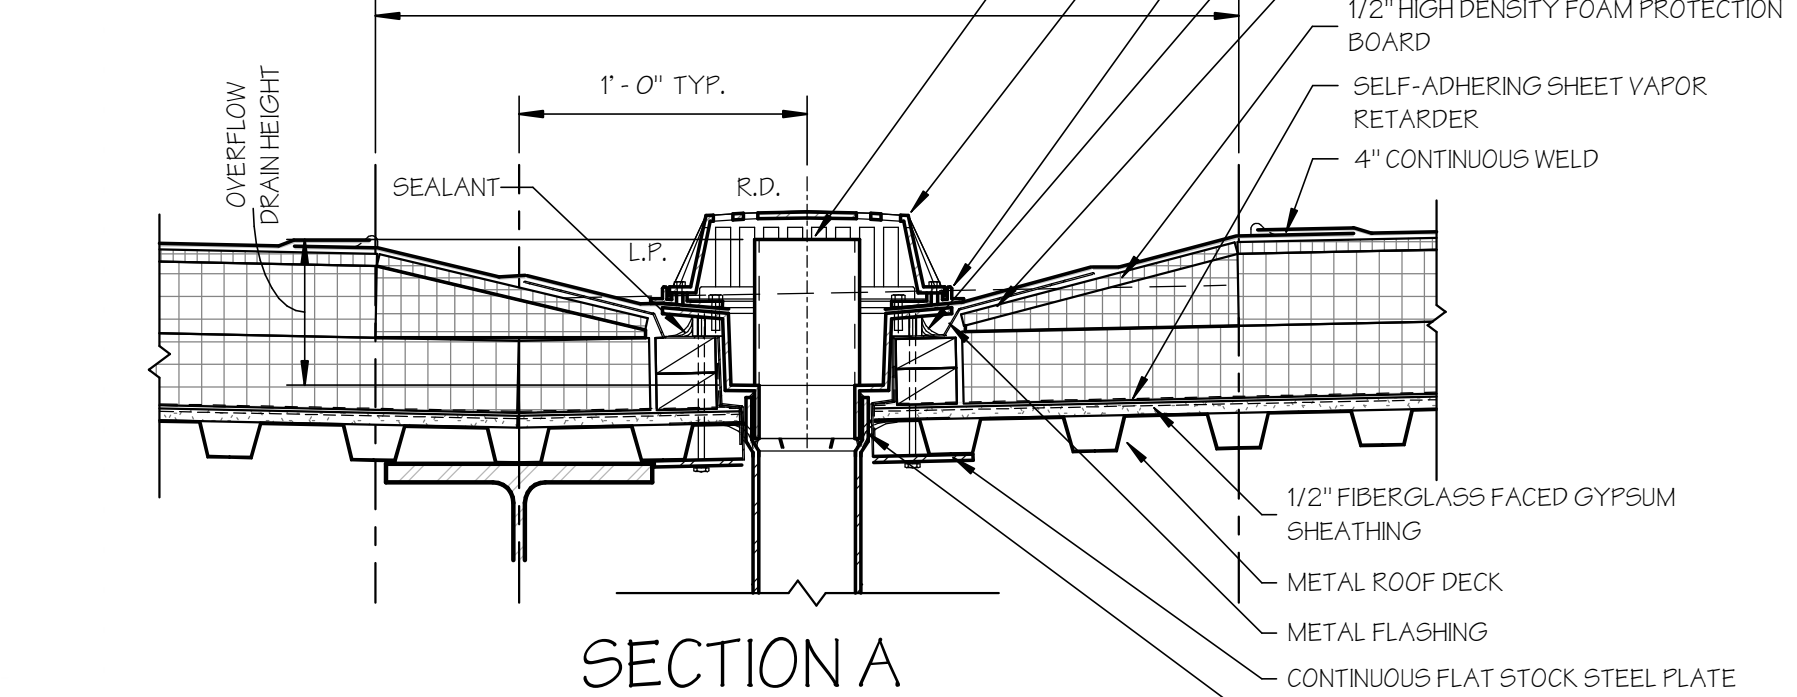

B1 TYPICAL ROOF DRAIN DETAIL  
SCALE: 1 1/2" = 1'-0"

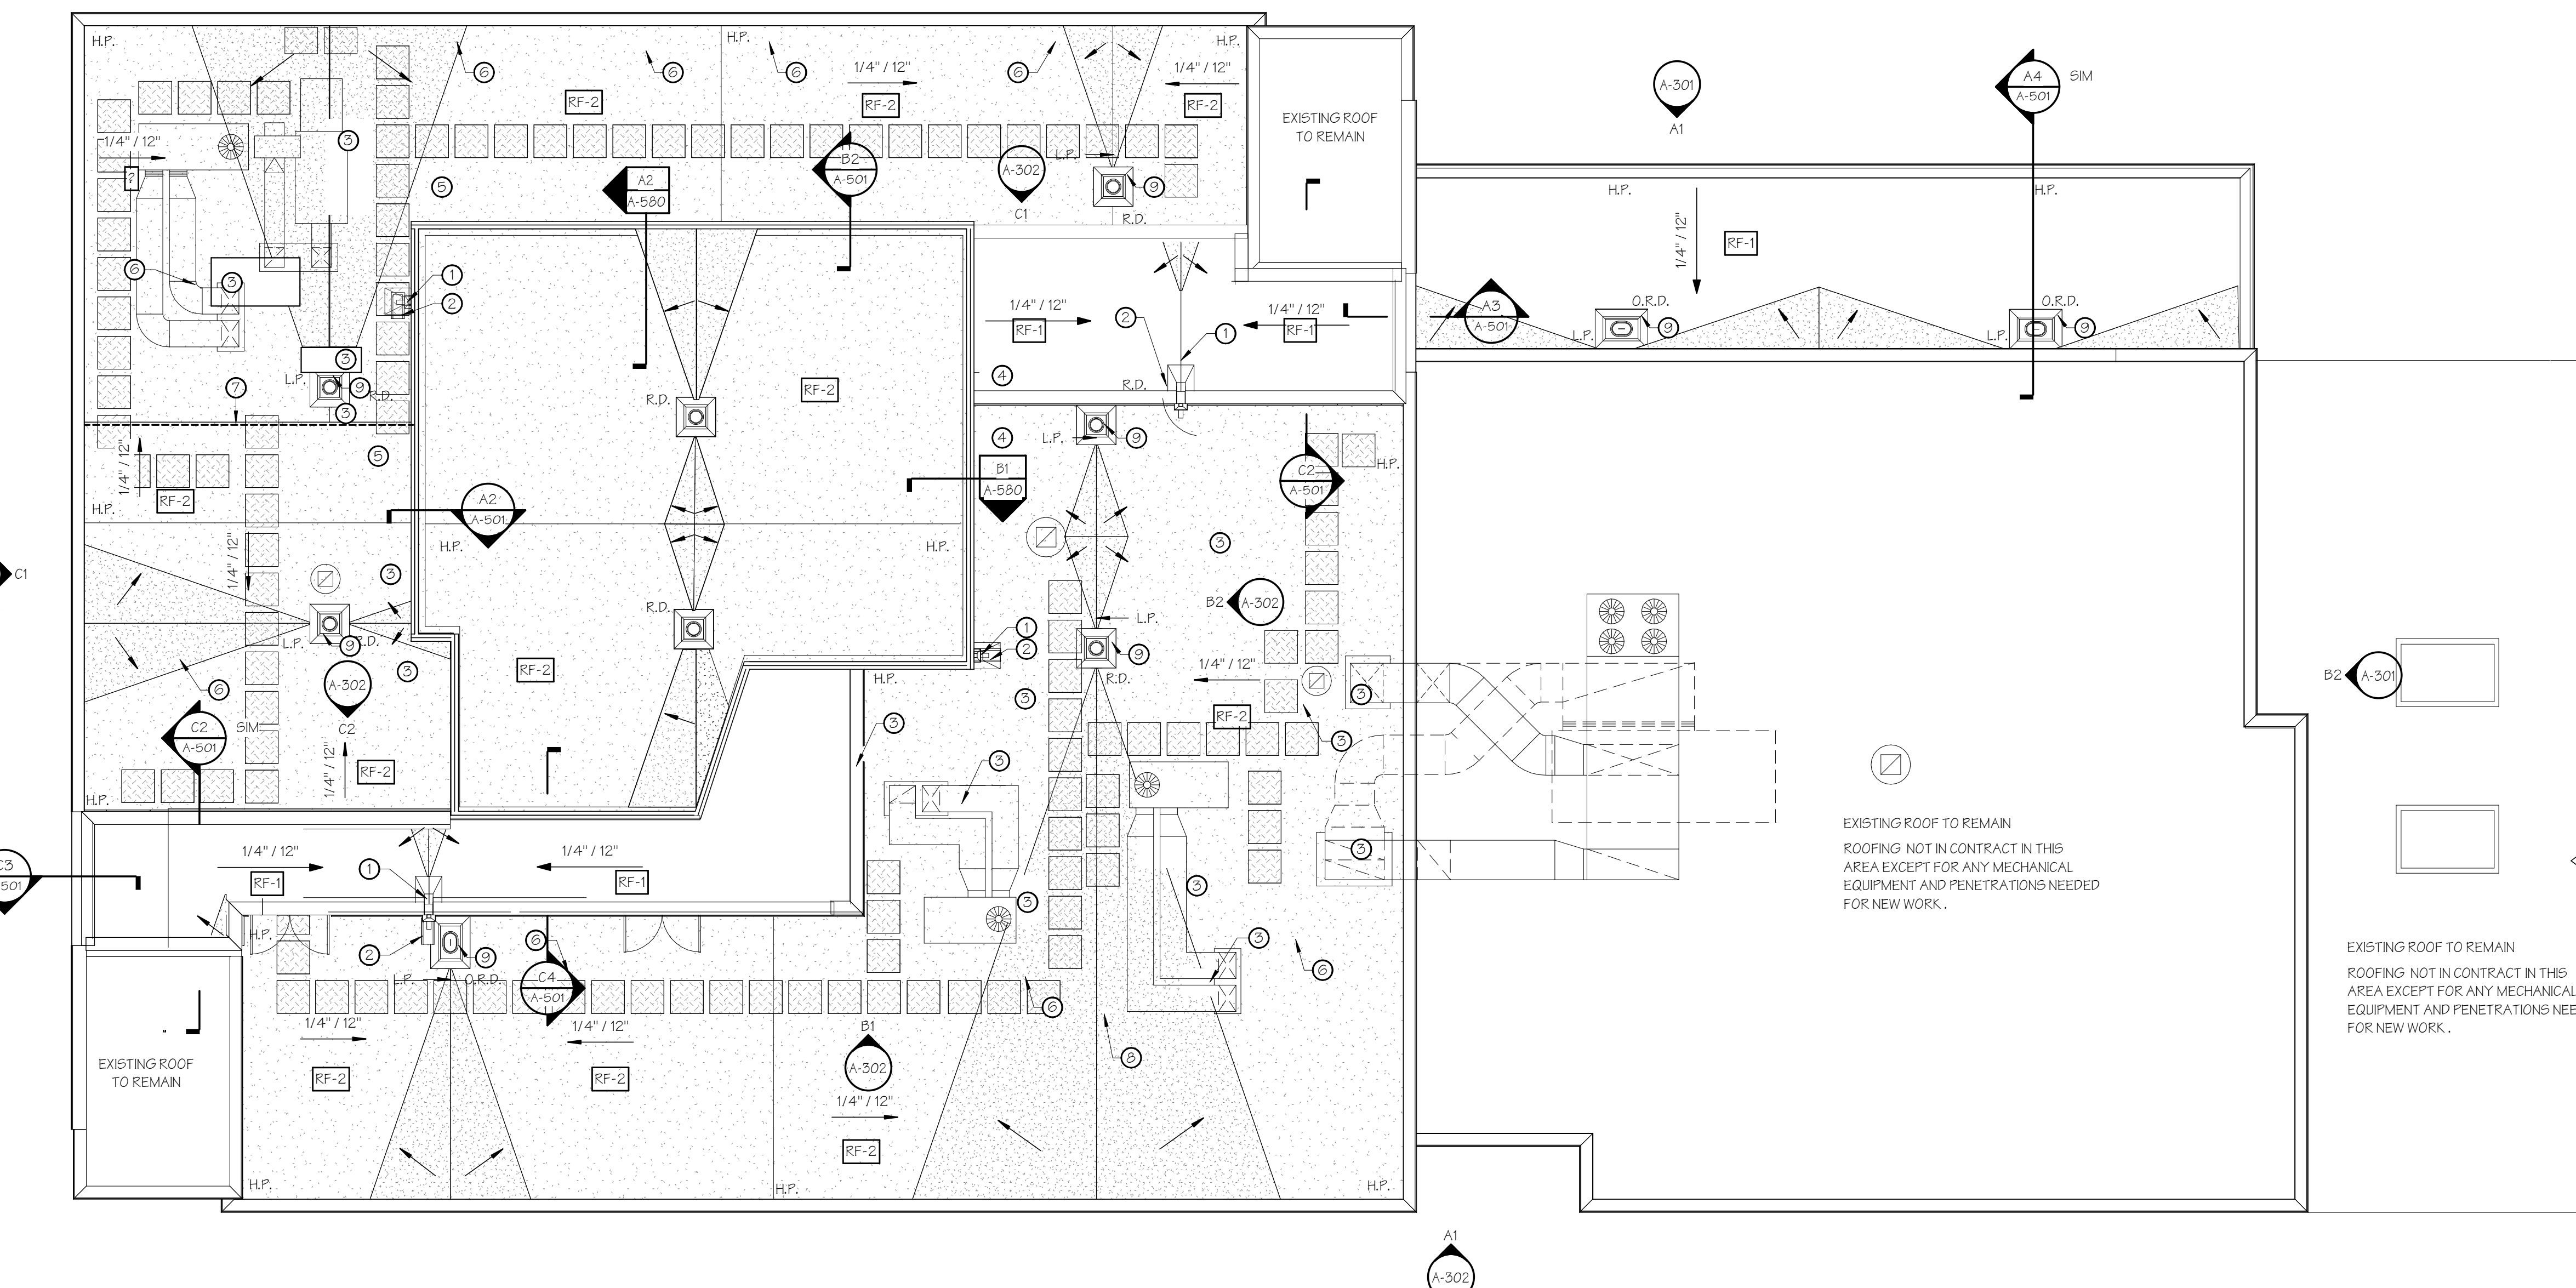

ROOF PLAN  
SCALE: 1/8" = 1'-0"

2/27/2020 1:07:01 PM C:\Users\rosenmich\OneDrive\Documents\Rescue Mission\_Phase 2\_Architecture\_rosehanan.rvt





ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

GENERAL CEILING CONSTRUCTION NOTES


- A. ALL PERIMETER TILES THAT MUST BE CUT SHALL BE REGULARIZED TO MATCH FACTORY CUT AS REQUIRED FOR TILE TO LAY LEVEL.
- B. ALL CEILING HEIGHTS SHALL BE 8'-0" C.H., UNLESS OTHERWISE NOTED.
- C. ALL CEILINGS TO BE INSTALLED PER SEISMIC REQUIREMENTS.
- D. ALL LAY-IN CEILINGS SHALL BE CENTERED WITHIN ROOM OR SPACE UNLESS OTHERWISE INDICATED ON THESE DRAWINGS.
- E. COORDINATE LIGHTING LAYOUTS WITH ACTUAL CONDITIONS IN FIELD AND CONSULT WITH ARCHITECT IF LAYOUT REQUIRES CHANGES.
- F. ALL ACOUSTICAL CEILING TILES SHALL BE (CLG-A) U.O.N.
- G. SURFACE-MOUNTED CEILING EQUIPMENT SHALL BE INDEPENDENTLY SUPPORTED BY HANGER WIRES UP TO CONCRETE DECK OR STRUCTURAL FRAMING ABOVE.
- H. ALL ROOMS THAT HAVE ONE FIXTURE, FIXTURE SHALL BE CENTERED W/IN SPACE OR ROOM; U.O.N.
- I. ALL GYP. BD. CEILINGS SHALL BE PAINTED CEILING WHITE, FLAT FINISH, U.O.N.
- J. ALL SOFFITS SHALL BE PAINTED CEILING WHITE, EGGSHELL FINISH, U.O.N. BOTH FACE & UNDERSIDE OF SOFFIT SHALL BE PAINTED TO MATCH FINISH DESIGNATION ON CEILING PLANS.
- K. REFER TO SPECIFICATIONS AND FINISH LEGEND ON SHEET FI-901 FOR CEILING TYPES AND FINISHES.
- L. FIXTURE TYPE (W3) SHALL BE CENTERED ABOVE RESTROOM MIRRORS.
- M. SEE MECH DWGS FOR CONDENSATE DRAIN LOCATIONS

CEILING NOTES

- 1 EXISTING CEILING TO REMAIN.
- 2 EXISTING CEILING AND LIGHTING TO REMAIN. CEILING SHALL PREPRED AND PAINTED (PT-1).
- 3 EXISTING CEILING TO REMAIN AND PAINTED (PT-1).
- 4 EXISTING CEILING TO REMAIN, CEILING MOUNTED CURTAIN TRACK TO BE REMOVED AND DAMAGED CEILING TILES SHALL BE REPLACED AS REQUIRED. NEW LIGHT FIXTURE CENTERED WITHIN SPACE, TYPE (S1).
- 5 EXISTING WALL MOUNTED FIXTURES SHALL BE REMOVED AND REPLACED WITH NEW TYPE (W1) WALL MOUNTED FIXTURES.
- 6 RECESSED PROJECTION SCREEN. COORDINATE EXACT LOCATION & SIZE WITH TECHNOLOGY CONSULTANTS.
- 9 CEILING MOUNTED PROJECTOR. COORDINATE EXACT LOCATION WITH TECHNOLOGY CONSULTANTS.


CEILING SYMBOLS LEGEND

- NEW 24" X 24" ACOUSTICAL CEILING TILES AND GRID.
- NEW 24" X 24" WASHABLE CEILING TILES AND GRID.
- CEILING GRID ALIGNMENT MARKS
- NEW GYPSUM BOARD CEILING / SOFFIT
- NEW SURFACE MOUNTED DIRECT/INDIRECT LIGHT FIXTURES
- NEW SURFACE MOUNTED SEALED LIGHT FIXTURE (FOOD PREP AREAS)
- NEW SURFACE MOUNTED LIGHT FIXTURES
- NEW RECESSED DOWNLIGHT
- NEW RECESSED DOWNLIGHT (WET LOCATION)
- NEW WALL MOUNTED FIXTURES
- NEW WALL MOUNTED EXTERIOR FLOOD
- NEW CEILING MOUNTED PROJECTOR

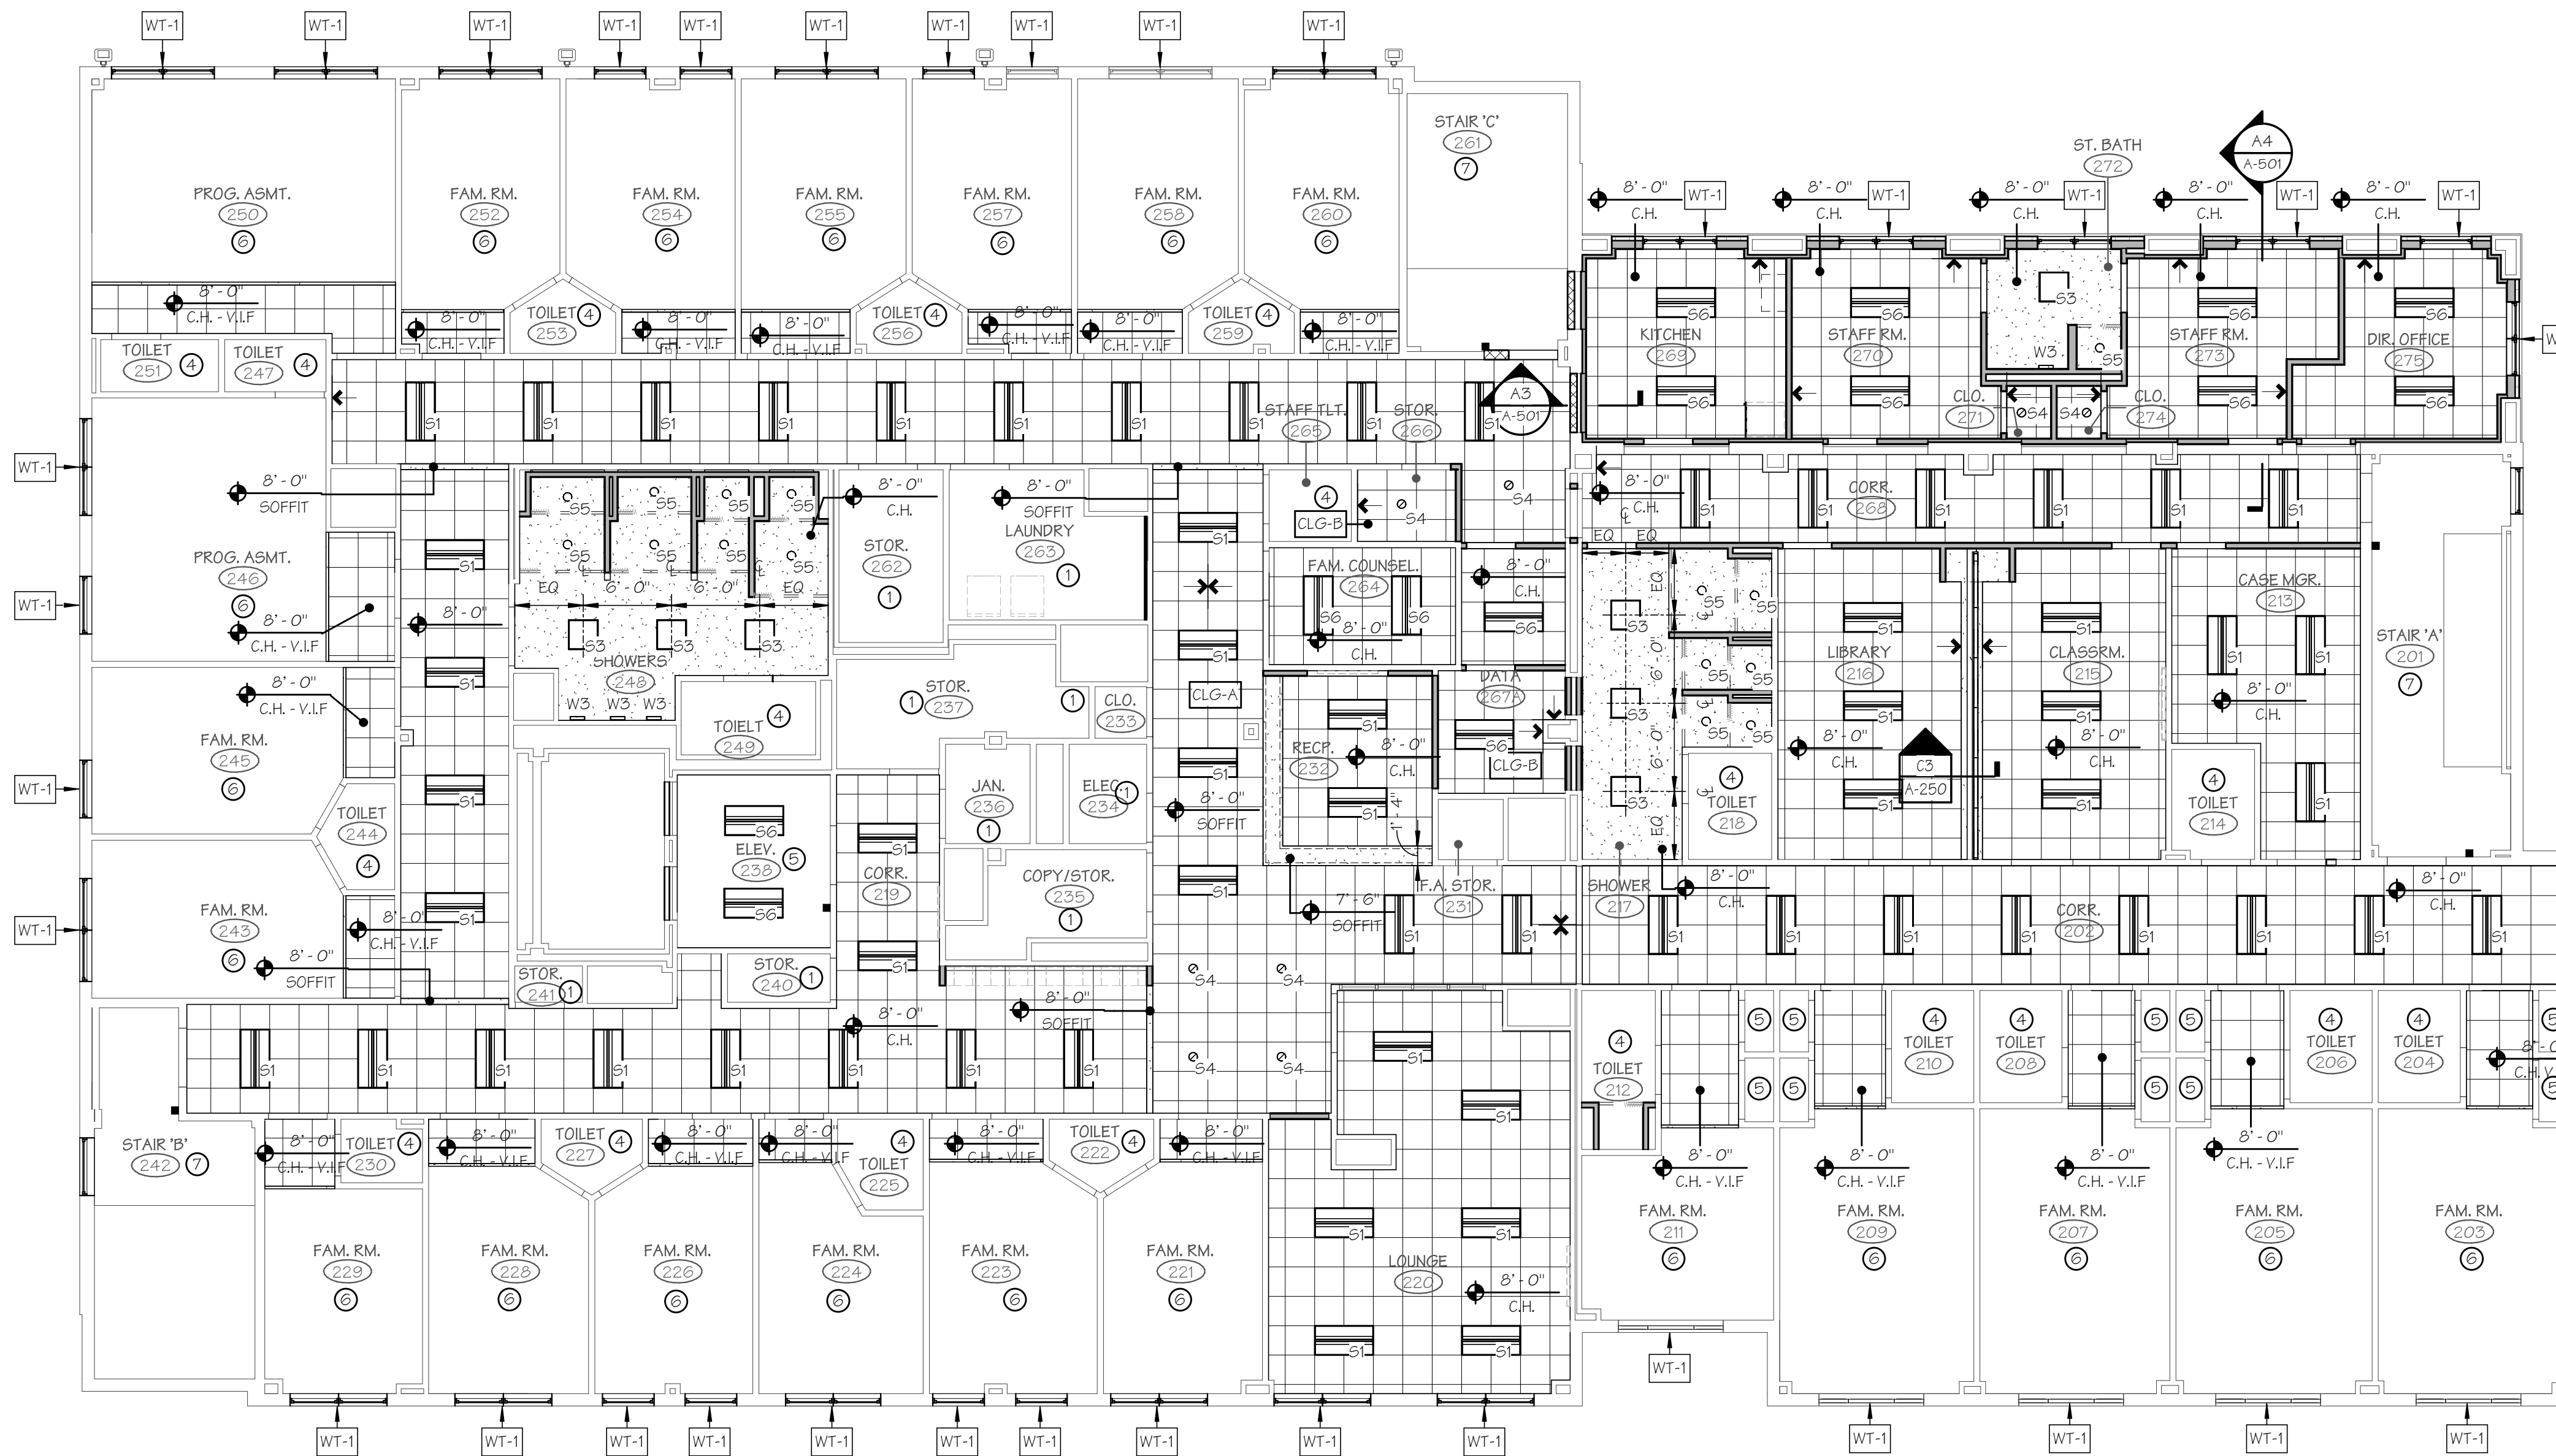

SECOND FLOOR REFLECTED CEILING PLAN

SCALE: 1/8" = 1'-0"



PROJECT NORTH

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:



REVISIONS		
NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
SECOND FLOOR REFLECTED CEILING PLAN

SCALE: As indicated DRAWN BY: BMD/KWG REVIEWED BY: DCF

DRAWING NO.

A-202

04.16.2020 - CM BID

DATE: 31 JANUARY 2020 JOB NUMBER: 18052



ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:  
**BID SET**  
31 JANUARY 2020  
04.16.2020 - CM BID

REVISIONS		
NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
THIRD FLOOR REFLECTED CEILING PLAN

SCALE: As indicated  
DRAWN BY: BMD/KWG  
REVIEWED BY: DCF

DRAWING NO.  
**A-203**  
04.16.2020 - CM BID  
DATE: 31 JANUARY 2020  
JOB NUMBER: 18052

GENERAL CEILING CONSTRUCTION NOTES


- A. ALL PERIMETER TILES THAT MUST BE CUT SHALL BE TEGULARIZED TO MATCH FACTORY CUT AS REQUIRED FOR TILE TO LAY LEVEL.
- B. ALL CEILING HEIGHTS SHALL BE 8'-0" C.H., UNLESS OTHERWISE NOTED.
- C. ALL CEILINGS TO BE INSTALLED PER SEISMIC REQUIREMENTS.
- D. ALL LAY-IN CEILINGS SHALL BE CENTERED WITHIN ROOM OR SPACE UNLESS OTHERWISE INDICATED ON THESE DRAWINGS.
- E. COORDINATE LIGHTING LAYOUTS WITH ACTUAL CONDITIONS IN FIELD AND CONSULT WITH ARCHITECT IF LAYOUT REQUIRES CHANGES.
- F. ALL ACOUSTICAL CEILING TILES SHALL BE (CLG-A) U.O.N.
- G. SURFACE-MOUNTED CEILING EQUIPMENT SHALL BE INDEPENDENTLY SUPPORTED BY HANGER WIRES UP TO CONCRETE DECK OR STRUCTURAL FRAMING ABOVE.
- H. ALL ROOMS THAT HAVE ONE FIXTURE, FIXTURE SHALL BE CENTERED W/IN SPACE OR ROOM; U.O.N.
- I. ALL GYP. BD. CEILINGS SHALL BE PAINTED CEILING WHITE, FLAT FINISH, U.O.N.
- J. ALL SOFFITS SHALL BE PAINTED CEILING WHITE, EGGSHELL FINISH, U.O.N. BOTH FACE & UNDERSIDE OF SOFFIT SHALL BE PAINTED TO MATCH FINISH DESIGNATION ON CEILING PLANS.
- K. REFER TO SPECIFICATIONS AND FINISH LEGEND ON SHEET FI-901 FOR CEILING TYPES AND FINISHES.
- L. FIXTURE TYPE (W3) SHALL BE CENTERED ABOVE RESTROOM MIRRORS.
- M. SEE MECH DWGS FOR CONDENSATE DRAIN LOCATIONS

CEILING NOTES

- 1 EXISTING CEILING TO REMAIN.
- 4 EXISTING CEILING AND LIGHTING TO REMAIN. CEILING SHALL PREP AND PAINTED (PT-1).
- 5 EXISTING CEILING TO REMAIN AND PAINTED (PT-1).
- 6 EXISTING CEILING TO REMAIN, CEILING MOUNTED CURTAIN TRACK TO BE REMOVED AND DAMAGED CEILING TILES SHALL BE REPLACED AS REQUIRED. NEW LIGHT FIXTURE CENTERED WITHIN SPACE, TYPE (S1).
- 7 EXISTING WALL MOUNTED FIXTURES SHALL BE REMOVED AND REPLACED WITH NEW TYPE (W1) WALL MOUNTED FIXTURES.
- 8 RECESSED PROJECTION SCREEN. COORDINATE EXACT LOCATION & SIZE WITH TECHNOLOGY CONSULTANTS.
- 9 CEILING MOUNTED PROJECTOR. COORDINATE EXACT LOCATION WITH TECHNOLOGY CONSULTANTS.

CEILING SYMBOLS LEGEND

- NEW 24" X 24" ACOUSTICAL CEILING TILES AND GRID.
- NEW 24" X 24" WASHABLE CEILING TILES AND GRID.
- CEILING GRID ALIGNMENT MARKS
- NEW GYPSUM BOARD CEILING/ SOFFIT
- NEW SURFACE MOUNTED DIRECT/INDIRECT LIGHT FIXTURES
- NEW SURFACE MOUNTED SEALED LIGHT FIXTURE (FOOD PREP AREAS)
- NEW SURFACE MOUNTED LIGHT FIXTURES
- NEW RECESSED DOWNLIGHT
- NEW RECESSED DOWNLIGHT (WET LOCATION)
- NEW WALL MOUNTED FIXTURES
- NEW WALL MOUNTED EXTERIOR FLOOD
- NEW CEILING MOUNTED PROJECTOR

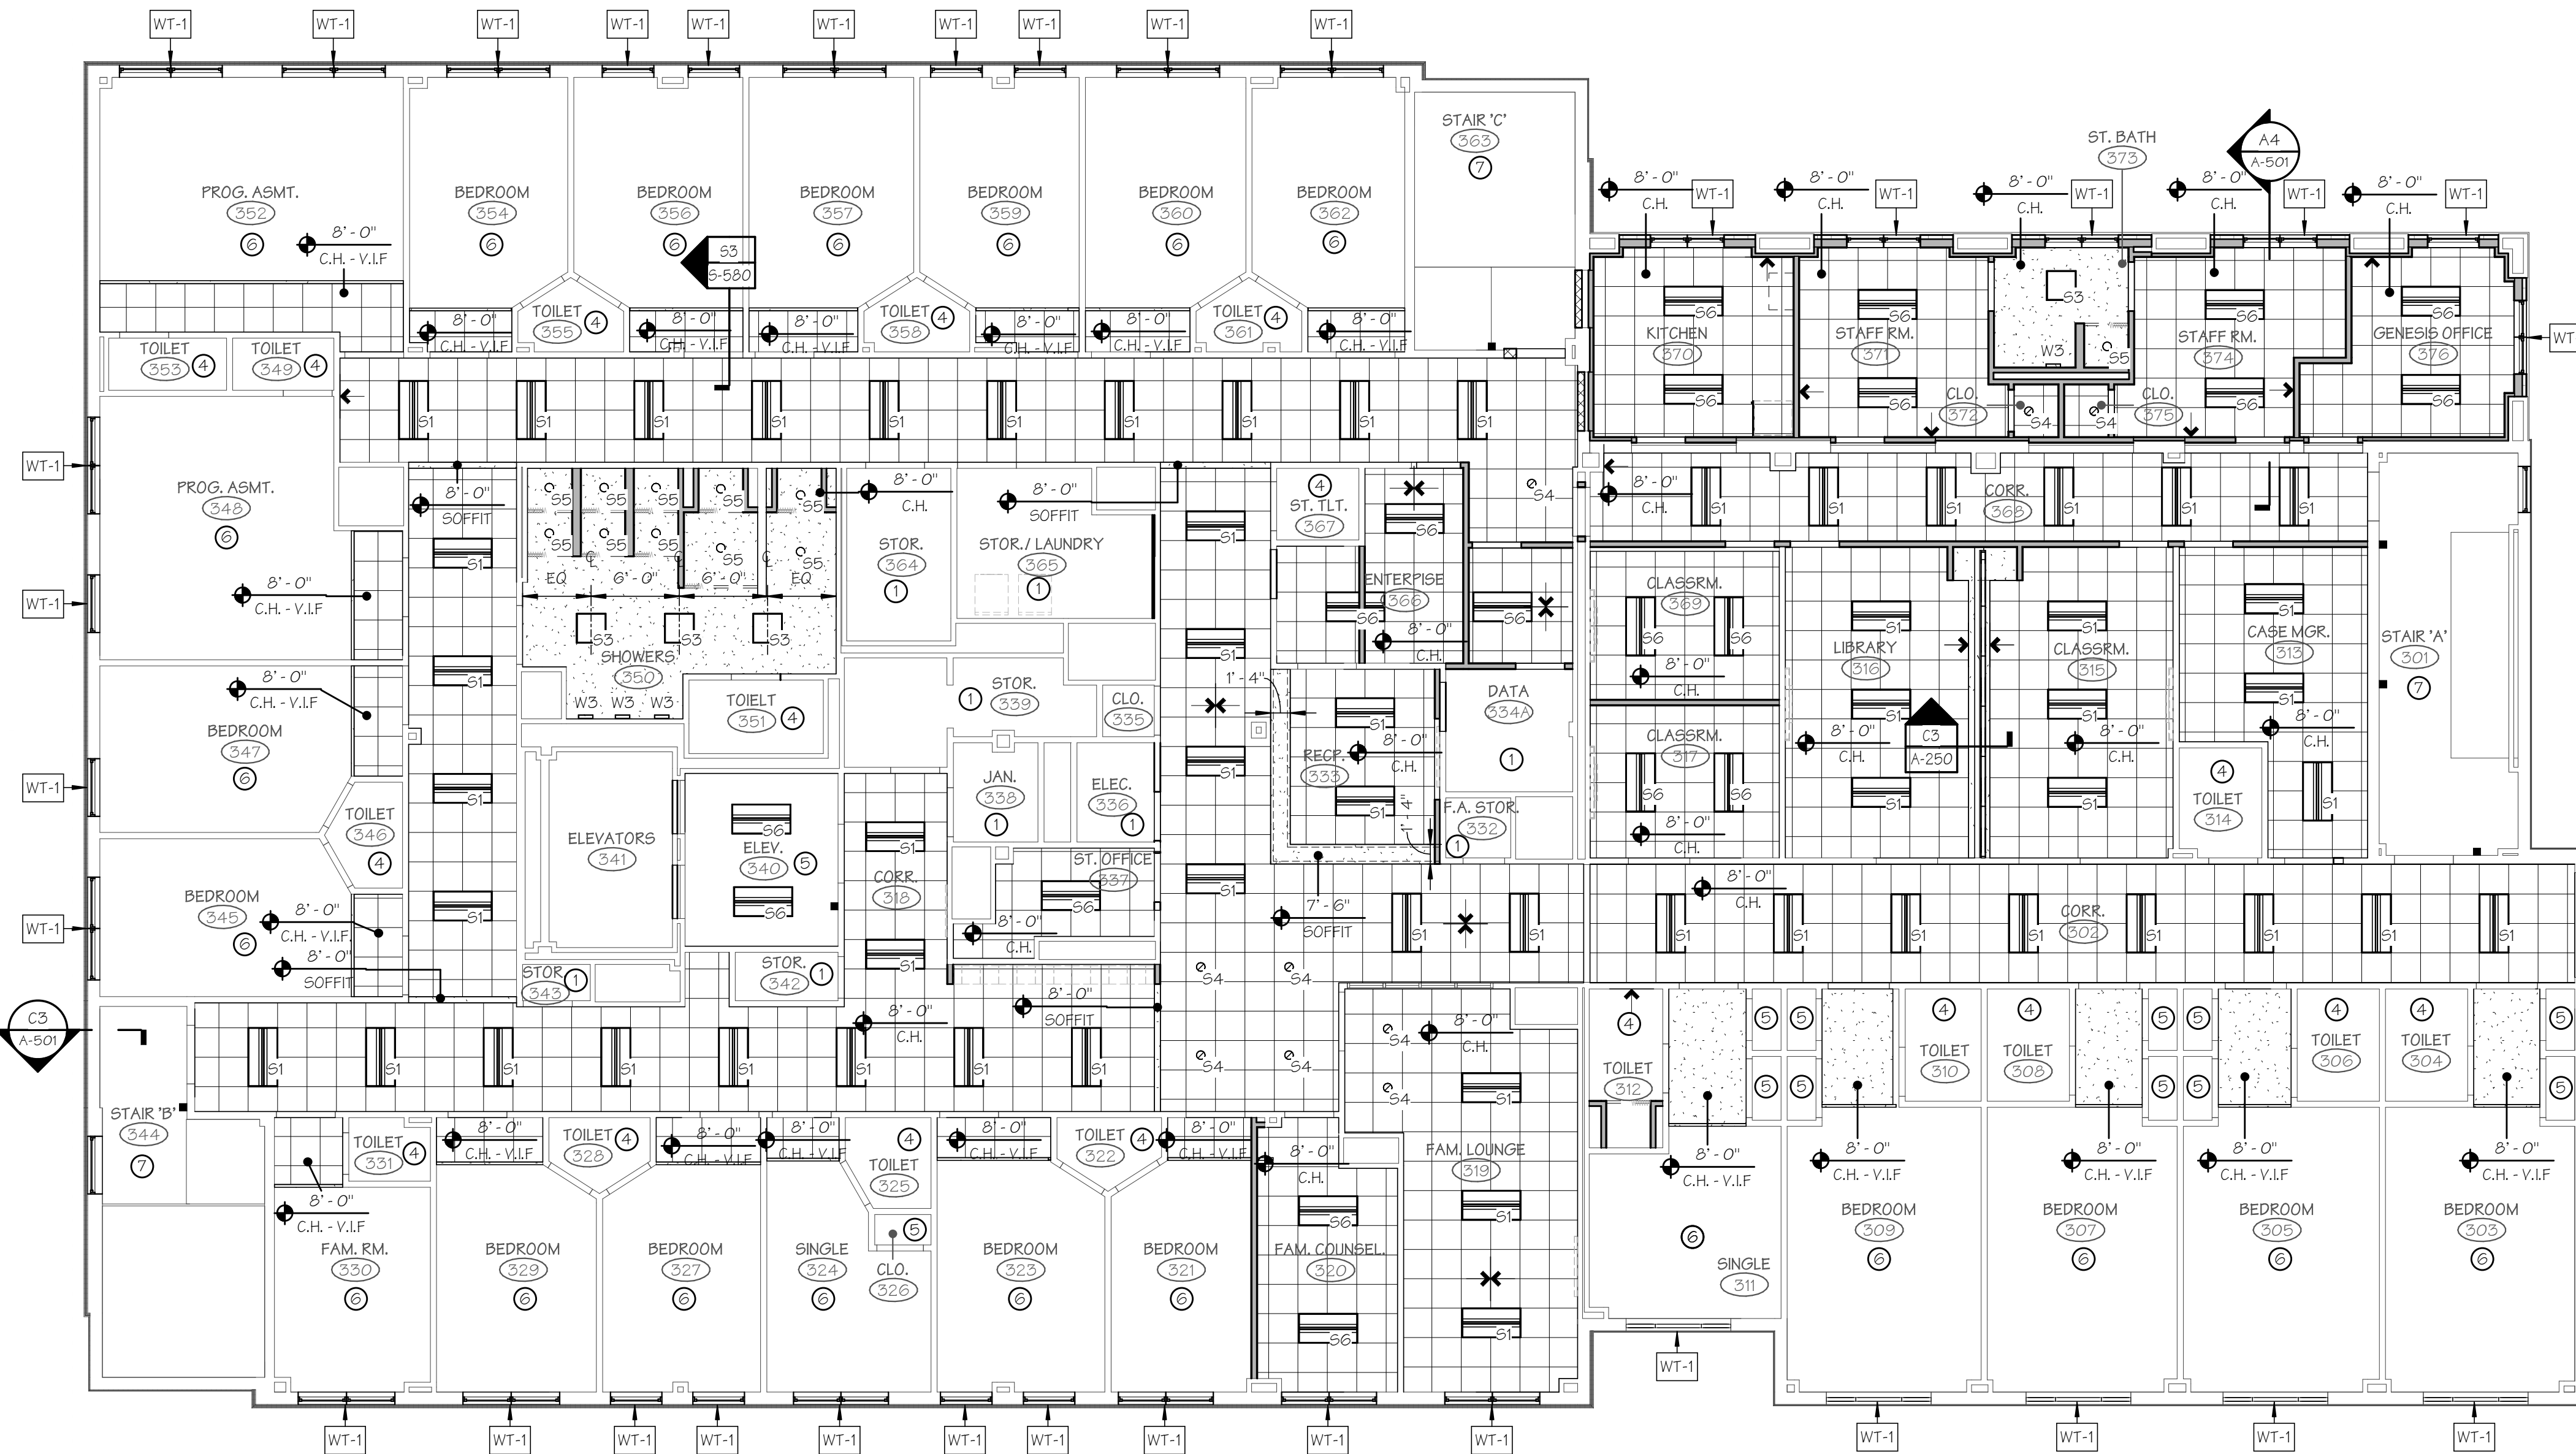

THIRD FLOOR REFLECTED CEILING PLAN

SCALE: 1/8" = 1'-0"



2/27/2020 1:07:11 PM C:\Users\rosenth\OneDrive\Documents\Rescue Mission\_Phase 2\_Architecture\_rosesthan.rvt



These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:  
**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
04.16.2020 - CM BID

REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
FOURTH FLOOR REFLECTED CEILING PLAN

SCALE: As indicated  
DRAWN BY: BMD/KWG  
REVIEWED BY: DCF

DRAWING NO.  
**A-204**  
04.16.2020 - CM BID  
DATE: 31 JANUARY 2020  
JOB NUMBER: 18052

GENERAL CEILING CONSTRUCTION NOTES


- A. ALL PERIMETER TILES THAT MUST BE CUT SHALL BE REGULARIZED TO MATCH FACTORY CUT AS REQUIRED FOR TILE TO LAY LEVEL.
- B. ALL CEILING HEIGHTS SHALL BE 8'-0" C.H., UNLESS OTHERWISE NOTED.
- C. ALL CEILINGS TO BE INSTALLED PER SEISMIC REQUIREMENTS.
- D. ALL LAY-IN CEILINGS SHALL BE CENTERED WITHIN ROOM OR SPACE UNLESS OTHERWISE INDICATED ON THESE DRAWINGS.
- E. COORDINATE LIGHTING LAYOUTS WITH ACTUAL CONDITIONS IN FIELD AND CONSULT WITH ARCHITECT IF LAYOUT REQUIRES CHANGES.
- F. ALL ACOUSTICAL CEILING TILES SHALL BE (CLG-A) U.O.N.
- G. SURFACE-MOUNTED CEILING EQUIPMENT SHALL BE INDEPENDENTLY SUPPORTED BY HANGER WIRES UP TO CONCRETE DECK OR STRUCTURAL FRAMING ABOVE.
- H. ALL ROOMS THAT HAVE ONE FIXTURE, FIXTURE SHALL BE CENTERED W/IN SPACE OR ROOM; U.O.N.
- I. ALL GYP. BD. CEILINGS SHALL BE PAINTED CEILING WHITE, FLAT FINISH, U.O.N.
- J. ALL SOFFITS SHALL BE PAINTED CEILING WHITE, EGGHELL FINISH, U.O.N. BOTH FACE & UNDERSIDE OF SOFFIT SHALL BE PAINTED TO MATCH FINISH DESIGNATION ON CEILING PLANS.
- K. REFER TO SPECIFICATIONS AND FINISH LEGEND ON SHEET FI-901 FOR CEILING TYPES AND FINISHES.
- L. FIXTURE TYPE (W3) SHALL BE CENTERED ABOVE RESTROOM MIRRORS.
- M. SEE MECH DWGS FOR CONDENSATE DRAIN LOCATIONS

CEILING NOTES

- 1 EXISTING CEILING TO REMAIN.
- 4 EXISTING CEILING AND LIGHTING TO REMAIN. CEILING SHALL PREP AND PAINTED (PT-1).
- 5 EXISTING CEILING TO REMAIN AND PAINTED (PT-1).
- 6 EXISTING CEILING TO REMAIN, CEILING MOUNTED CURTAIN TRACK TO BE REMOVED AND DAMAGED CEILING TILES SHALL BE REPLACED AS REQUIRED. NEW LIGHT FIXTURE CENTERED WITHIN SPACE, TYPE (S1).
- 7 EXISTING WALL MOUNTED FIXTURES SHALL BE REMOVED AND REPLACED WITH NEW TYPE (W1) WALL MOUNTED FIXTURES.
- 8 RECESSED PROJECTION SCREEN. COORDINATE EXACT LOCATION & SIZE WITH TECHNOLOGY CONSULTANTS.
- 9 CEILING MOUNTED PROJECTOR. COORDINATE EXACT LOCATION WITH TECHNOLOGY CONSULTANTS.


CEILING SYMBOLS LEGEND

- NEW 24" X 24" ACOUSTICAL CEILING TILES AND GRID.
- NEW 24" X 24" WASHABLE CEILING TILES AND GRID.
- CEILING GRID ALIGNMENT MARKS
- NEW GYPSUM BOARD CEILING/ SOFFIT
- NEW SURFACE MOUNTED DIRECT/INDIRECT LIGHT FIXTURES
- NEW SURFACE MOUNTED SEALED LIGHT FIXTURE (FOOD PREP AREAS)
- NEW SURFACE MOUNTED LIGHT FIXTURES
- NEW RECESSED DOWNLIGHT
- NEW RECESSED DOWNLIGHT (WET LOCATION)
- NEW WALL MOUNTED FIXTURES
- NEW WALL MOUNTED EXTERIOR FLOOD
- NEW CEILING MOUNTED PROJECTOR

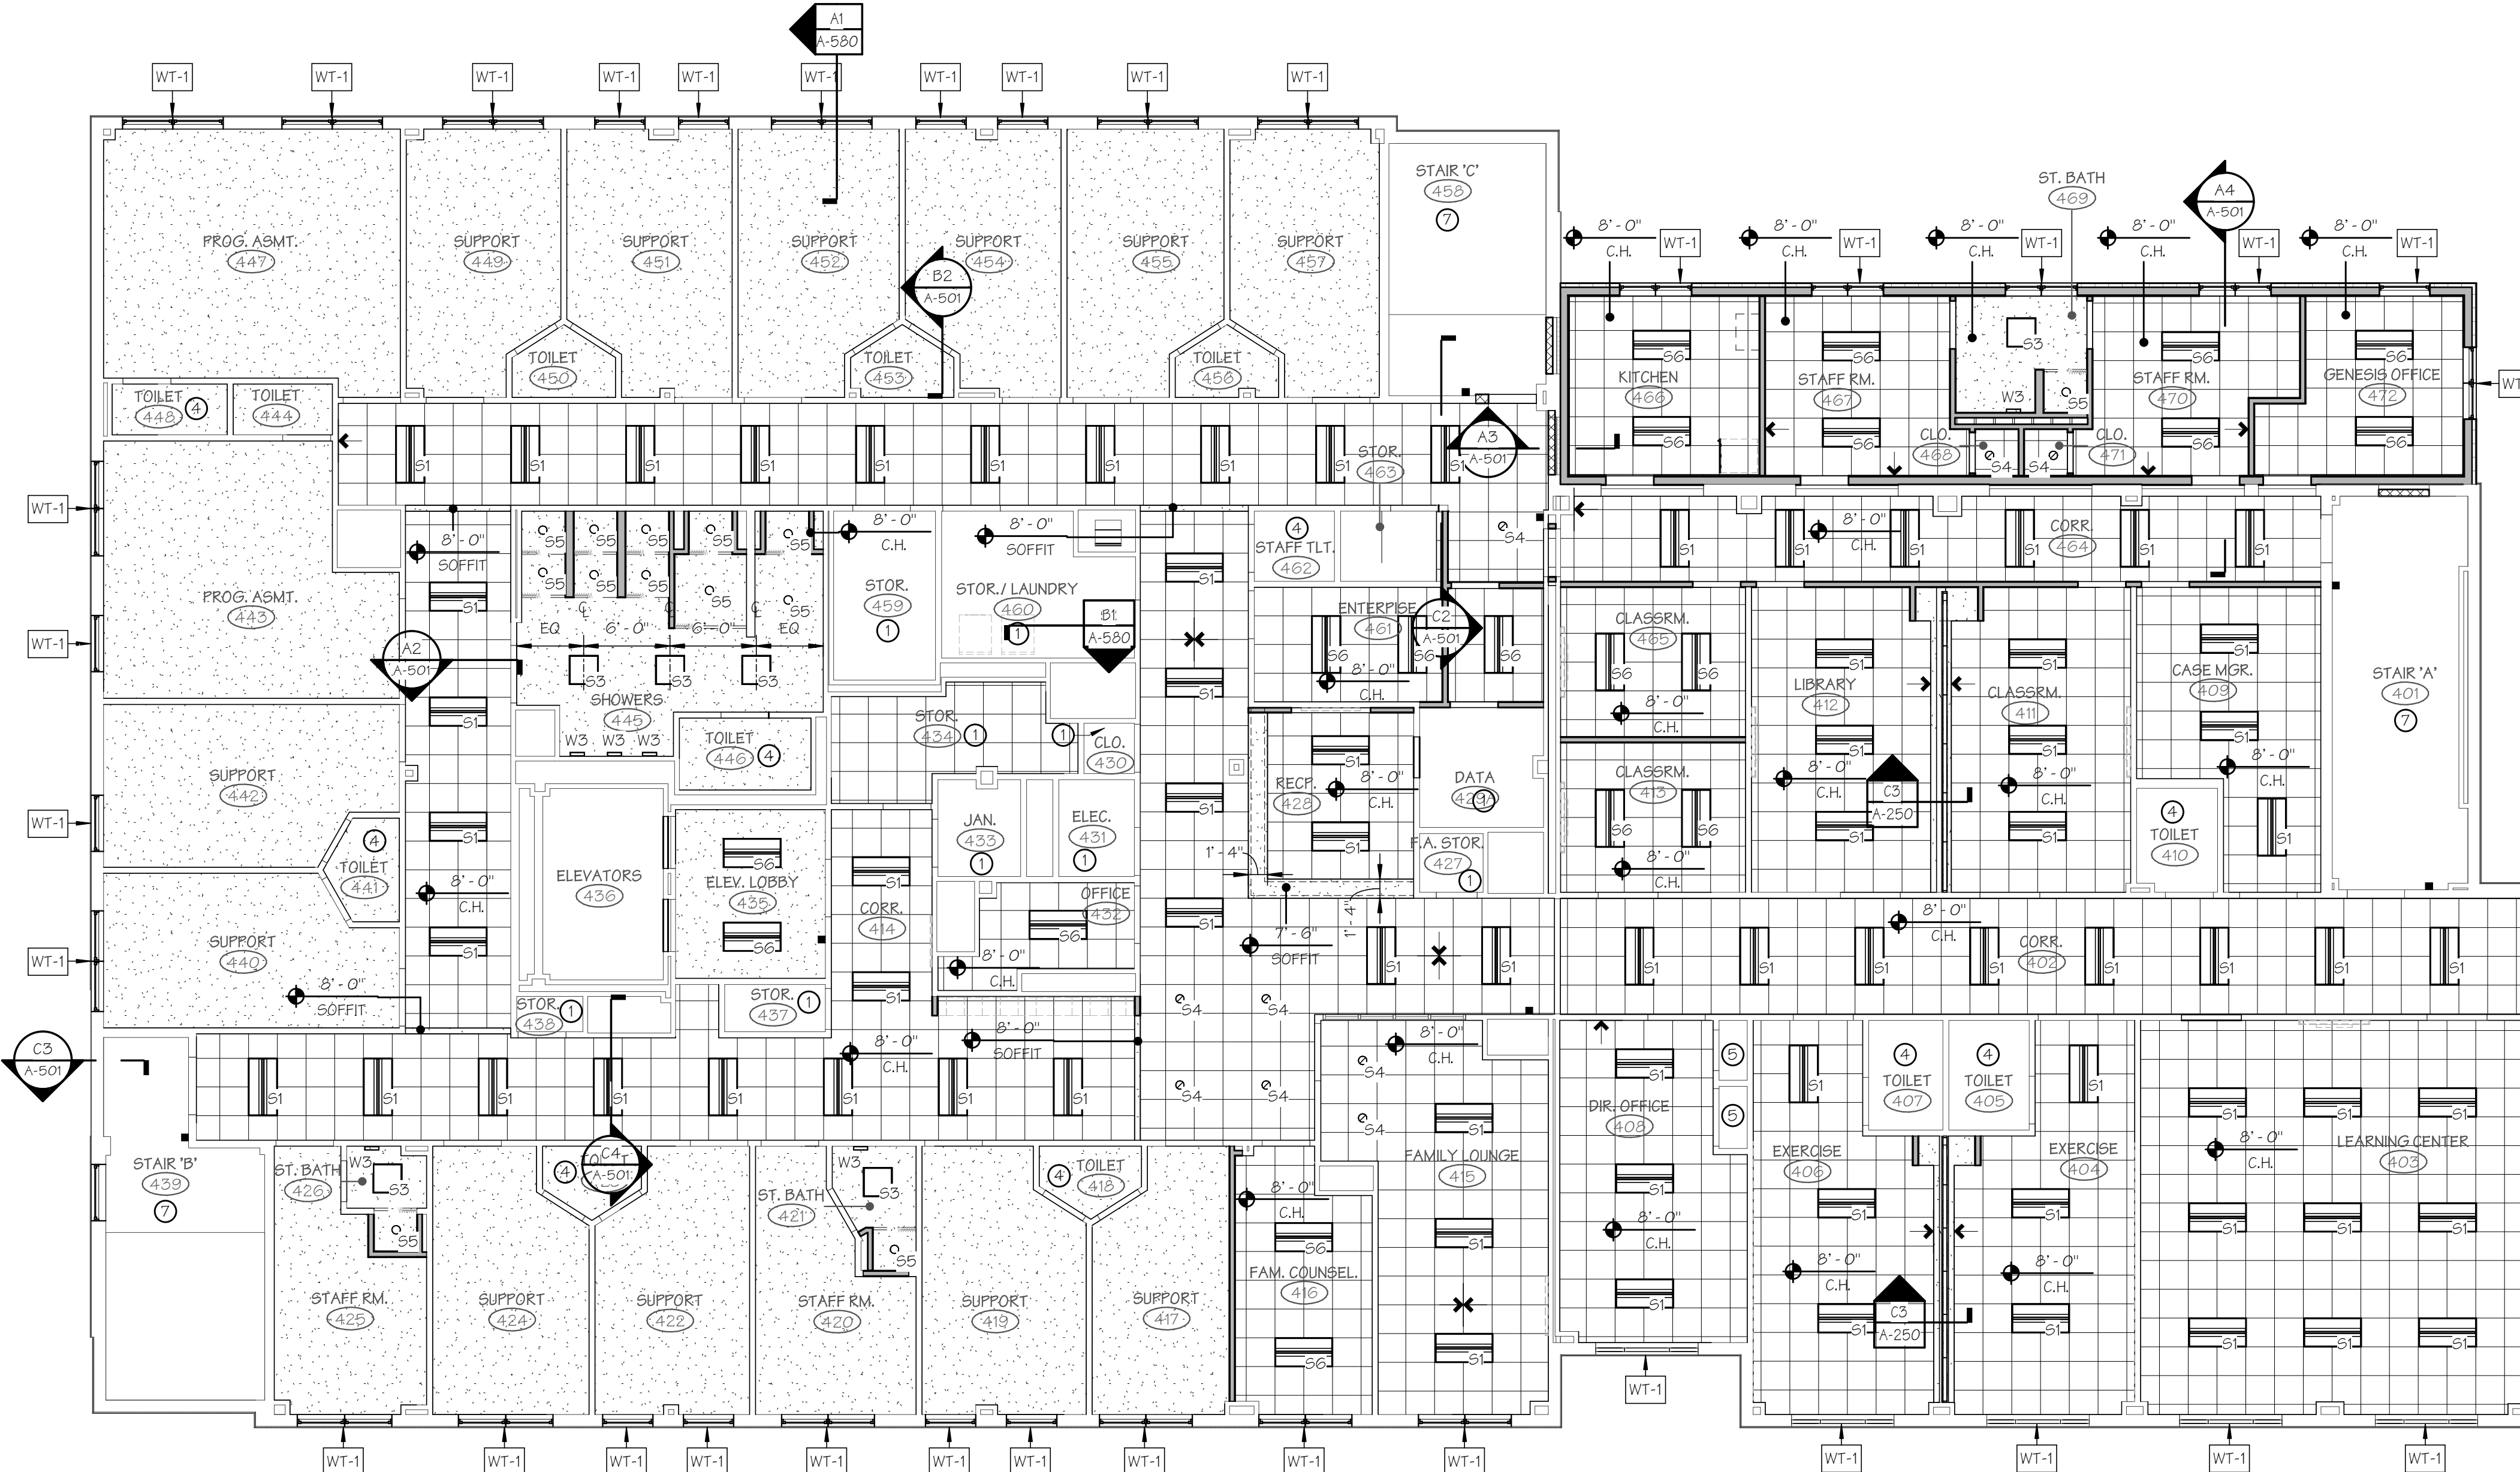


FOURTH FLOOR REFLECTED CEILING PLAN

SCALE: 1/8" = 1'-0"



PROJECT NORTH

2/27/2020 1:07:13 PM C:\Users\rosenhan1\OneDrive\Documents\Rescue Mission\_Phase 2\_Architecture\_rosehan1.rvt

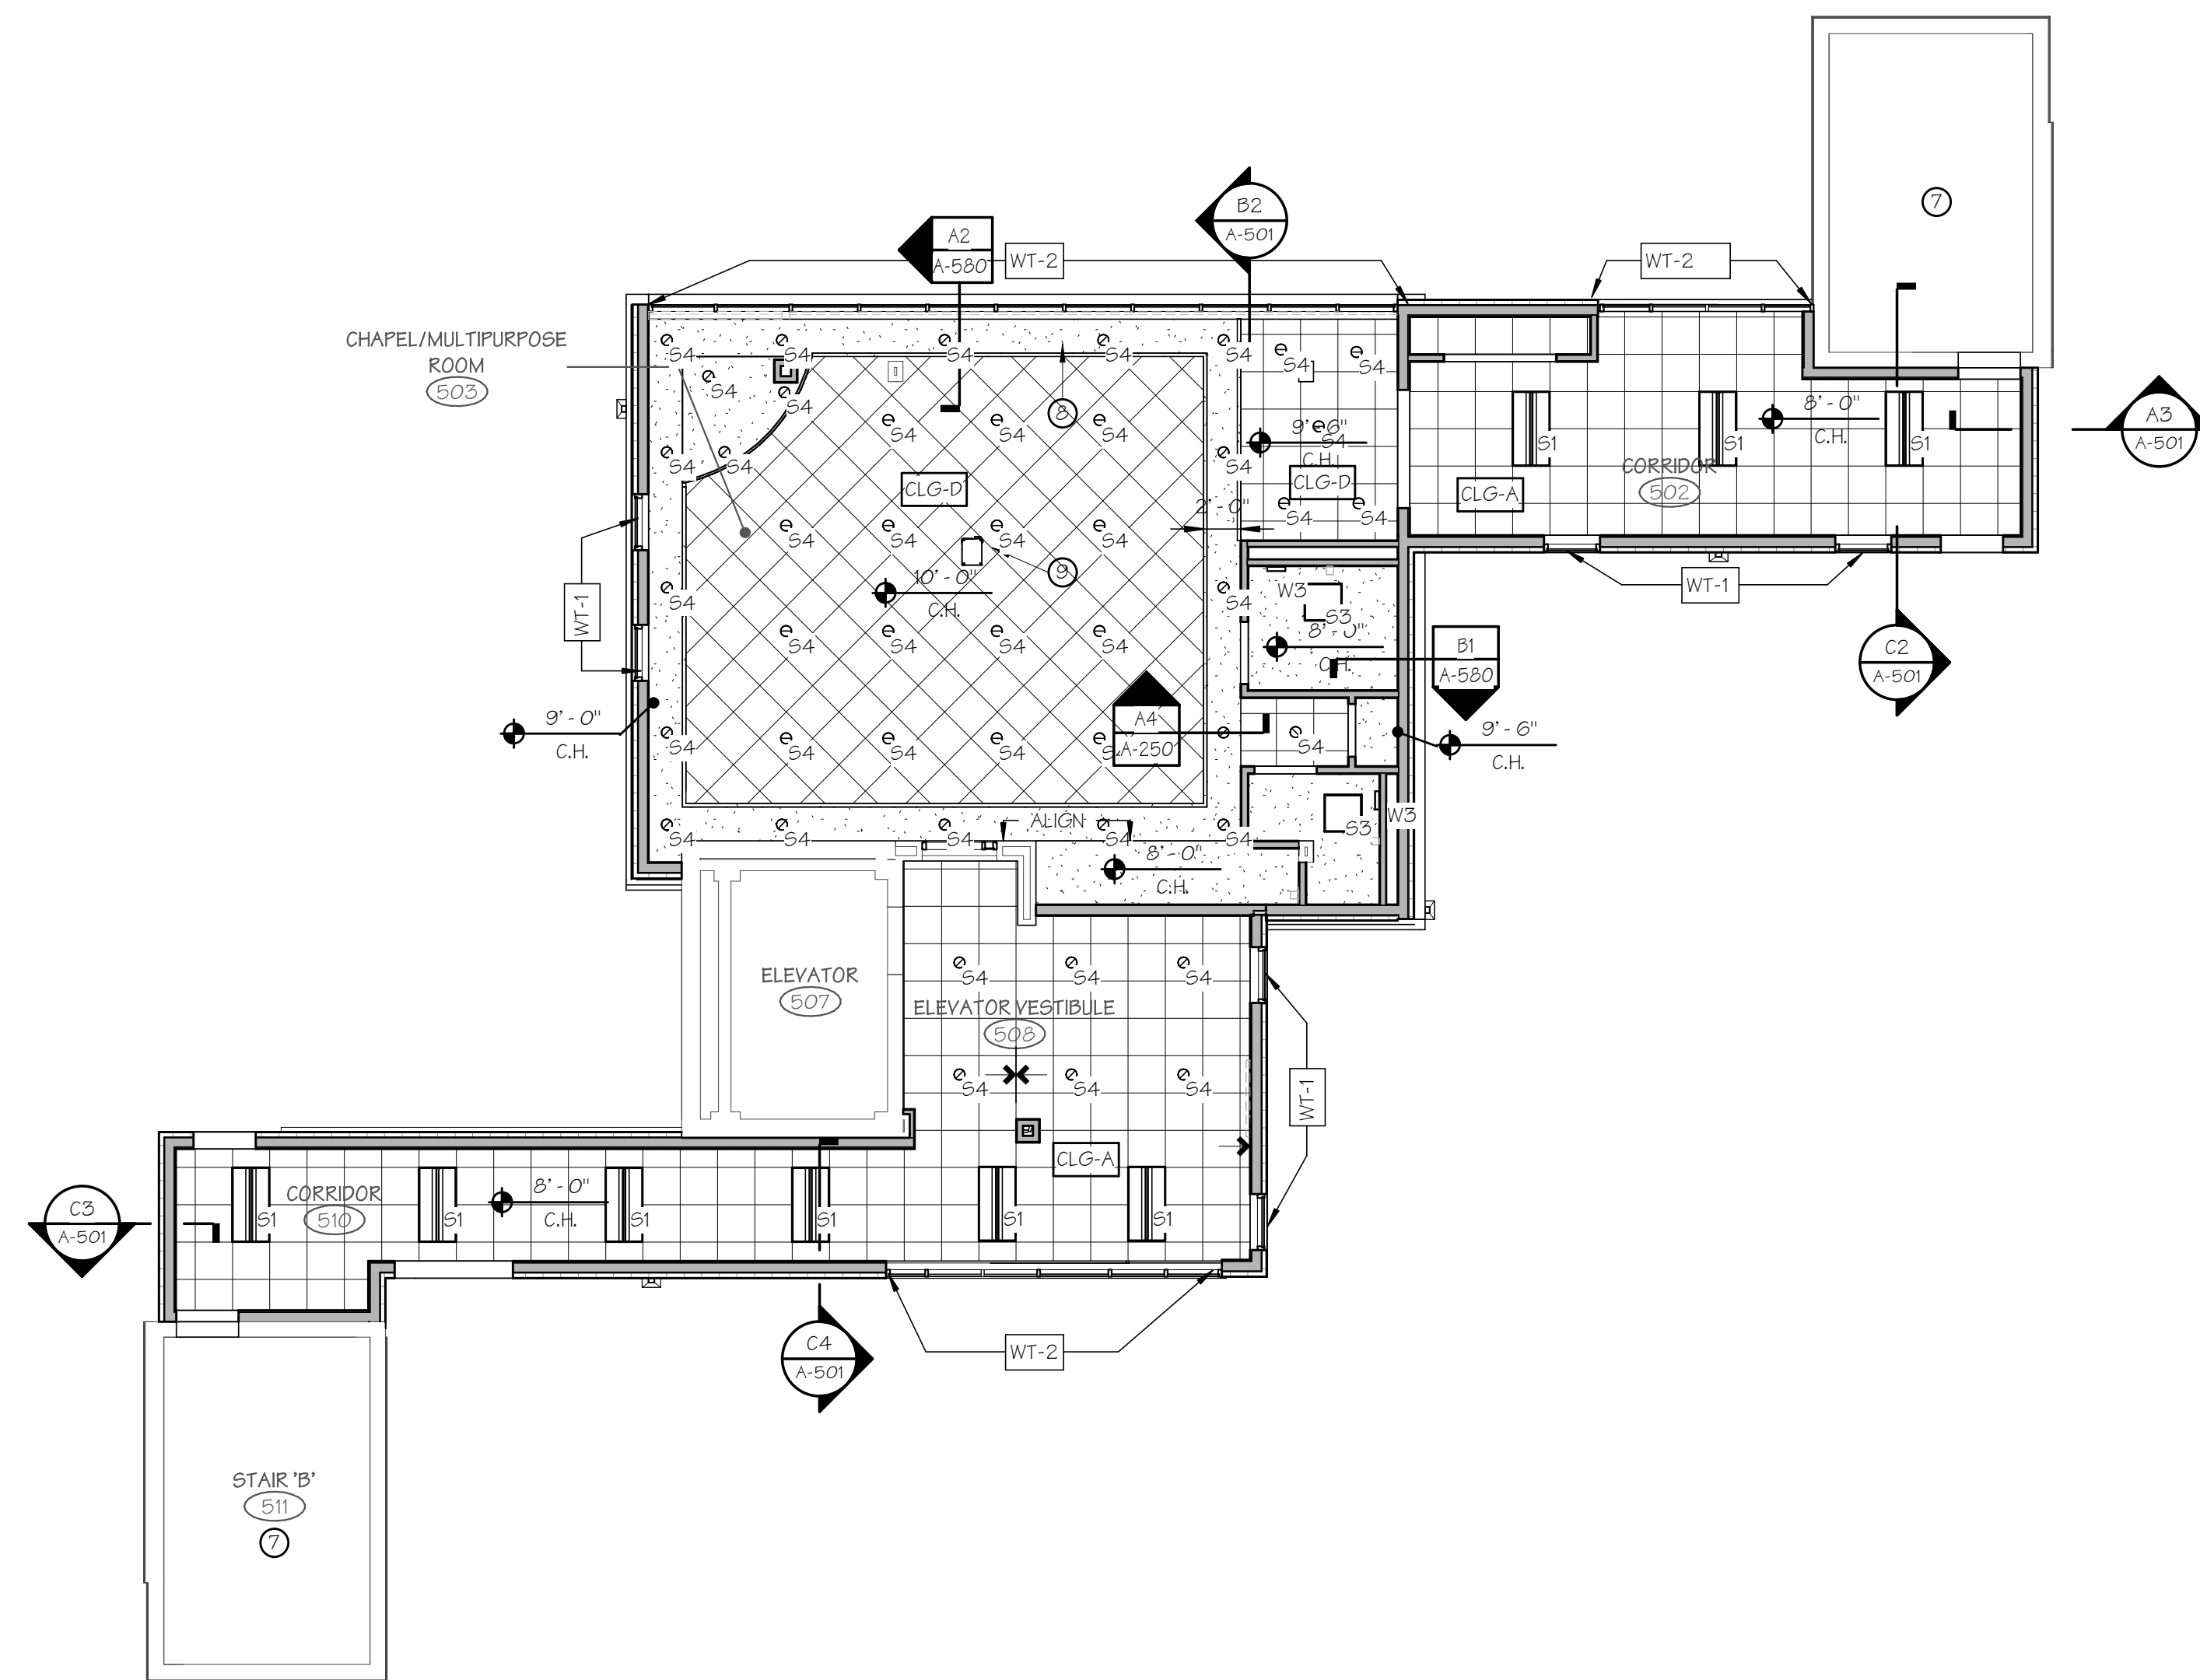

FIFTH FLOOR REFLECTED CEILING PLAN  
SCALE: 1/8" = 1'-0"



**GENERAL CEILING CONSTRUCTION NOTES**

- A. ALL PERIMETER TILES THAT MUST BE CUT SHALL BE TEGULARIZED TO MATCH FACTORY CUT AS REQUIRED FOR TILE TO LAY LEVEL.
- B. ALL CEILING HEIGHTS SHALL BE 8'-0" C.H. UNLESS OTHERWISE NOTED.
- C. ALL CEILINGS TO BE INSTALLED PER SEISMIC REQUIREMENTS.
- D. ALL LAY-IN CEILINGS SHALL BE CENTERED WITHIN ROOM OR SPACE UNLESS OTHERWISE INDICATED ON THESE DRAWINGS.
- E. COORDINATE LIGHTING LAYOUTS WITH ACTUAL CONDITIONS IN FIELD AND CONSULT WITH ARCHITECT IF LAYOUT REQUIRES CHANGES.
- F. ALL ACOUSTICAL CEILING TILES SHALL BE (CLG-A) U.O.N.
- G. SURFACE-MOUNTED CEILING EQUIPMENT SHALL BE INDEPENDENTLY SUPPORTED BY HANGER WIRES UP TO CONCRETE DECK OR STRUCTURAL FRAMING ABOVE.
- H. ALL ROOMS THAT HAVE ONE FIXTURE, FIXTURE SHALL BE CENTERED W/IN SPACE OR ROOM; U.O.N.
- I. ALL GYP. BD. CEILINGS SHALL BE PAINTED CEILING WHITE, FLAT FINISH, U.O.N.
- J. ALL SOFFITS SHALL BE PAINTED CEILING WHITE, EGGHELL FINISH, U.O.N. BOTH FACE & UNDERSIDE OF SOFFIT SHALL BE PAINTED TO MATCH FINISH DESIGNATION ON CEILING PLANS.
- K. REFER TO SPECIFICATIONS AND FINISH LEGEND ON SHEET FI-901 FOR CEILING TYPES AND FINISHES.
- L. FIXTURE TYPE (W3) SHALL BE CENTERED ABOVE RESTROOM MIRRORS.
- M. SEE MECH DWGS FOR CONDENSATE DRAIN LOCATIONS

**CEILING NOTES**

- 1 EXISTING CEILING TO REMAIN.
- 4 EXISTING CEILING AND LIGHTING TO REMAIN. CEILING SHALL PREP AND PAINTED (PT-1).
- 5 EXISTING CEILING TO REMAIN AND PAINTED (PT-1).
- 6 EXISTING CEILING TO REMAIN, CEILING MOUNTED CURTAIN TRACK TO BE REMOVED AND DAMAGED CEILING TILES SHALL BE REPLACED AS REQUIRED. NEW LIGHT FIXTURE CENTERED WITHIN SPACE, TYPE (S1).
- 7 EXISTING WALL MOUNTED FIXTURES SHALL BE REMOVED AND REPLACED WITH NEW TYPE (W1) WALL MOUNTED FIXTURES.
- 8 RECESSED PROJECTION SCREEN. COORDINATE EXACT LOCATION & SIZE WITH TECHNOLOGY CONSULTANTS.
- 9 CEILING MOUNTED PROJECTOR. COORDINATE EXACT LOCATION WITH TECHNOLOGY CONSULTANTS.

**CEILING SYMBOLS LEGEND**

- NEW 24" X 24" ACOUSTICAL CEILING TILES AND GRID.
- NEW 24" X 24" WASHABLE CEILING TILES AND GRID.
- CEILING GRID ALIGNMENT MARKS
- NEW GYPSUM BOARD CEILING/ SOFFIT
- NEW SURFACE MOUNTED DIRECT/ INDIRECT LIGHT FIXTURES
- NEW SURFACE MOUNTED SEALED LIGHT FIXTURE (FOOD PREP AREAS)
- NEW SURFACE MOUNTED LIGHT FIXTURES
- NEW RECESSED DOWNLIGHT
- NEW RECESSED DOWNLIGHT (WET LOCATION)
- NEW WALL MOUNTED FIXTURES
- NEW WALL MOUNTED EXTERIOR FLOOD
- NEW CEILING MOUNTED PROJECTOR



ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:

**BID SET**  
 31 JANUARY 2020  
 FOR CONSTRUCTION  
 04.16.2020 - CM BID

**REVISIONS**

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

**JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION**  
**PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION**  
 725 PARK AVENUE  
 BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
FIFTH FLOOR REFLECTED CEILING PLAN

SCALE: As indicated	DRAWN BY: BMD/KWG	REVIEWED BY: DCF
------------------------	----------------------	---------------------

DRAWING NO.

**A-205**

DATE: 31 JANUARY 2020  
JOB NUMBER: 18052



COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:

**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
**04.16.2020 - CM BID**

REVISIONS		
NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

**JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT**




DRAWING TITLE:  
CEILING DETAILS

SCALE: As indicated	DRAWN BY: KWG	REVIEWED BY: DCF
------------------------	------------------	---------------------

DRAWING NO.:

**A-250**  
04.16.2020 - CM BID

DATE: 31 JANUARY 2020 JOB NUMBER: 18052

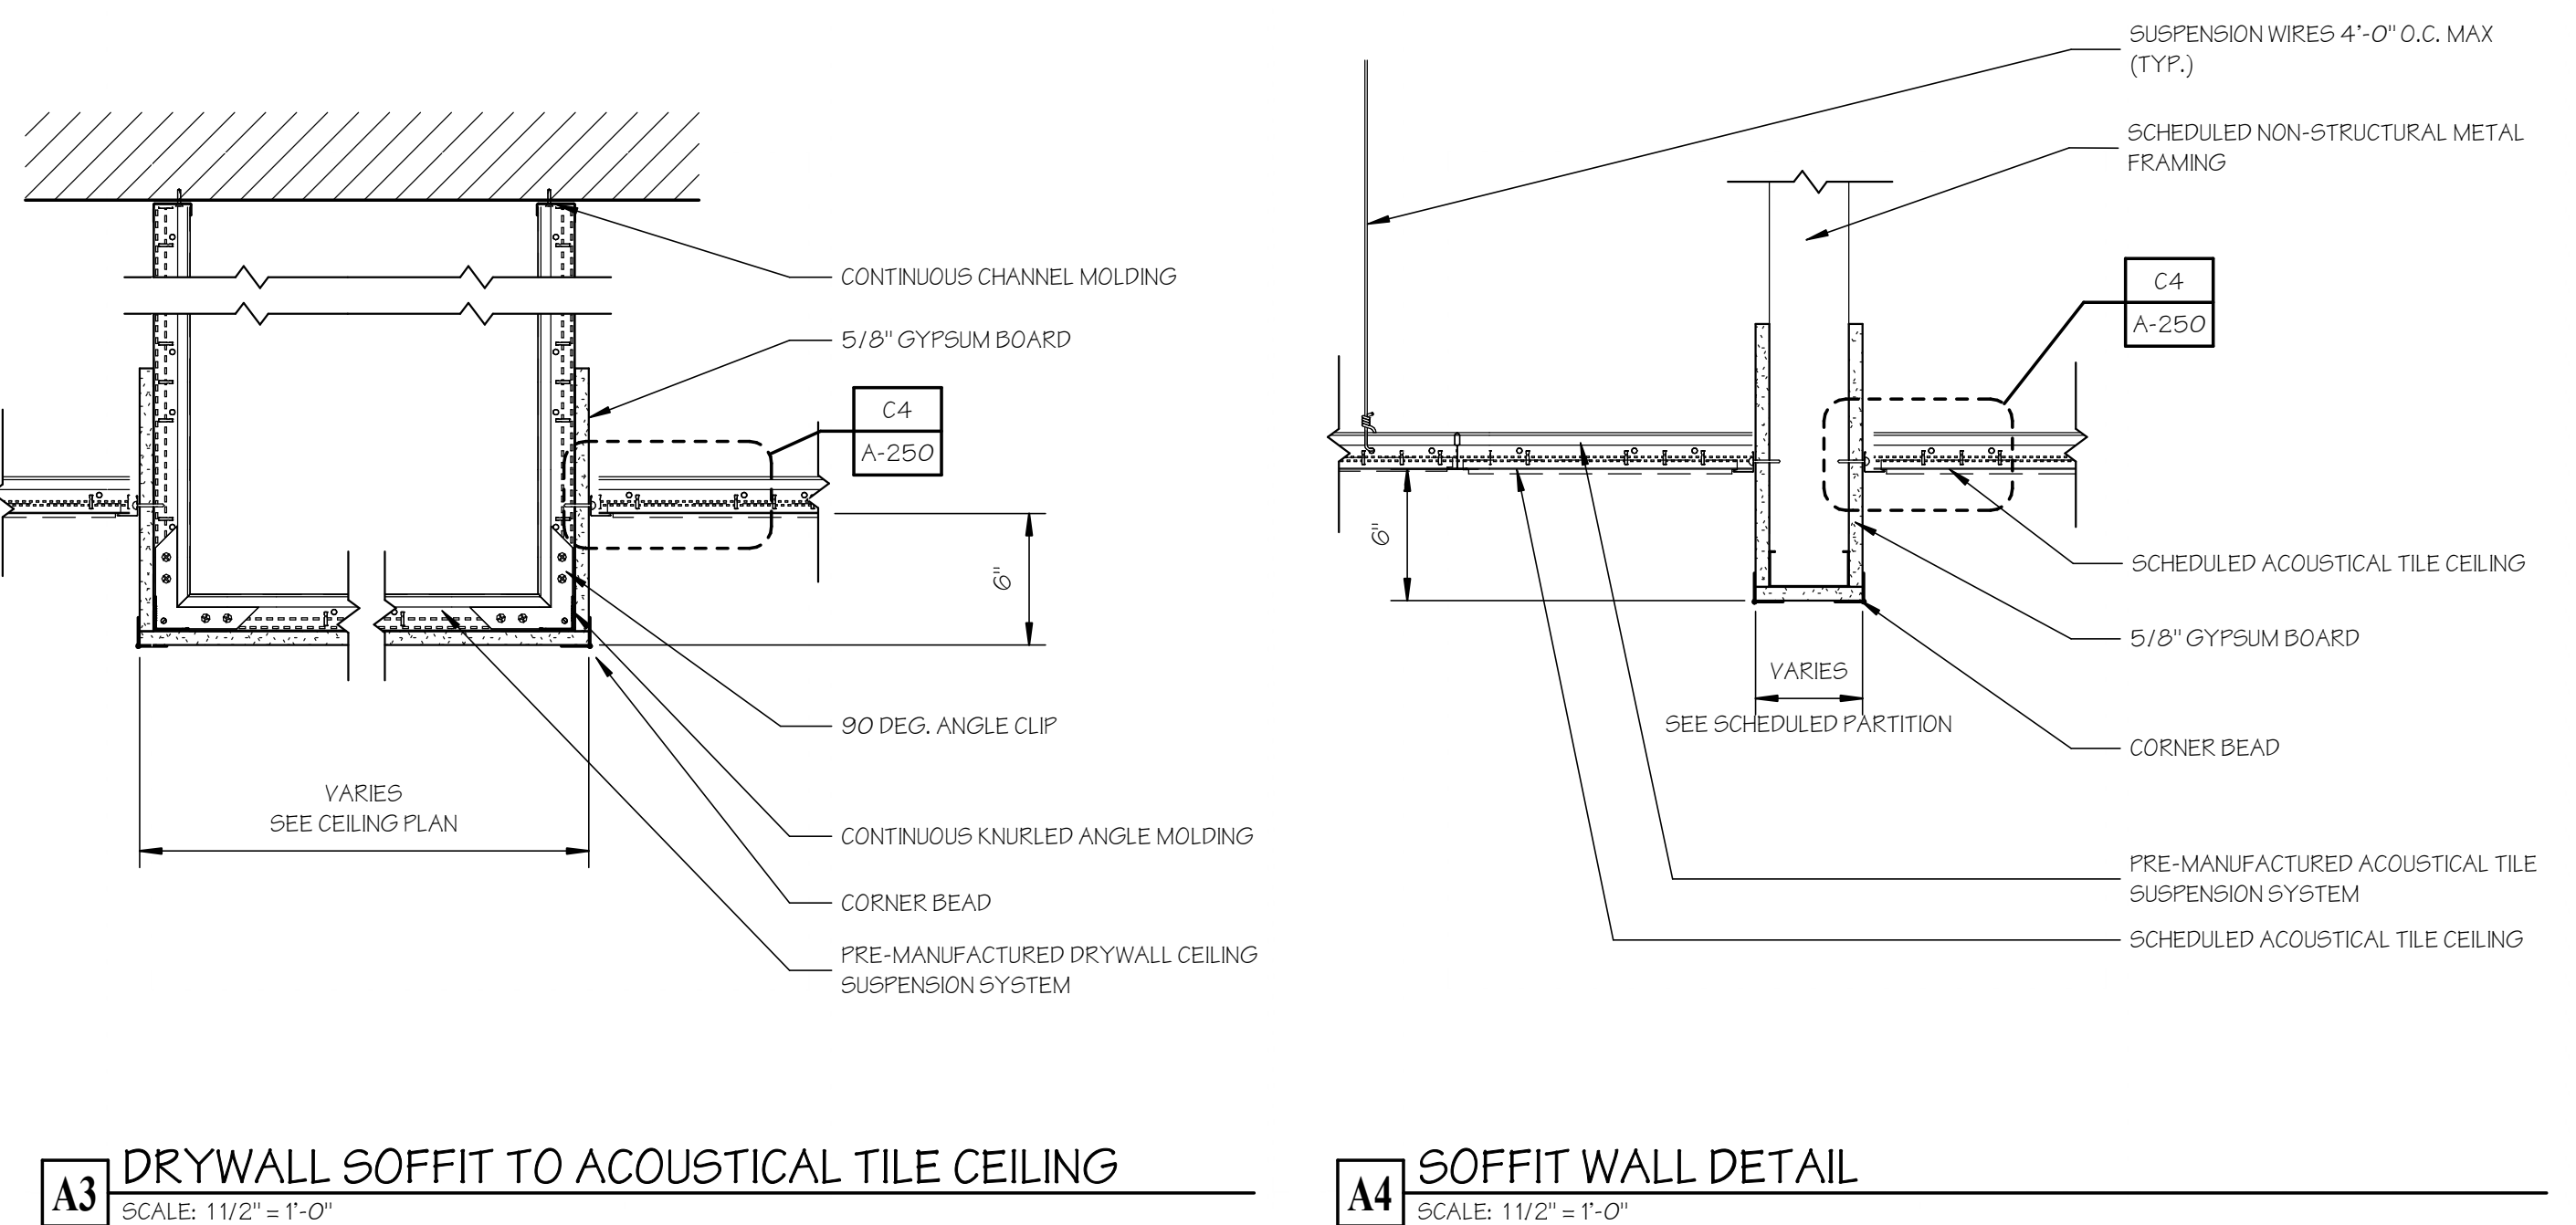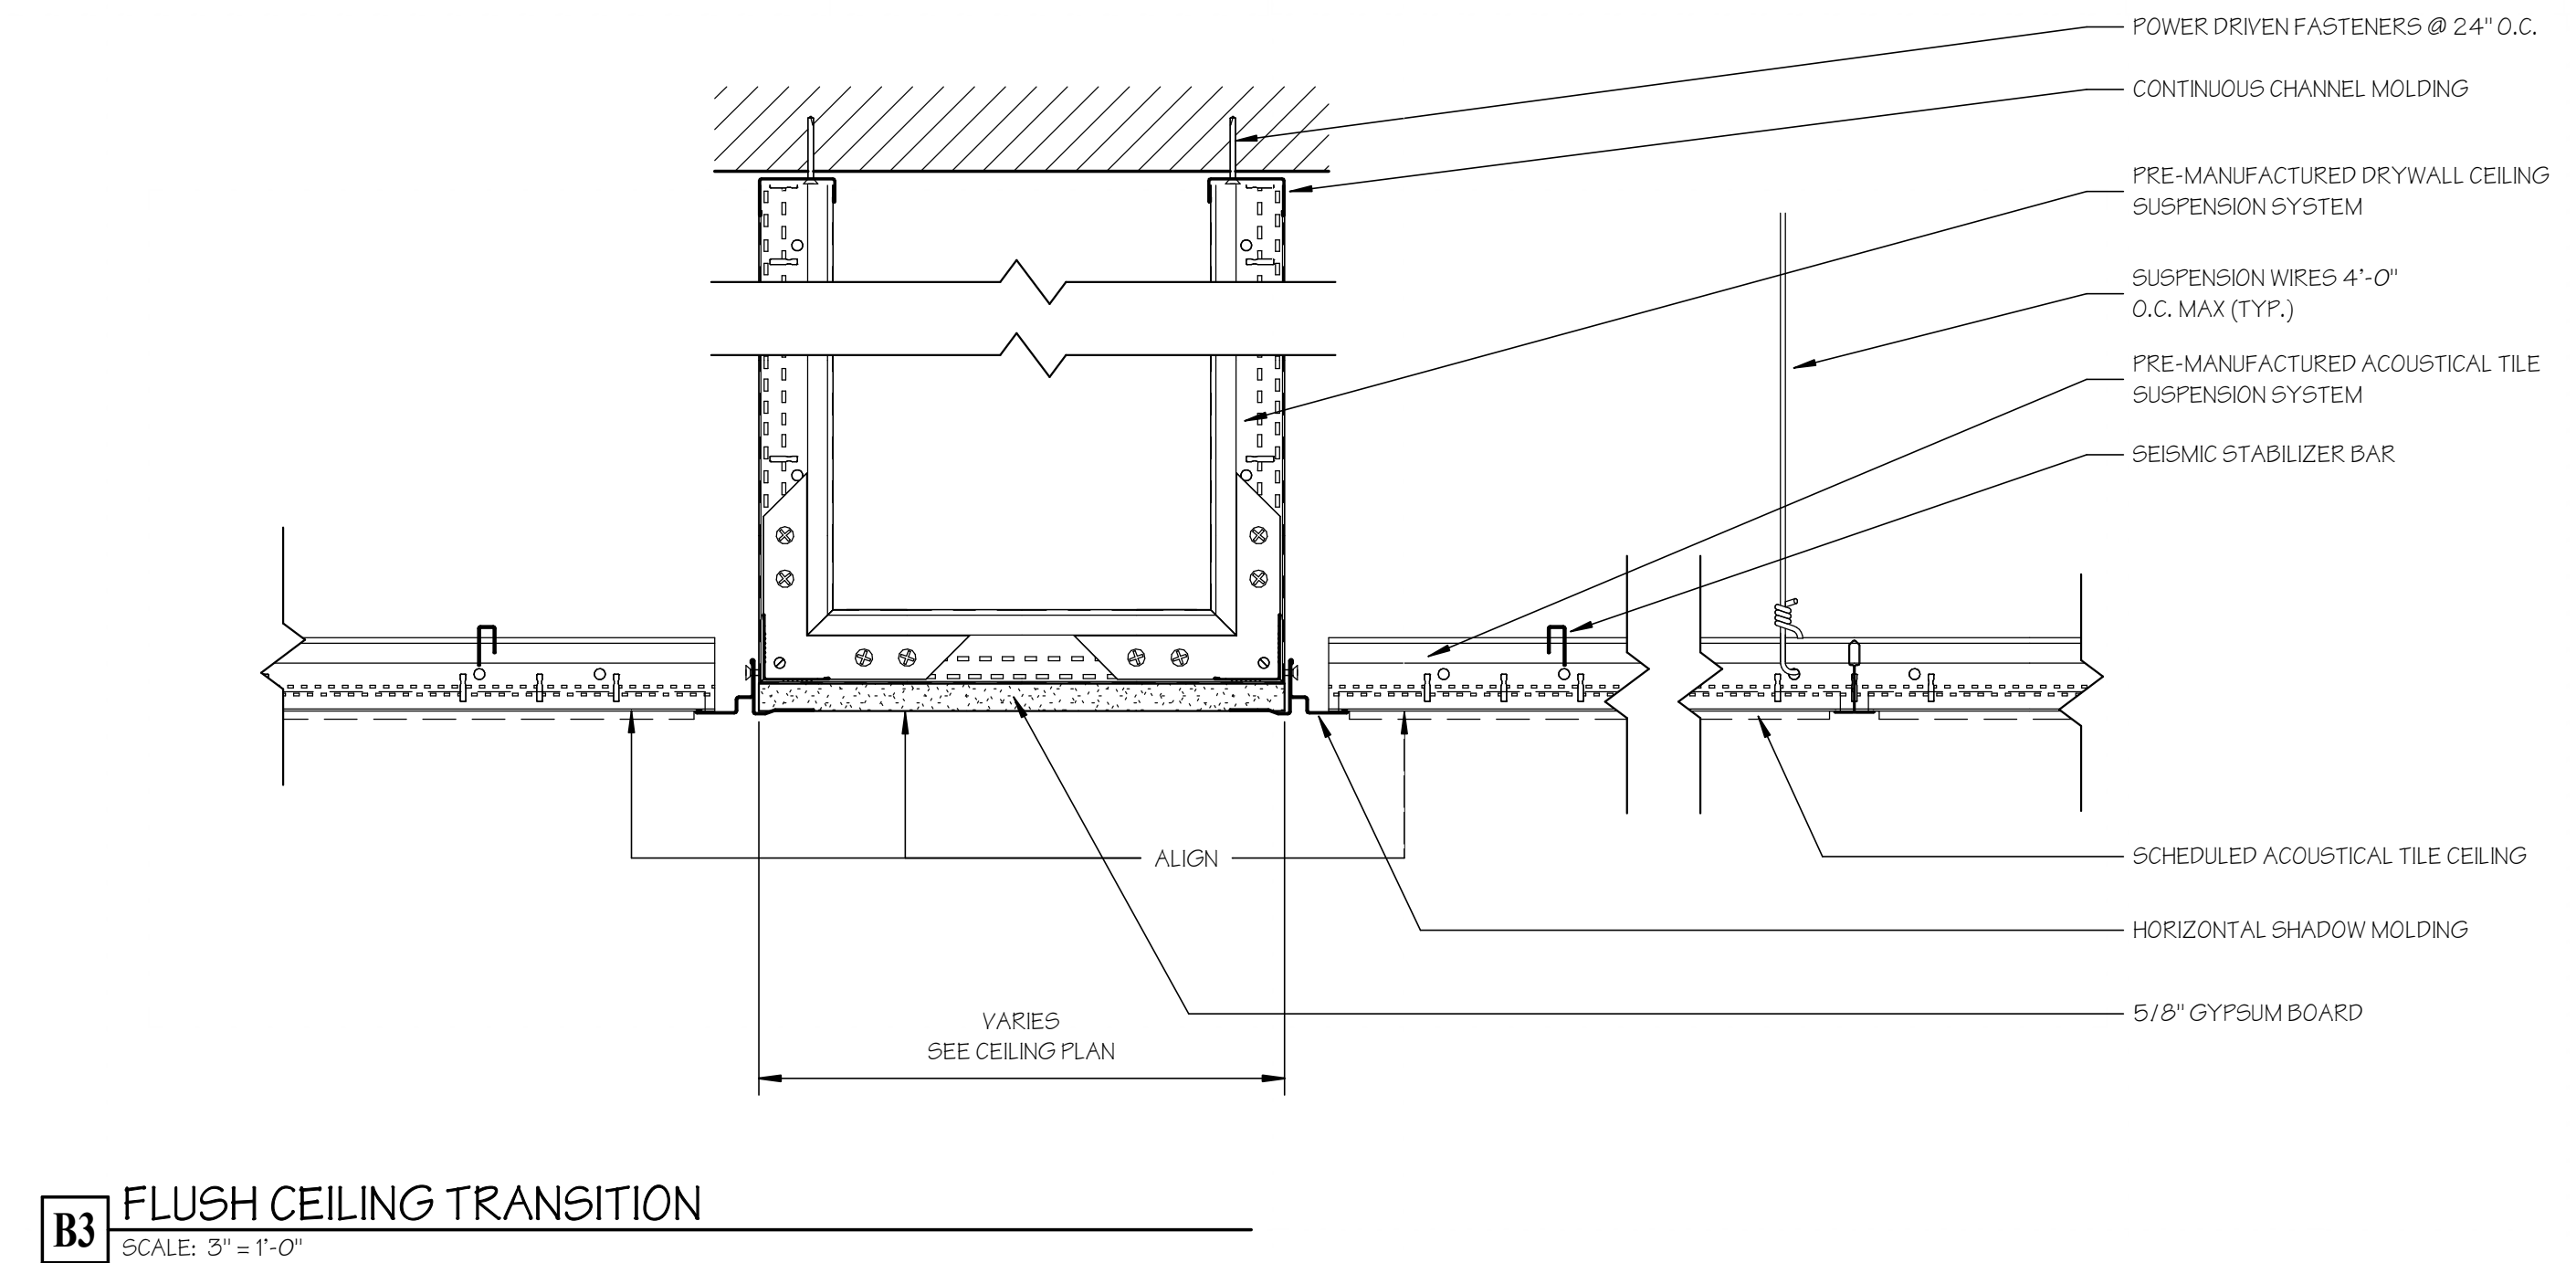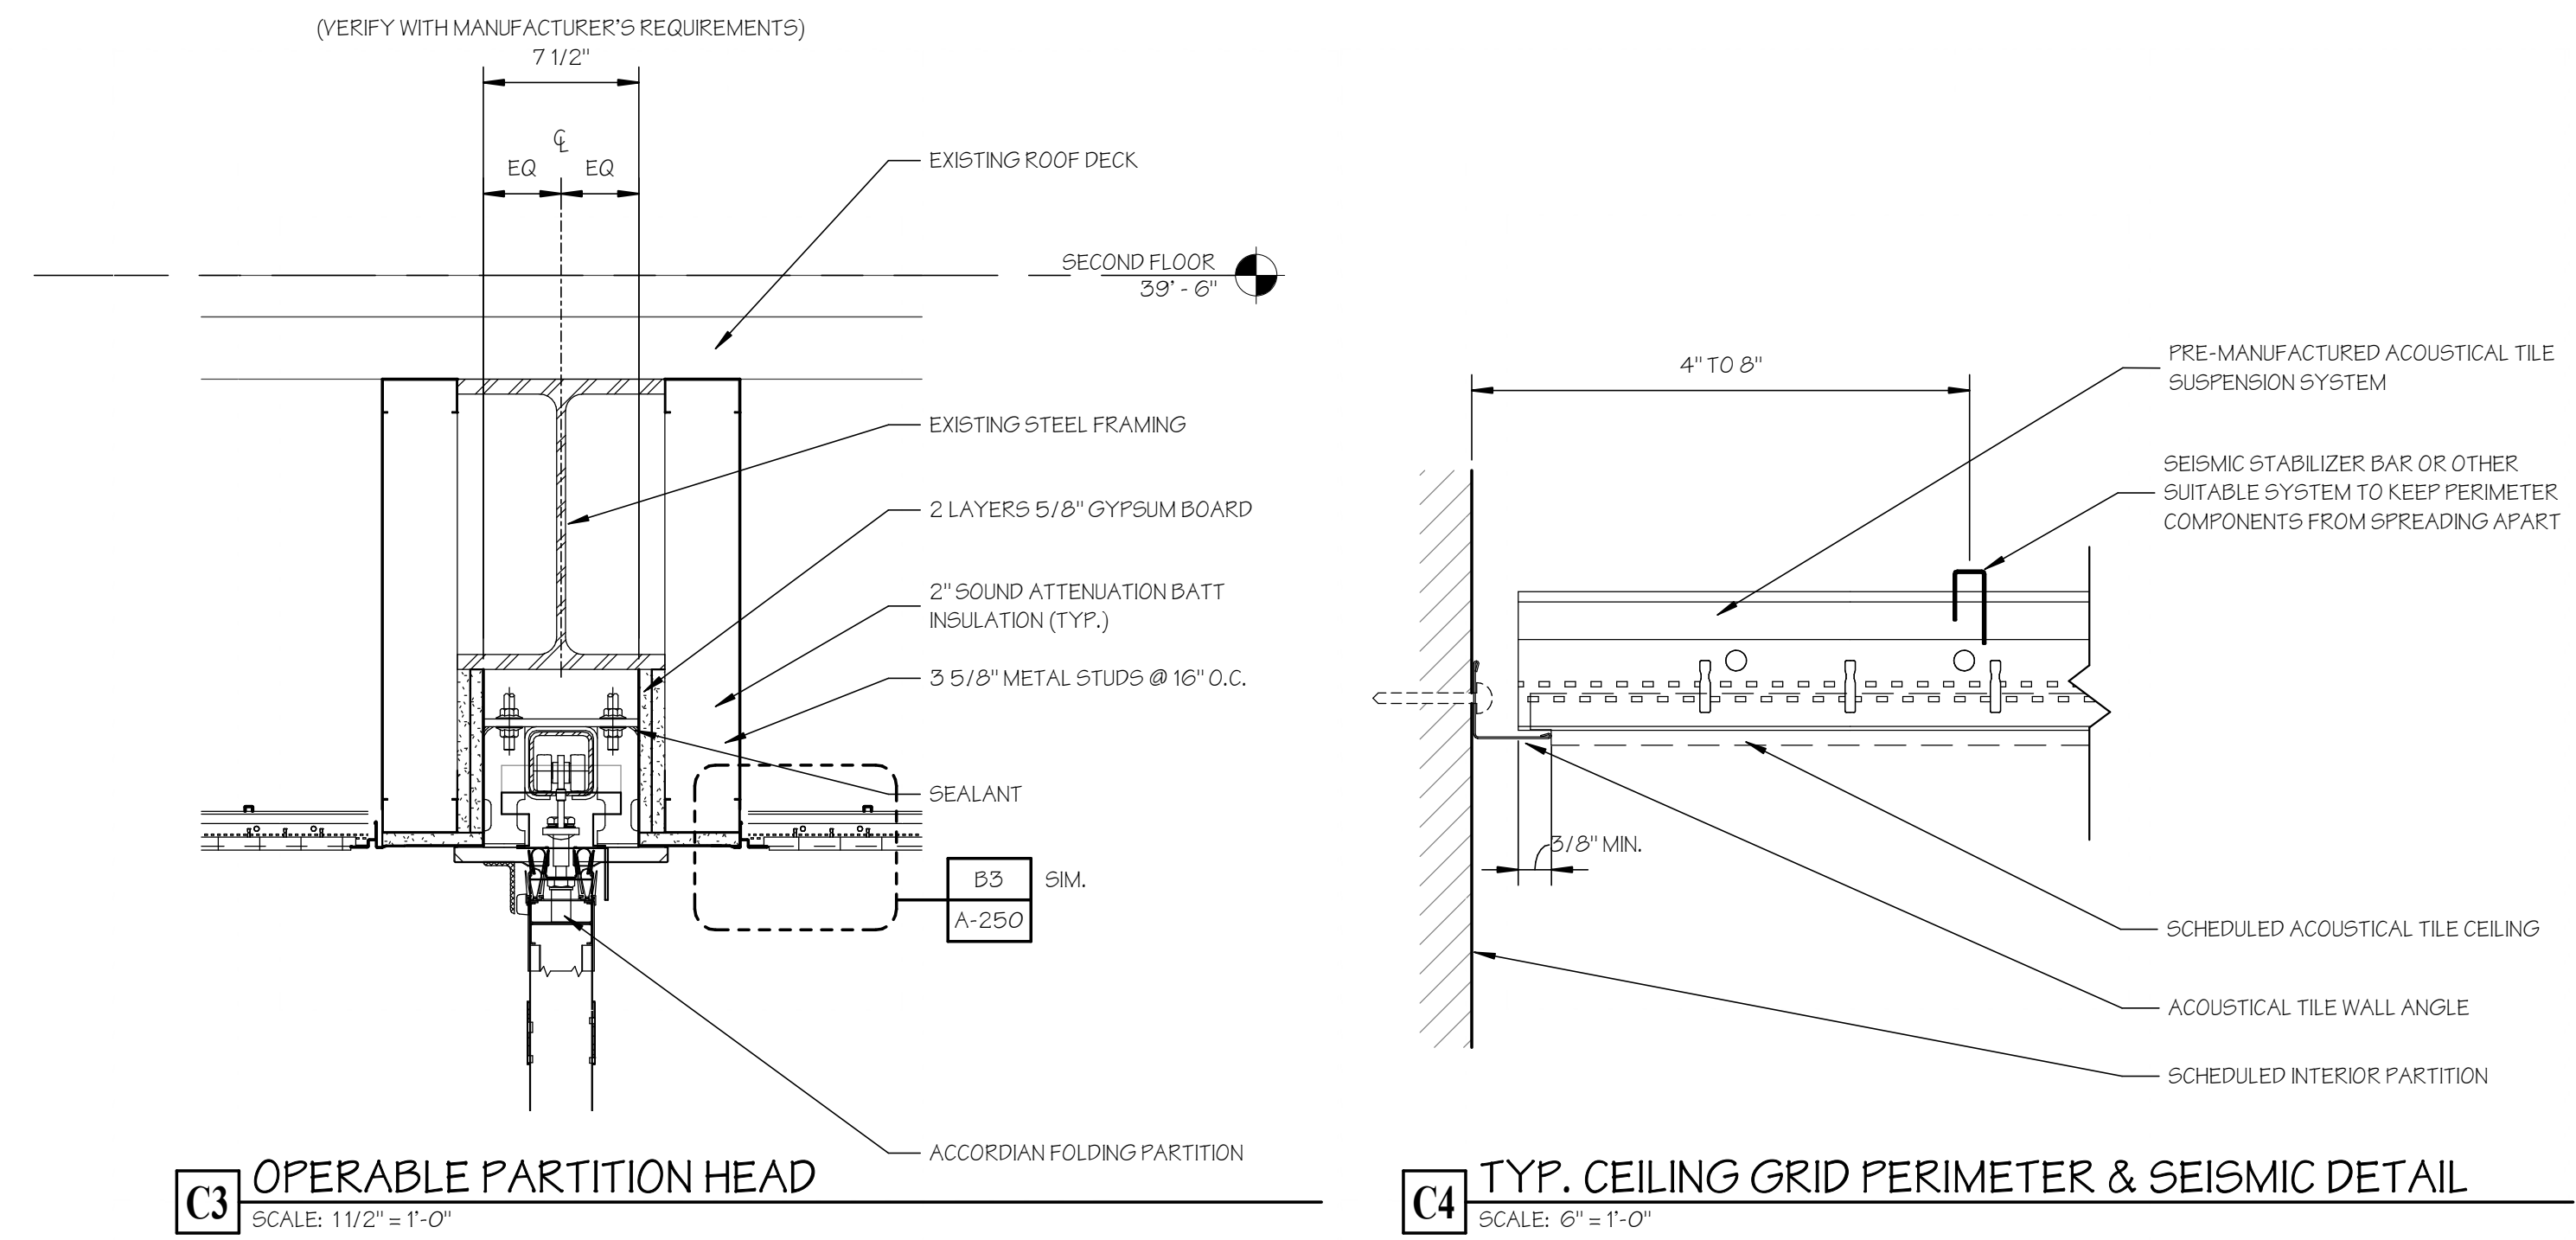



ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

ELEVATION NOTES

- 1 NEW METAL SILL FLASHING AT BASE OF E.I.F.S. FINISH - COLOR TO MATCH EXISTING OPENINGS
- 2 NEW EXTERIOR WALL WITH E.I.F.S. STUCCO FINISH - COLOR T.B.D.
- 3 FLASH E.P.D.M. MEMBRANE ROOFING UP WALL TO METAL COUNTERFLASHING UNDER E.I.F.S. ABOVE
- 4 NEW (2) PART METAL ROOF EDGE FASCIA & TRIM - COLOR TO MATCH EXISTING
- 5 THROUGH WALL SCUPPER & RAIN LEADER TO PRECAST CONCRETE SPLASH BLOCK BELOW
- 6 FLASH E.P.D.M. MEMBRANE ROOFING FROM EXISTING ROOF TO OVER TOP OF WALL ABOVE
- 7 EXISTING TO REMAIN HIDDEN FOR CLARITY
- 8 NEW REPLACEMENT WINDOW WITH INSULATED LOW-E GLASS & THERMALLY BROKEN FRAME IN FIXED DOUBLE-HUNG LOOK UNITS AND/OR PICTURE UNITS TO MATCH APPEARANCE AND DIMENSIONS OF EXISTING WINDOW
- 11 CM TO REVIEW EXISTING MASONRY WITH CONTRACTOR, OWNER & ARCHITECT TO DETERMINE SCOPE OF NEEDED REPAIRS. FOR BID ASSUME AREA AS SHOWN. PROVIDE UNIT & QTY PRICE FOR REPOINTING, REMOVE AND REPLACE BRICK, REPLACING SEALANT IN CONTROL JOINTS AND EXPANSION JOINTS (L.F) REPAIR/ REPLACEMENT OF ANY FLASHING AND OR OTHER MASONRY ACCESSORIES.

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 955-5460 www.antinozzi.com


These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:


**BID SET**  
 31 JANUARY 2020  
 FOR CONSTRUCTION  
 04.16.2020 - CM BID

REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

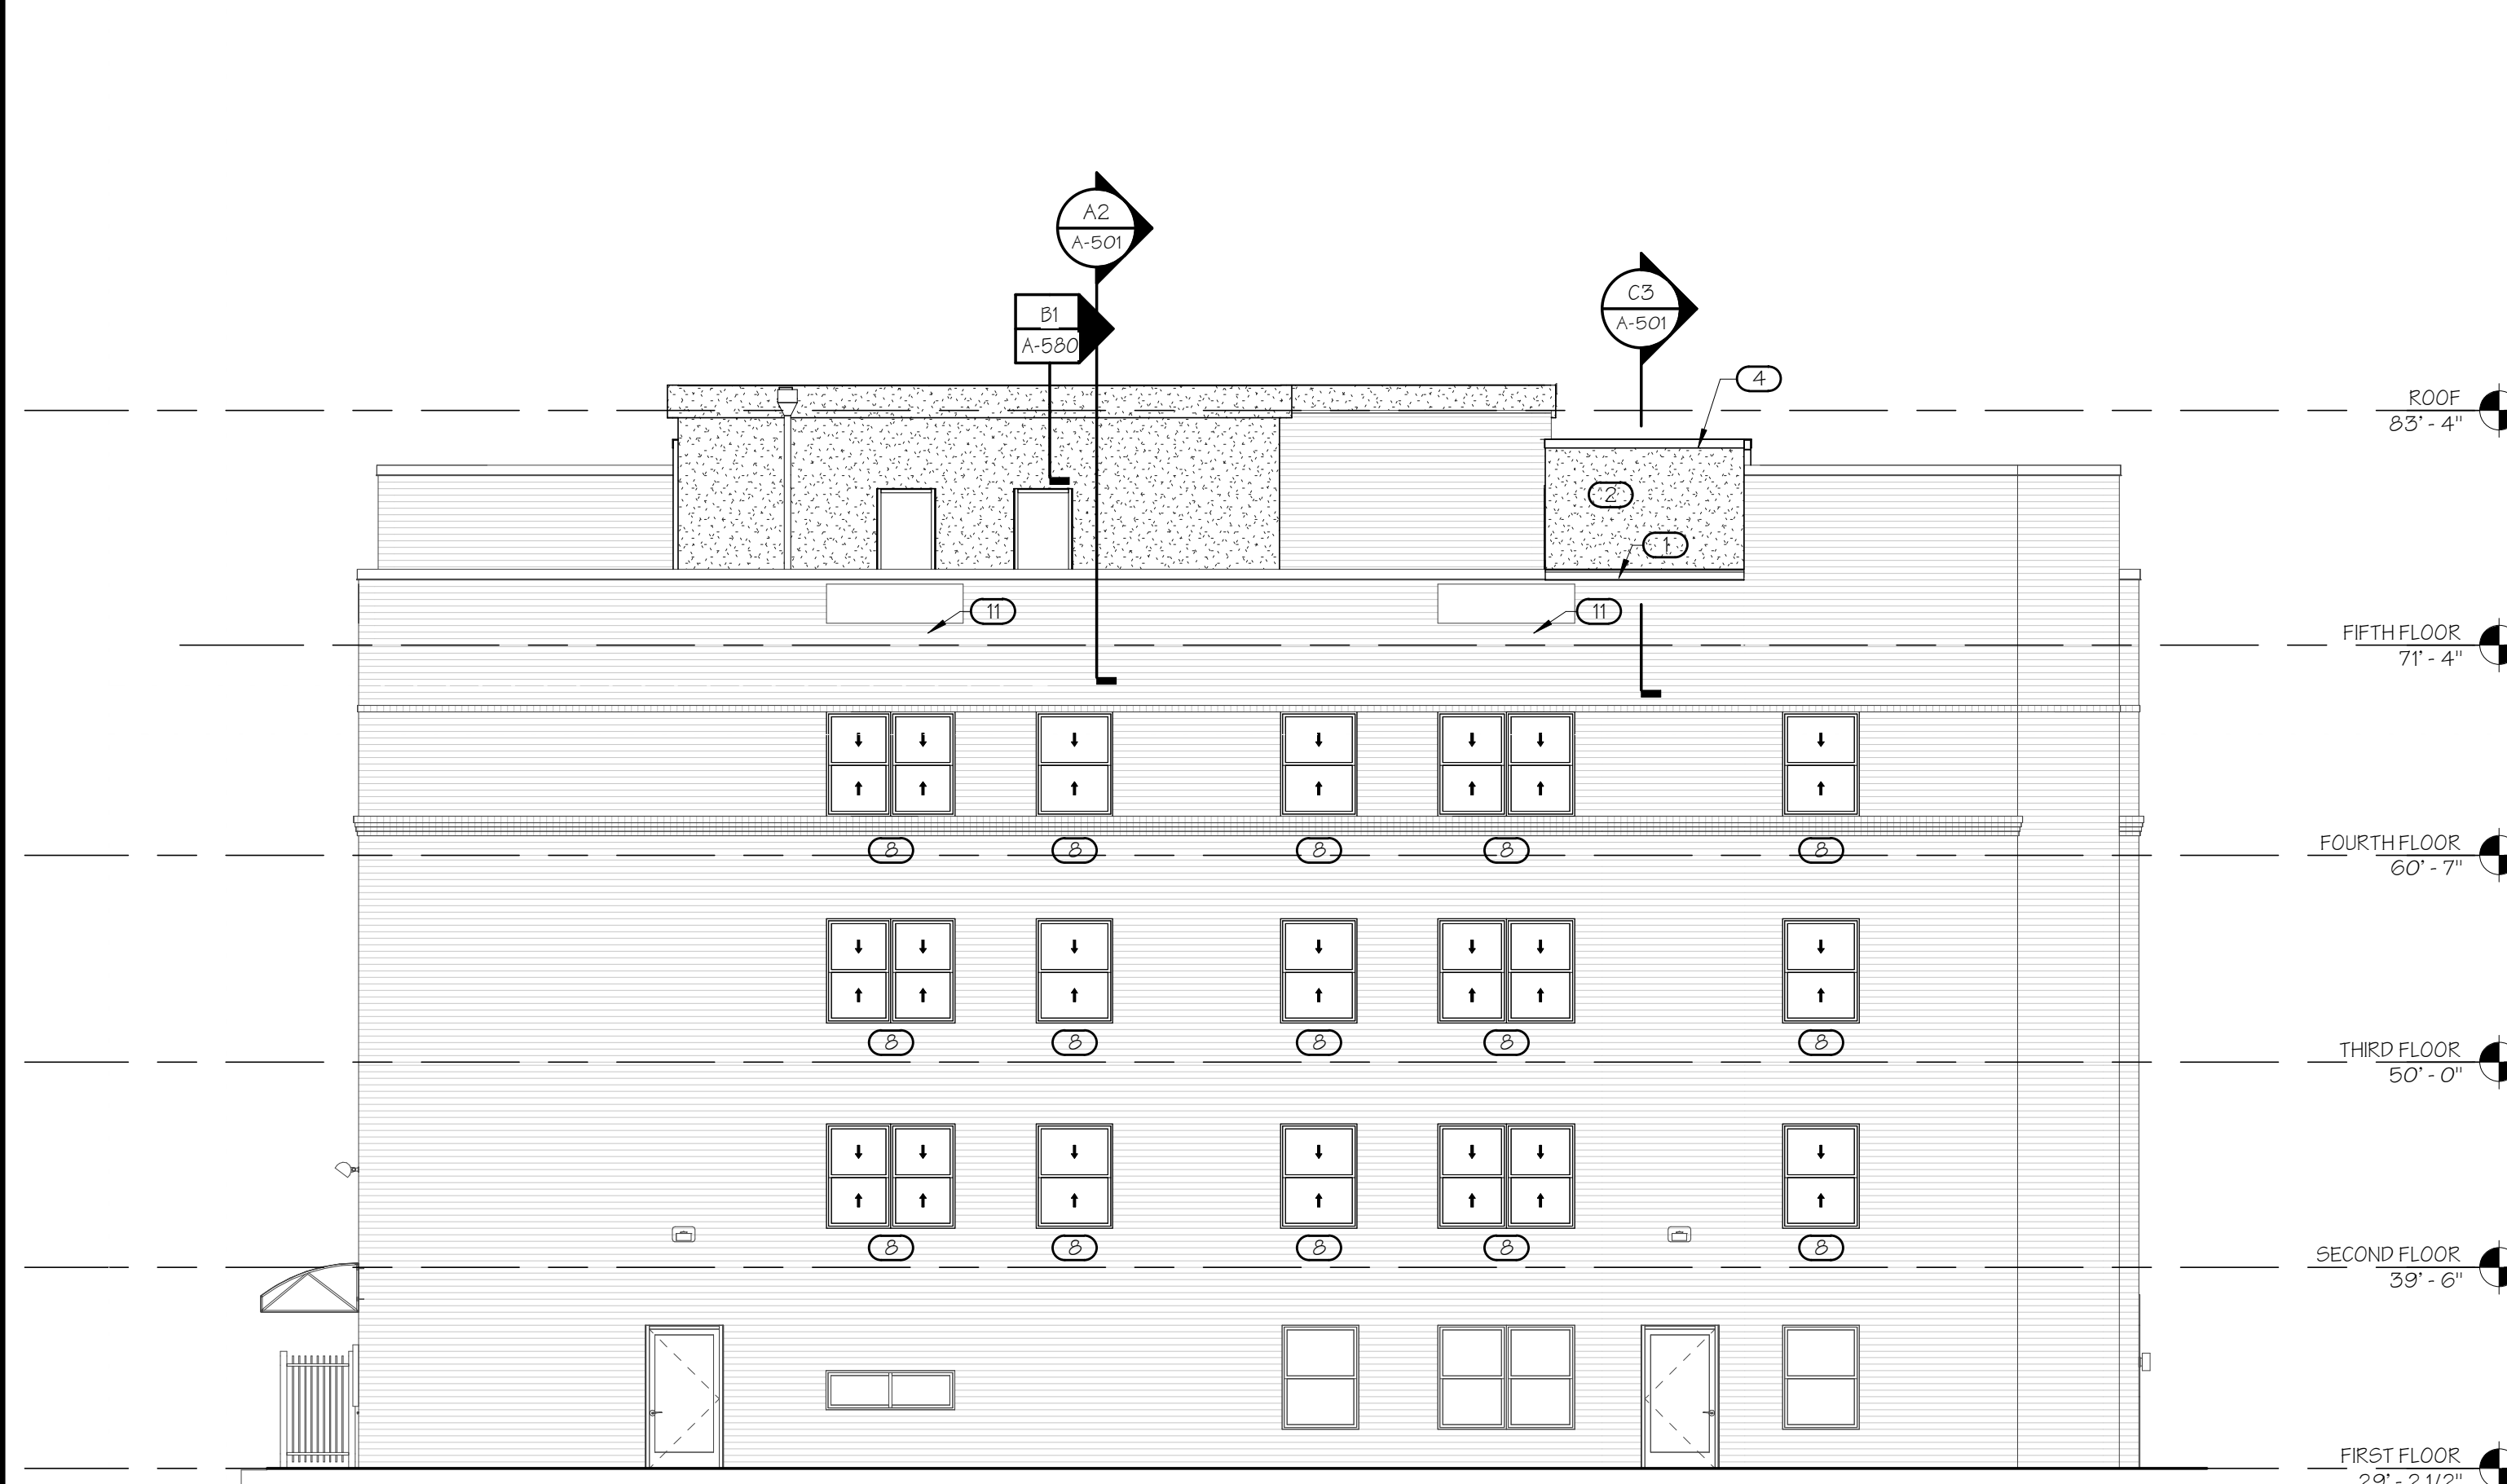


**C1** EXTERIOR ELEVATION - SOUTH  
SCALE: 1/8" = 1'-0"

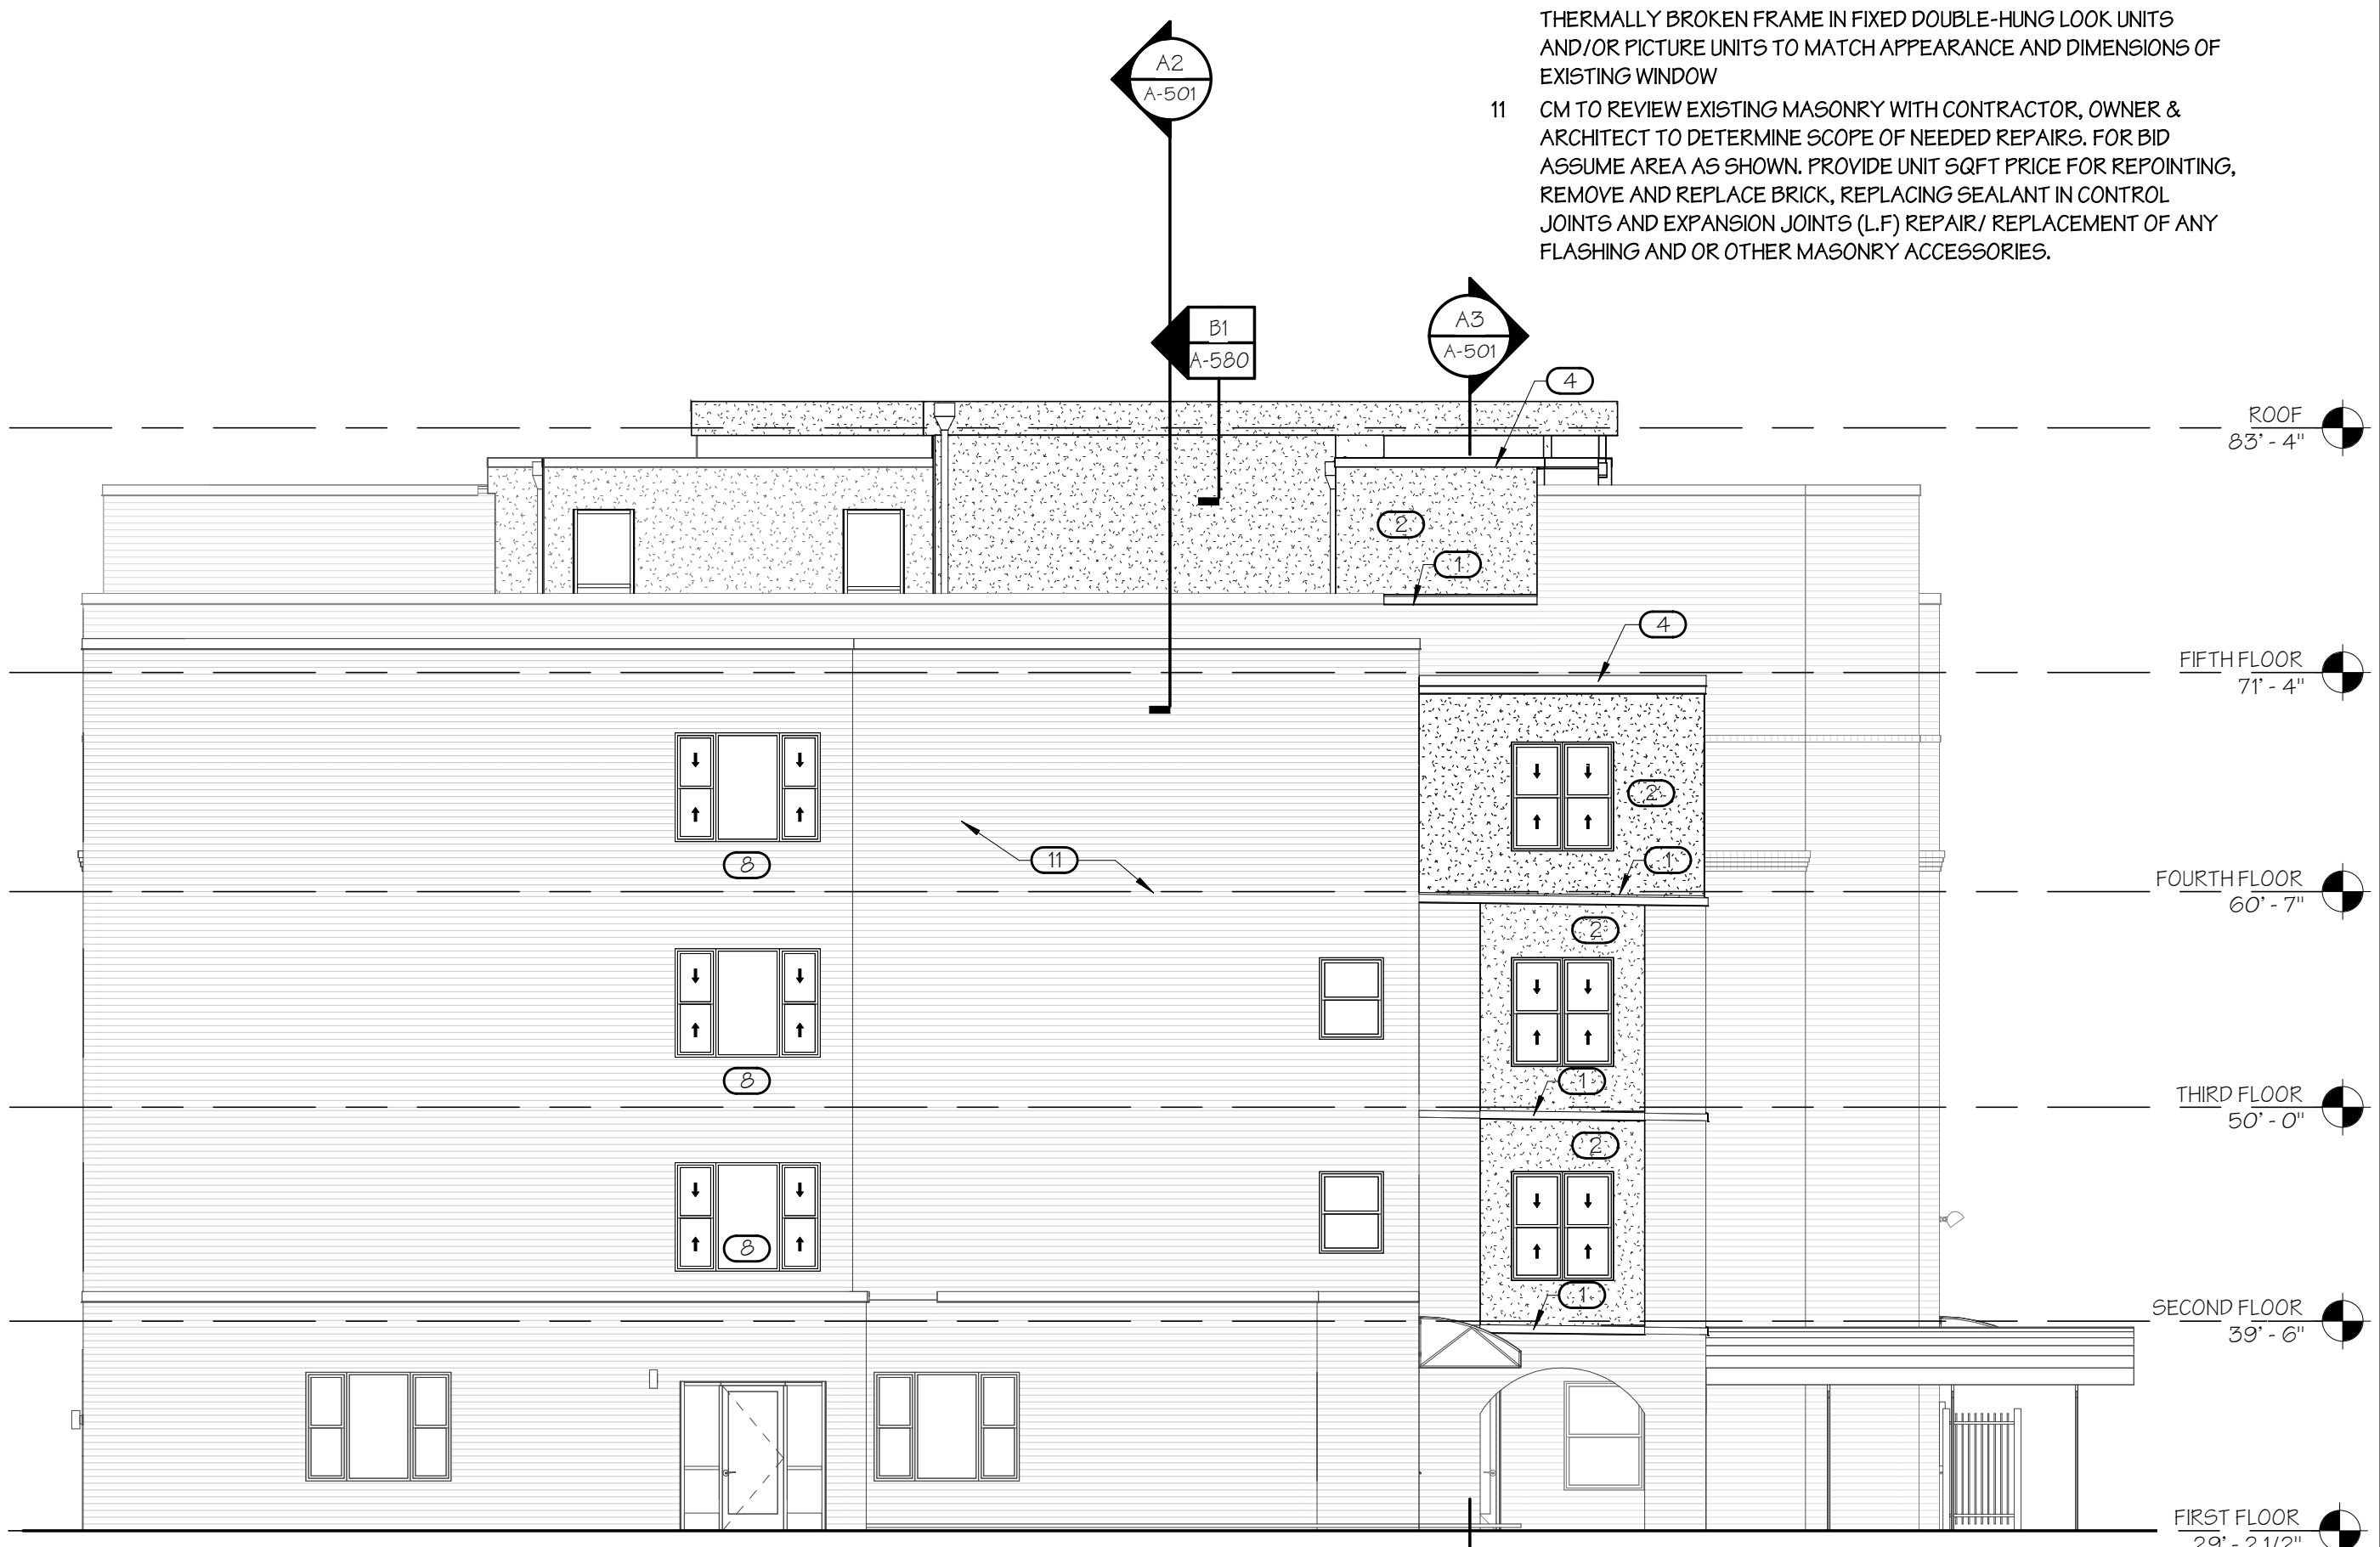

**B2** EXTERIOR ELEVATION - NORTH  
SCALE: 1/8" = 1'-0"



**A1** EXTERIOR ELEVATION - WEST  
SCALE: 1/8" = 1'-0"

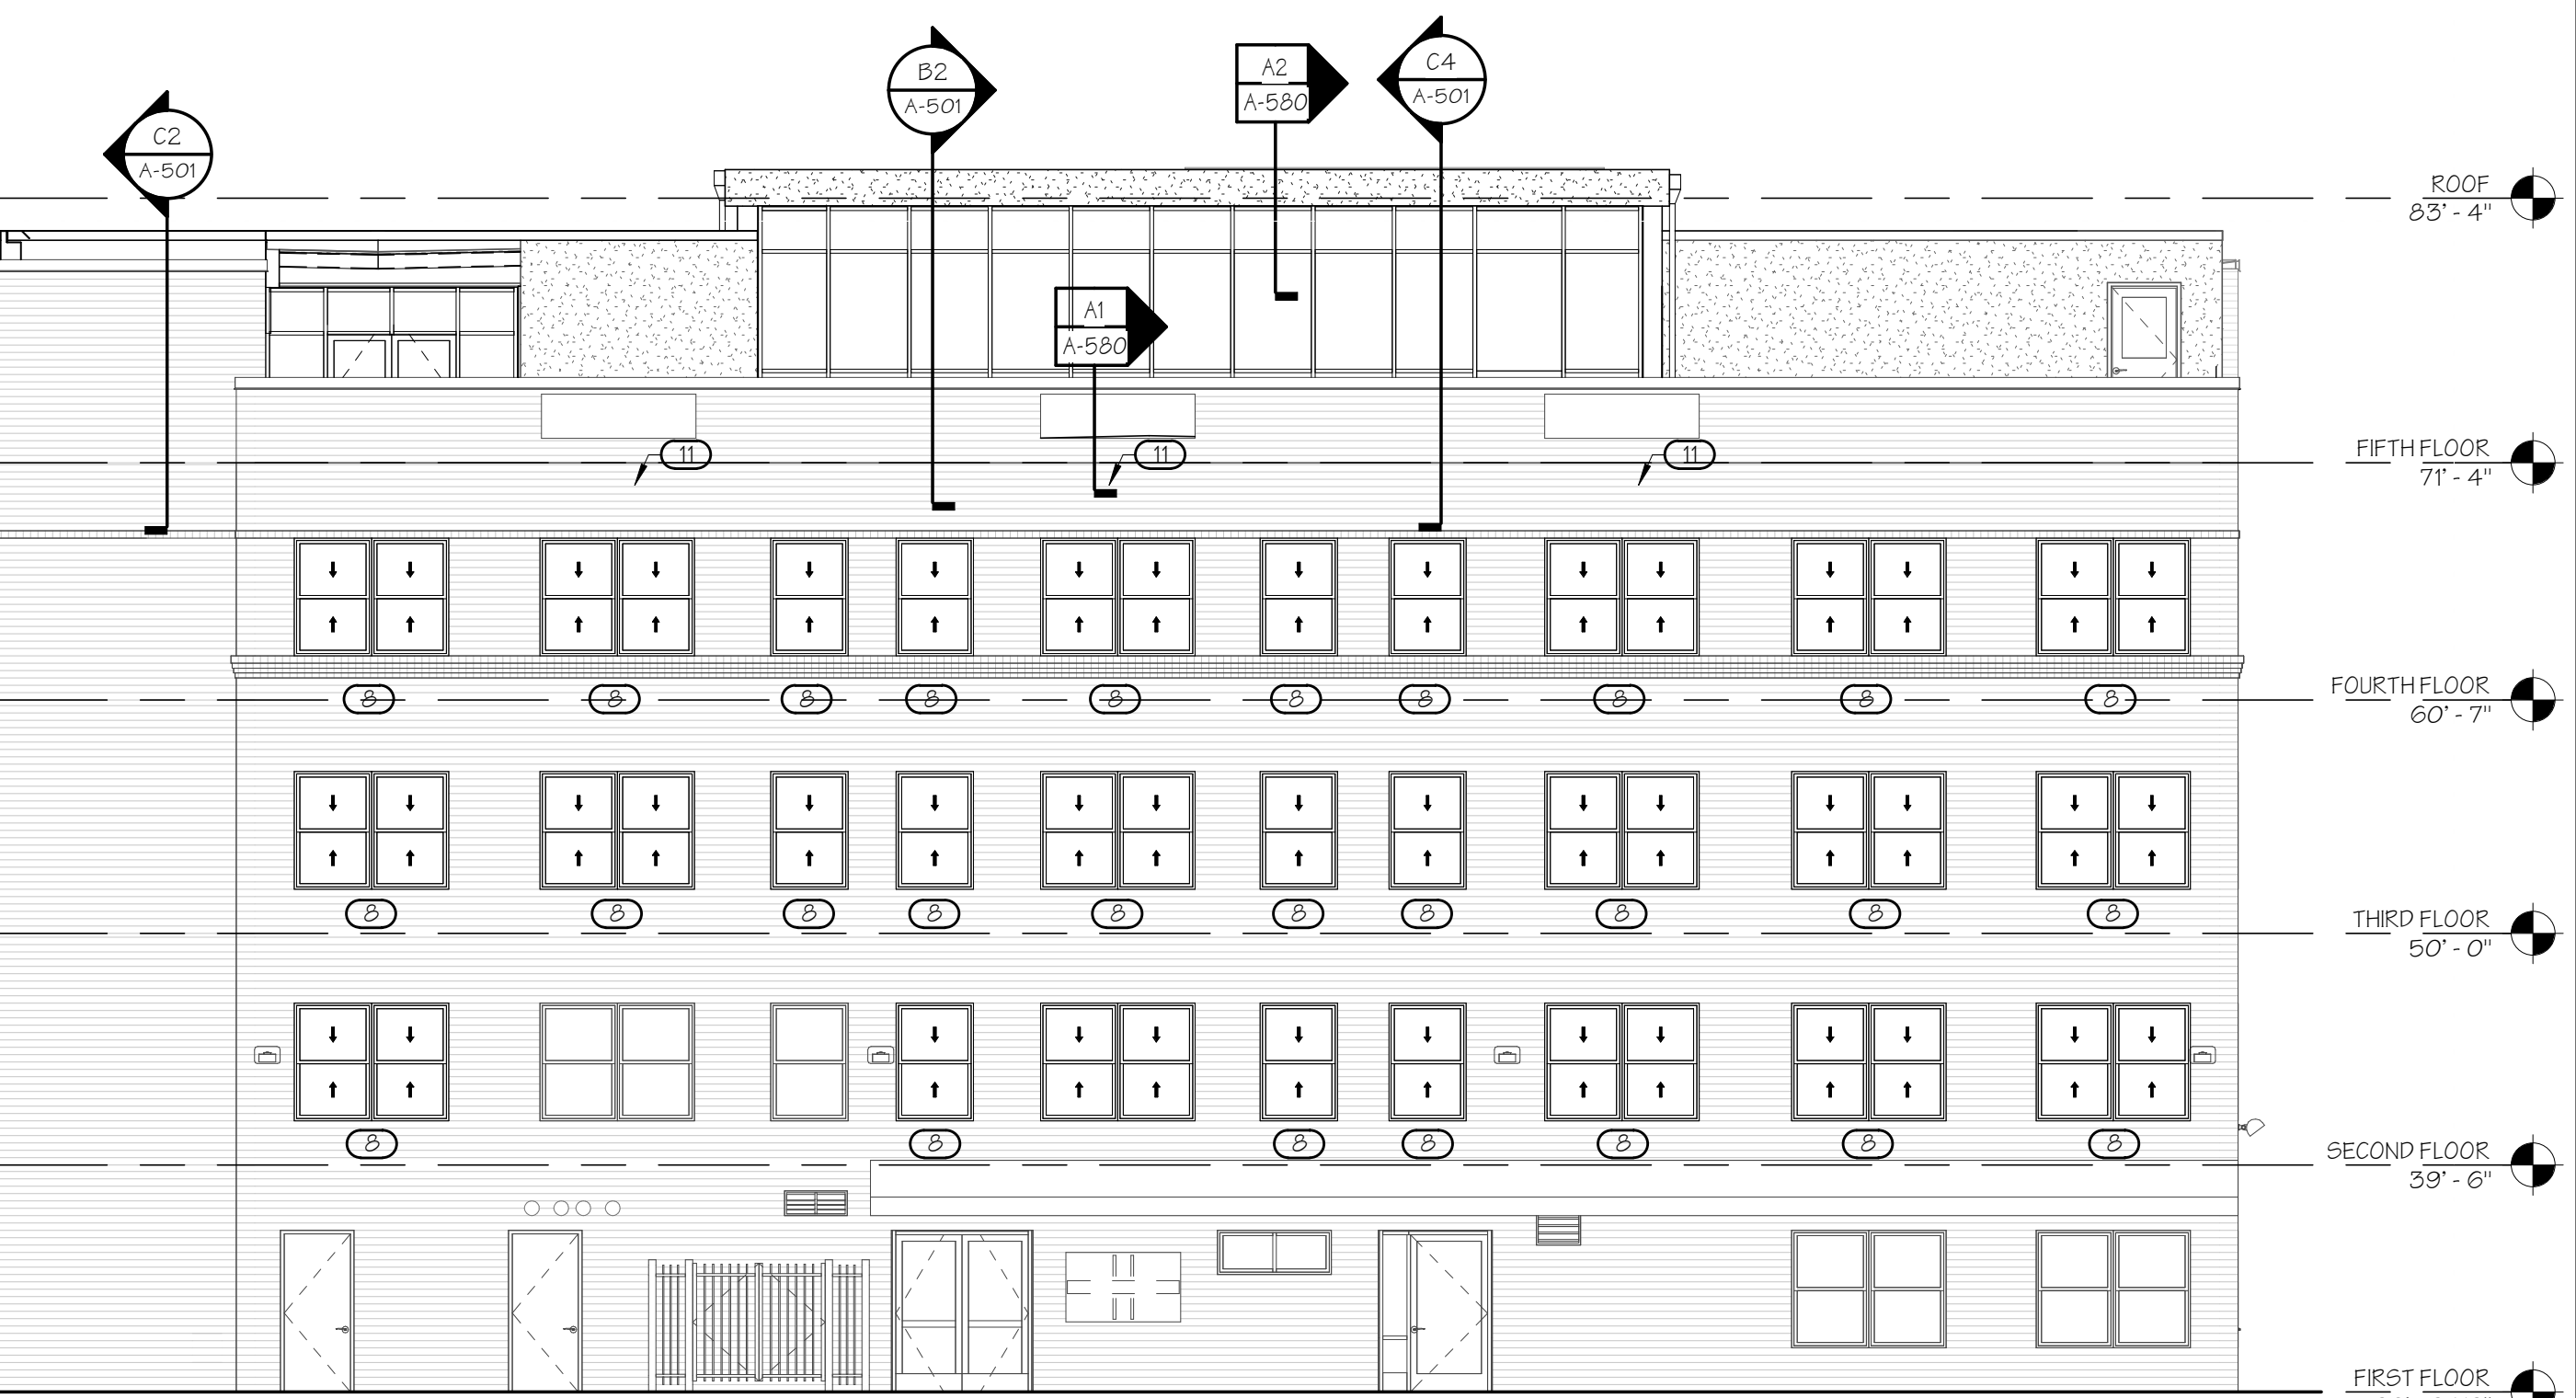

**JOEL SMILOW CARE CENTER**  
**BRIDGEPORT RESCUE MISSION**  
 PHASE II: INTERIOR RENOVATIONS  
 & NEW CONSTRUCTION  
 725 PARK AVENUE  
 BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
EXTERIOR ELEVATIONS

SCALE: 1/8" = 1'-0" DRAWN BY: KWG REVIEWED BY: DCF

DRAWING NO. A-301

04.16.2020 - CM BID

DATE: 31 JANUARY 2020 JOB NUMBER: 18052

2/27/2020 1:07:18 PM  
 C:\Users\rosehaind\OneDrive\Documents\18052\_Bridgeport\_Rescue\_Mission\_Phase 2\_Architecture\_rosehaind.rvt



ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

### ELEVATION NOTES

- 1 NEW METAL SILL FLASHING AT BASE OF E.L.F.S. FINISH - COLOR TO MATCH EXISTING OPENINGS
- 2 NEW EXTERIOR WALL WITH E.L.F.S. STUCCO FINISH - COLOR T.B.D.
- 3 FLASH E.P.D.M. MEMBRANE ROOFING UP WALL TO METAL COUNTERFLASHING UNDER E.L.F.S. ABOVE
- 4 NEW (2) PART METAL ROOF EDGE FASCIA & TRIM - COLOR TO MATCH EXISTING
- 5 THROUGH WALL SCUPPER & RAIN LEADER TO PRECAST CONCRETE SPLASH BLOCK BELOW
- 6 FLASH E.P.D.M. MEMBRANE ROOFING FROM EXISTING ROOF TO OVER TOP OF WALL ABOVE
- 7 EXISTING TO REMAIN HIDDEN FOR CLARITY
- 8 NEW REPLACEMENT WINDOW WITH INSULATED LOW-E GLASS & THERMALLY BROKEN FRAME IN FIXED DOUBLE-HUNG LOOK UNITS AND/OR PICTURE UNITS TO MATCH APPEARANCE AND DIMENSIONS OF EXISTING WINDOW
- 11 CM TO REVIEW EXISTING MASONRY WITH CONTRACTOR, OWNER & ARCHITECT TO DETERMINE SCOPE OF NEEDED REPAIRS. FOR BID ASSUME AREA AS SHOWN. PROVIDE UNIT & QFT PRICE FOR REPOINTING, REMOVE AND REPLACE BRICK, REPLACING SEALANT IN CONTROL JOINTS AND EXPANSION JOINTS (L.F) REPAIR/ REPLACEMENT OF ANY FLASHING AND OR OTHER MASONRY ACCESSORIES.

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgewater, CT  
Tel: (203) 377-1300  
Tel: (203) 378-3002

301 Merritt 7  
Newark, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com


These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:


**BID SET**  
31 JANUARY 2020  
04.16.2020 - CM BID

### REVISIONS


NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

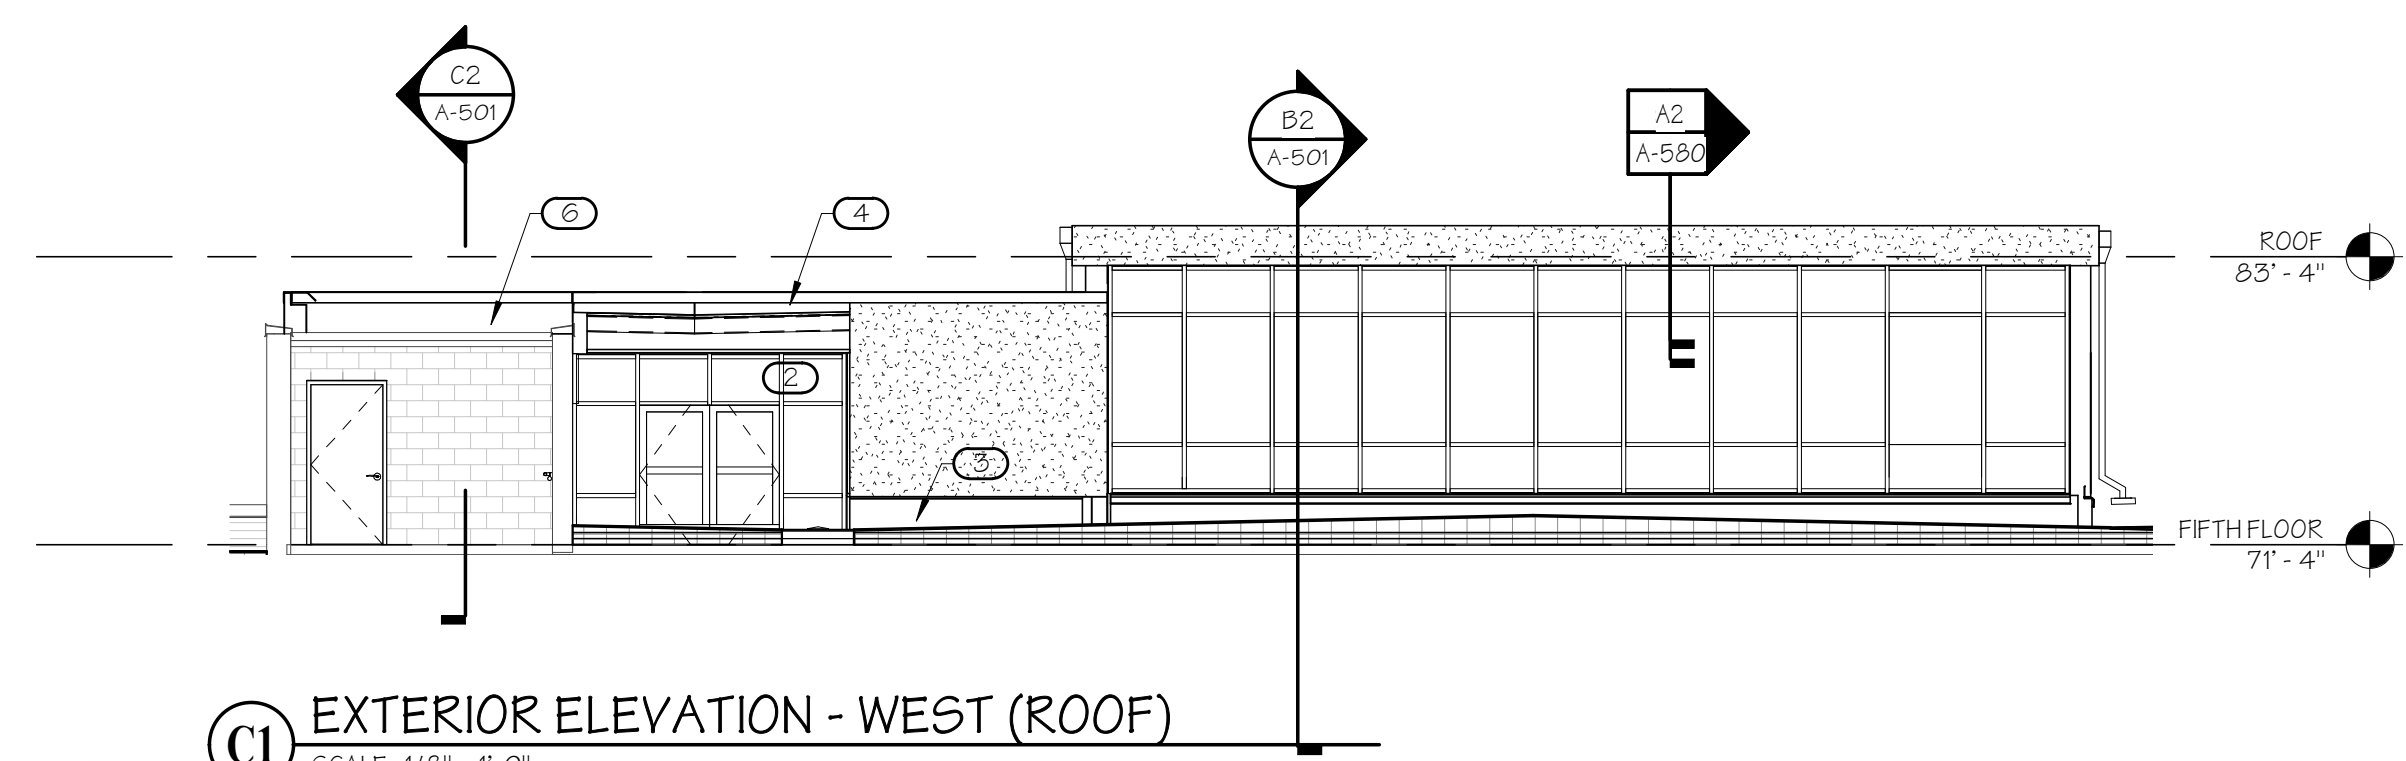


**C1** EXTERIOR ELEVATION - WEST (ROOF)  
SCALE: 1/8" = 1'-0"

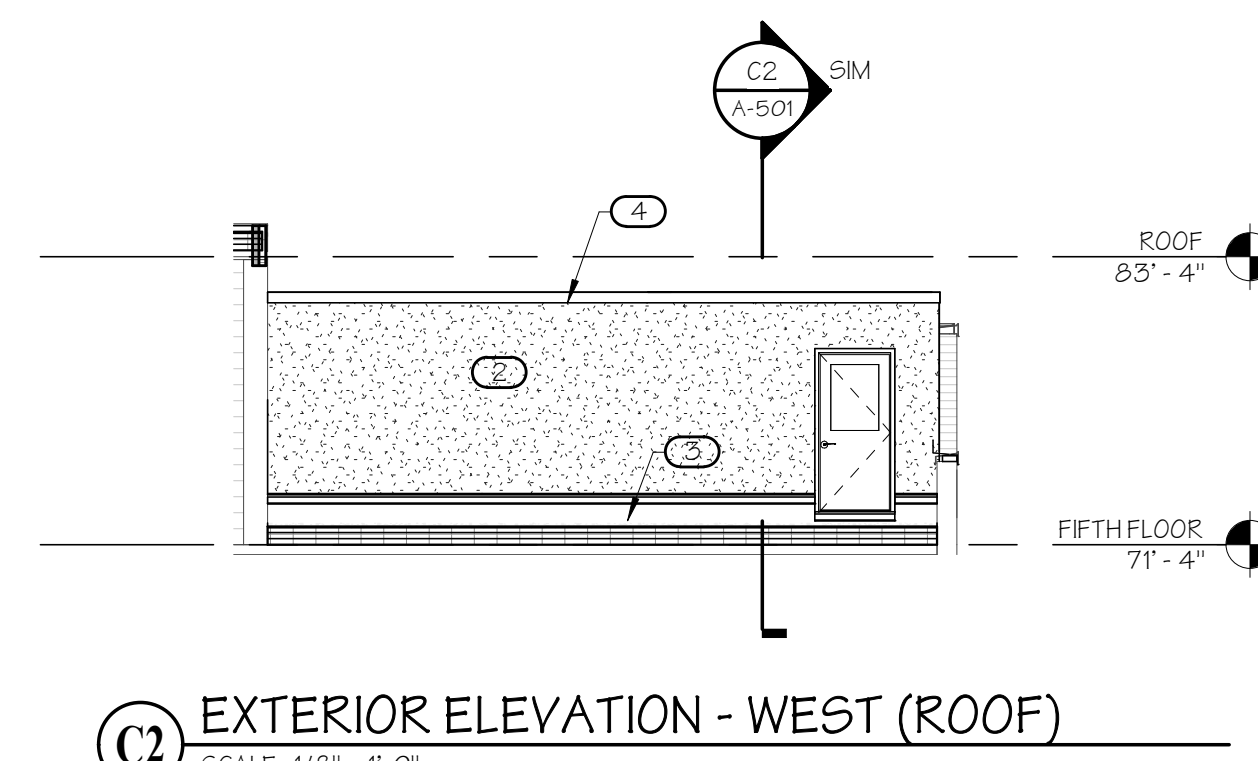

**C2** EXTERIOR ELEVATION - WEST (ROOF)  
SCALE: 1/8" = 1'-0"

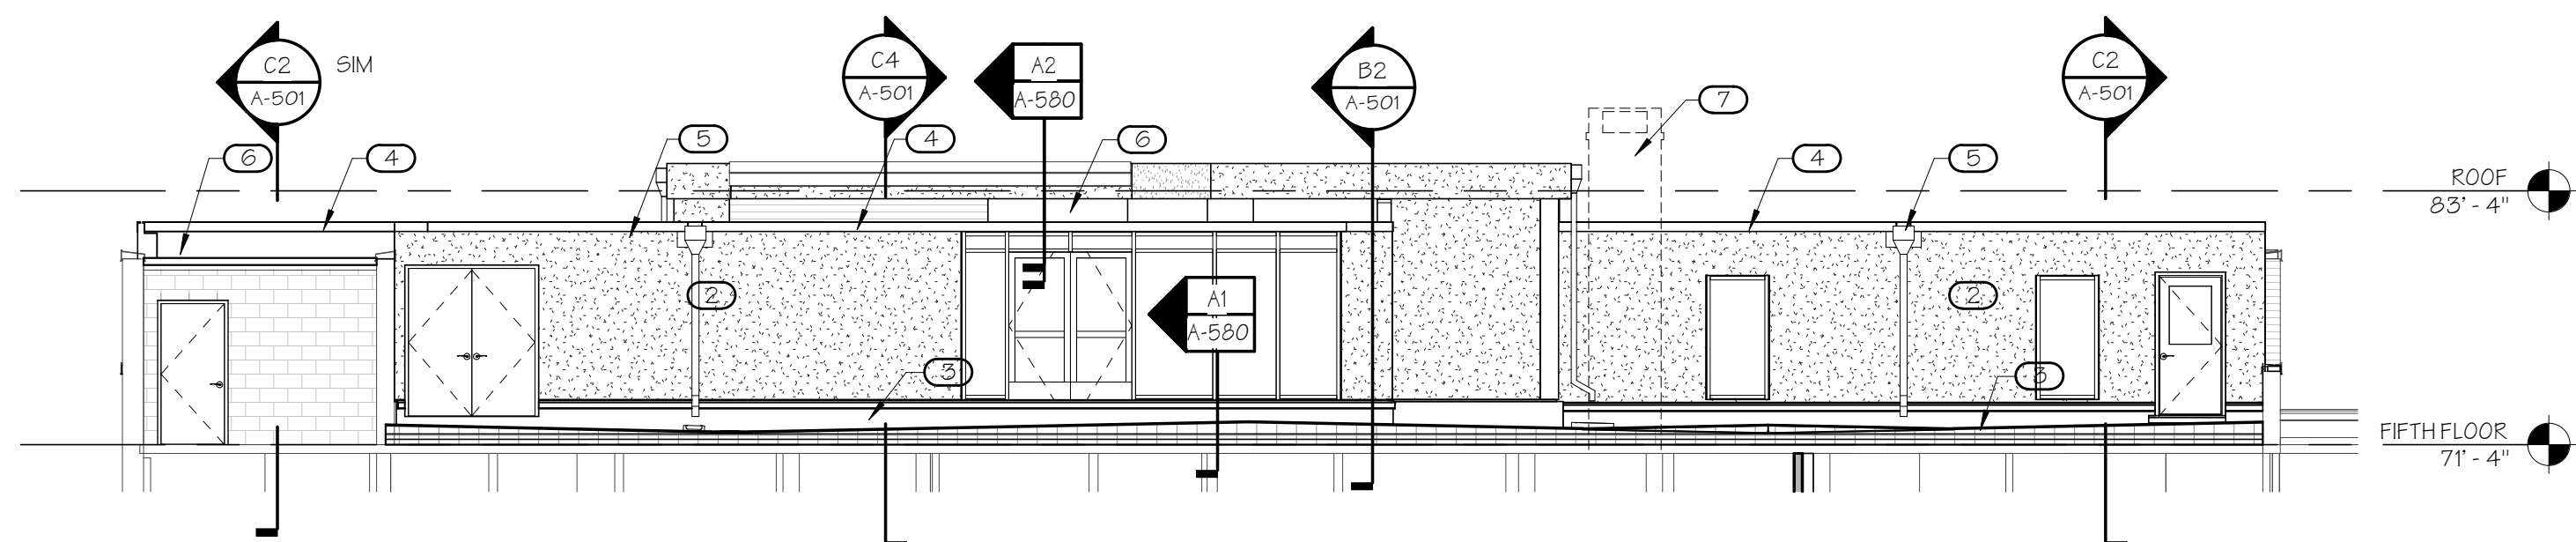

**B1** EXTERIOR ELEVATION - EAST (ROOF)  
SCALE: 1/8" = 1'-0"

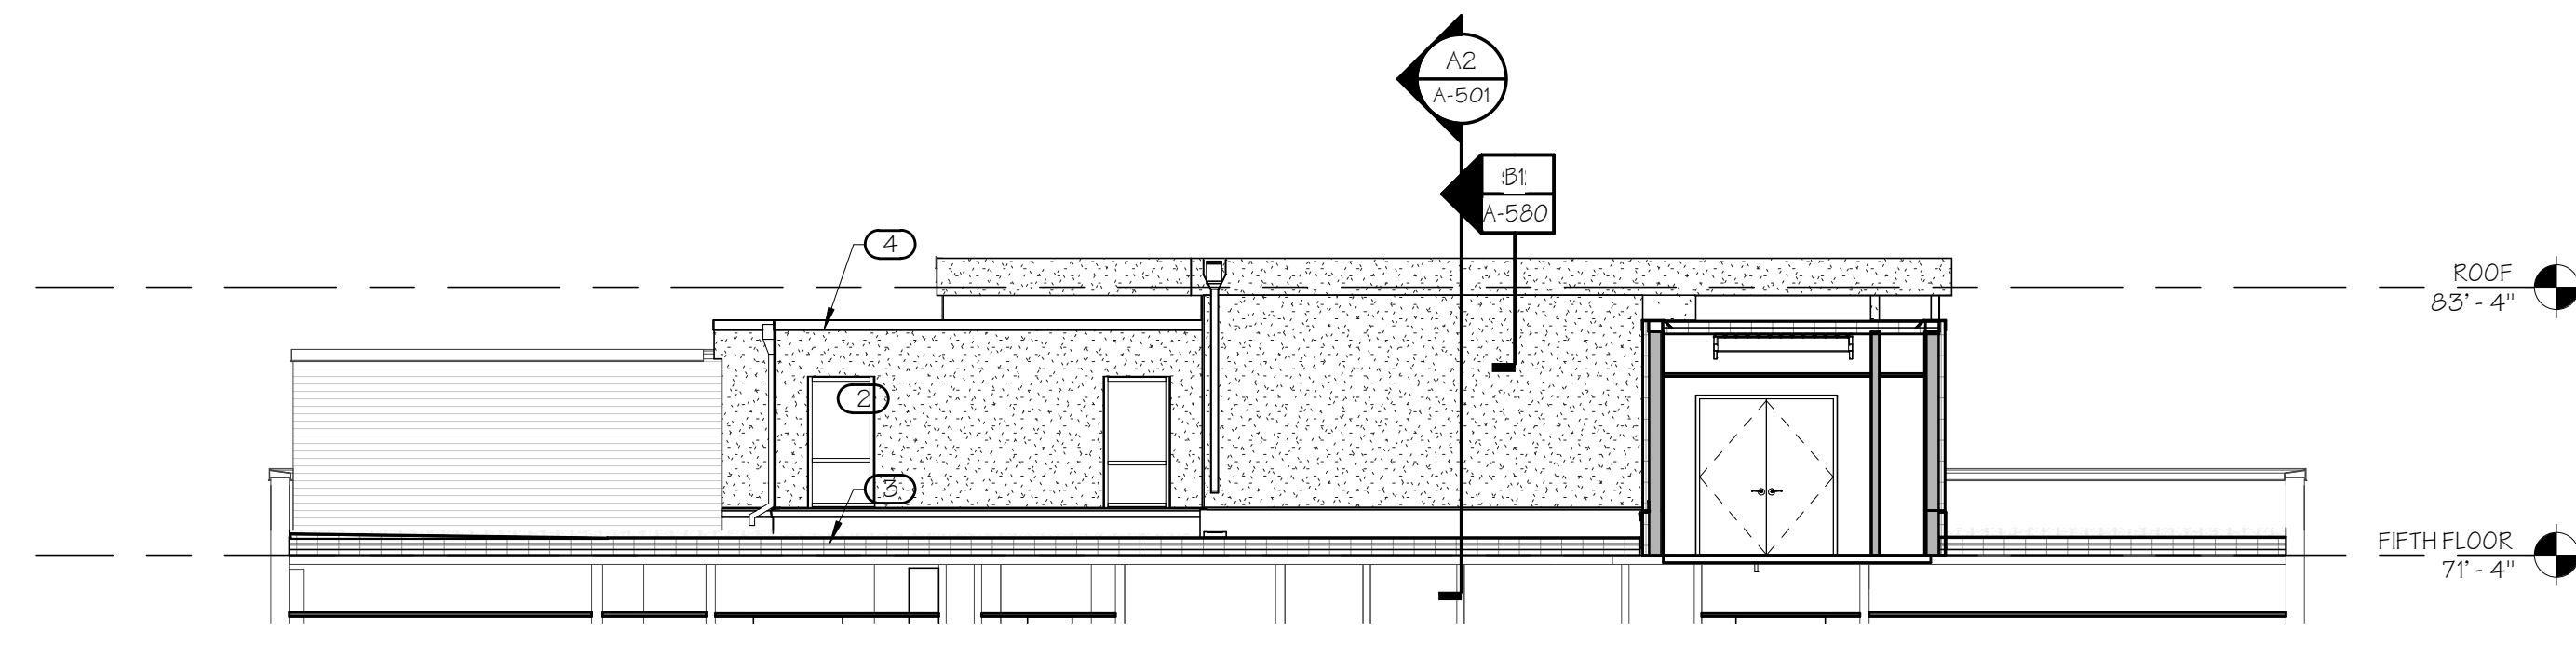

**B2** EXTERIOR ELEVATION - NORTH (ROOF)  
SCALE: 1/8" = 1'-0"



**A1** EXTERIOR ELEVATION - EAST  
SCALE: 1/8" = 1'-0"

**JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION**  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT


DRAWING TITLE:  
EXTERIOR ELEVATIONS

SCALE: 1/8" = 1'-0"    DRAWN BY: KWG    REVIEWED BY: DCF


DRAWING NO.

**A-302**  
04.16.2020 - CM BID


DATE: 31 JANUARY 2020    JOB NUMBER: 18052

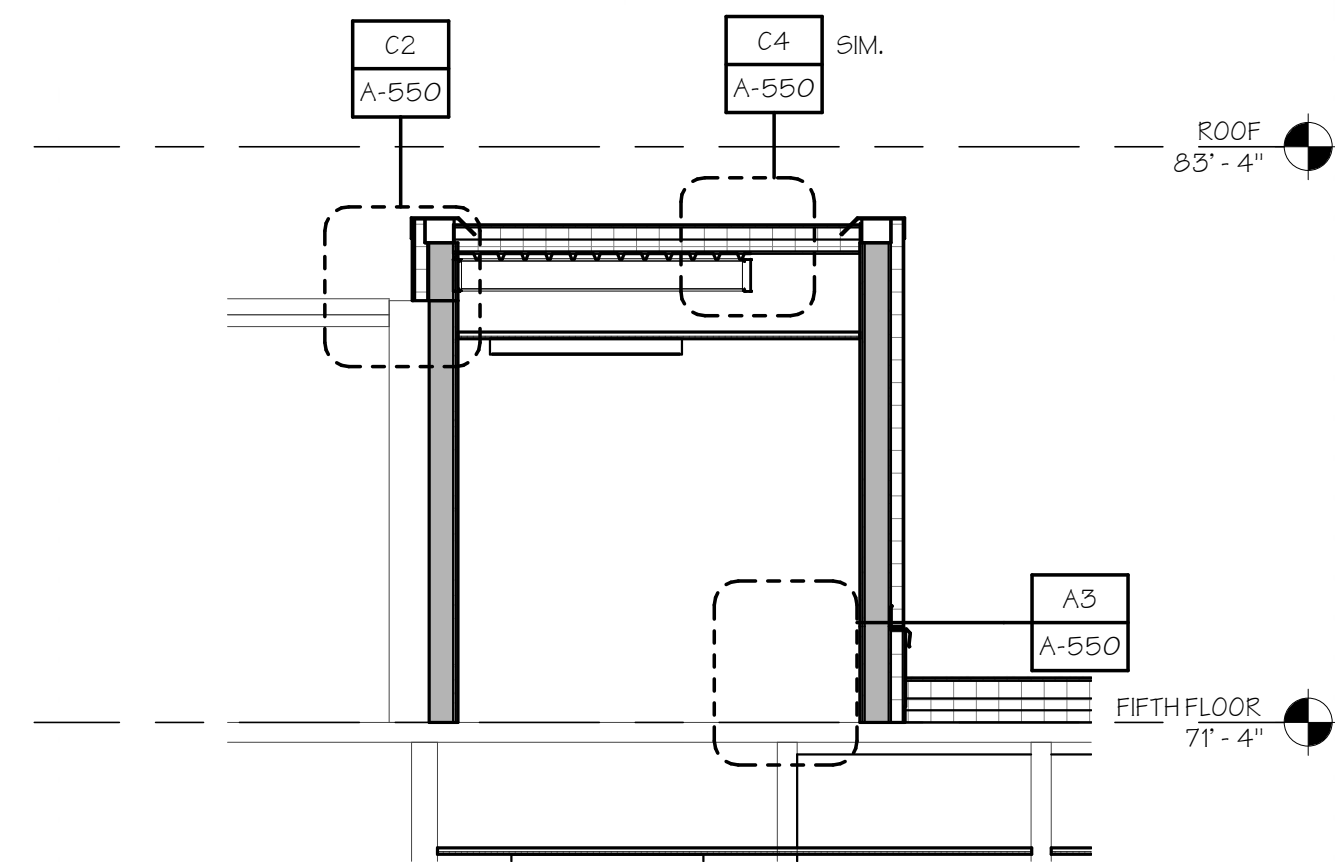


**C2** WALL SECTION  
SCALE: 1/4" = 1'-0"

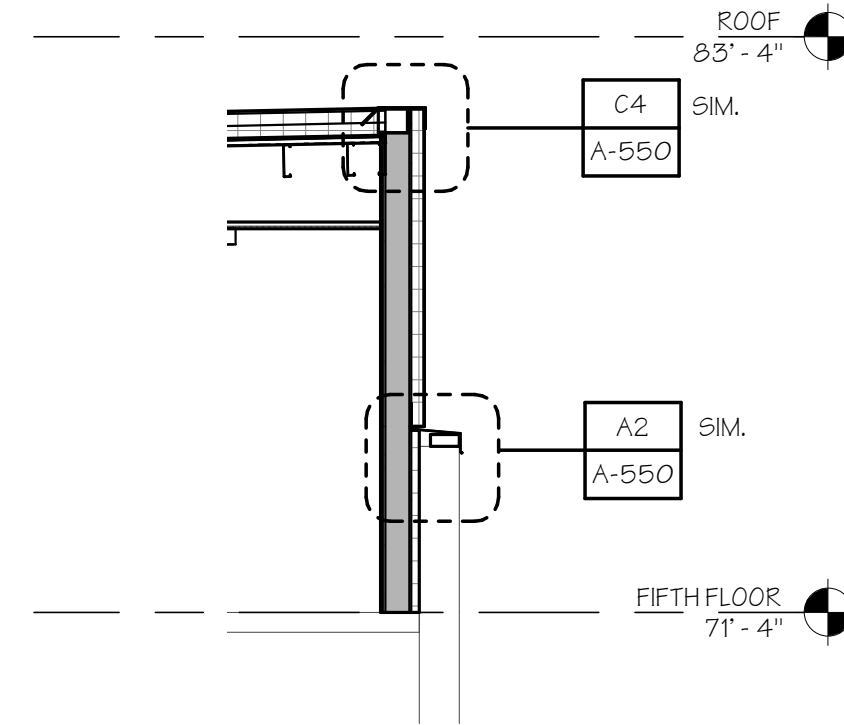


**C3** WALL SECTION  
SCALE: 1/4" = 1'-0"

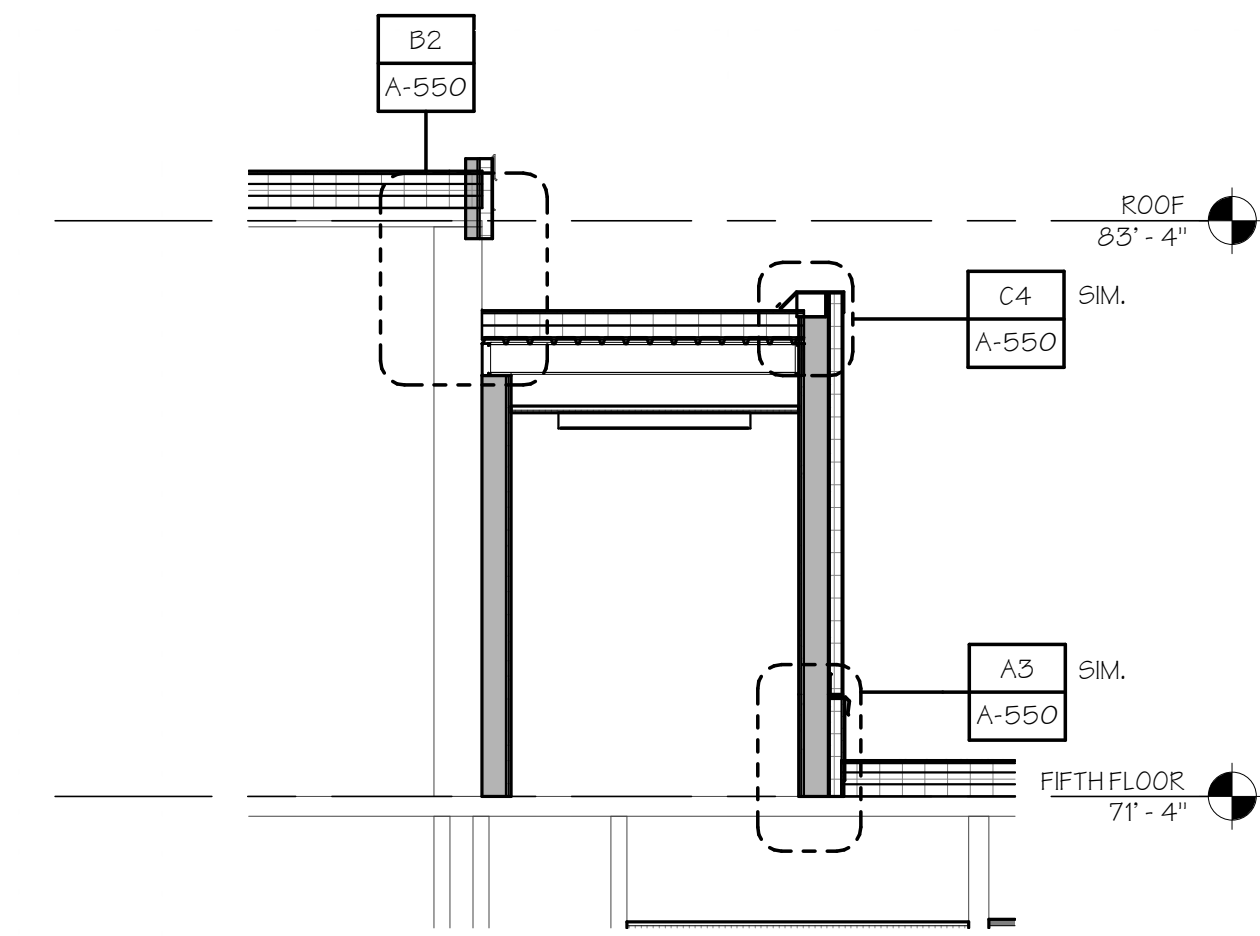


**C4** WALL SECTION  
SCALE: 1/4" = 1'-0"

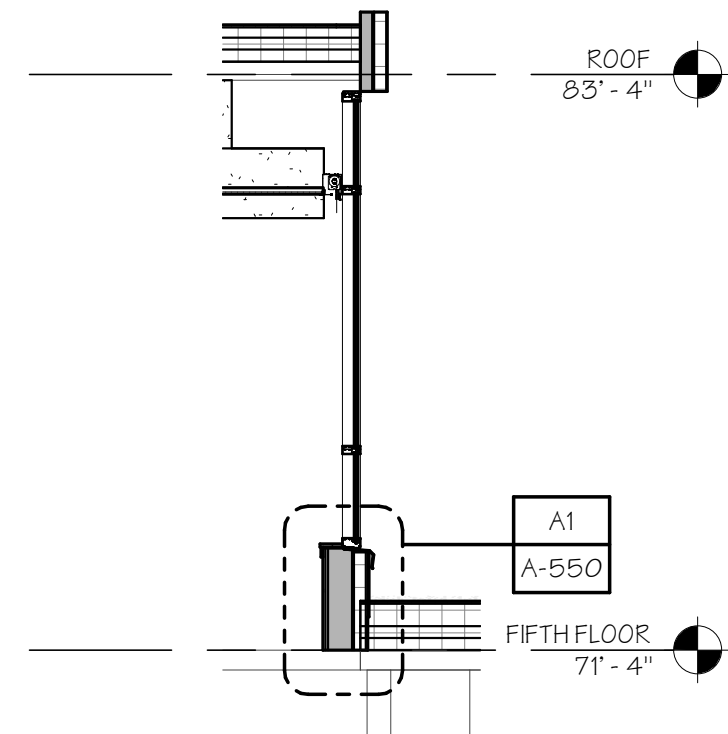


**B2** WALL SECTION  
SCALE: 1/4" = 1'-0"

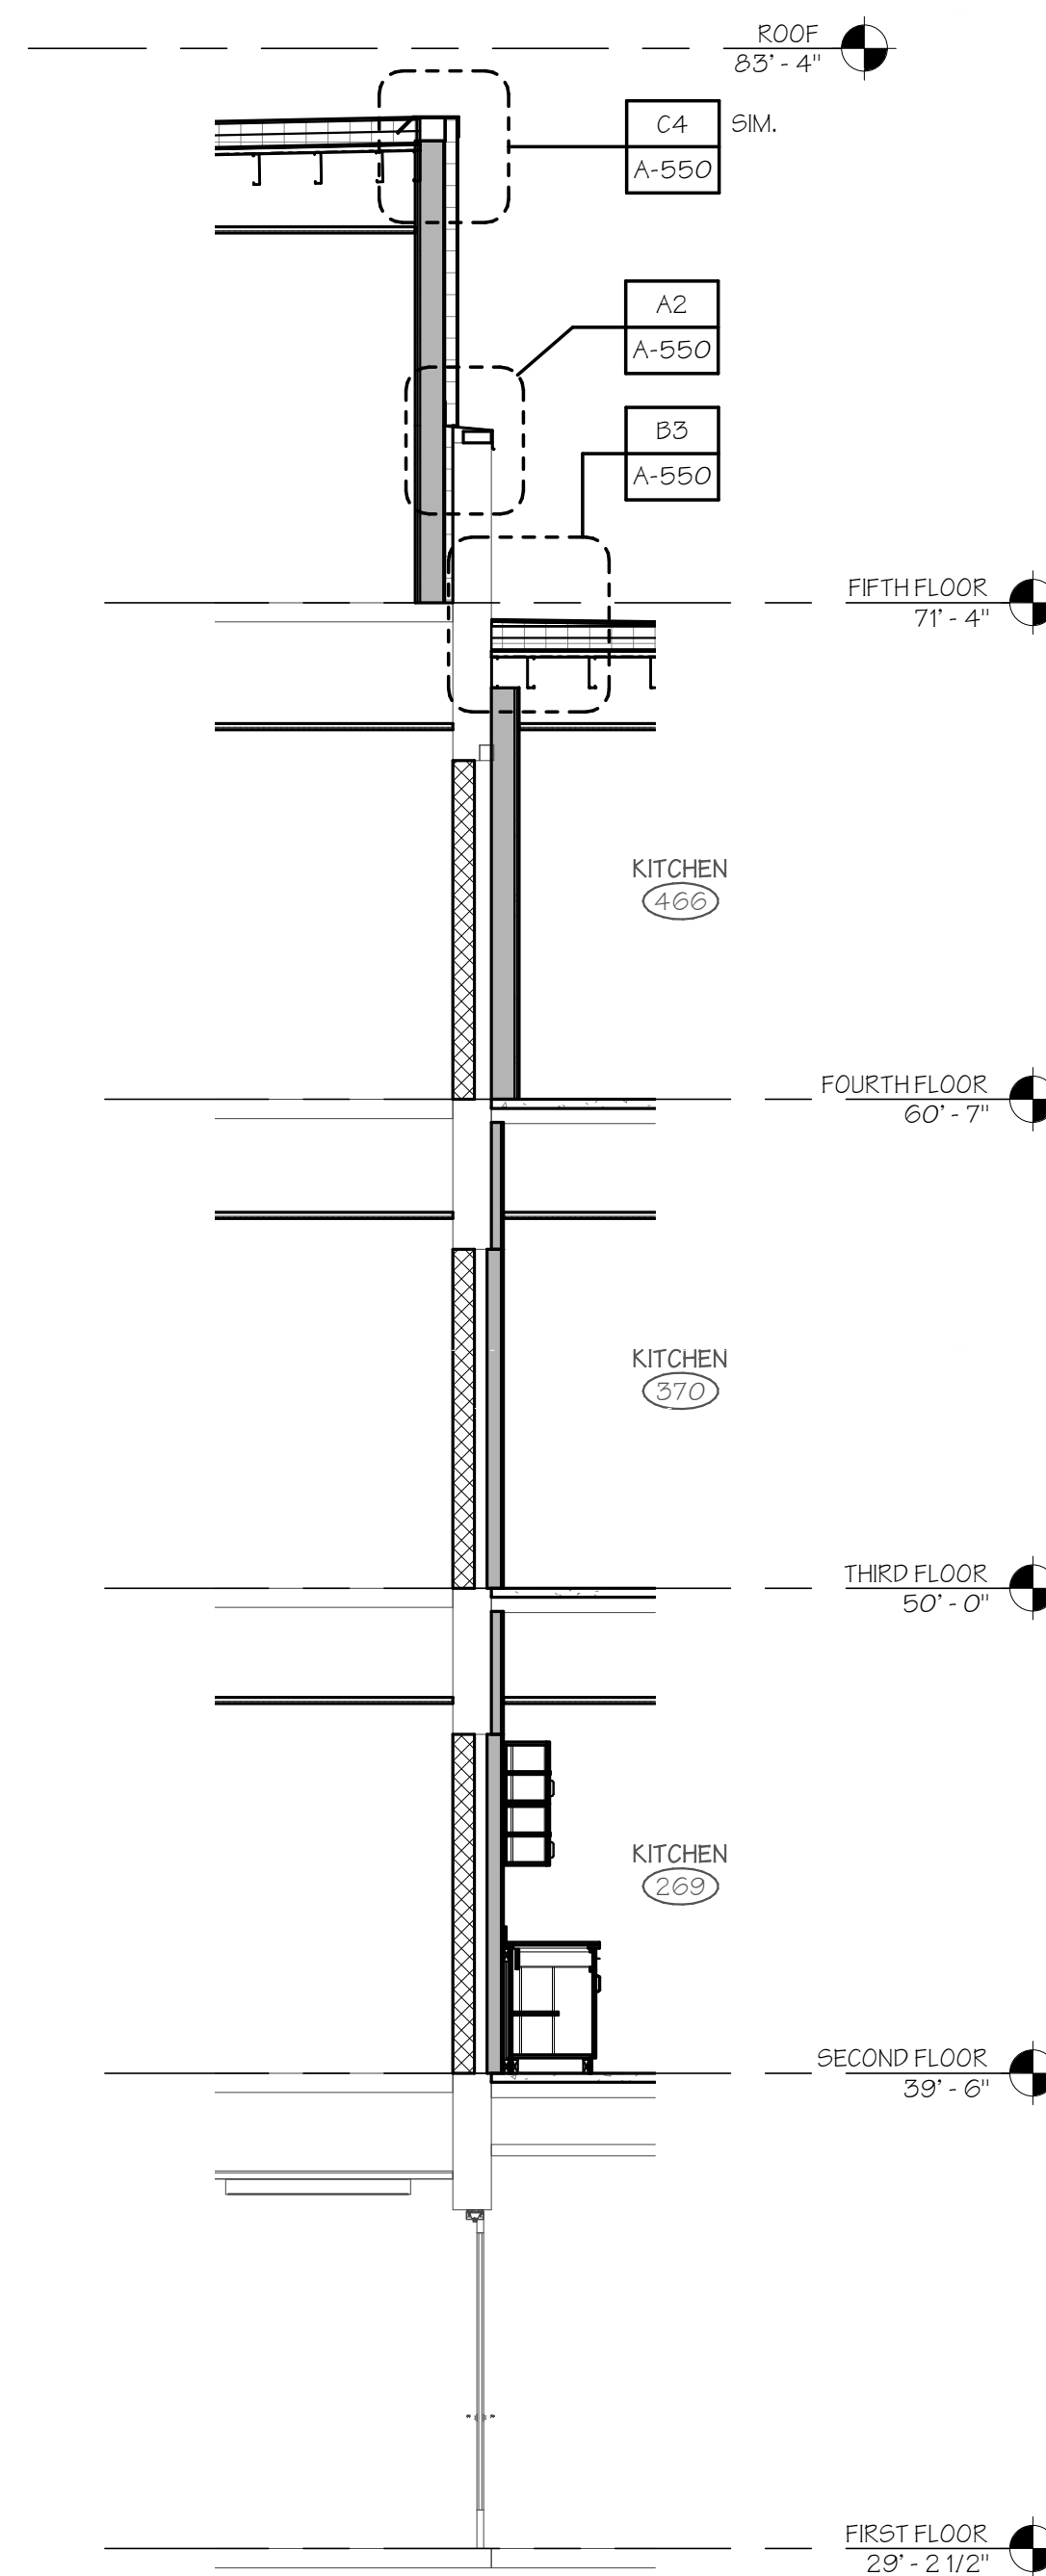

**A3** WALL SECTION  
SCALE: 1/4" = 1'-0"

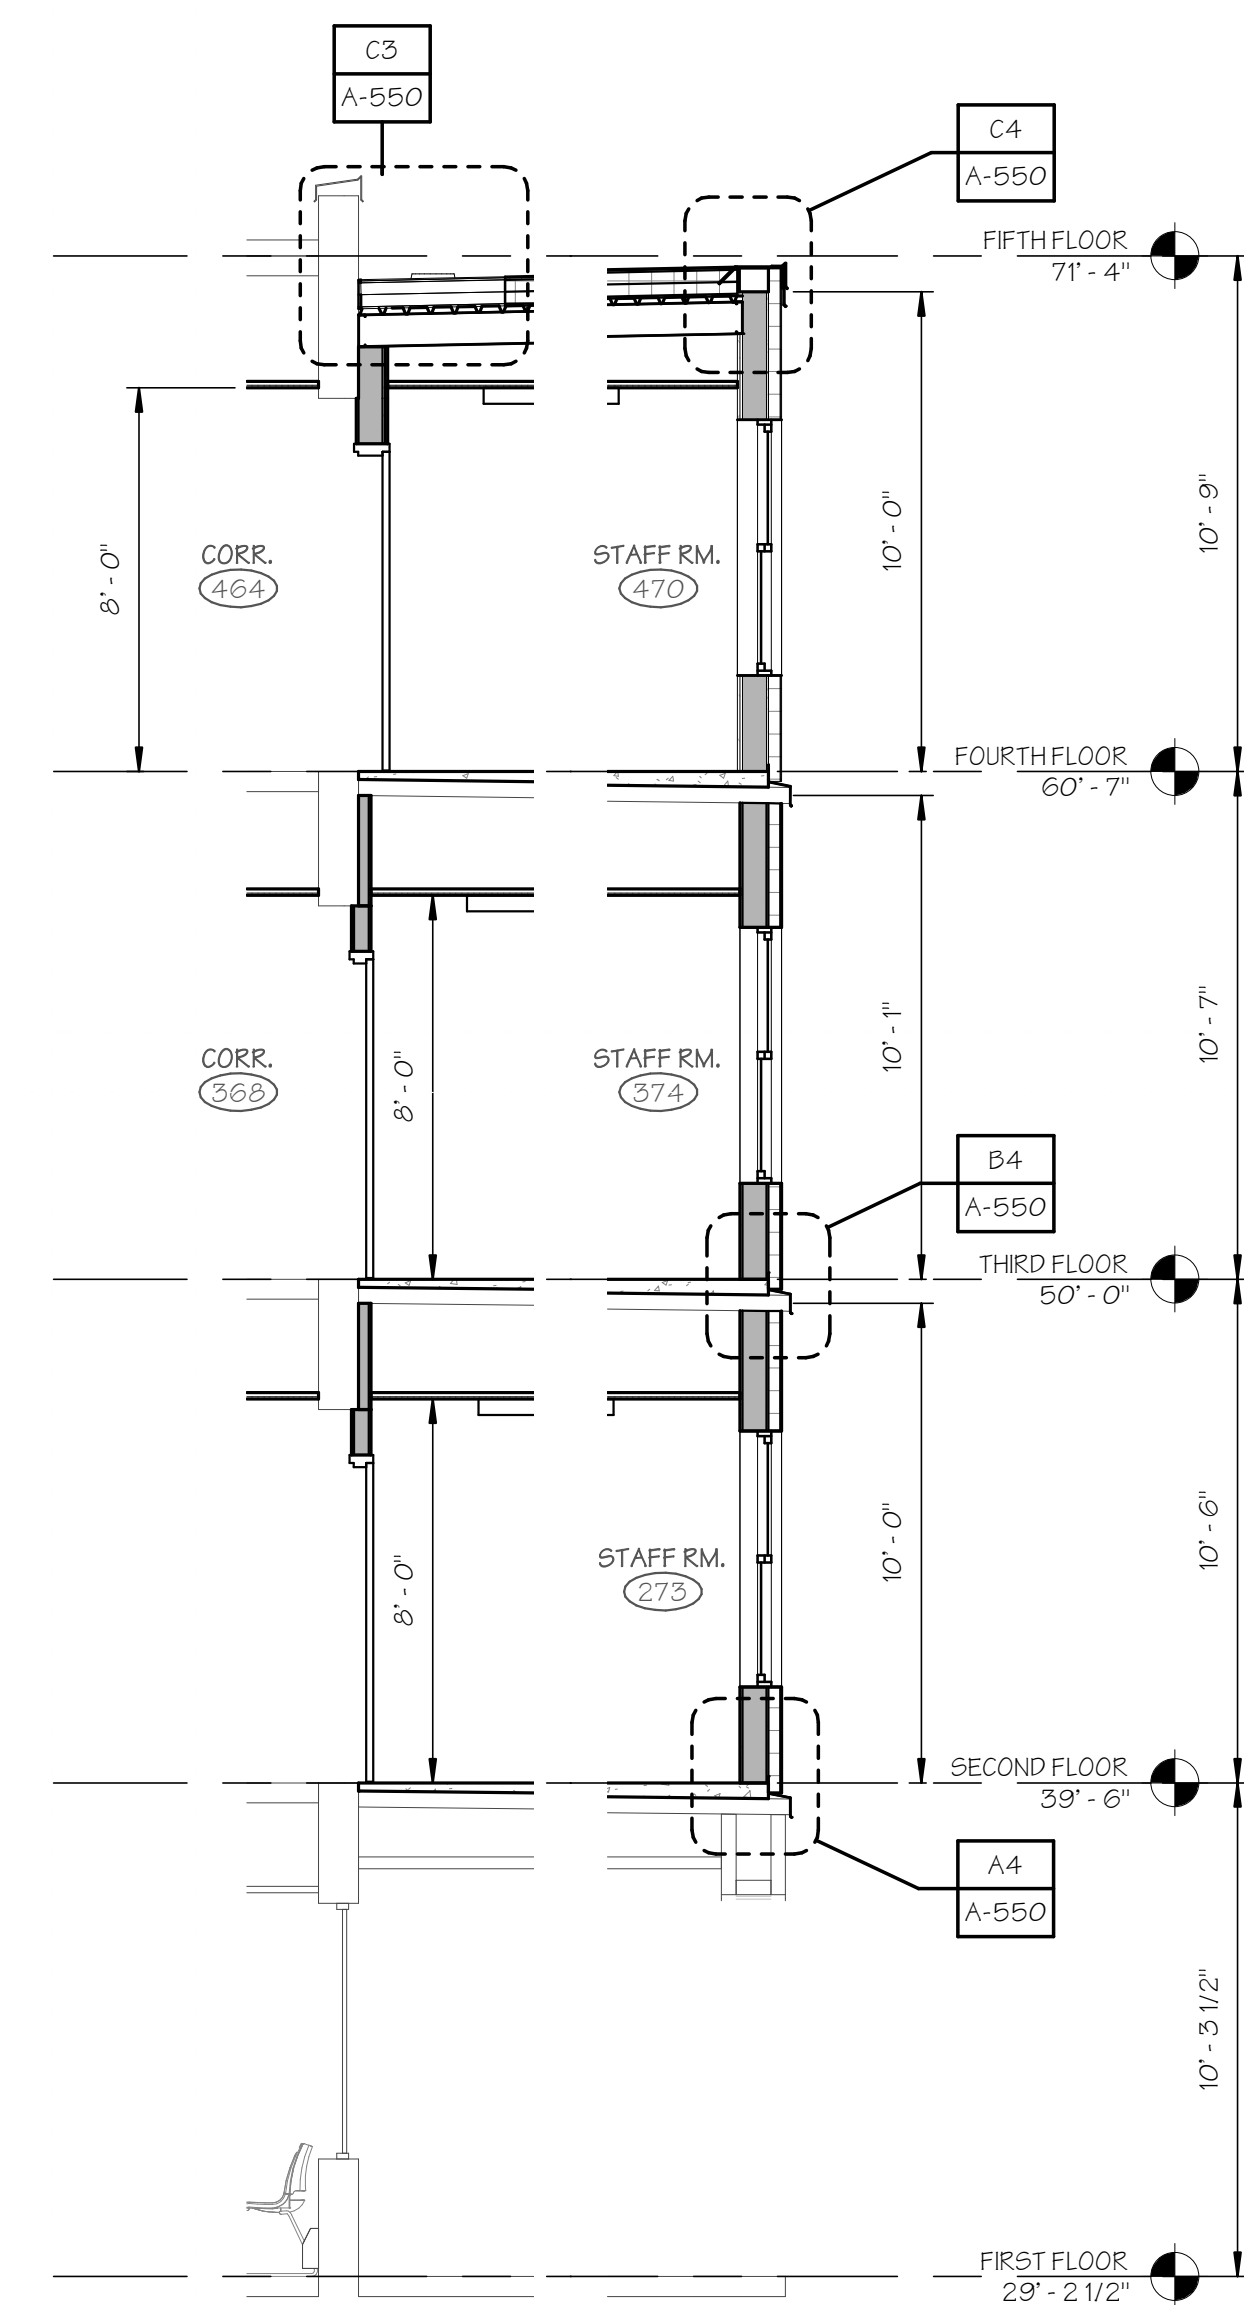

**A4** WALL SECTION  
SCALE: 1/4" = 1'-0"

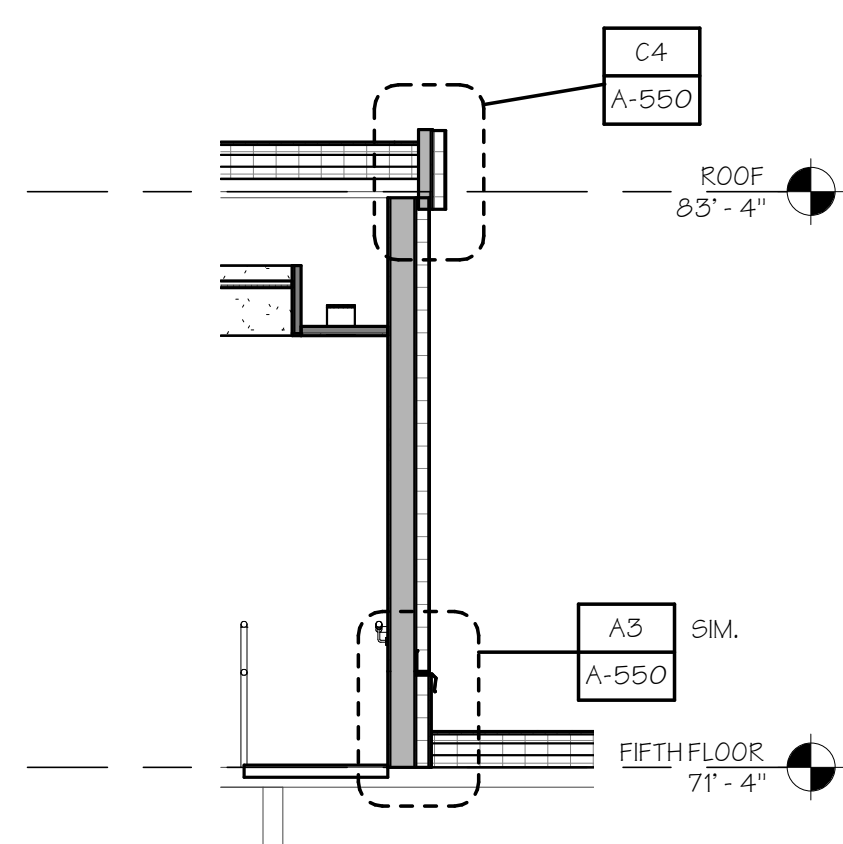

**A2** WALL SECTION  
SCALE: 1/4" = 1'-0"



**ANTINOZZI ASSOCIATES**  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:

**BID SET**  
JANUARY 2020  
NOT FOR CONSTRUCTION  
**04.16.2020 - CM BID**

REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

**JOEL SMILOW CARE CENTER**  
**BRIDGEPORT RESCUE MISSION**  
**PHASE II: INTERIOR RENOVATIONS**  
**& NEW CONSTRUCTION**  
**725 PARK AVENUE**  
**BRIDGEPORT, CONNECTICUT**

DRAWING TITLE:  
WALL SECTIONS

SCALE: 1/4" = 1'-0"    DRAWN BY: KWG    REVIEWED BY: DCF

DRAWING NO.

**A-501**  
**04.16.2020 - CM BID**

DATE: 31 JANUARY 2020    JOB NUMBER: 18052

2/27/2020 10:21 AM  
C:\Users\rosenthal\OneDrive\Documents\18052\_Bridgeport\_Rescue\_Mission\_Phase 2\_Architecture\_roseenthal.rvt





ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:

**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
**04.16.2020 - CM BID**

REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

**JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION**  
**PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION**  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT


DRAWING TITLE:  
WALL SECTION DETAILS

SCALE: 1 1/2" = 1'-0"  
DRAWN BY: KWG  
REVIEWED BY: DCF


DRAWING NO.:

**A-550**  
**04.16.2020 - CM BID**


DATE: 31 JANUARY 2020  
JOB NUMBER: 18052

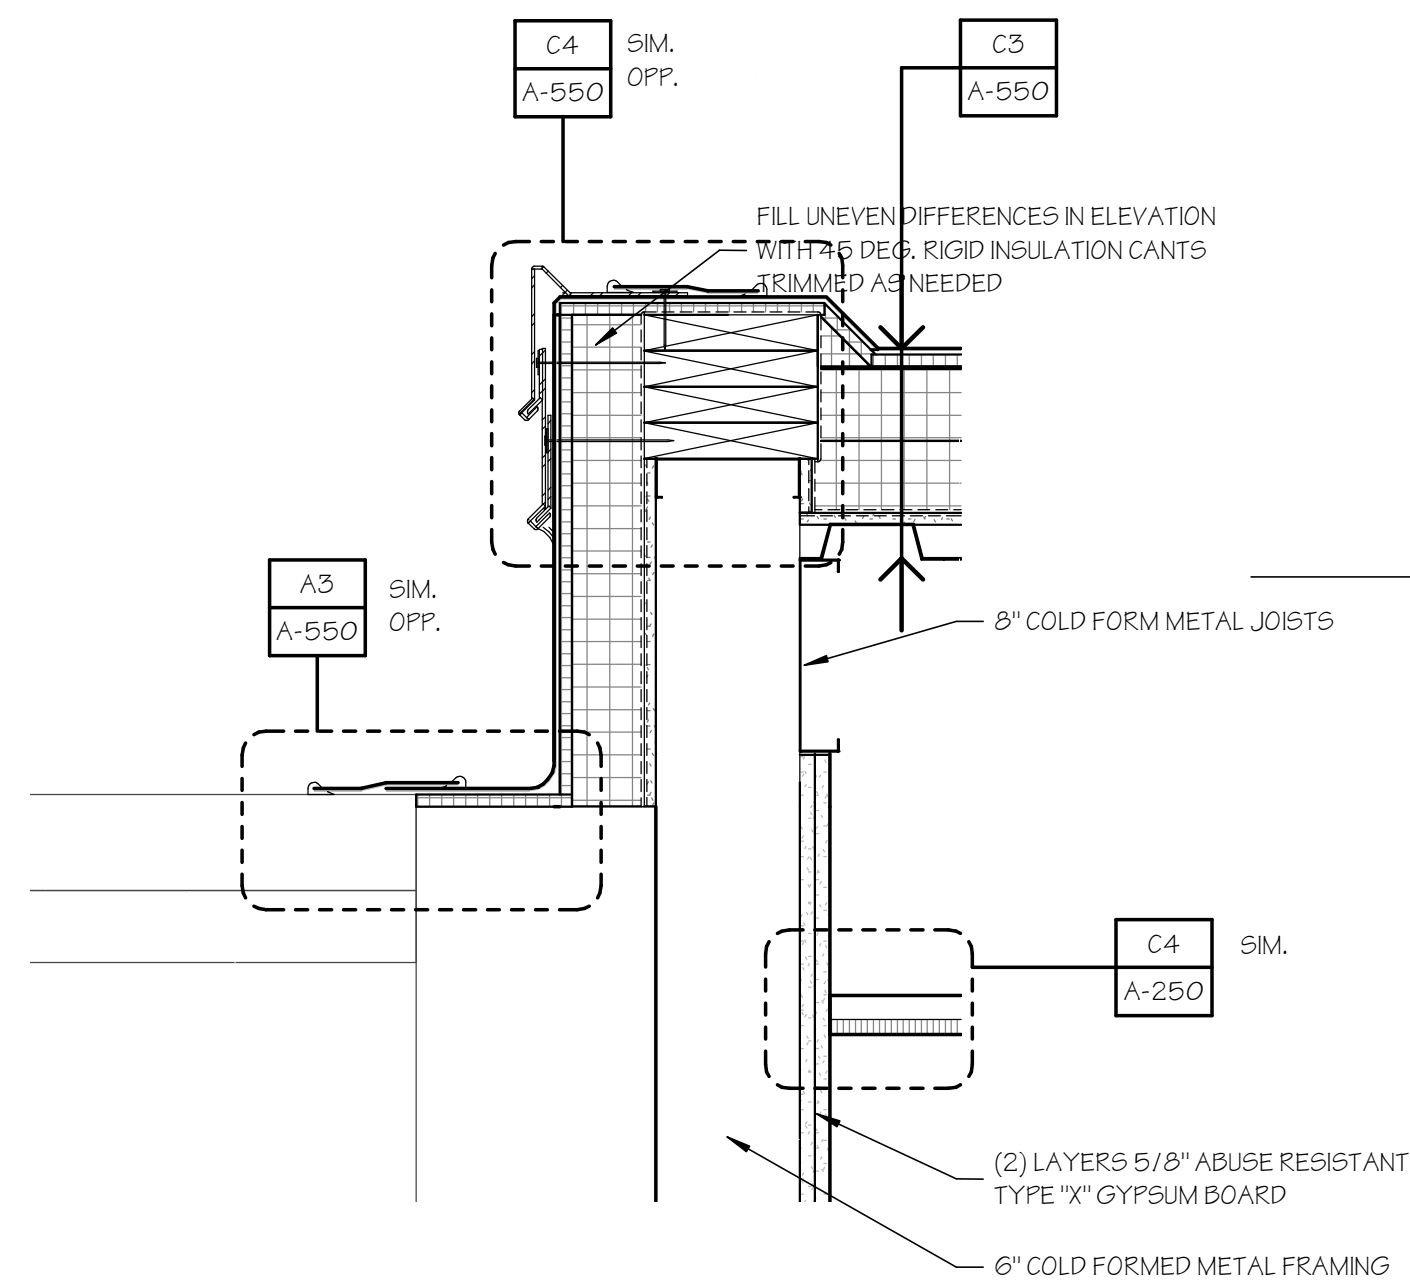


**A2** SECTION DETAIL  
SCALE: 1 1/2" = 1'-0"

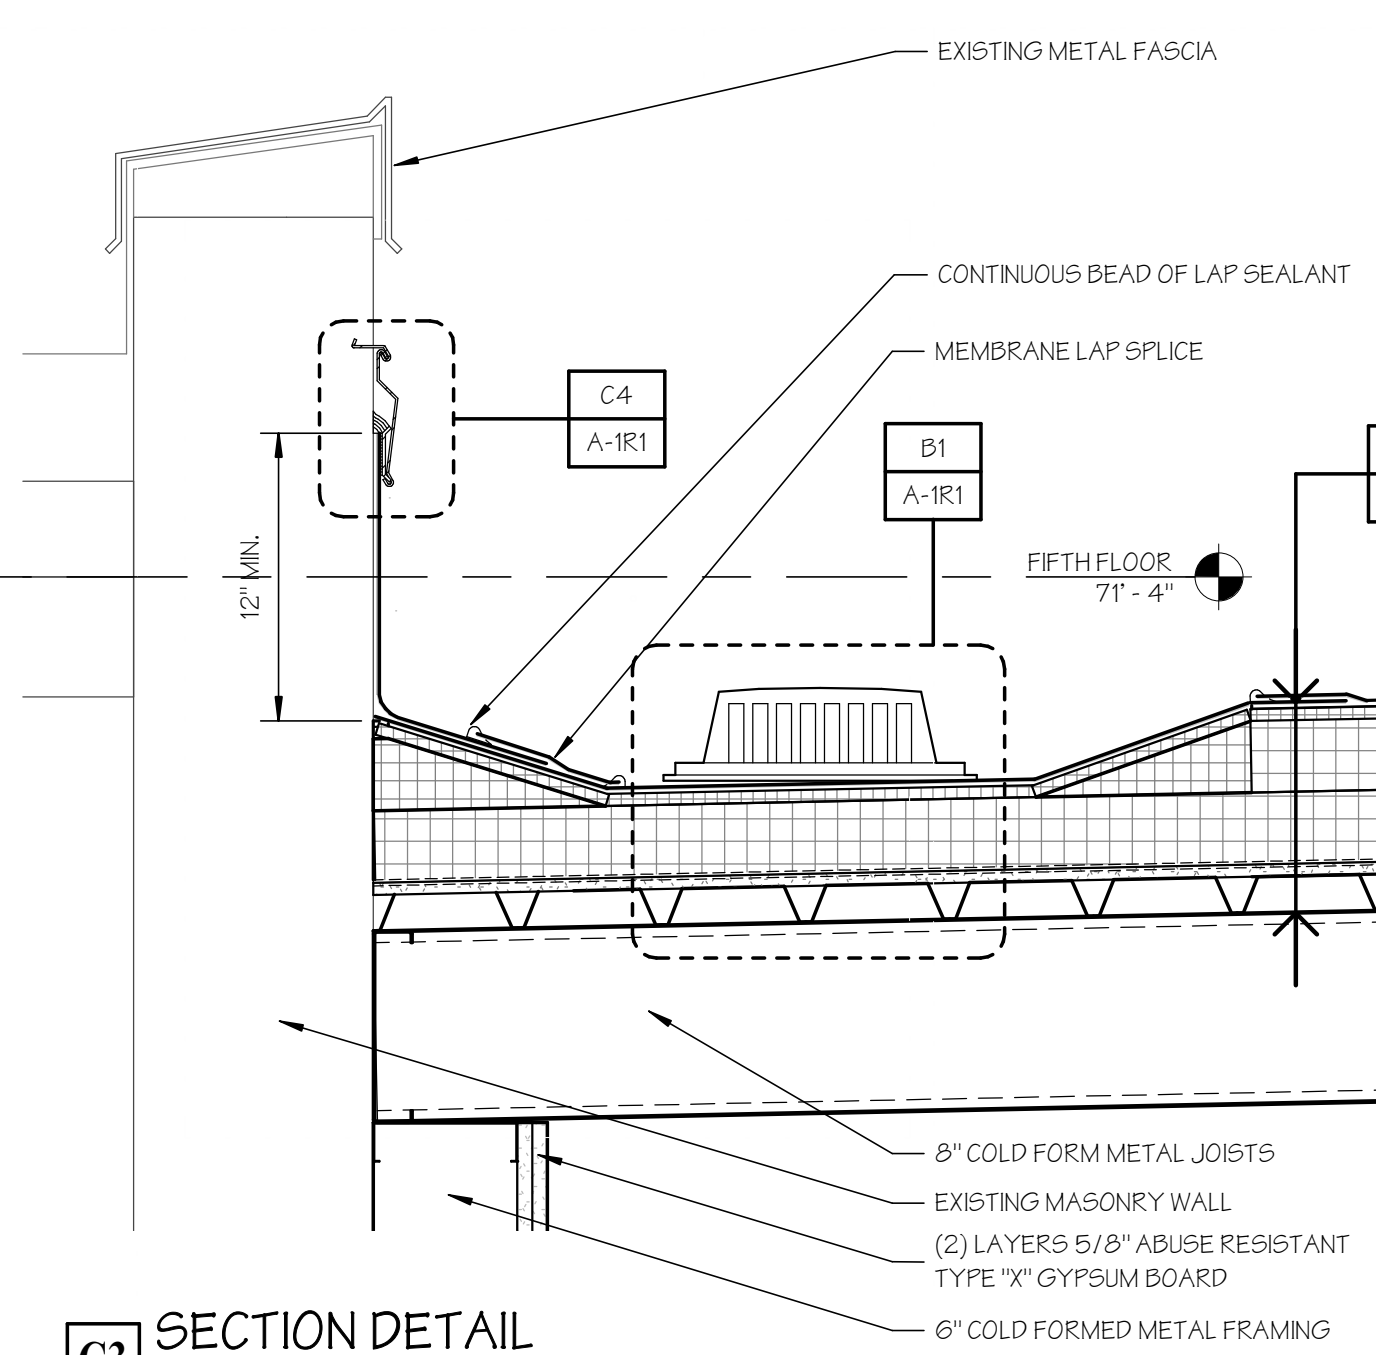


**B1** SECTION DETAIL  
SCALE: 1 1/2" = 1'-0"

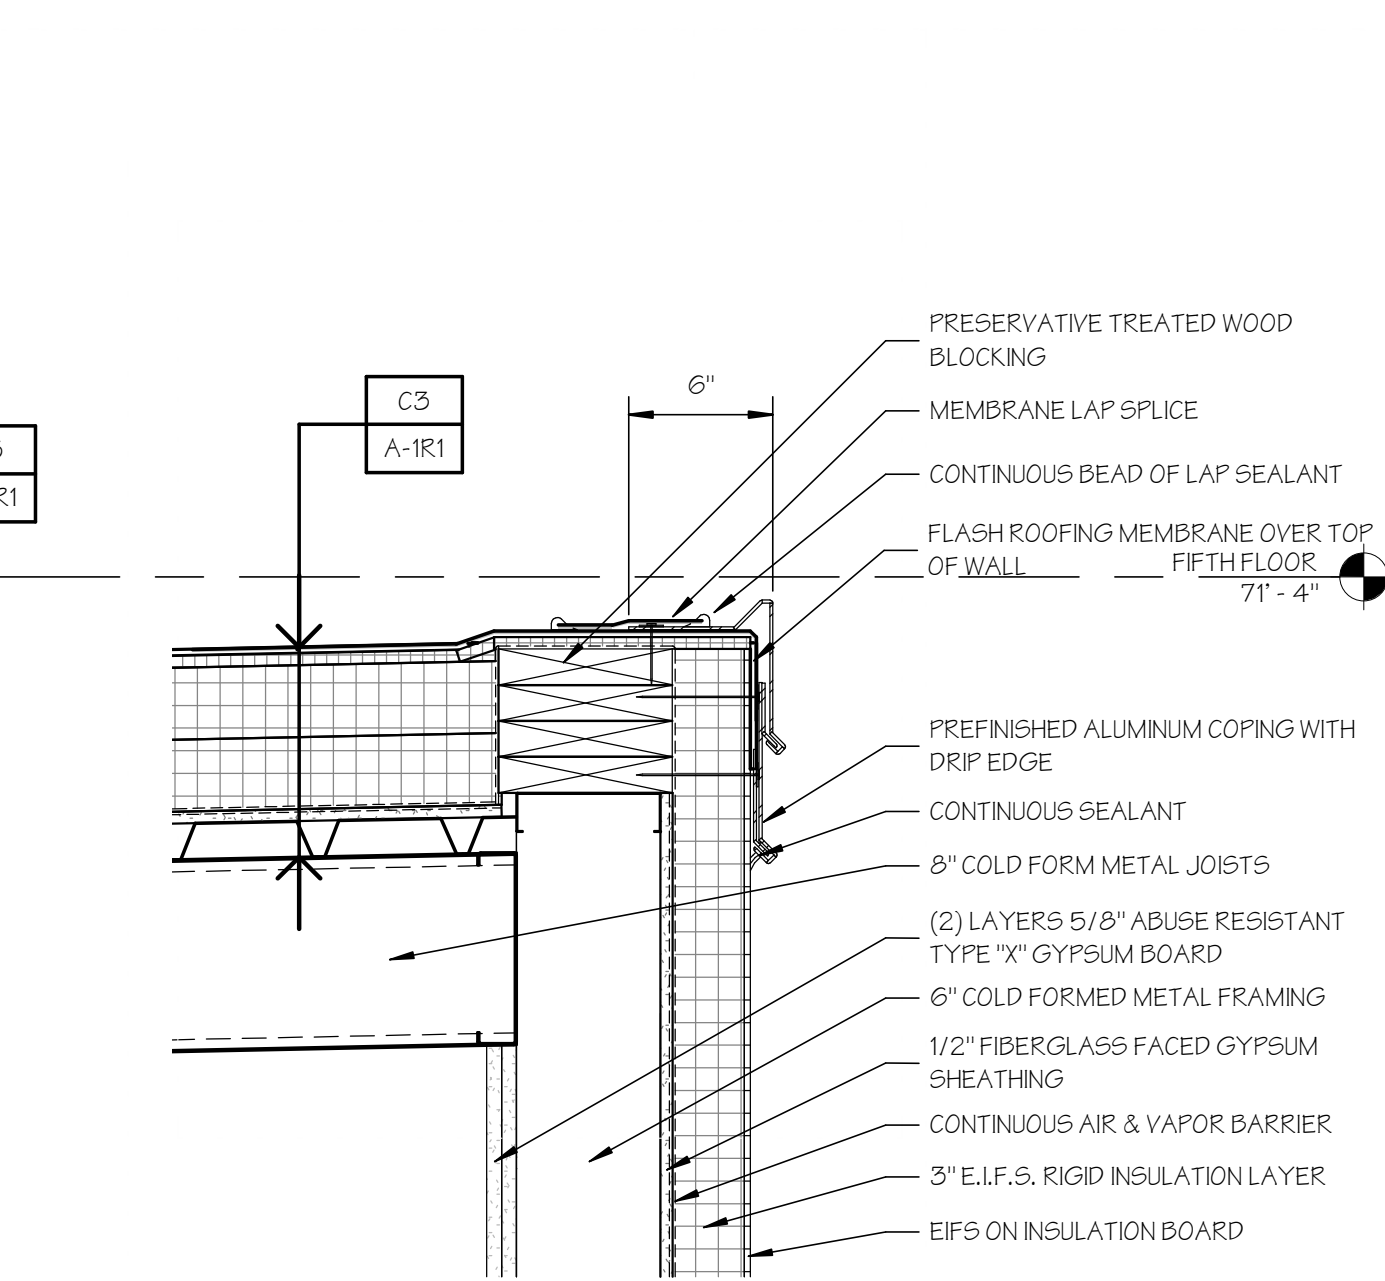


**C2** SECTION DETAIL  
SCALE: 1 1/2" = 1'-0"

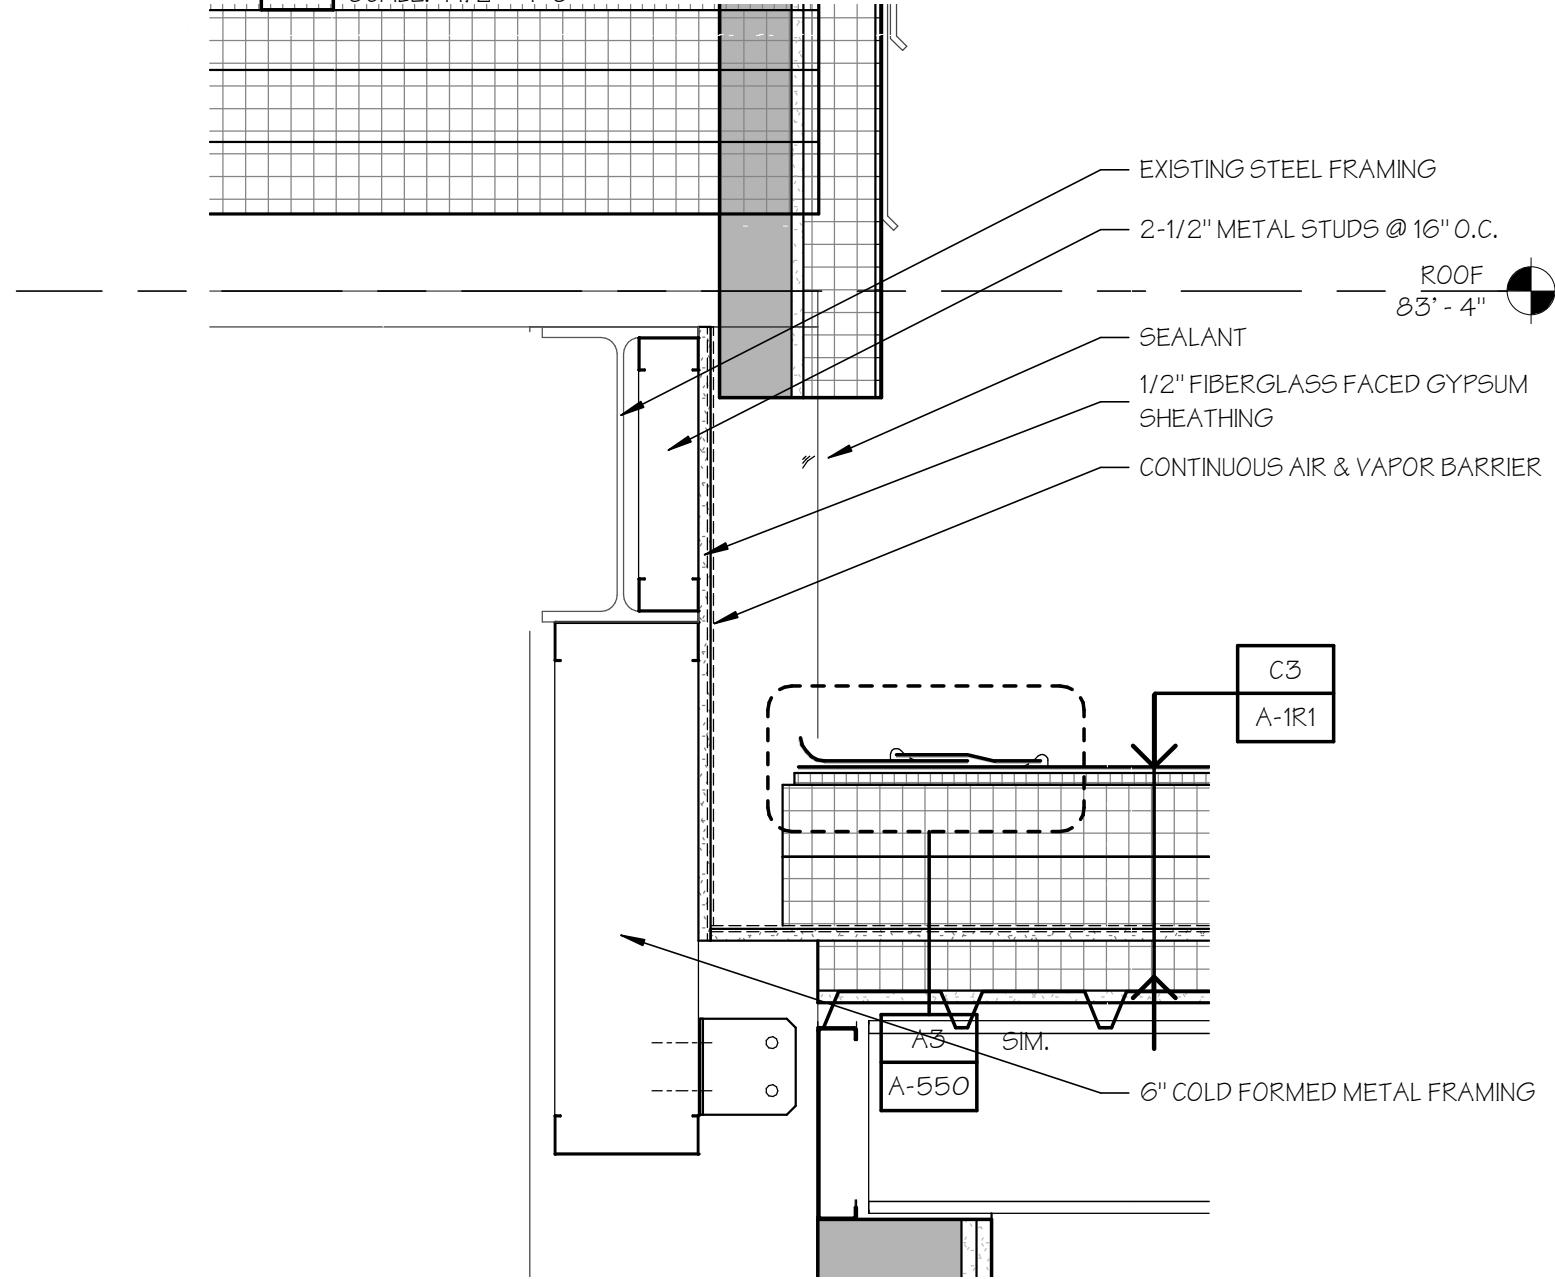


**A1** SECTION DETAIL  
SCALE: 1 1/2" = 1'-0"

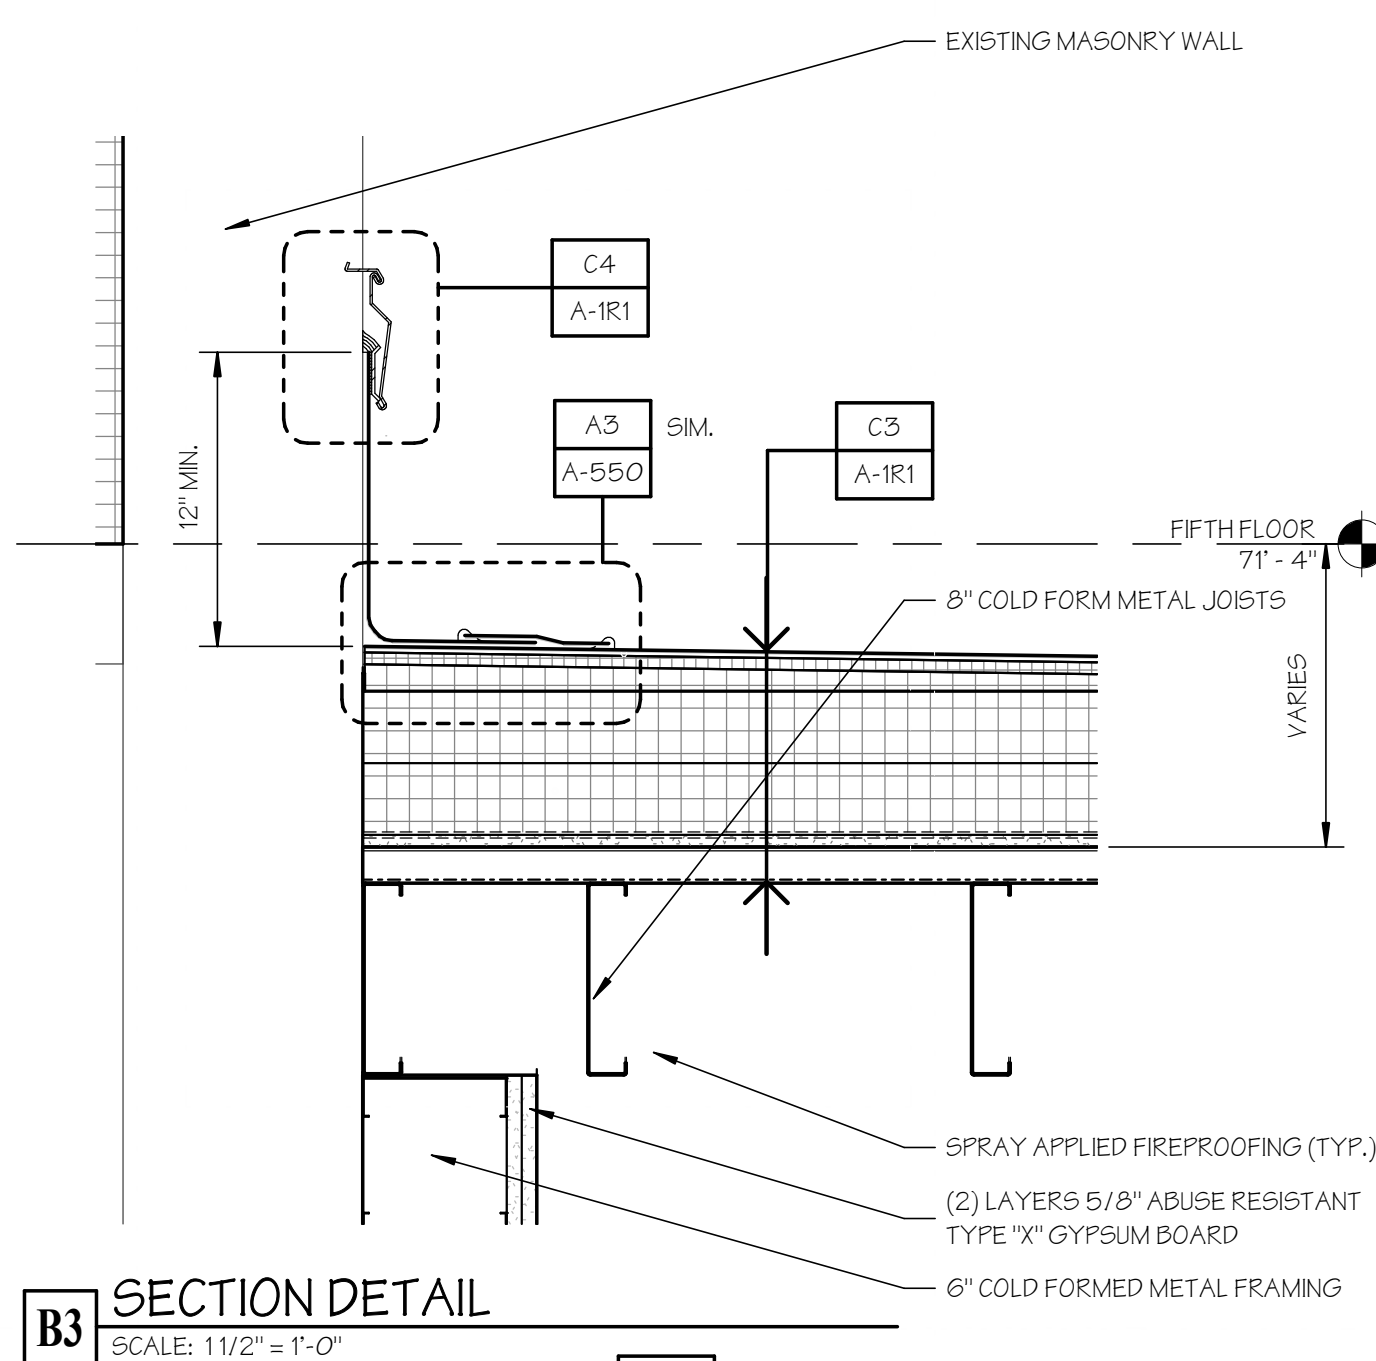


**B2** SECTION DETAIL  
SCALE: 1 1/2" = 1'-0"

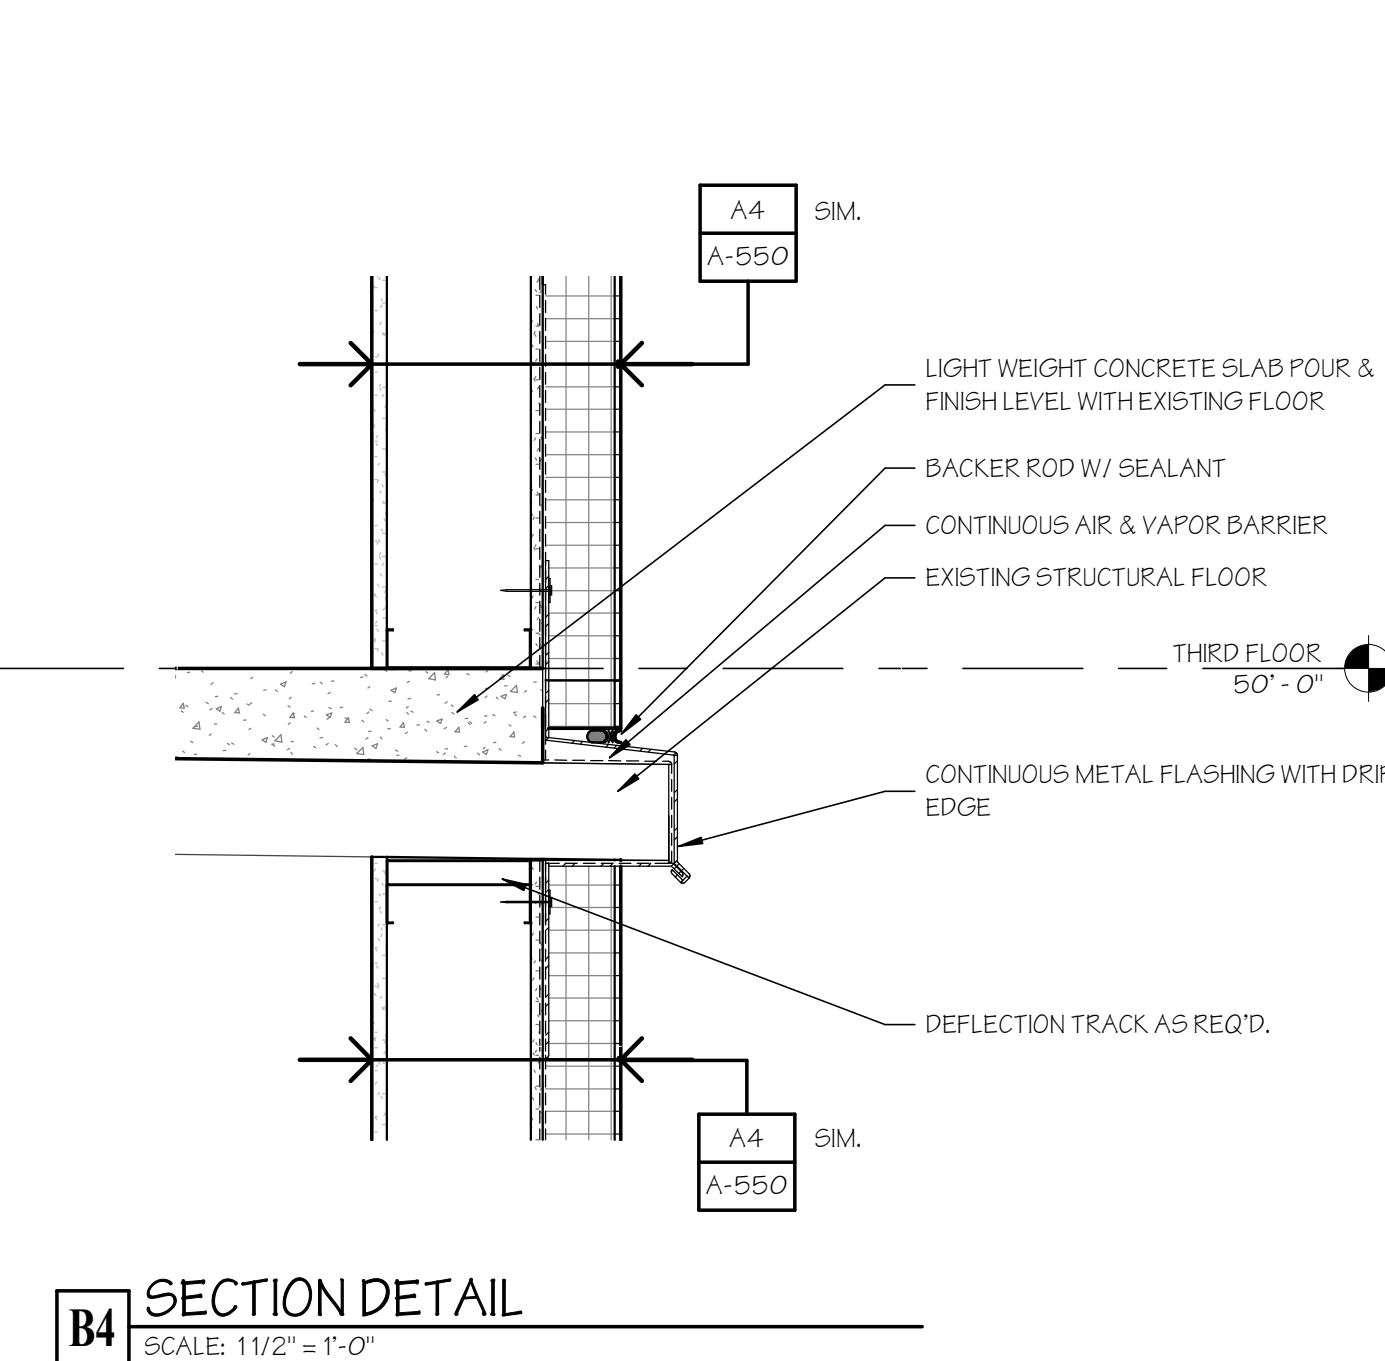


**C3** SECTION DETAIL  
SCALE: 1 1/2" = 1'-0"

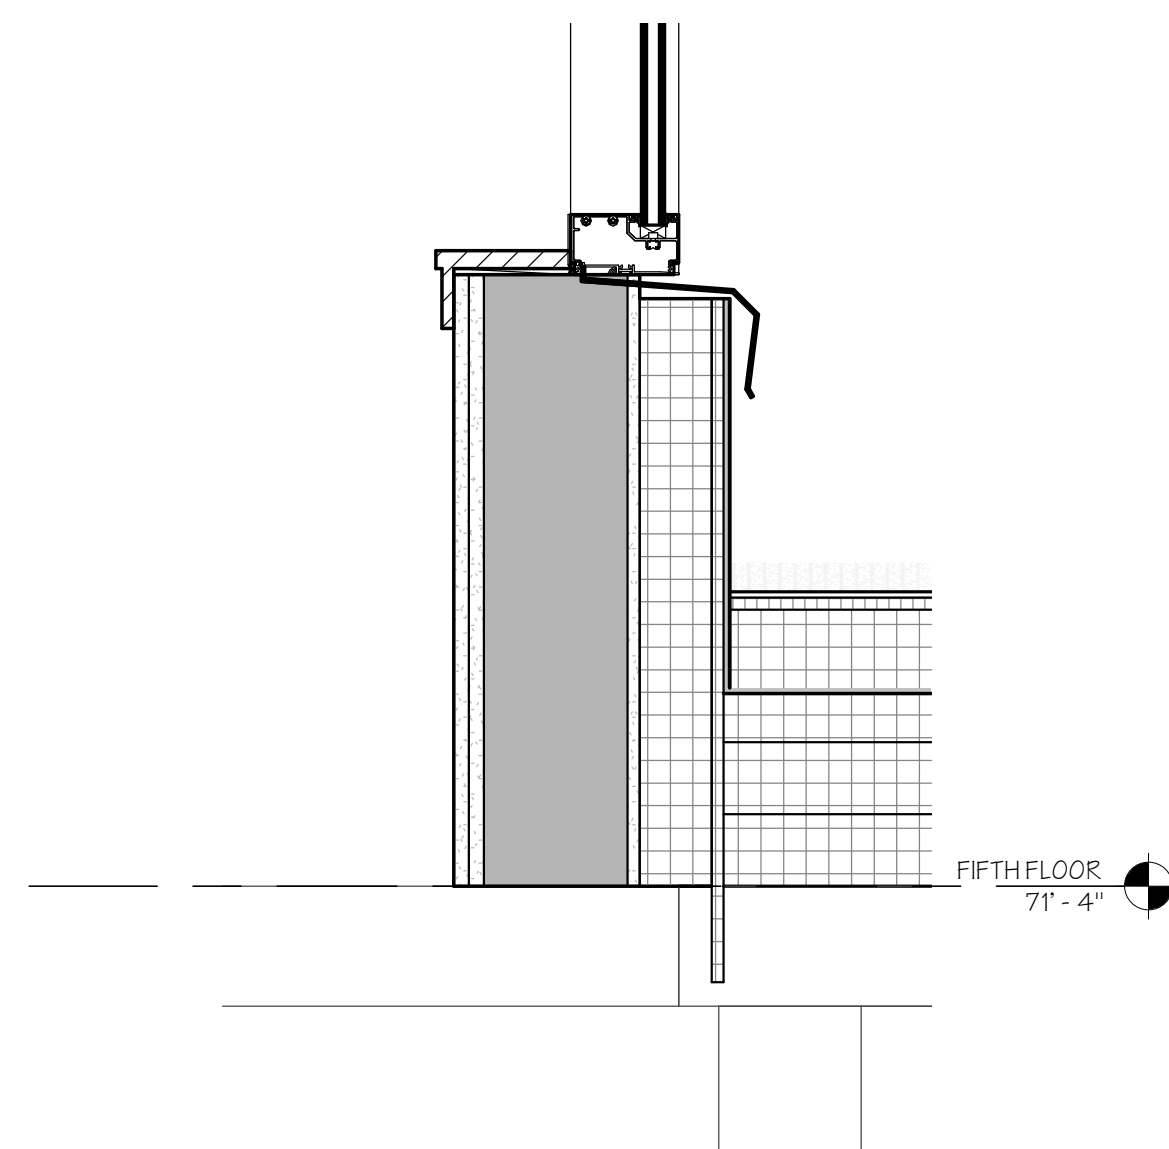


**A3** SECTION DETAIL  
SCALE: 1 1/2" = 1'-0"

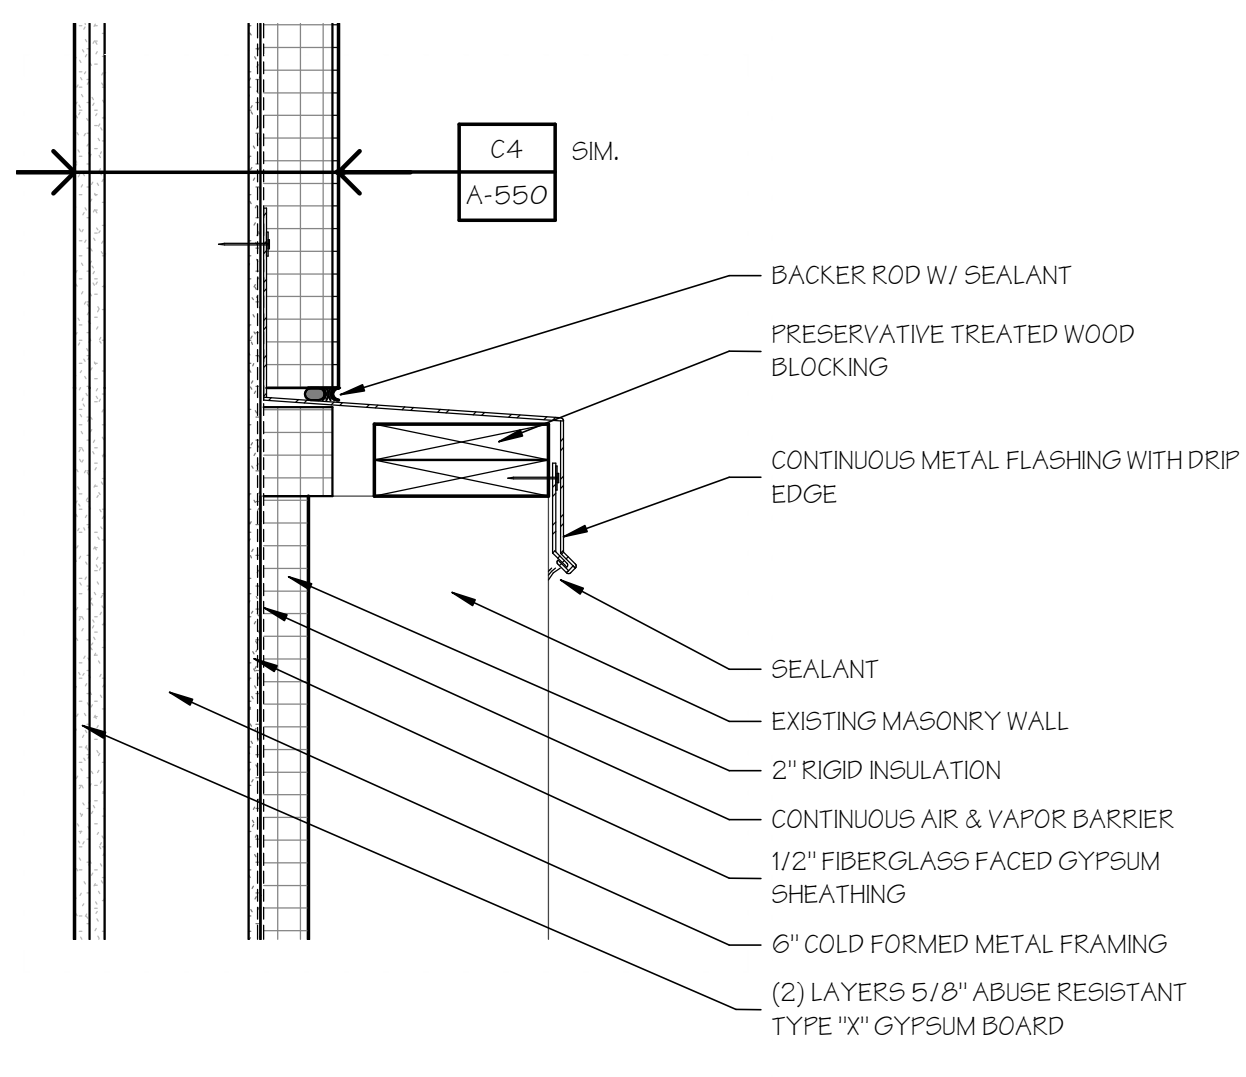

**A4** SECTION DETAIL  
SCALE: 1 1/2" = 1'-0"

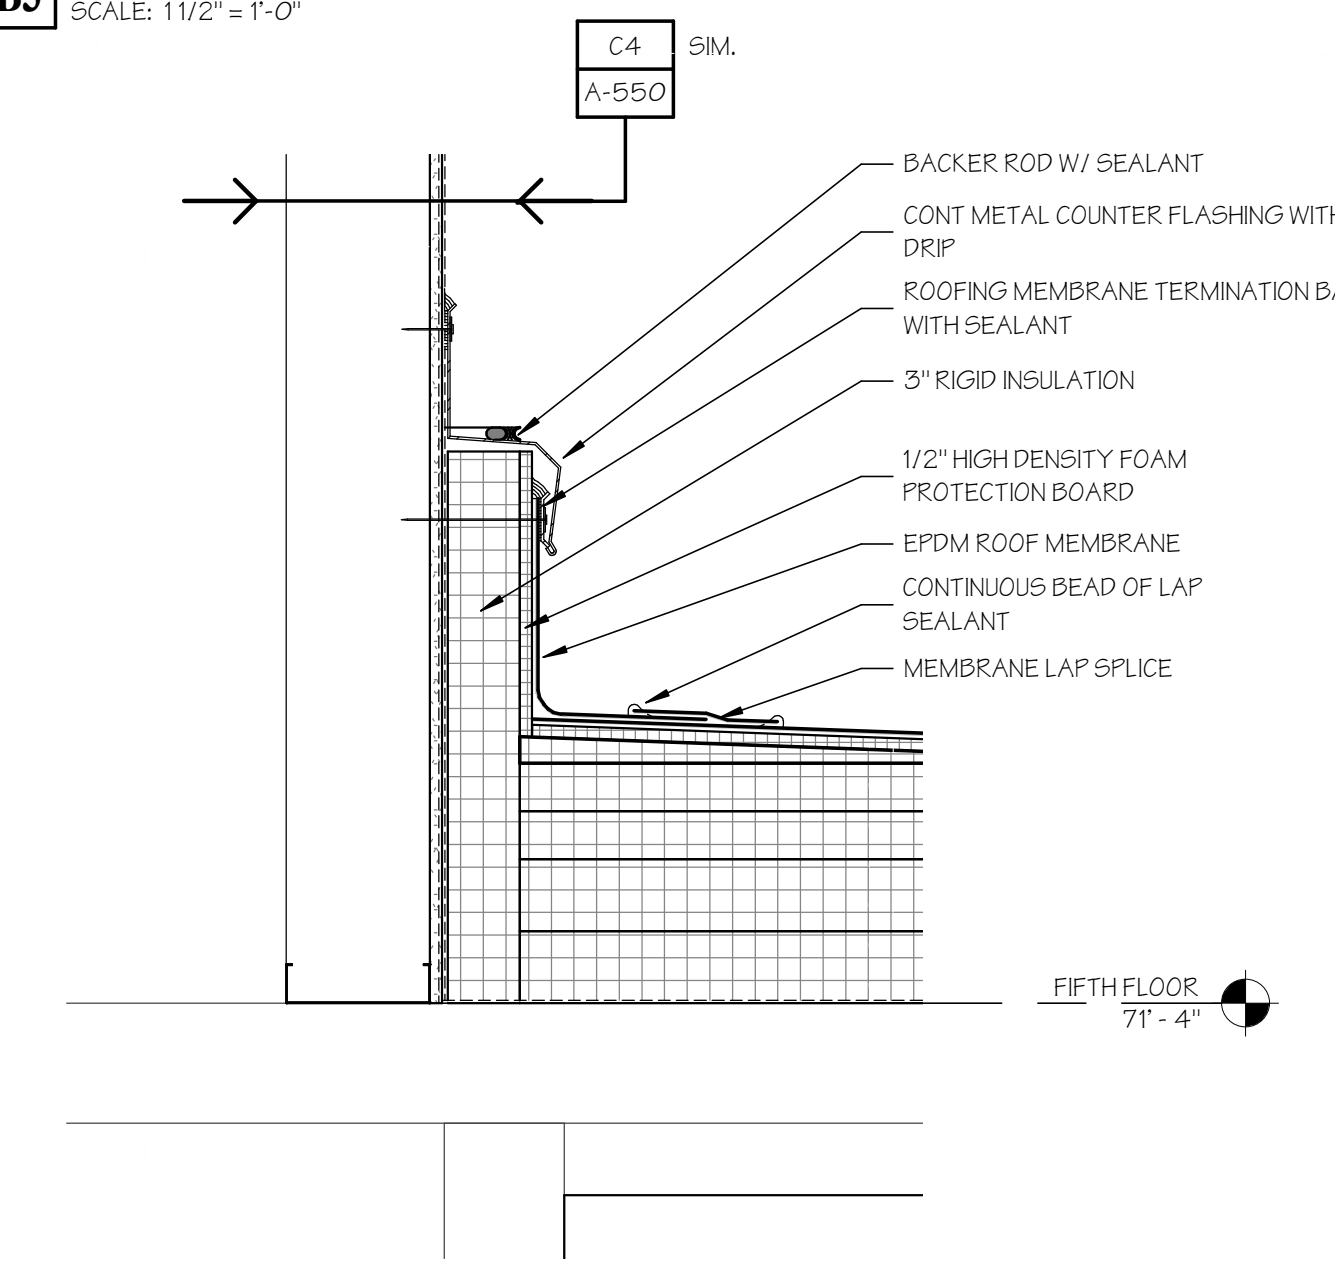

**B3** SECTION DETAIL  
SCALE: 1 1/2" = 1'-0"

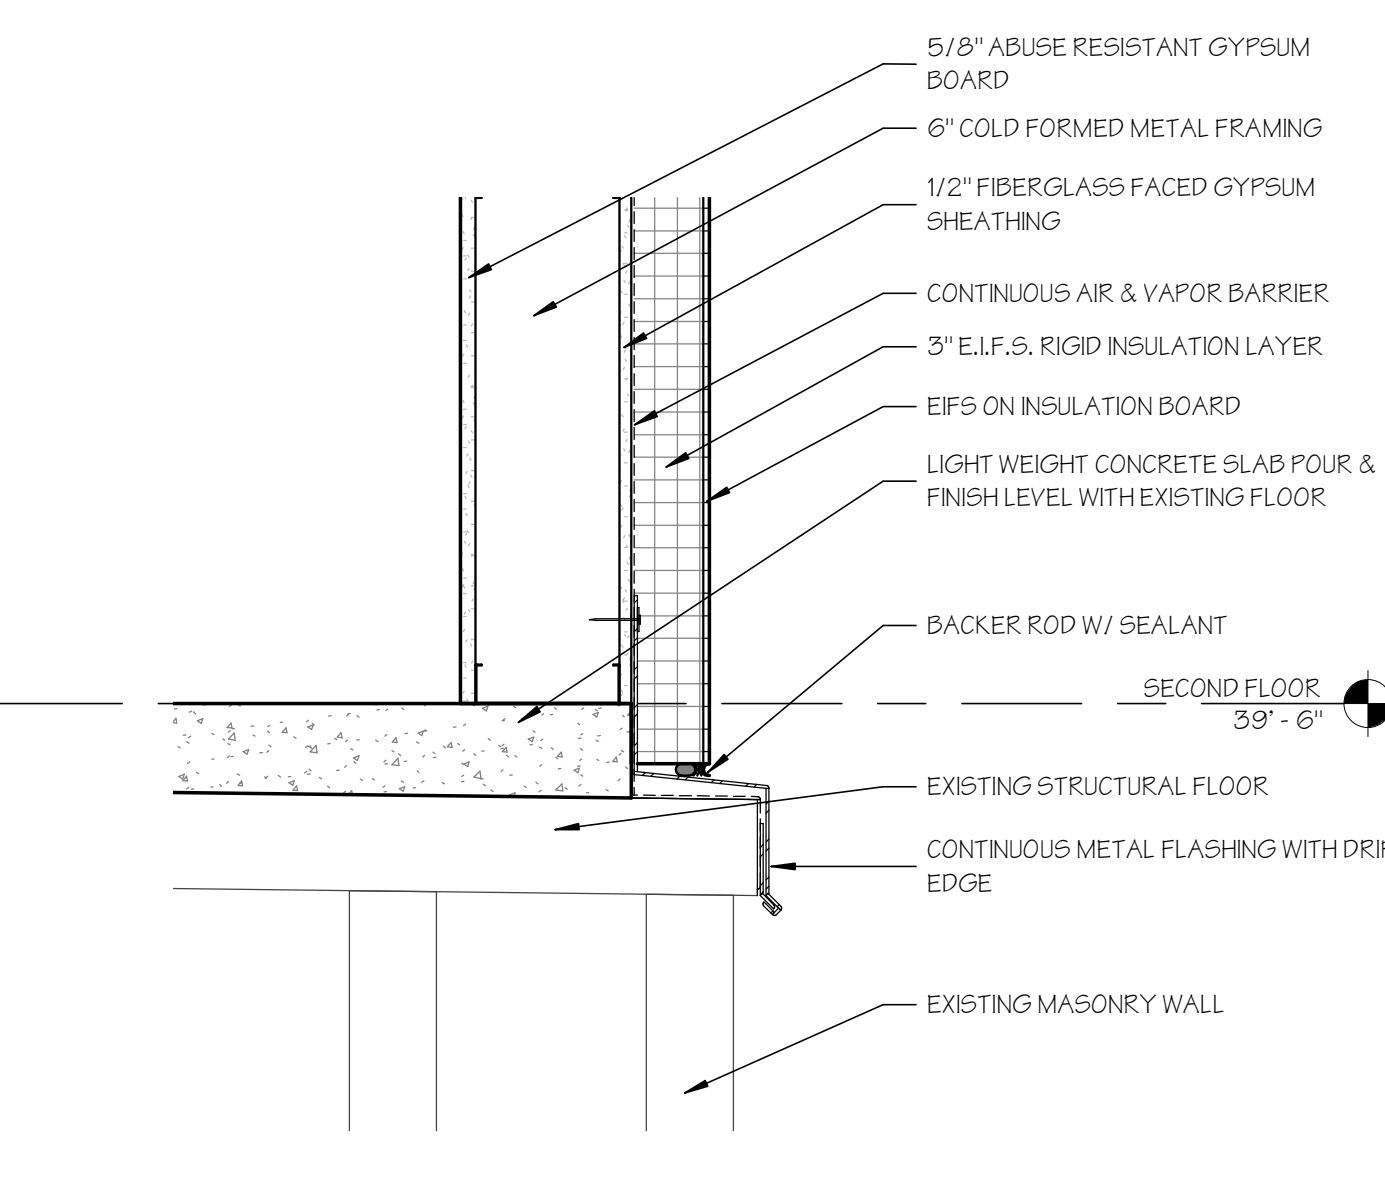

**C4** SECTION DETAIL  
SCALE: 1 1/2" = 1'-0"



CERTIFICATION:

**BID SET**  
30 JANUARY 2015  
FOR CONSTRUCTION  
**04.16.2020 - CM BID**

REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT


DRAWING TITLE:  
ROOF DETAILS

SCALE: 1" = 1'-0"	DRAWN BY: RMR	REVIEWED BY: Approver
----------------------	------------------	--------------------------


DRAWING NO.:

**A-580**  
**04.16.2020 - CM BID**


DATE: 01/31/20	JOB NUMBER: 18052
-------------------	----------------------

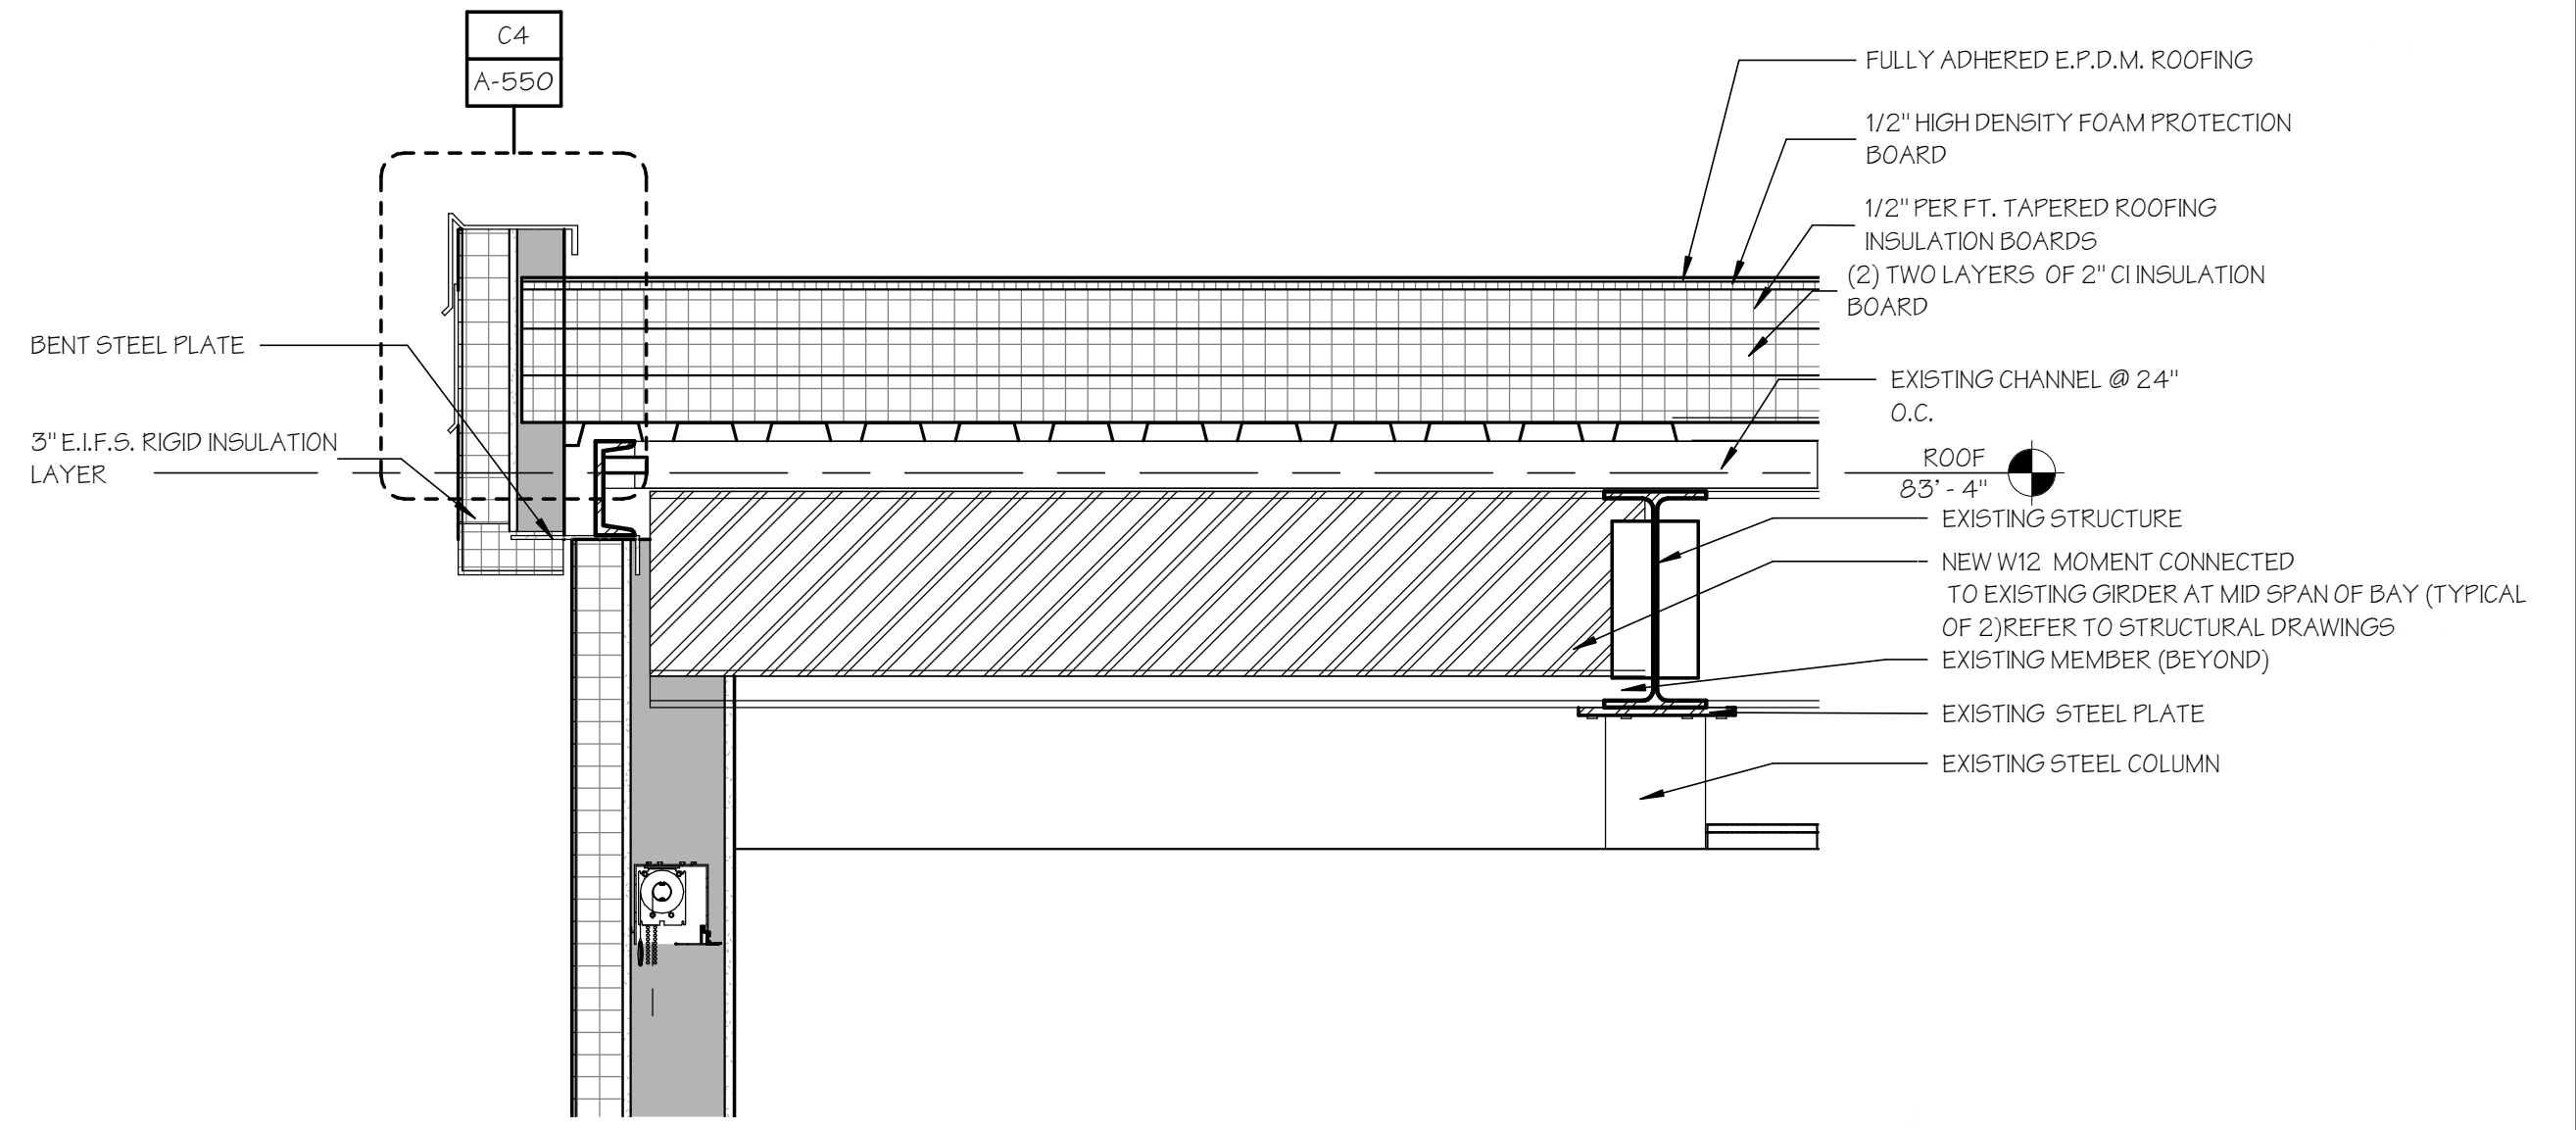

(B1) PENTHOUSE ROOF DETAIL  
SCALE: 1" = 1'-0"

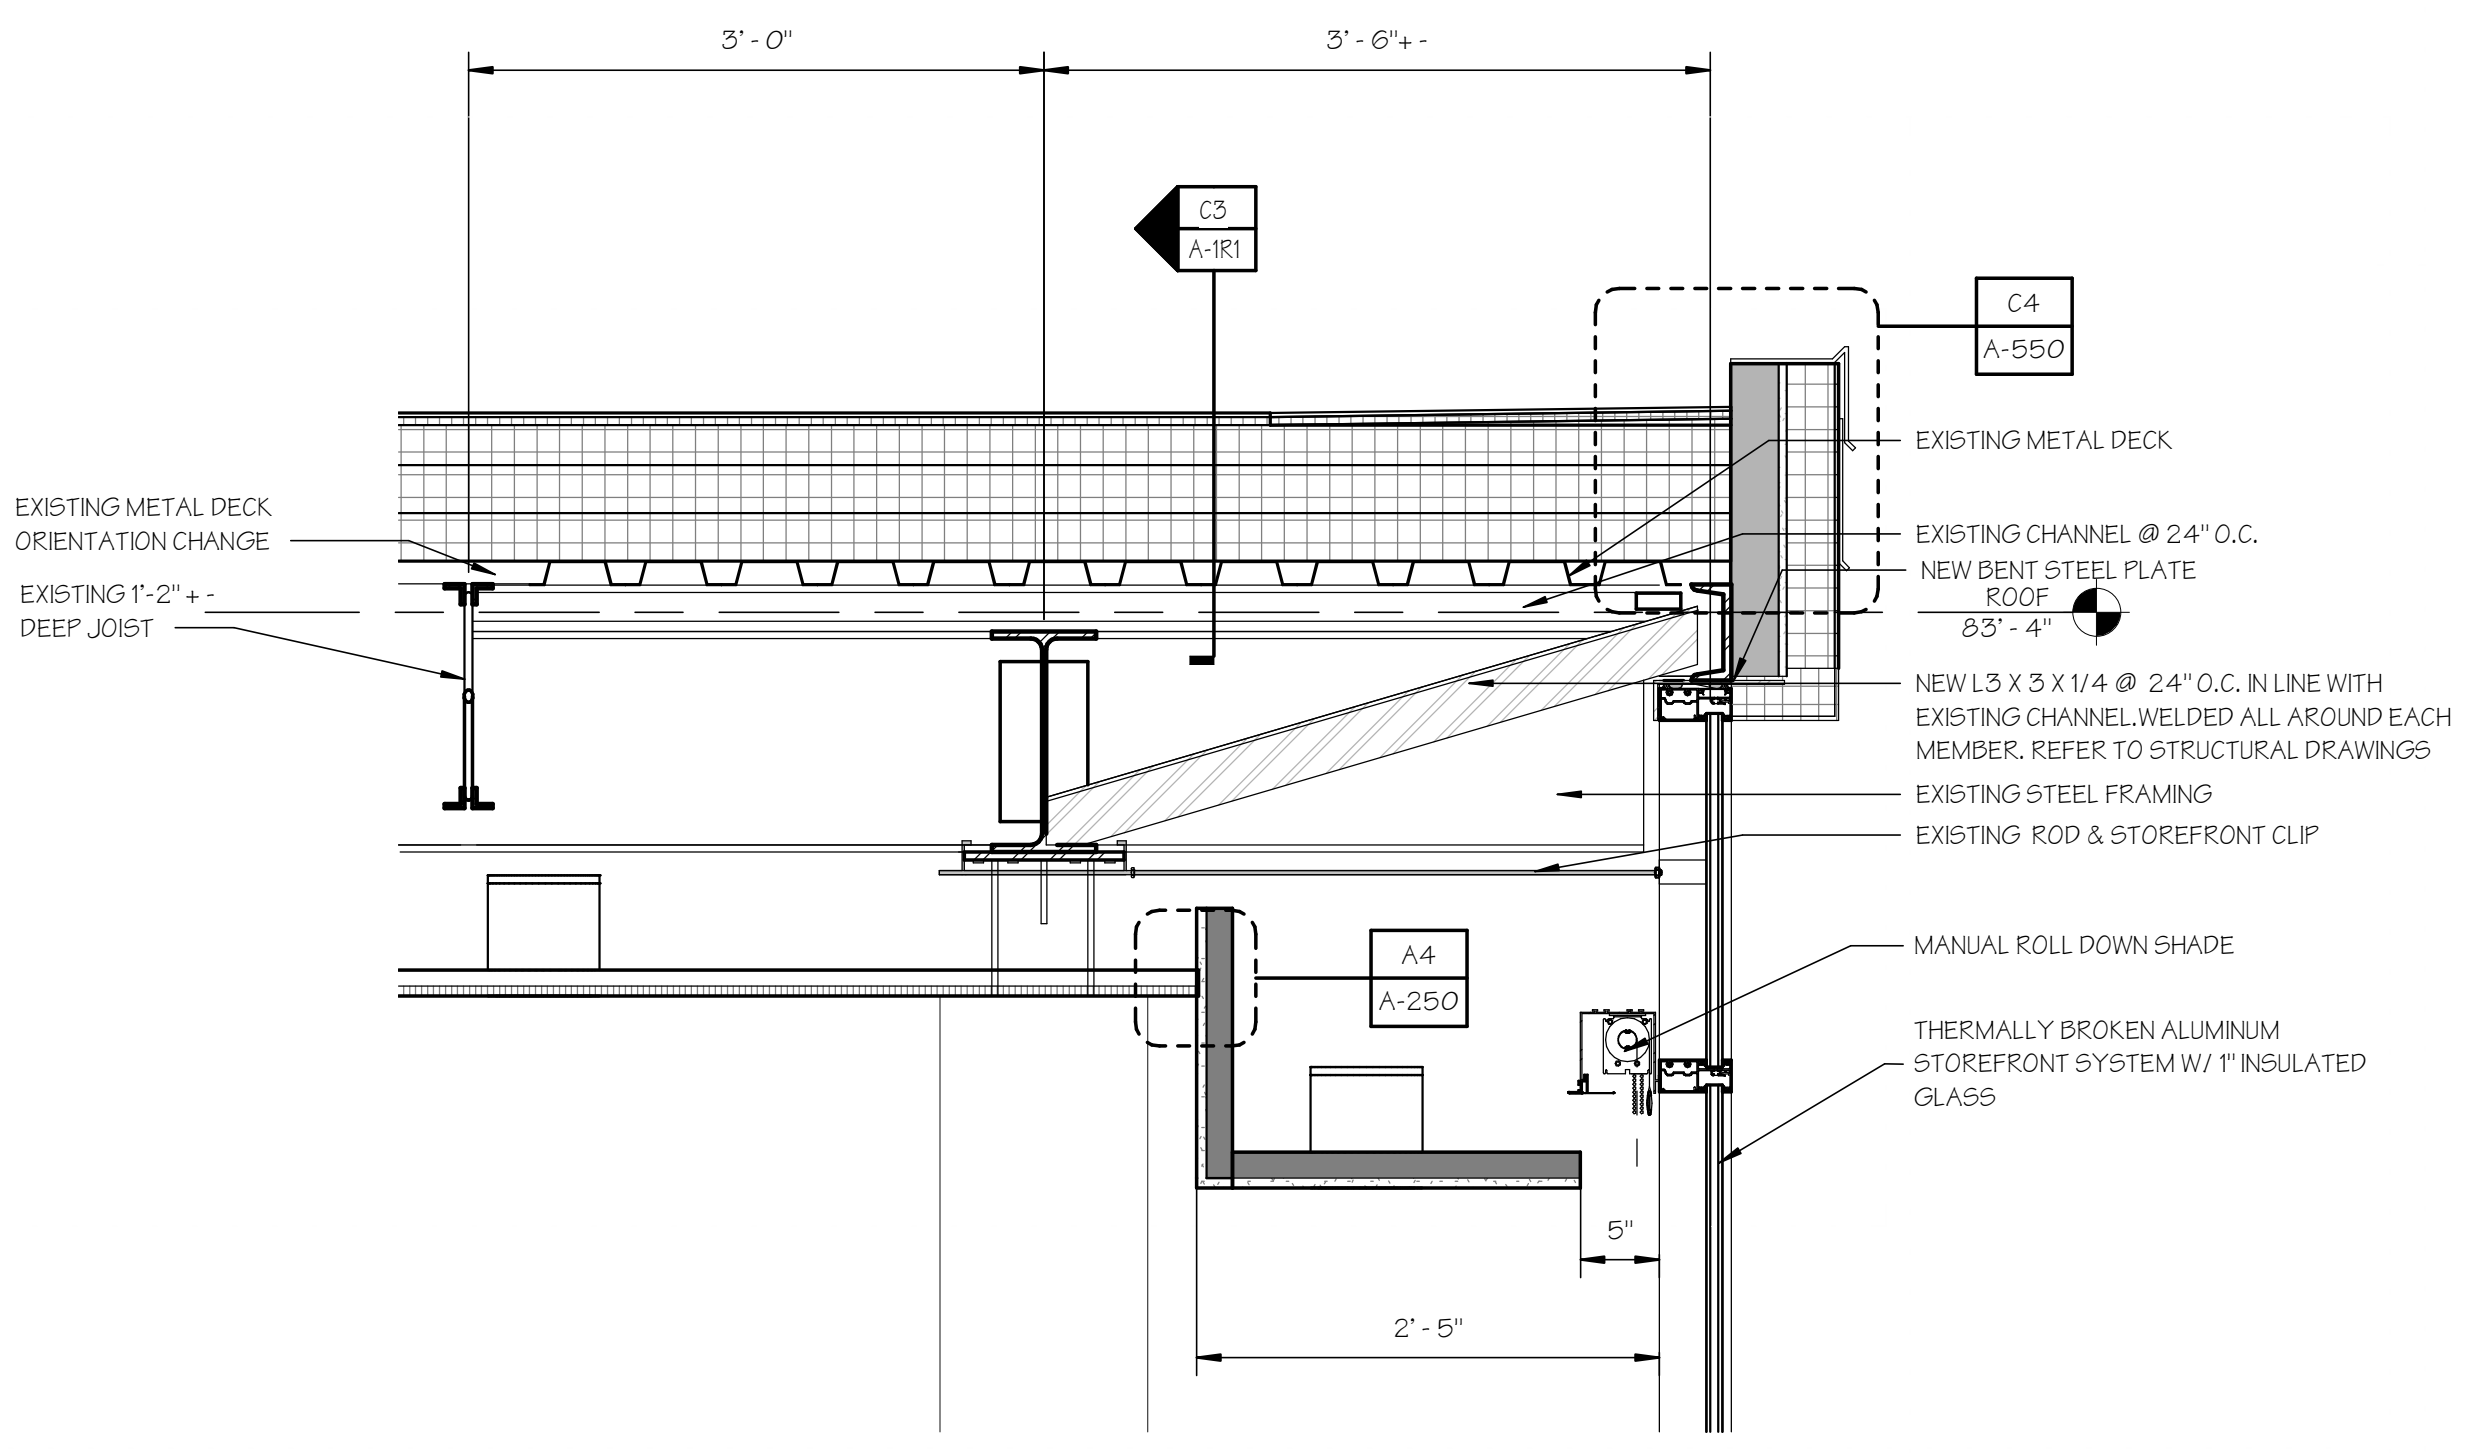


(A2) PENTHOUSE ROOF DETAIL  
SCALE: 1" = 1'-0"

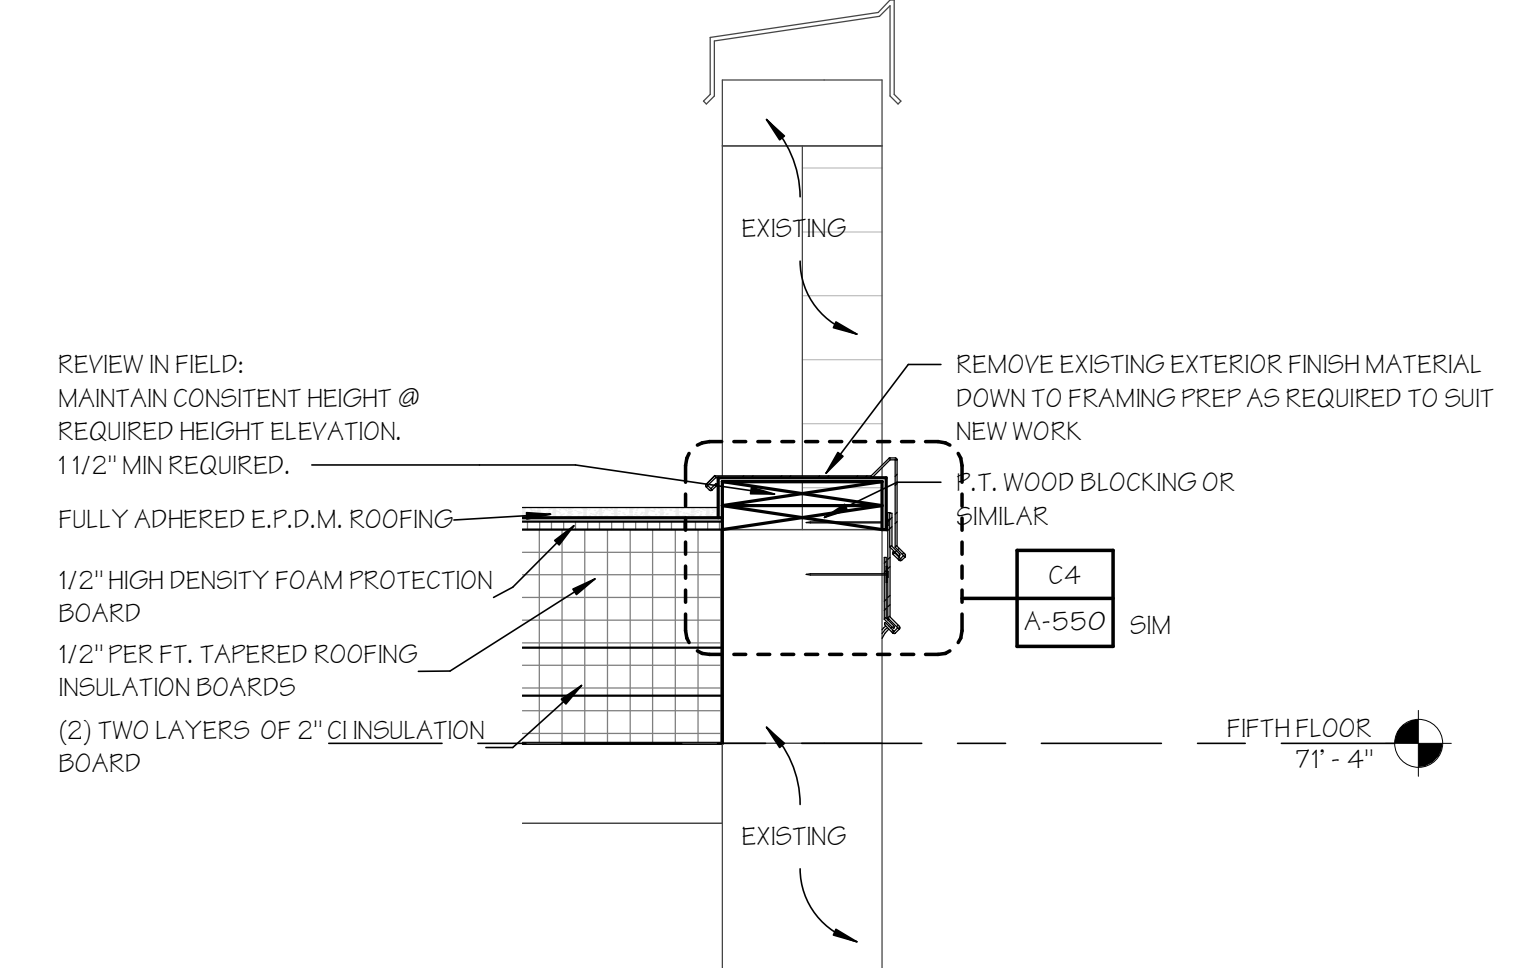


(A1) ROOF ELEVATION OPENING DETAIL  
SCALE: 1" = 1'-0"


2/27/2020 1:07:25 PM  
C:\Users\roscsm\OneDrive\Documents\18052\_Bridgeport Rescue Mission\_Phase 2\_Architecture\_roscsm.dwg

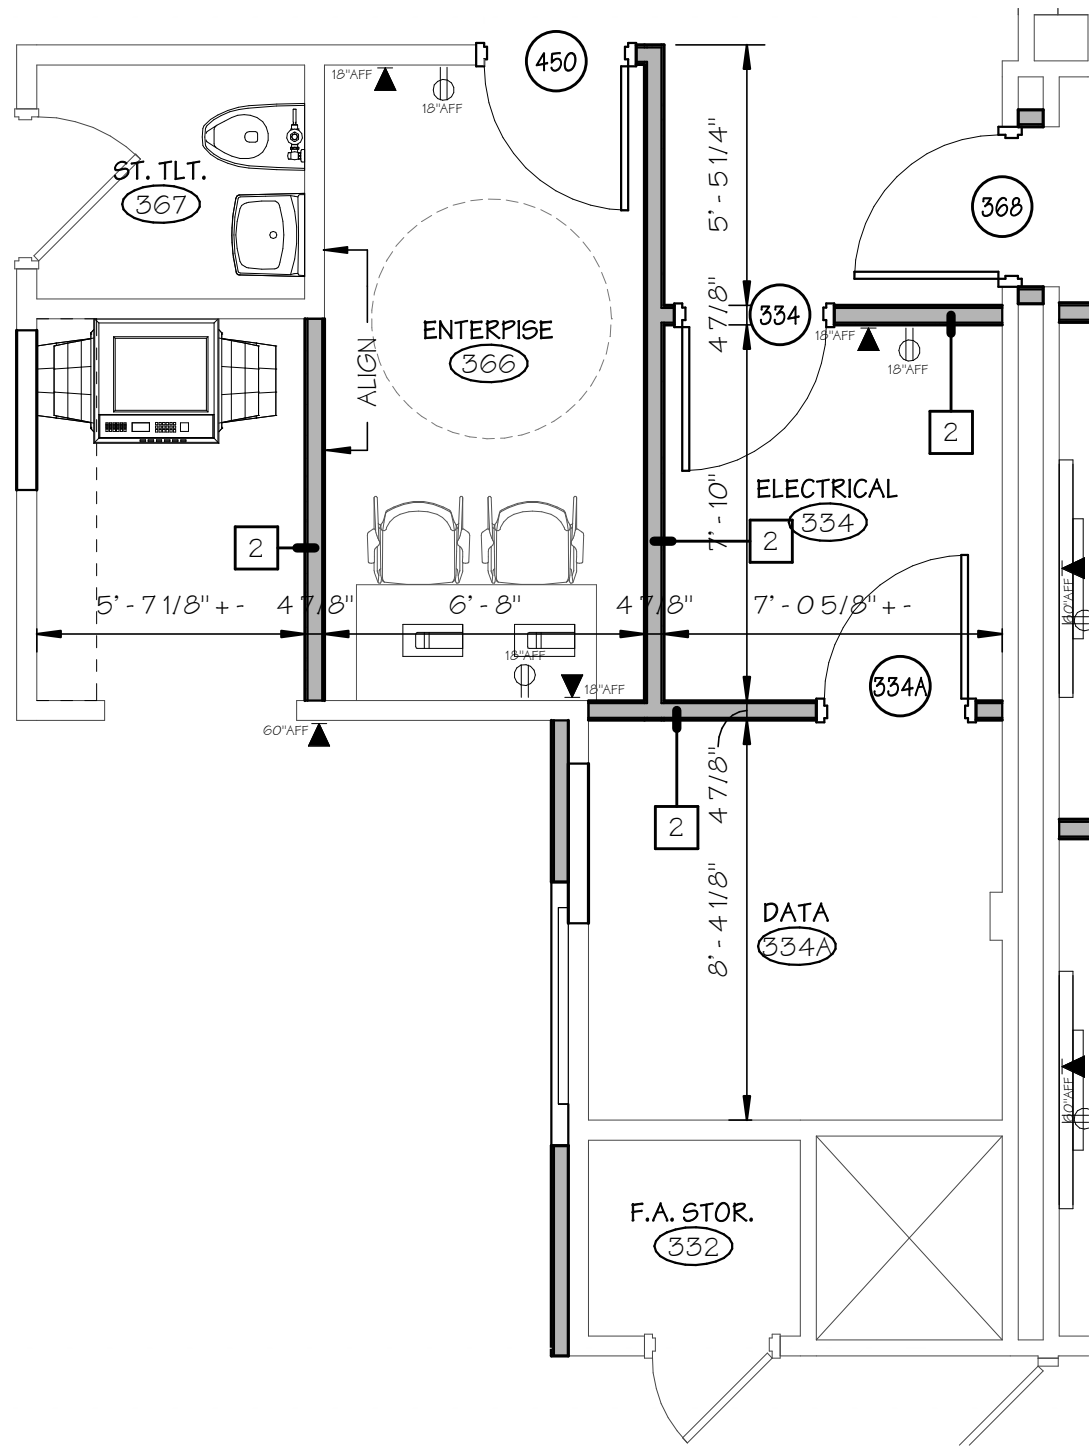


C1 TYPICAL DATA/ELECTRICAL ROOMS  
SCALE: 1/4" = 1'-0"

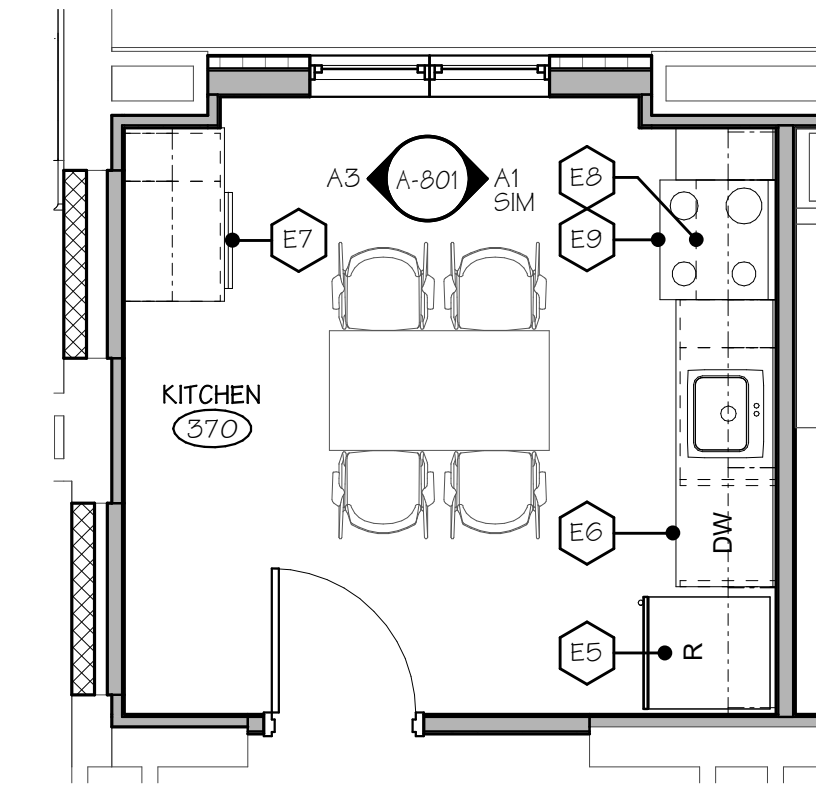


C3 ENLARGED KITCHEN 370  
SCALE: 1/4" = 1'-0"

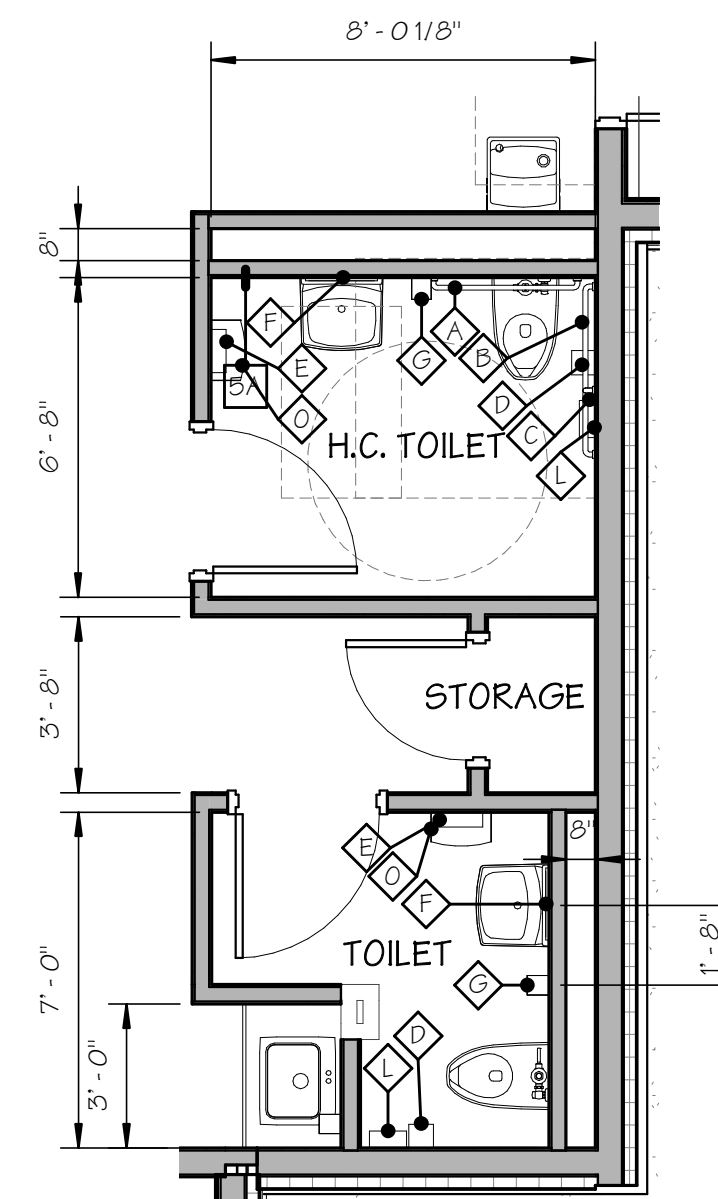


C4 ENLARGED TOILET 5TH FLOOR  
SCALE: 1/4" = 1'-0"

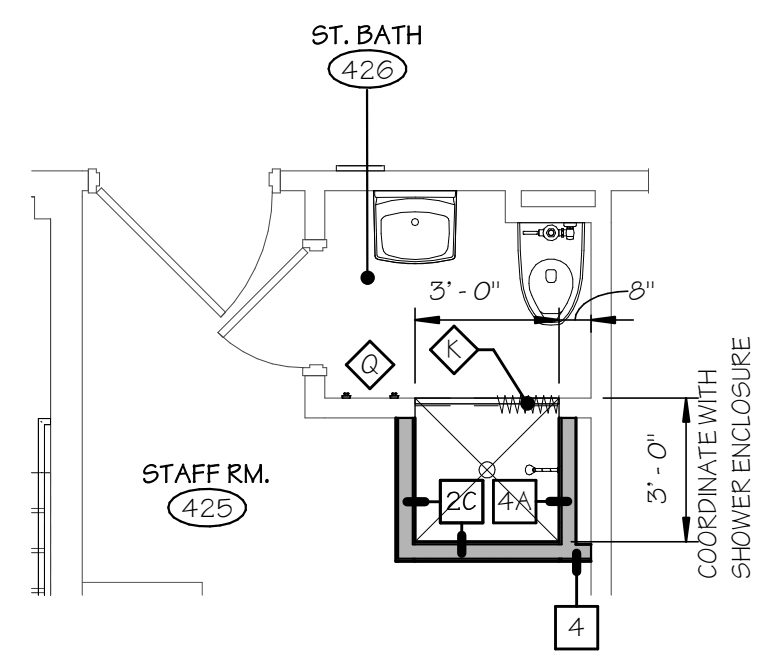


B1 ENLARGED STAFF TOILET 425  
SCALE: 1/4" = 1'-0"

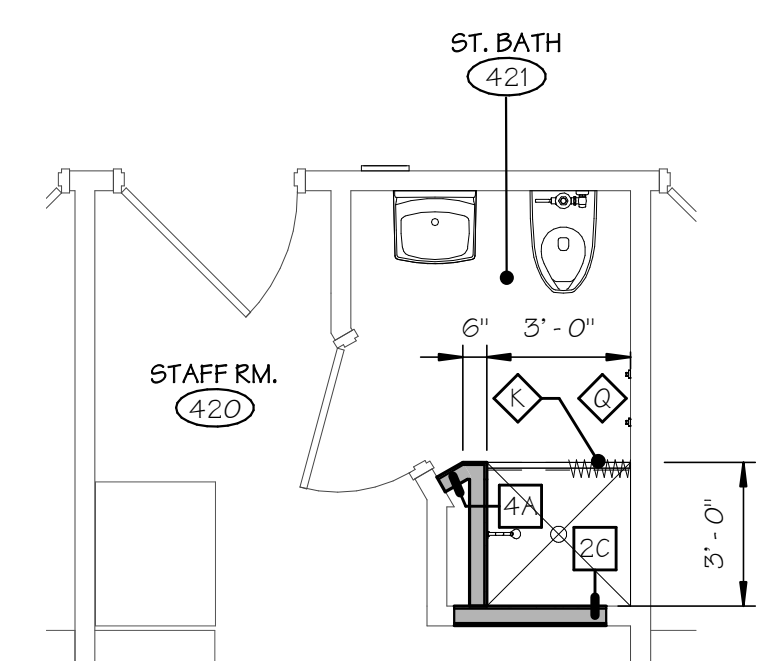


B2 ENLARGED STAFF TOILET 420  
SCALE: 1/4" = 1'-0"

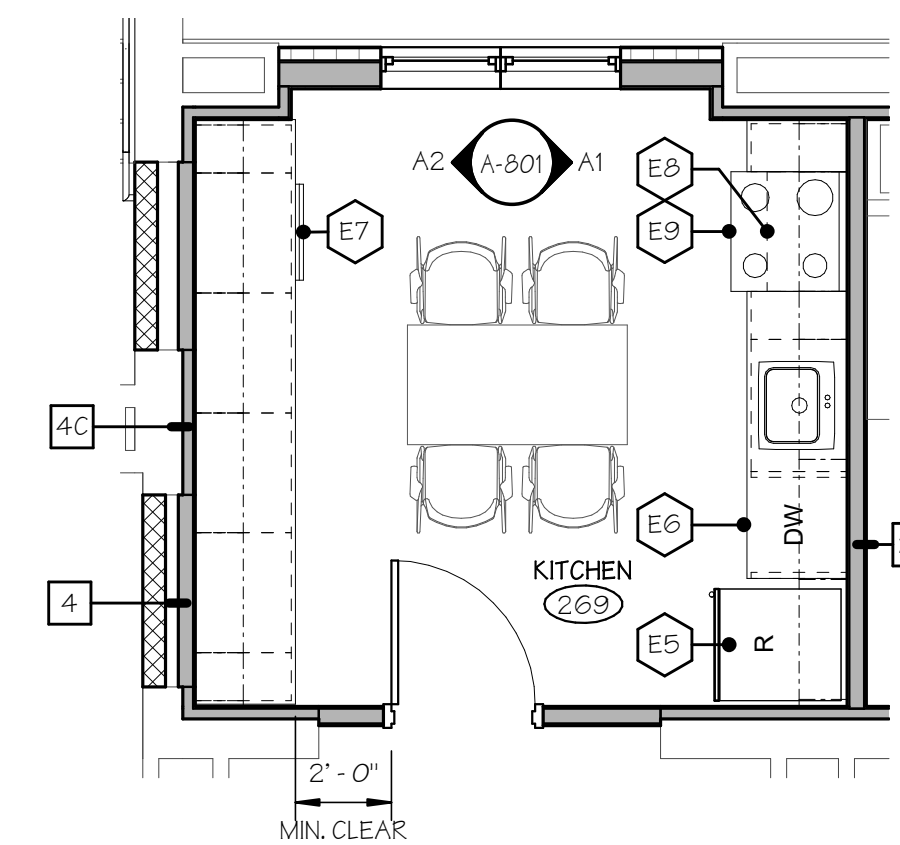


B3 ENLARGED KITCHEN 269  
SCALE: 1/4" = 1'-0"

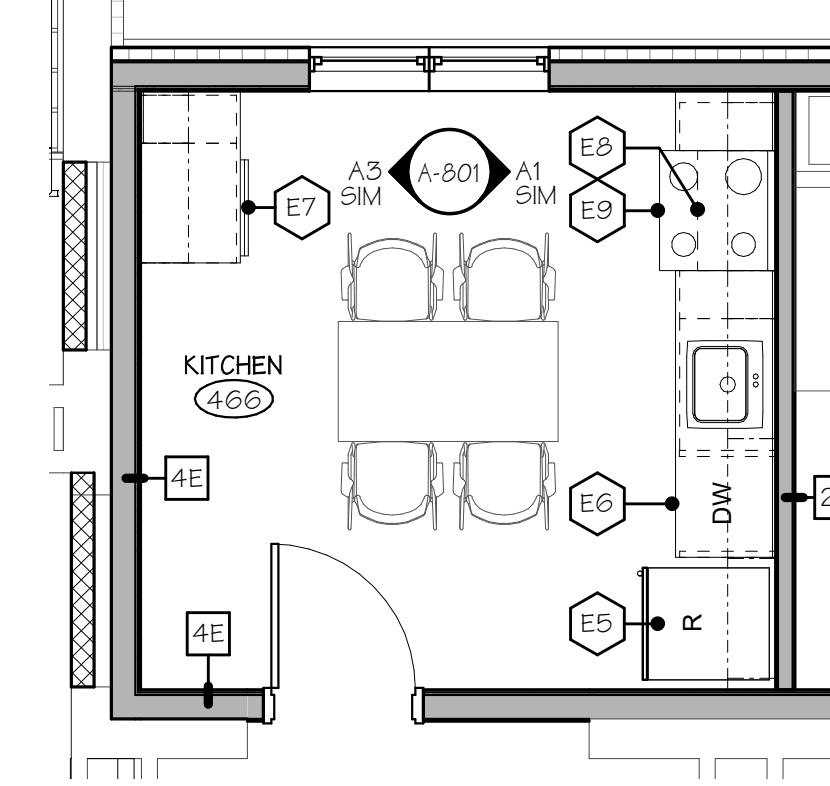


B4 ENLARGED KITCHEN 466  
SCALE: 1/4" = 1'-0"

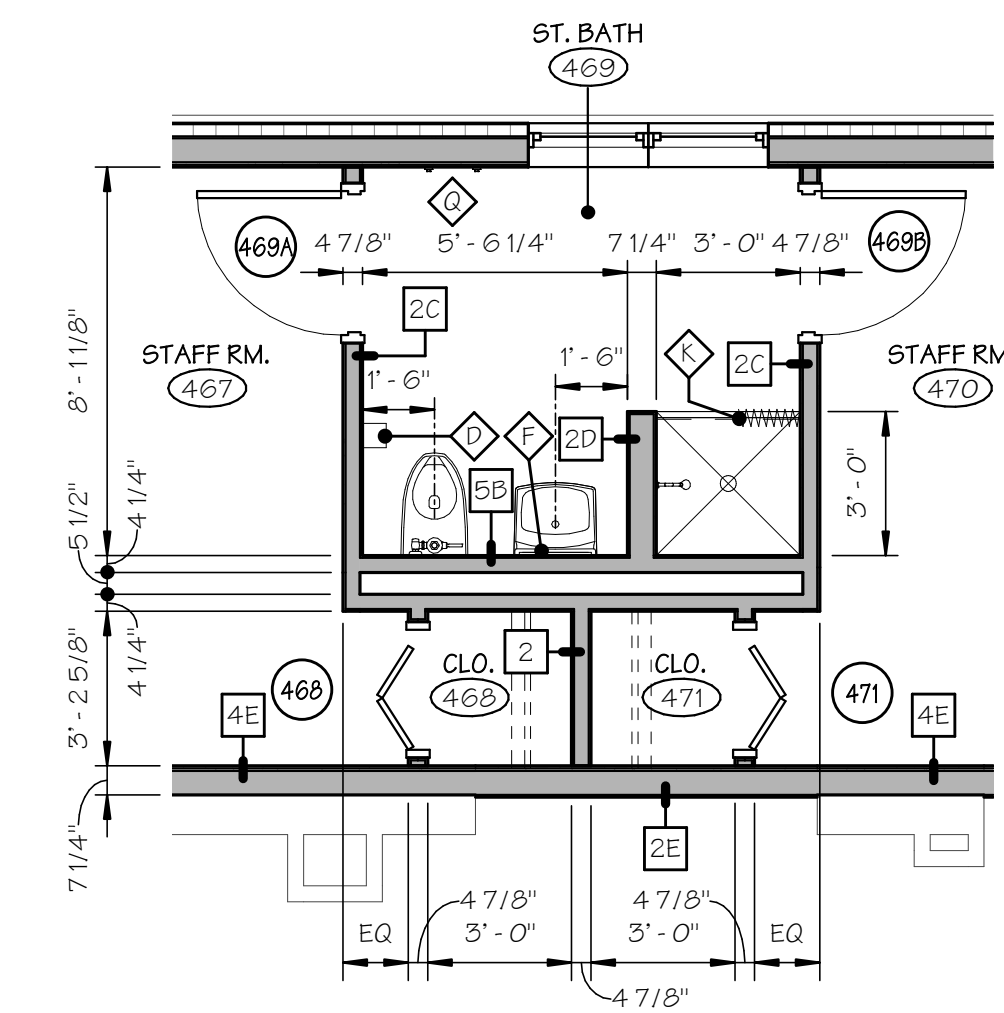


B5 ENLARGED STAFF ROOM 467 & 470  
SCALE: 1/4" = 1'-0"

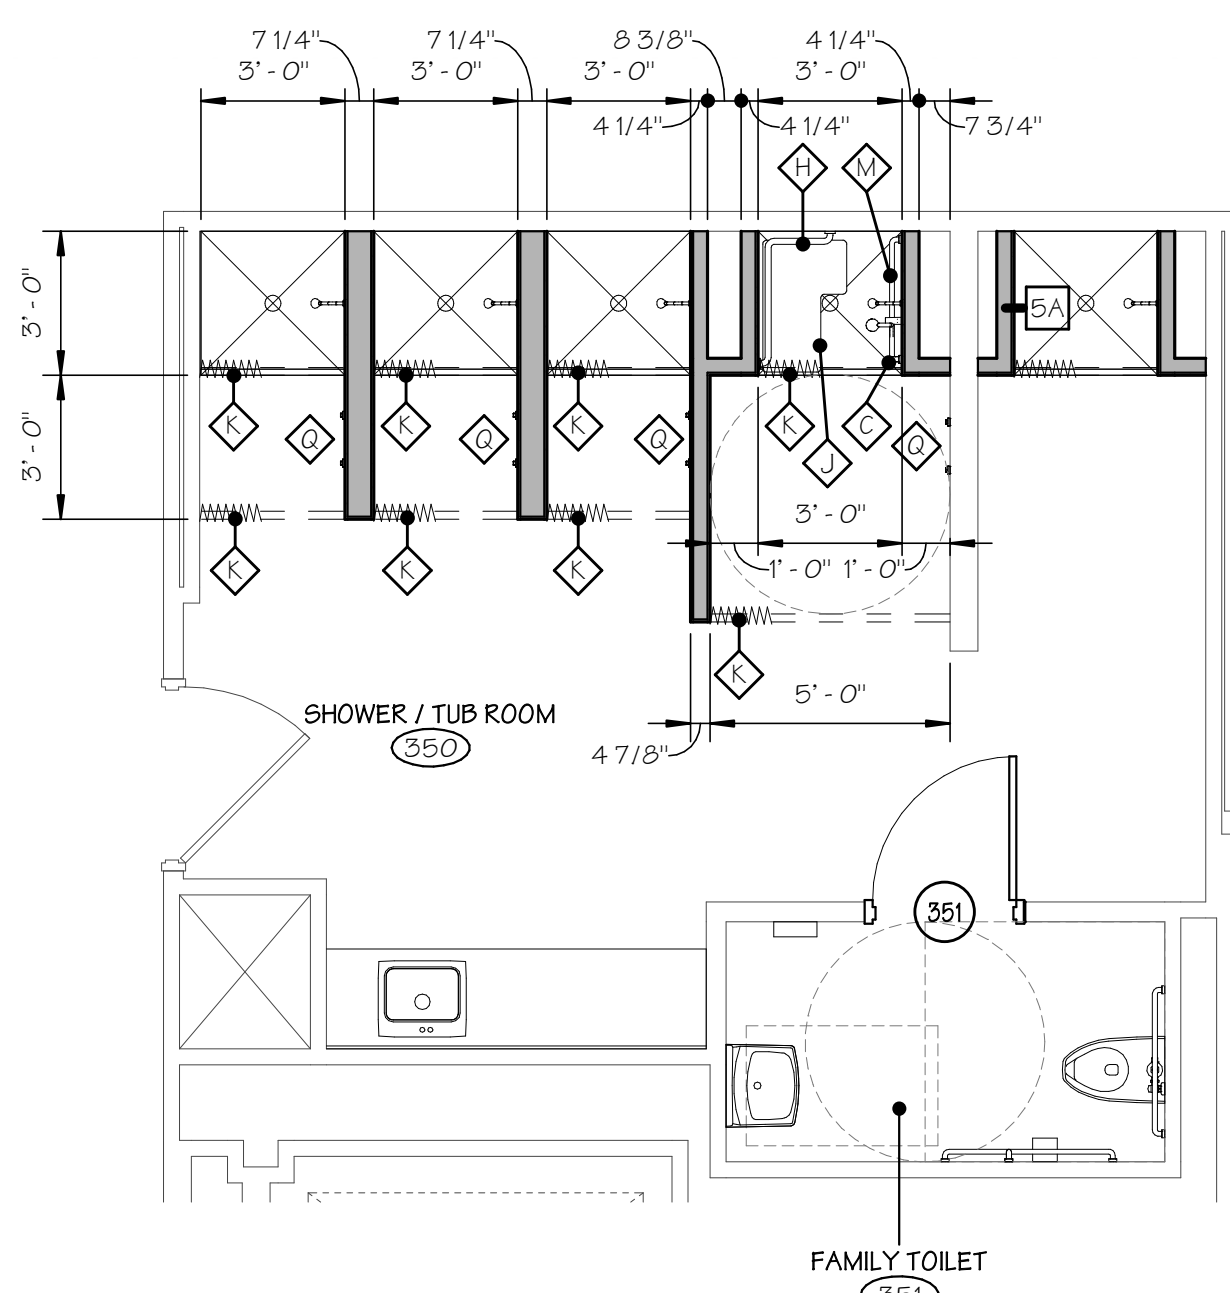


A1 ENLARGED SHOWER 350  
SCALE: 1/4" = 1'-0"

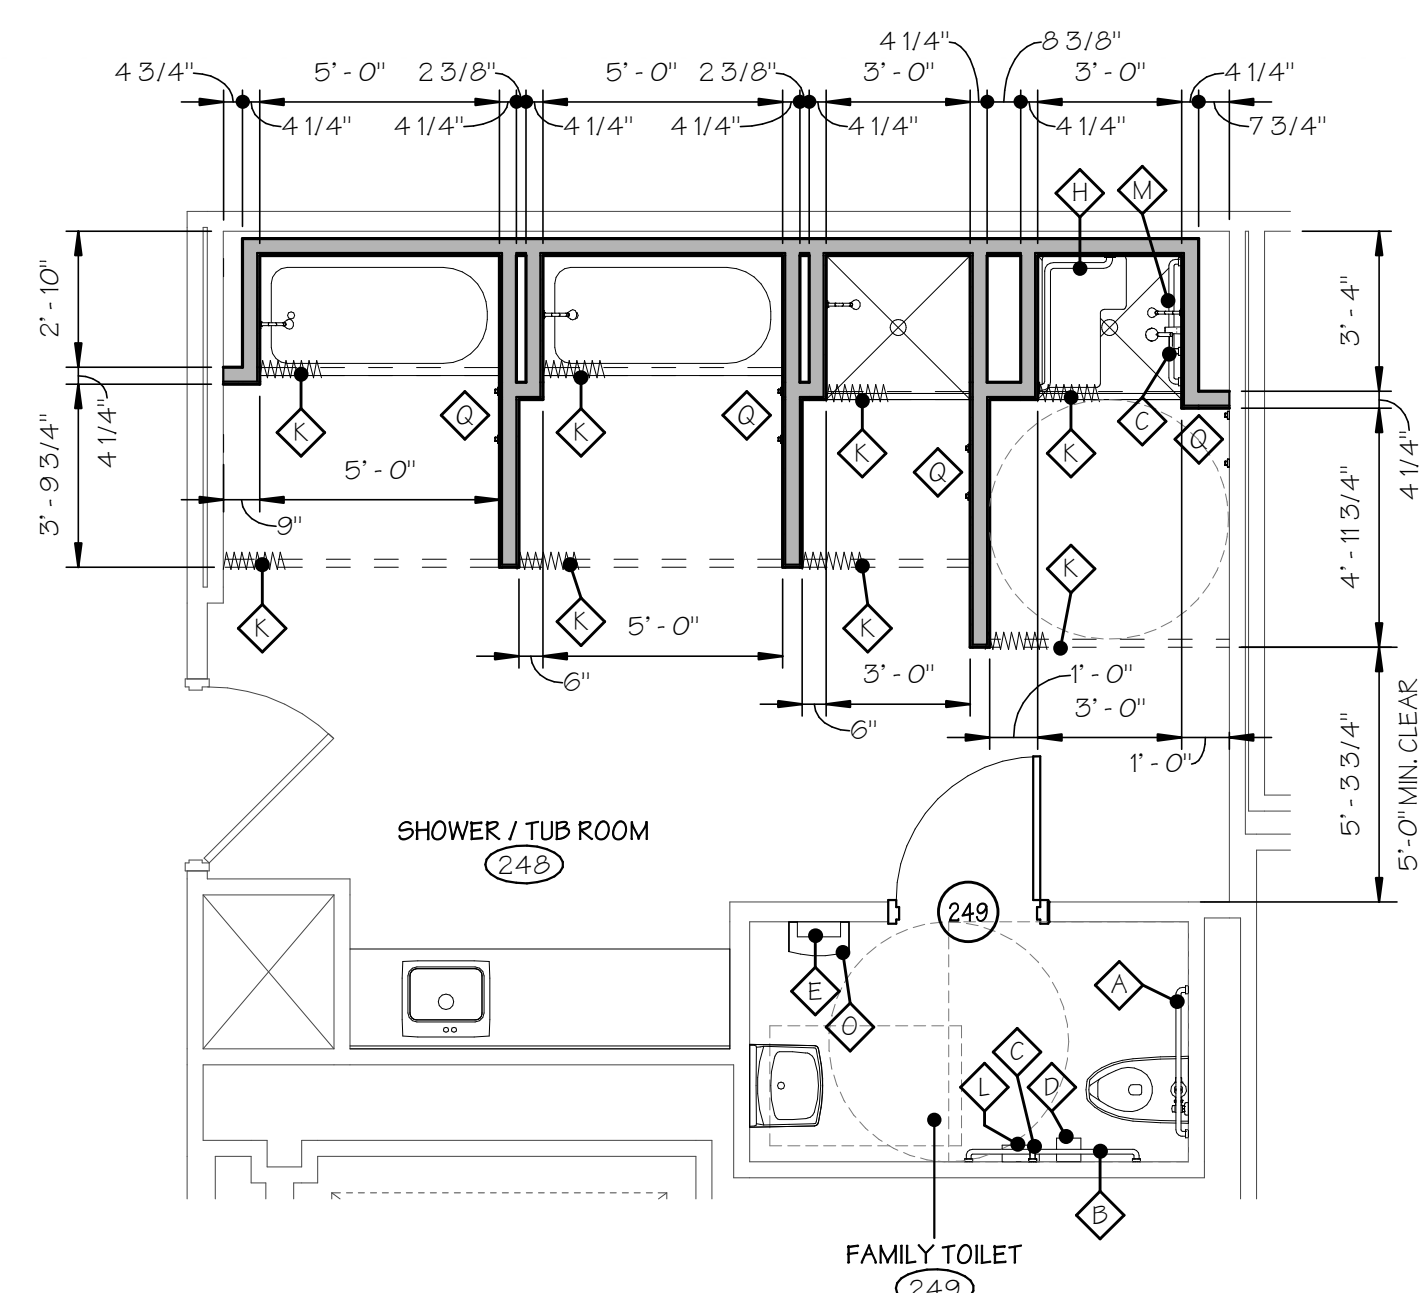

A2 ENLARGED SHOWER ROOM 248  
SCALE: 1/4" = 1'-0"

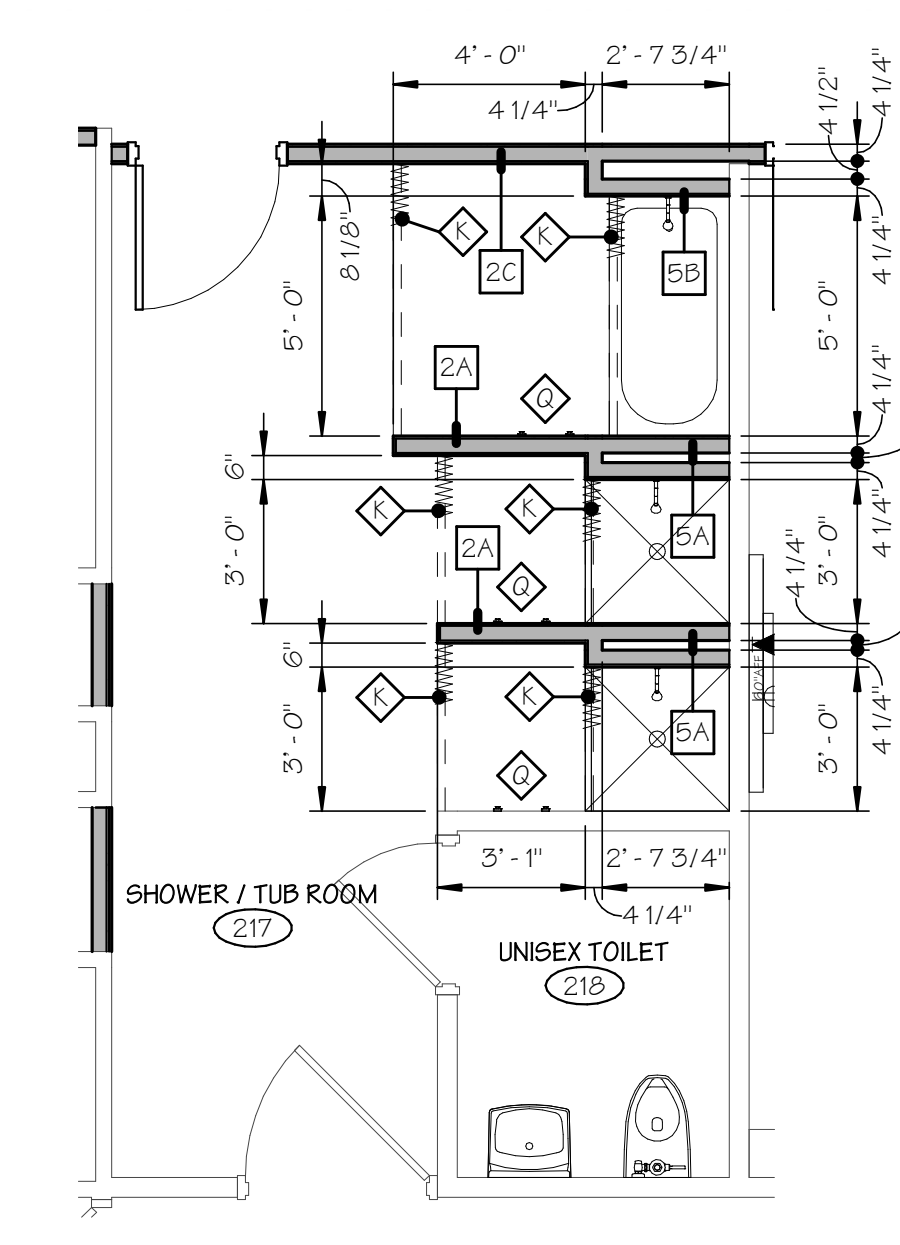

A3 ENLARGED SHOWER ROOM 217  
SCALE: 1/4" = 1'-0"

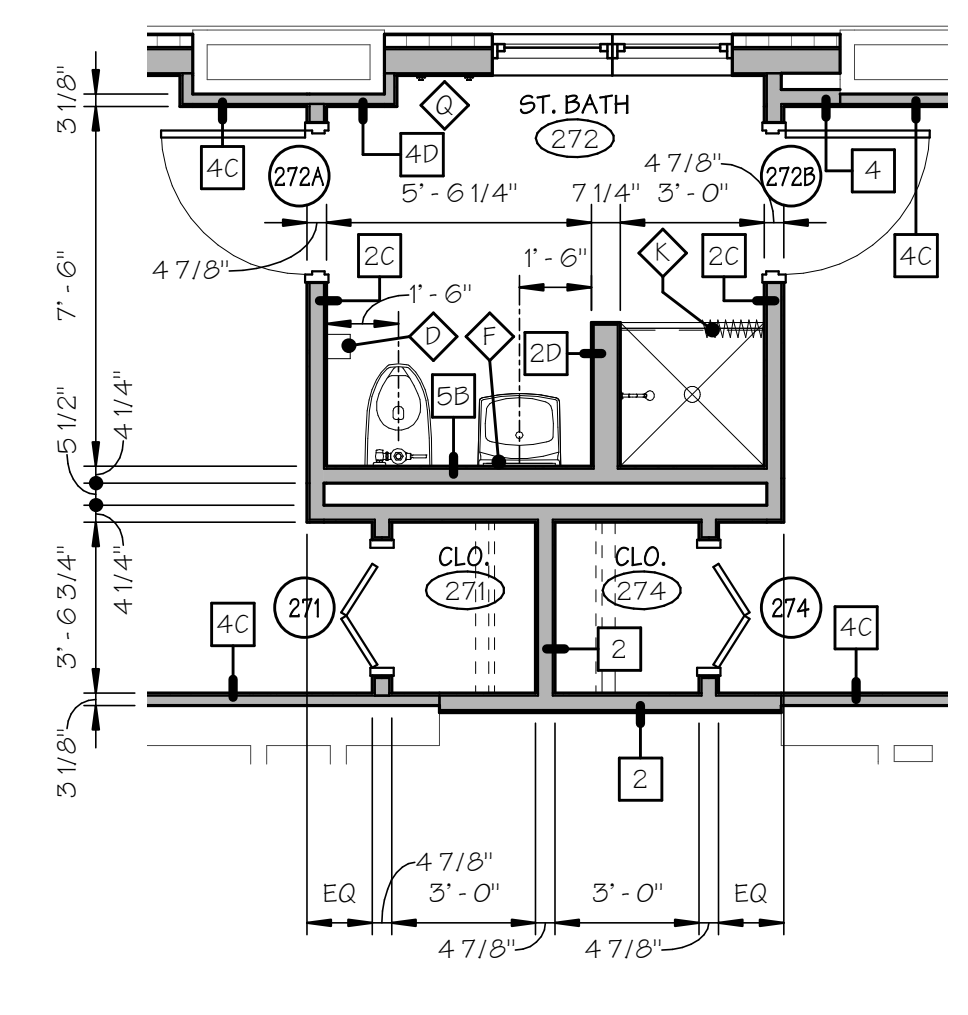

A4 ENLARGED ST. BATH 272  
SCALE: 1/4" = 1'-0"

GENERAL BATHROOM & SHOWER NOTES

- NOTE: THE FOLLOWING NOTES APPLY TO ALL AREAS OF REQUIRED WORK.
1. REFER TO INFO-2 FOR ALL MOUNTING HEIGHTS FOR HANDICAPPED ACCESSIBLE FIXTURES AND TYPICAL DIMENSIONS AT ACCESSIBLE TOILETS.
  2. PROVIDE BLOCKING AS REQUIRED PER TYPICAL MOUNTING HEIGHTS AT METAL STUD PARTITIONS.
  3. SEE SPECIFICATION SECTION 102800- TOILET, BATH AND LAUNDRY ACCESSORIES FOR ADDITIONAL INFORMATION.
  4. 5% OF EACH TYPE OF LOCKER TO BE FITTED FOR ACCESSIBLE USE.
  5. REFER TO FINISH PLANS FOR WALL TILE FINISHES IN TOILETS AND LOCKER ROOMS.

ACCESSORY LEGEND

- A 1 1/2" DIA. STAINLESS STEEL GRAB BAR - 36" LONG
- B 1 1/2" DIA. STAINLESS STEEL GRAB BAR - 42" LONG
- C 1 1/2" DIA. STAINLESS STEEL GRAB BAR - 18" LONG
- D SURFACE MOUNTED TOILET PAPER DISPENSER
- E SURFACE MOUNTED PAPER TOWEL DISPENSER
- F 18" x 30" ADA STAINLESS STEEL FRAMED MIRROR
- G SURFACE MOUNTED SOAP DISPENSER
- H 1 1/2" DIA. STAINLESS STEEL GRAB BAR - 12" LONG
- I 1 1/2" DIA. STAINLESS STEEL GRAB BAR - 30" LONG
- M (2) TOWEL HOOKS - 48" A.F.F.
- R CALL FOR AID SWITCH W/ CORD CONNECTED TO VISIBLE & AUDIBLE ALARM IN CORRIDOR
- S TOILET PARTITION DOOR WITH PRIVACY LATCH (TP-1) REFER TO FINISH LEGEND



COPYRIGHT 2017 BY:  
ANTIINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Newark, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:

**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
04.16.2020 - CM BID

REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
ENLARGED FLOOR PLANS,  
ELEVATIONS AND MISCELLANEOUS  
DETAILS

SCALE: 1/4" = 1'-0"	DRAWN BY: KWG	REVIEWED BY: DCF
------------------------	------------------	---------------------

DRAWING NO.:

**A-601**  
04.16.2020 - CM BID

DATE:  
31 JANUARY 2020

JOB NUMBER:  
18052




These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:


**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
**04.16.2020 - CM BID**

REVISIONS


NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

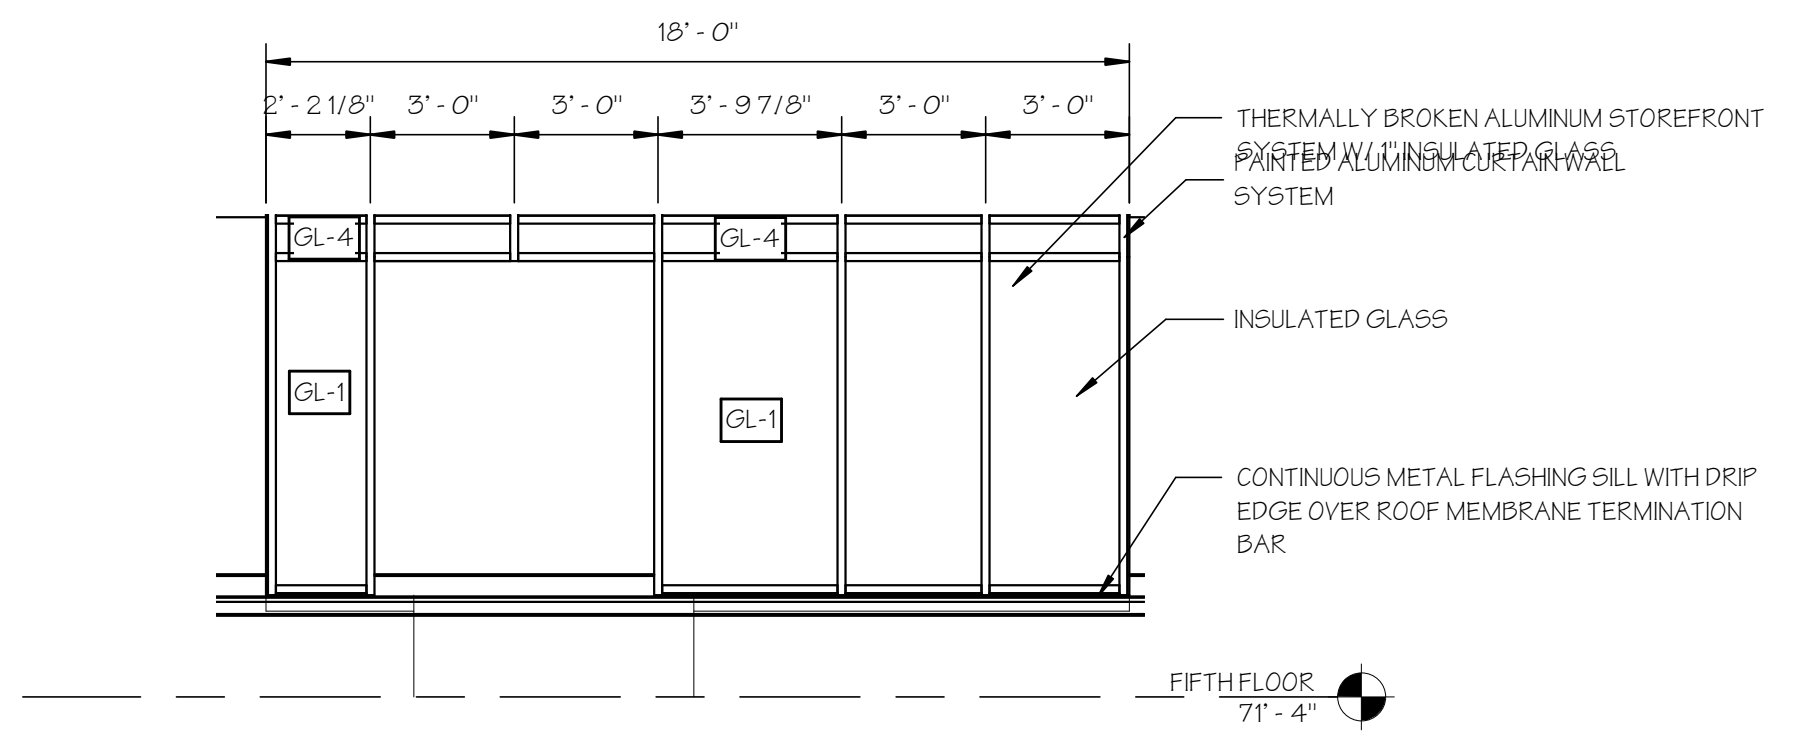


**D2 STOREFRONT ELEVATION**  
SCALE: 1/4" = 1'-0"

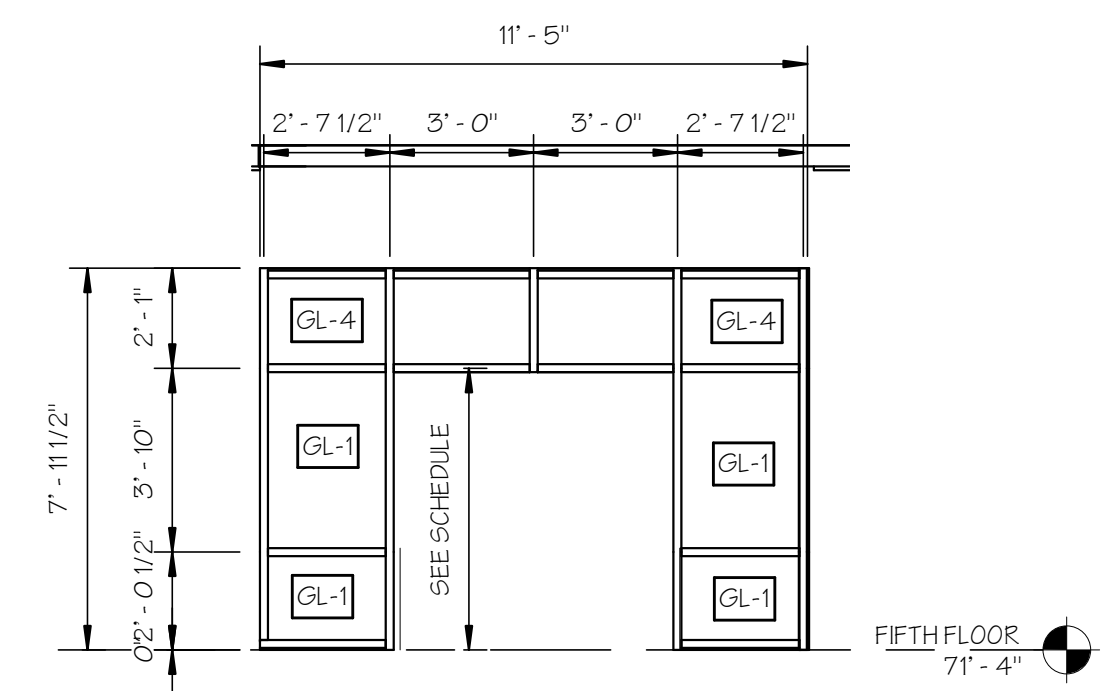


**D3 STOREFRONT ELEVATION**  
SCALE: 1/4" = 1'-0"

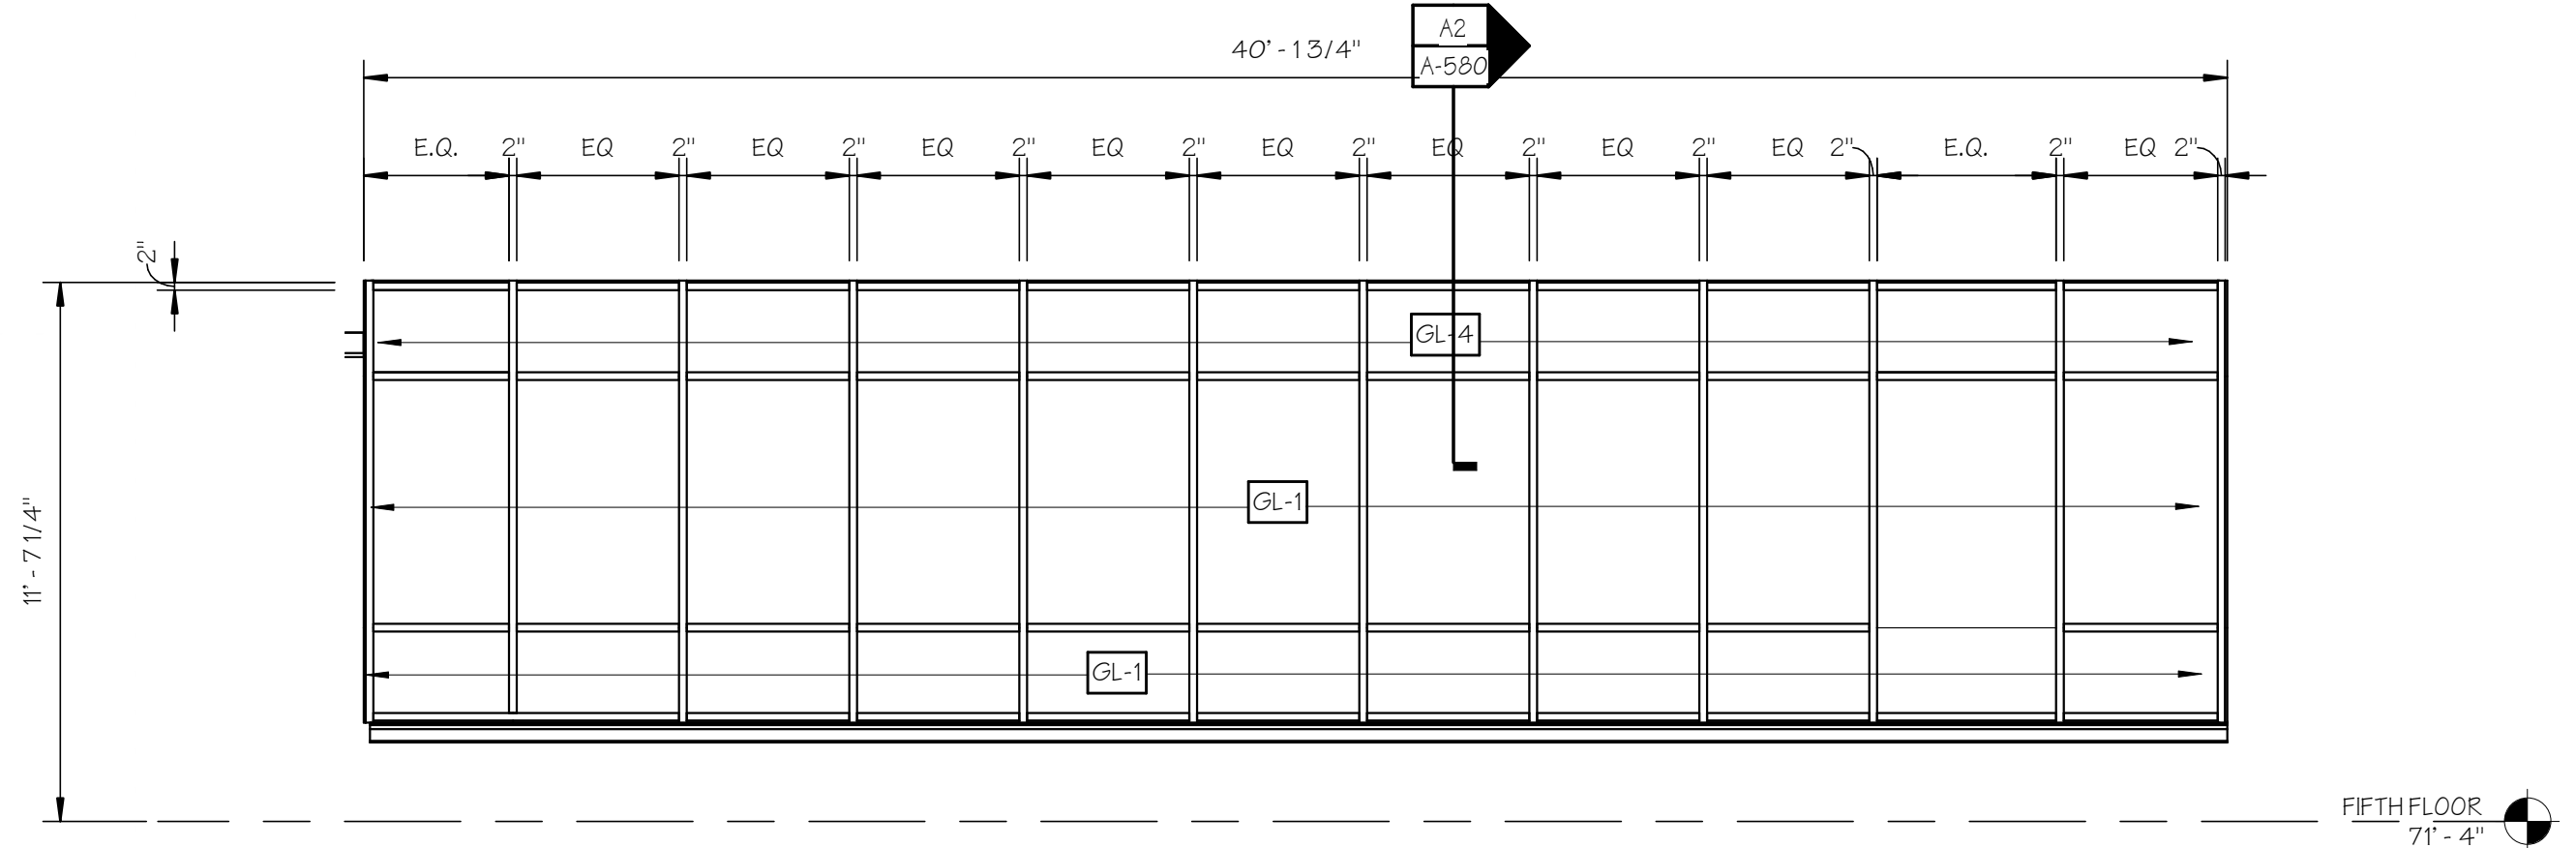


**C1 STOREFRONT ELEVATION**  
SCALE: 1/4" = 1'-0"

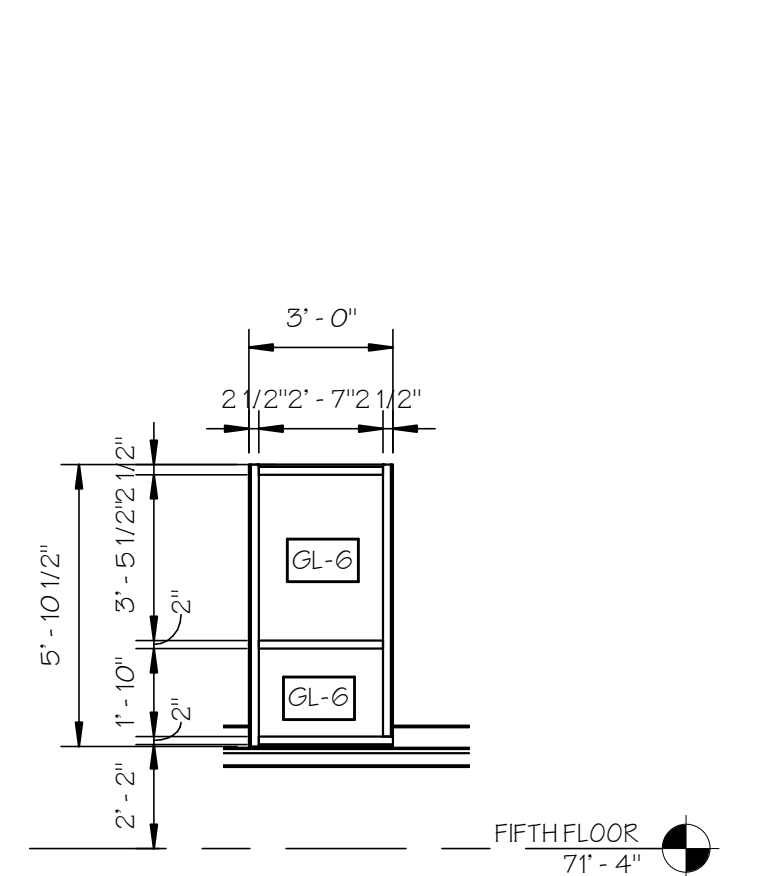


**C2 STOREFRONT ELEVATION**  
SCALE: 1/4" = 1'-0"

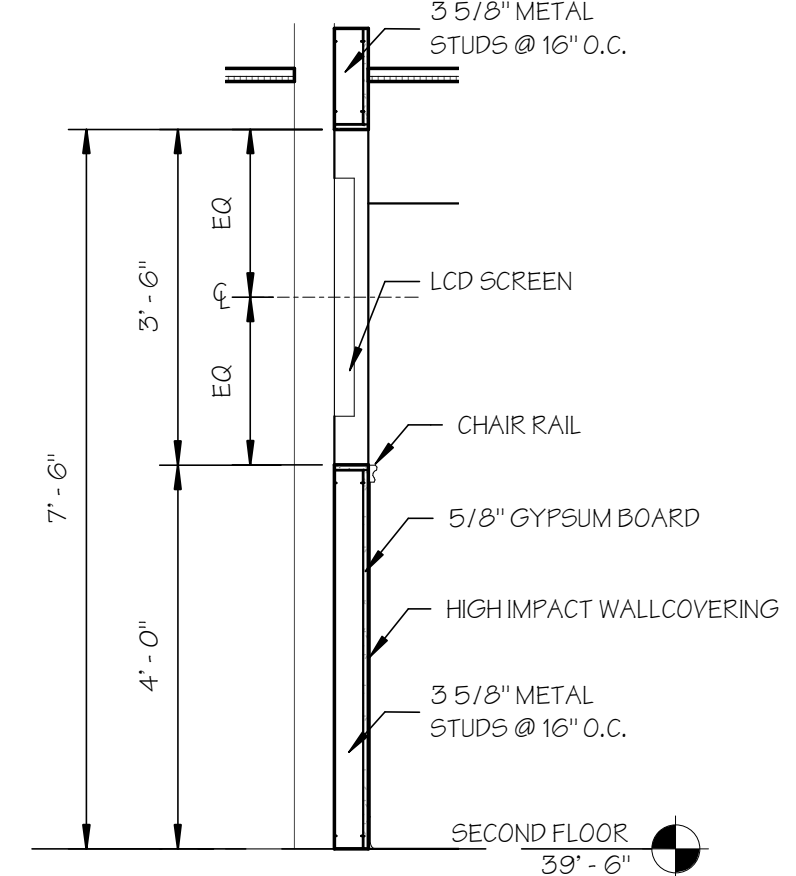


**C3 SECTION DETAIL**  
SCALE: 1/2" = 1'-0"

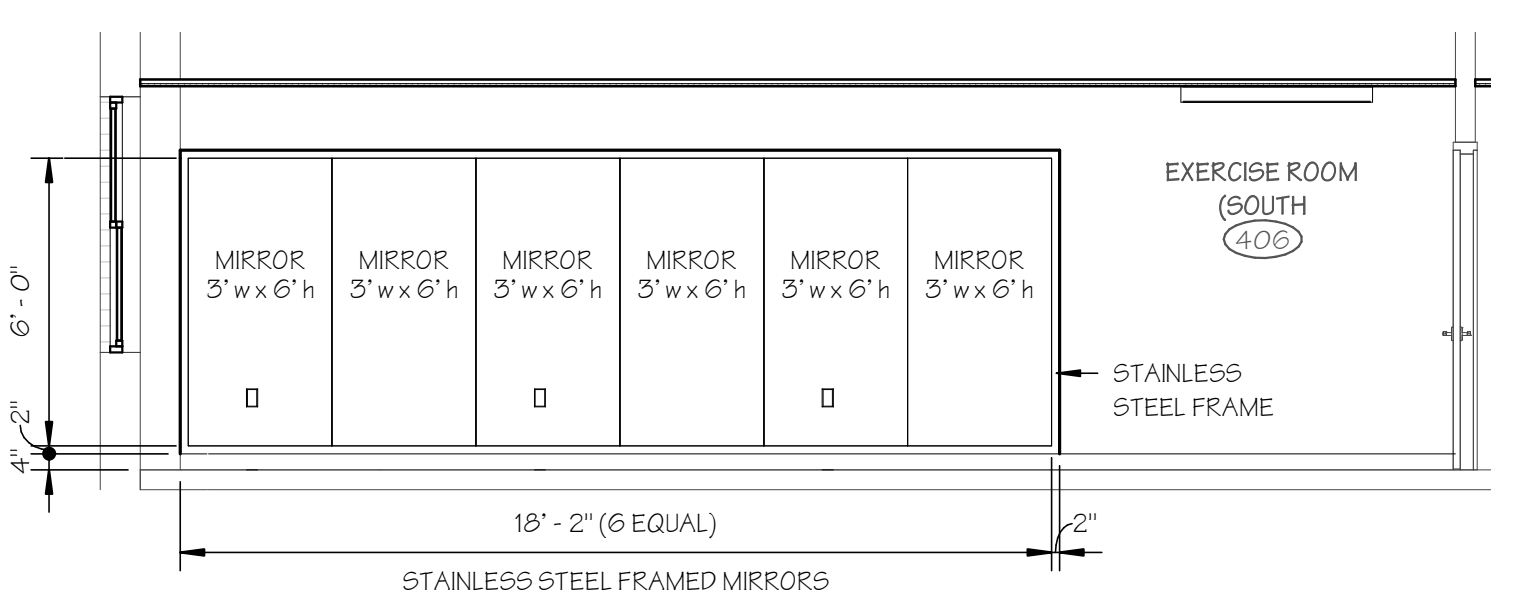


**B1 INTERIOR ELEVATION**  
SCALE: 1/4" = 1'-0"

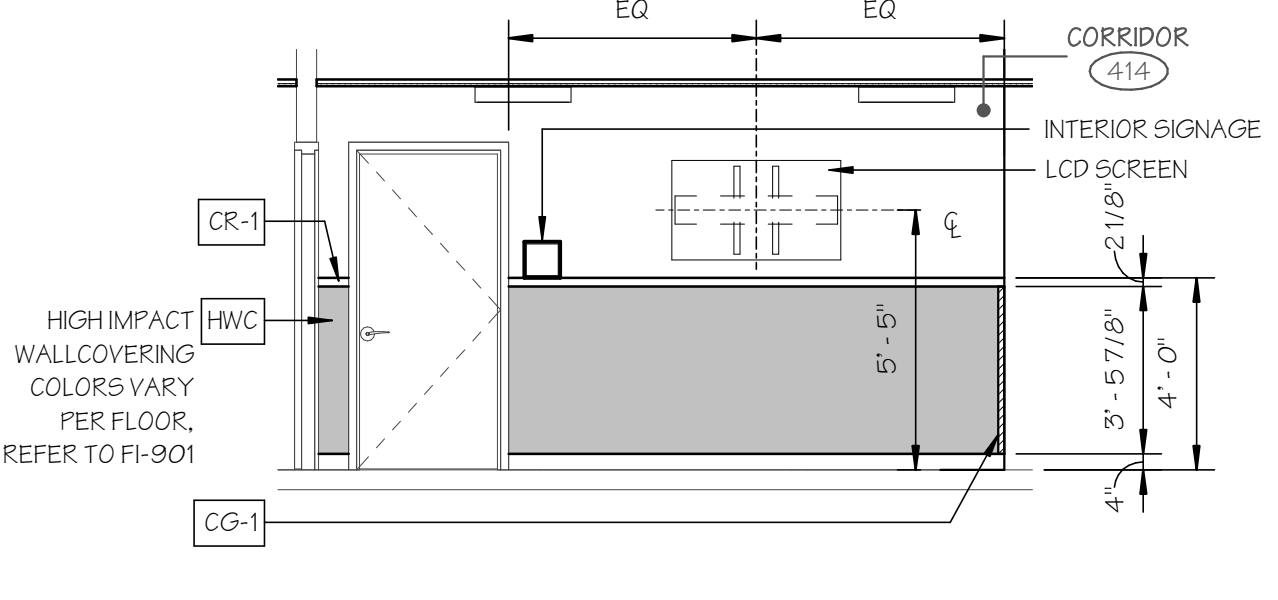


**B2 INTERIOR ELEVATION**  
SCALE: 1/4" = 1'-0"

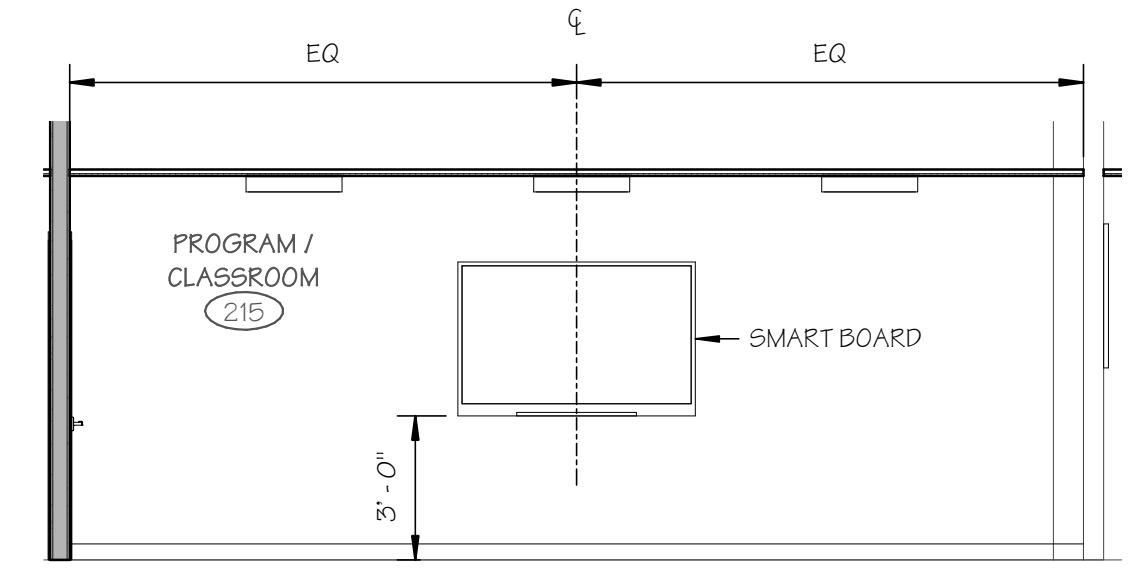


**B3 INTERIOR ELEVATION**  
SCALE: 1/4" = 1'-0"

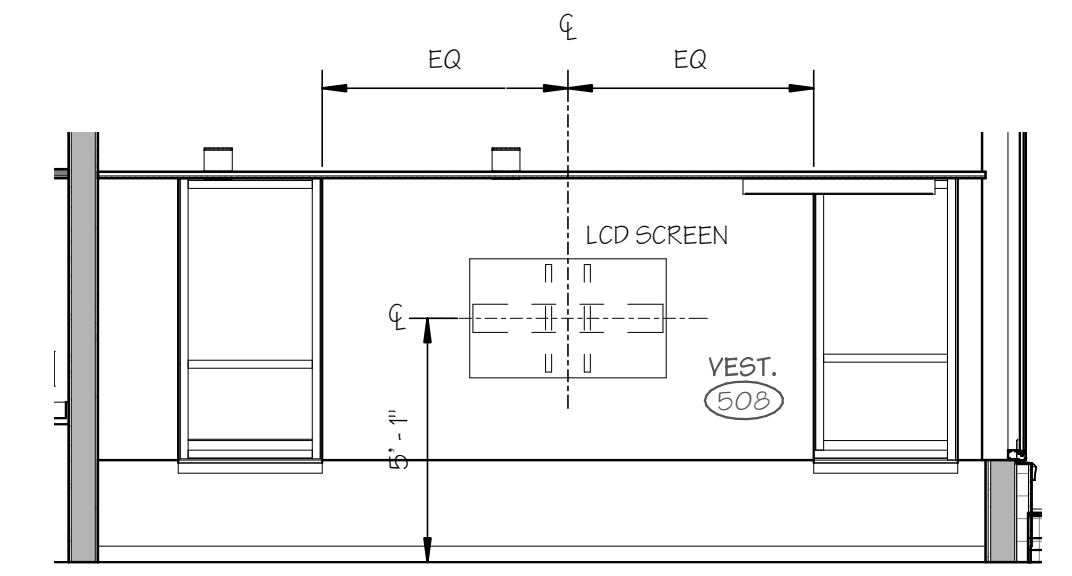


**B4 INTERIOR ELEVATION**  
SCALE: 1/4" = 1'-0"

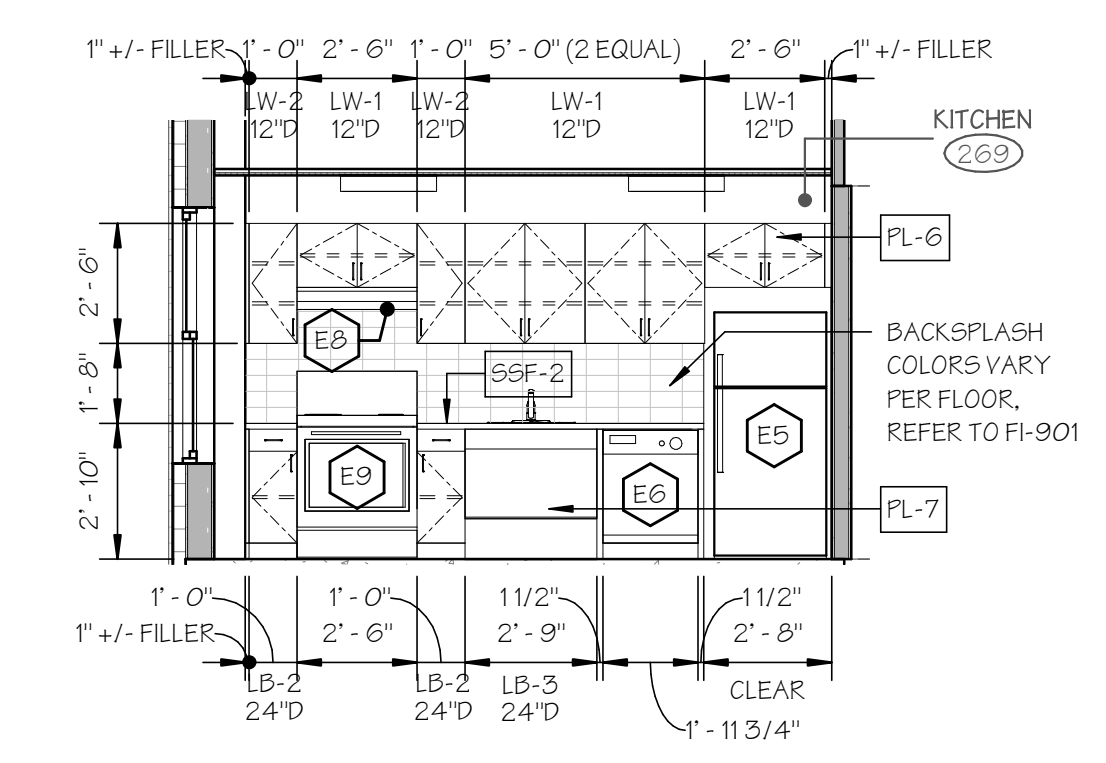


**A1 INTERIOR ELEVATION**  
SCALE: 1/4" = 1'-0"

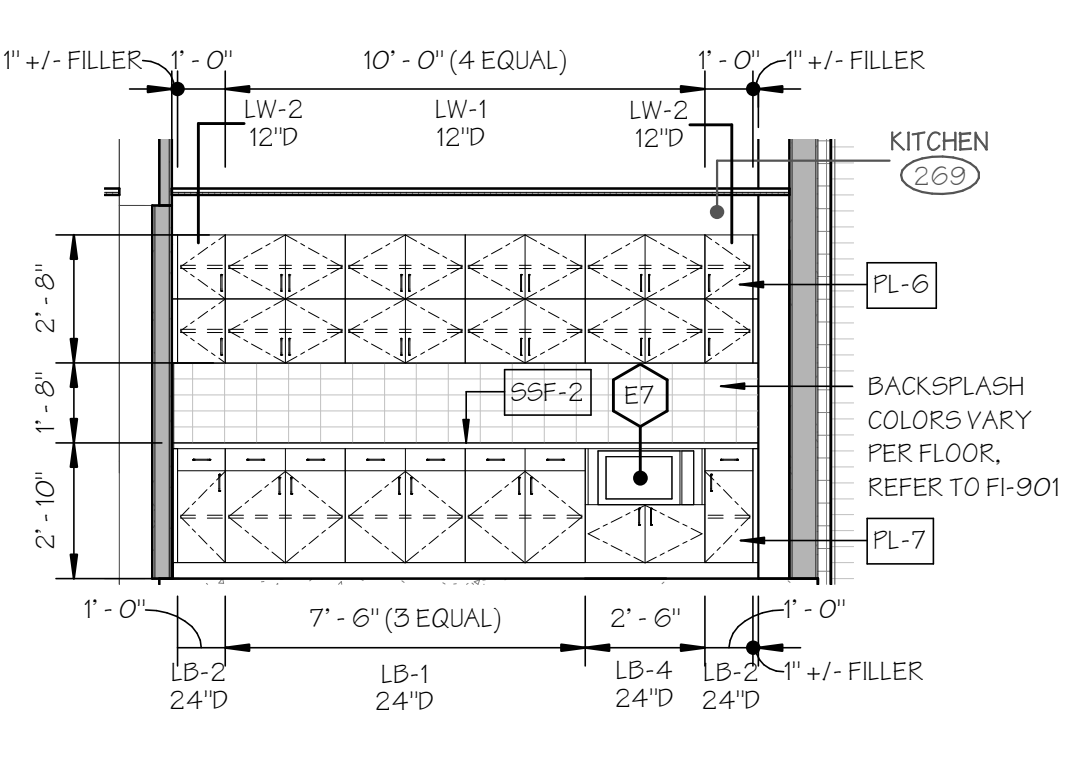


**A2 INTERIOR ELEVATION**  
SCALE: 1/4" = 1'-0"

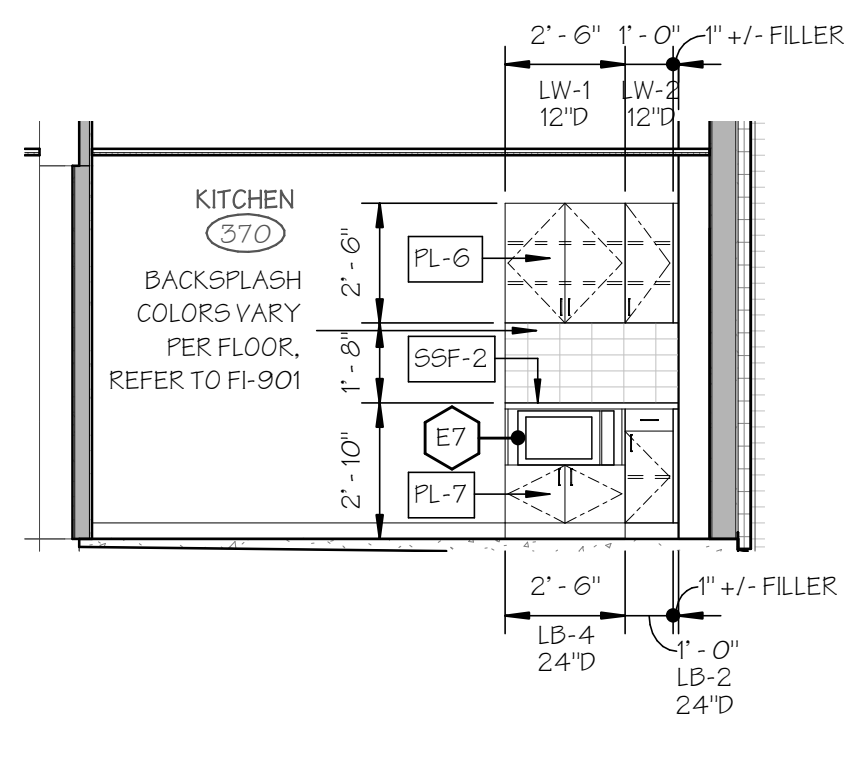


**A3 INTERIOR ELEVATION**  
SCALE: 1/4" = 1'-0"

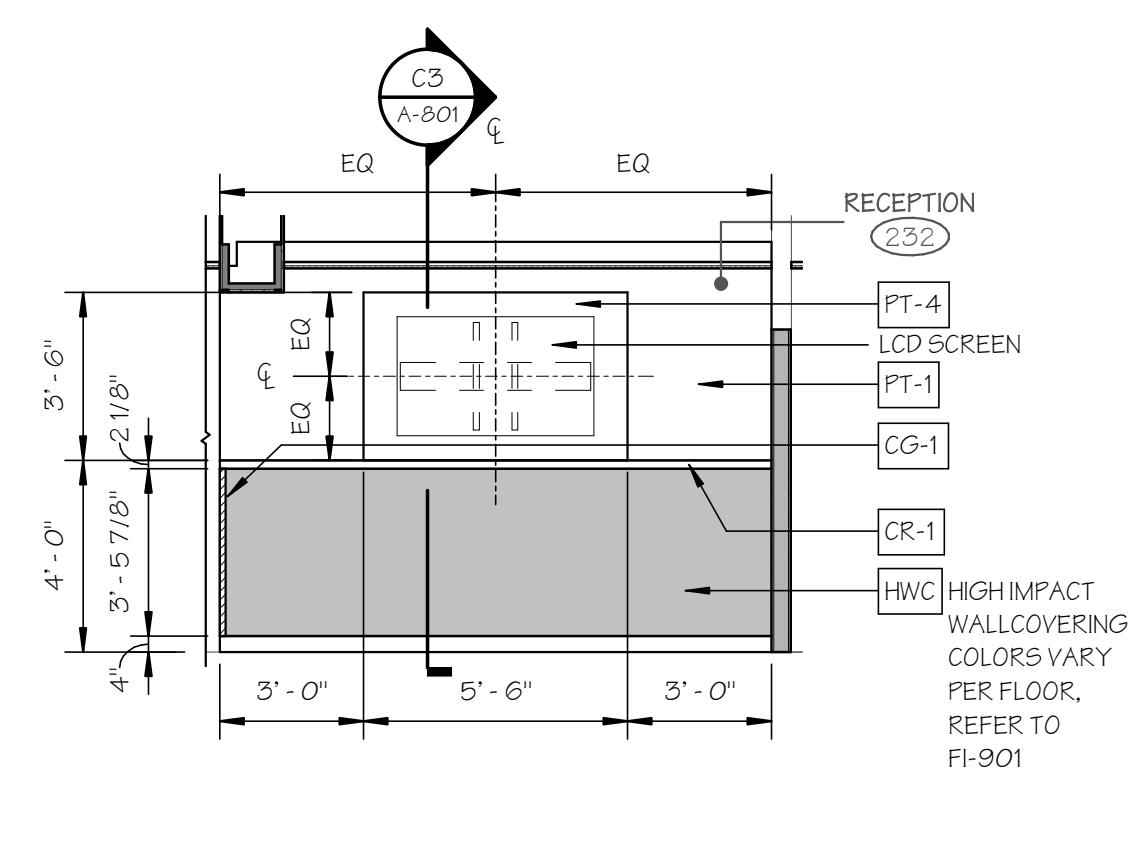

**A4 INTERIOR ELEVATION**  
SCALE: 1/4" = 1'-0"

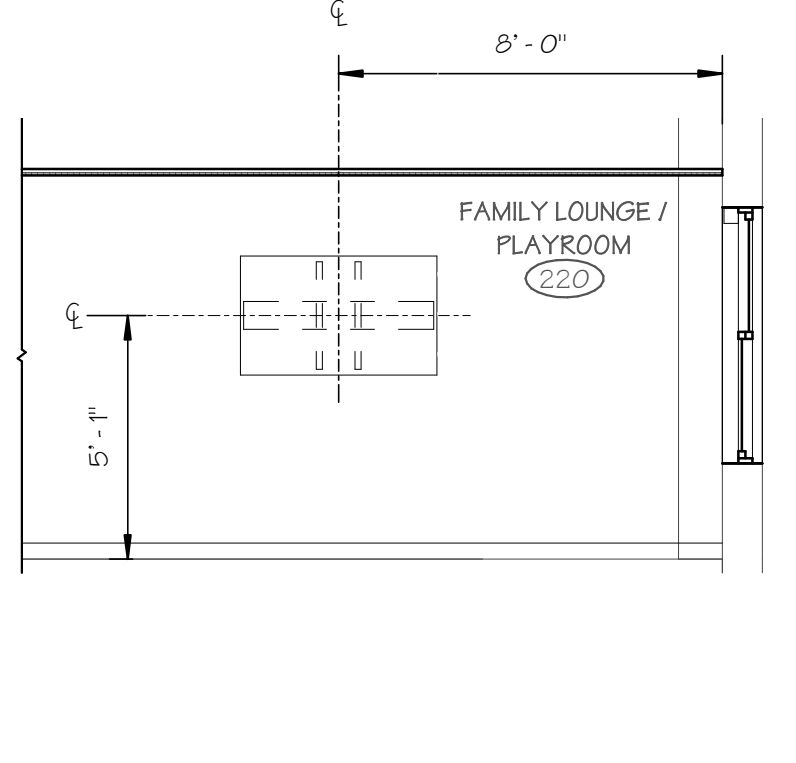

**A5 INTERIOR ELEVATION**  
SCALE: 1/4" = 1'-0"

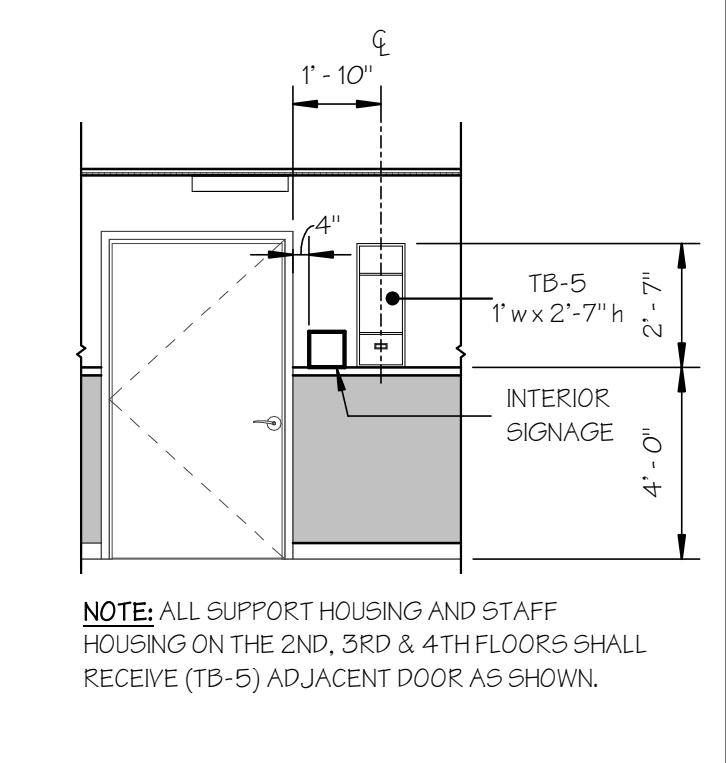

**A6 INTERIOR ELEVATION**  
SCALE: 1/4" = 1'-0"

NOTE: ALL SUPPORT HOUSING AND STAFF HOUSING ON THE 2ND, 3RD & 4TH FLOORS SHALL RECEIVE (TB-5) ADJACENT DOOR AS SHOWN.

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
INTERIOR ELEVATIONS

SCALE: As indicated  
DRAWN BY: BMD  
REVIEWED BY: DCF

DRAWING NO.  
**A-801**  
04.16.2020 - CM BID

DATE: 31 JANUARY 2020  
JOB NUMBER: 18052

2/27/2020 1:07:25 PM  
C:\Users\rosenthan\OneDrive\Documents\18052\_Bridgeport\_Rescue Mission\_Phase 2\_Architecture\_rosesthan.rvt



CERTIFICATION:

**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
04.16.2020 - CM BID

REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT


DRAWING TITLE:  
ENLARGED MILLWORK PLANS,  
ELEVATIONS AND DETAILS

SCALE: As indicated      DRAWN BY: BMD      REVIEWED BY: DCF


DRAWING NO.:

**A-830**  
04.16.2020 - CM BID


DATE: 31 JANUARY 2020      JOB NUMBER: 18052

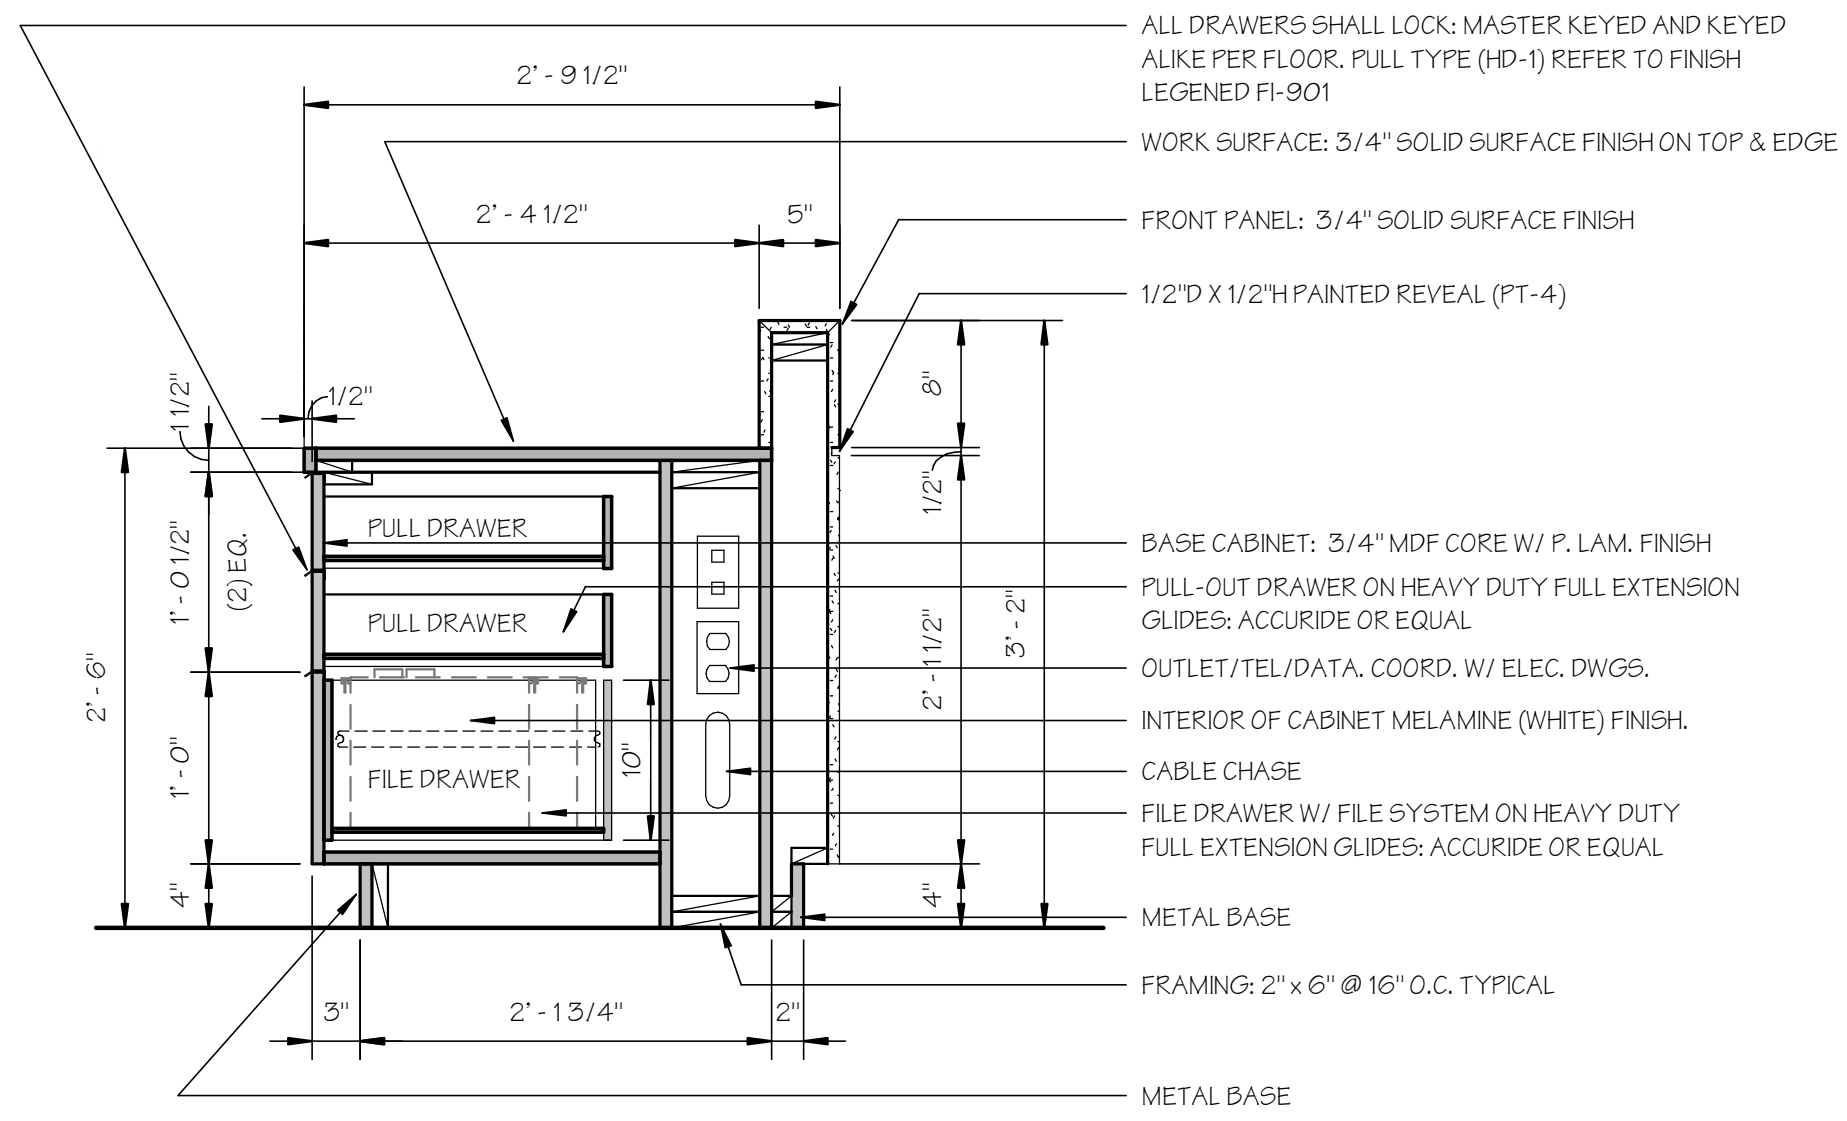


**C1 SECTION @ BOX/BOX/FILE**  
SCALE: 1"=1'-0"

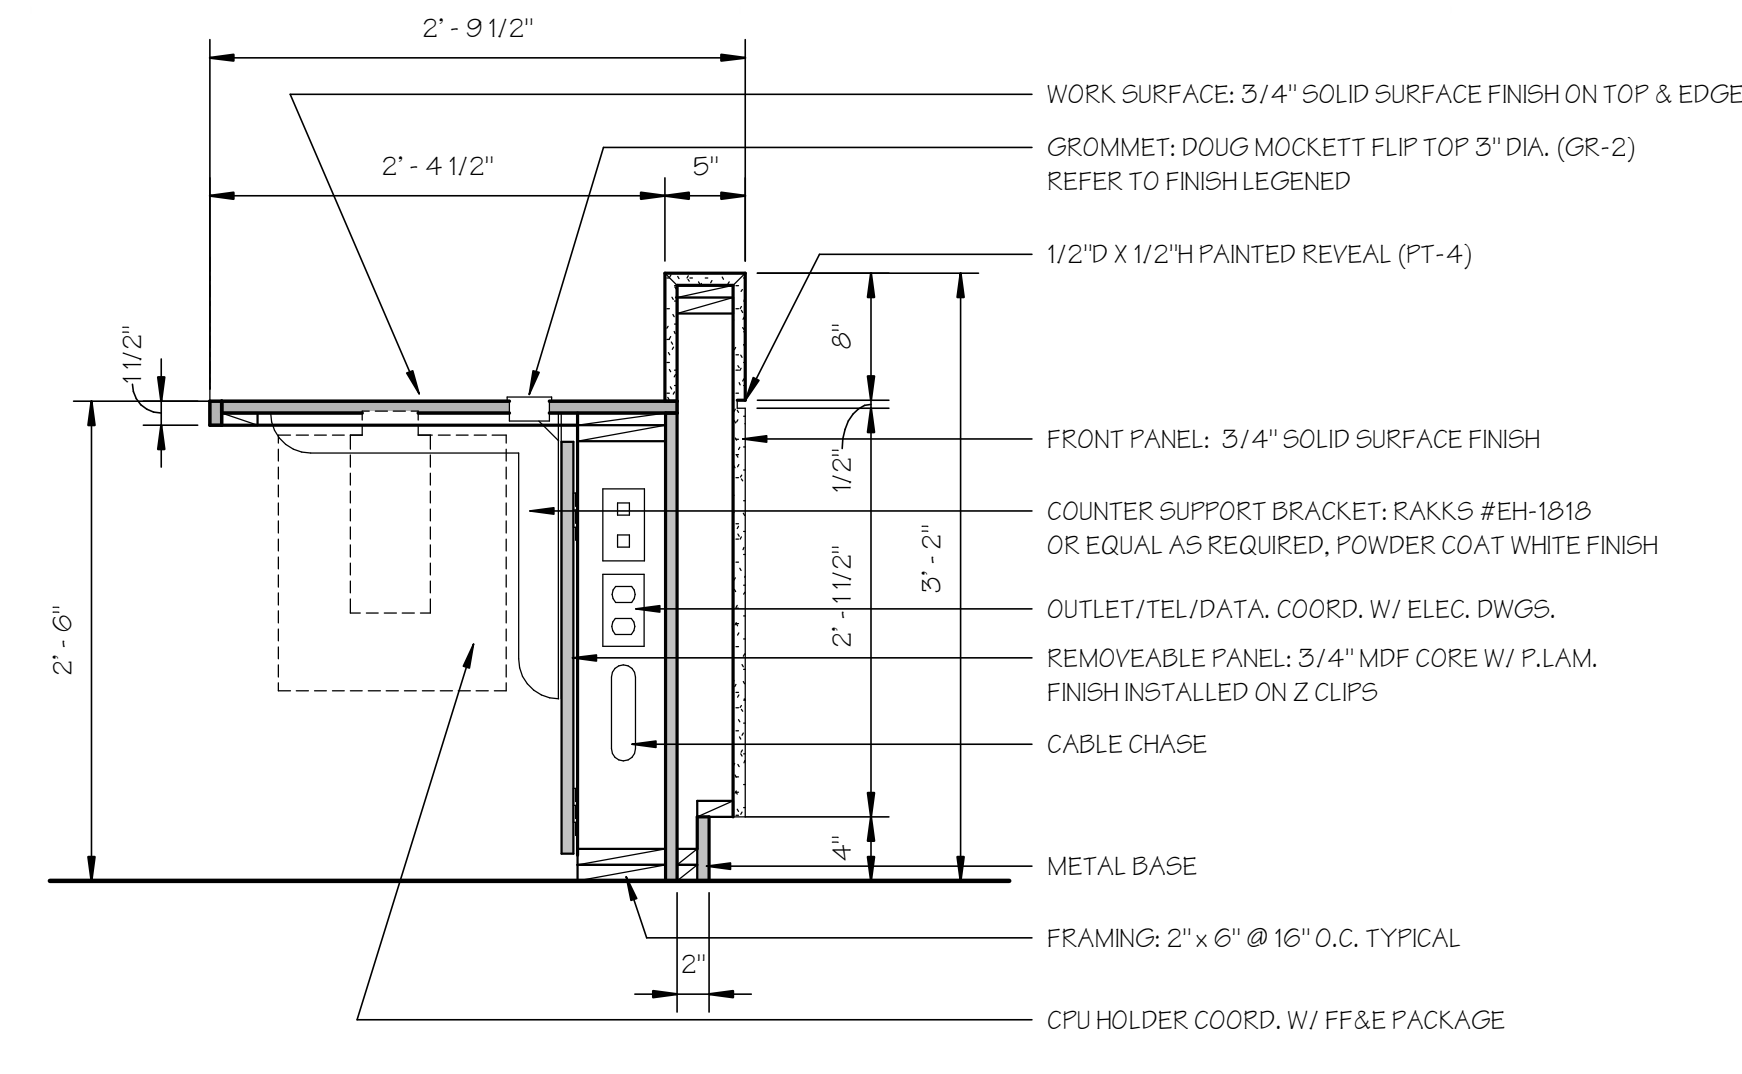


**C2 SECTION @ OPEN WORKSTATION**  
SCALE: 1"=1'-0"

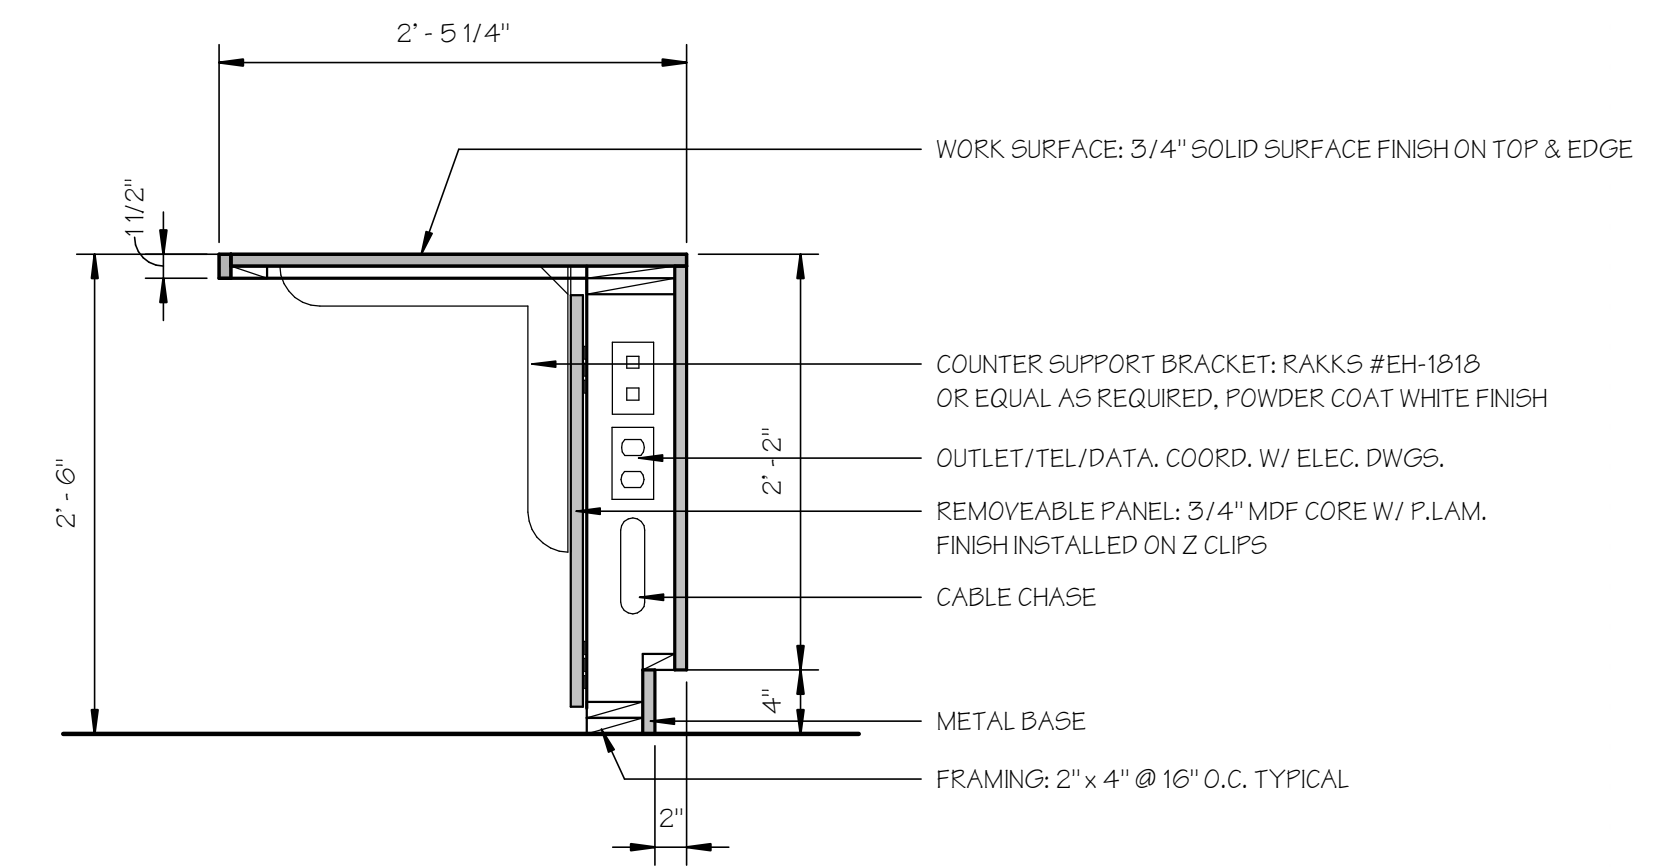


**C3 SECTION @ OPEN WORKSTATION**  
SCALE: 1"=1'-0"

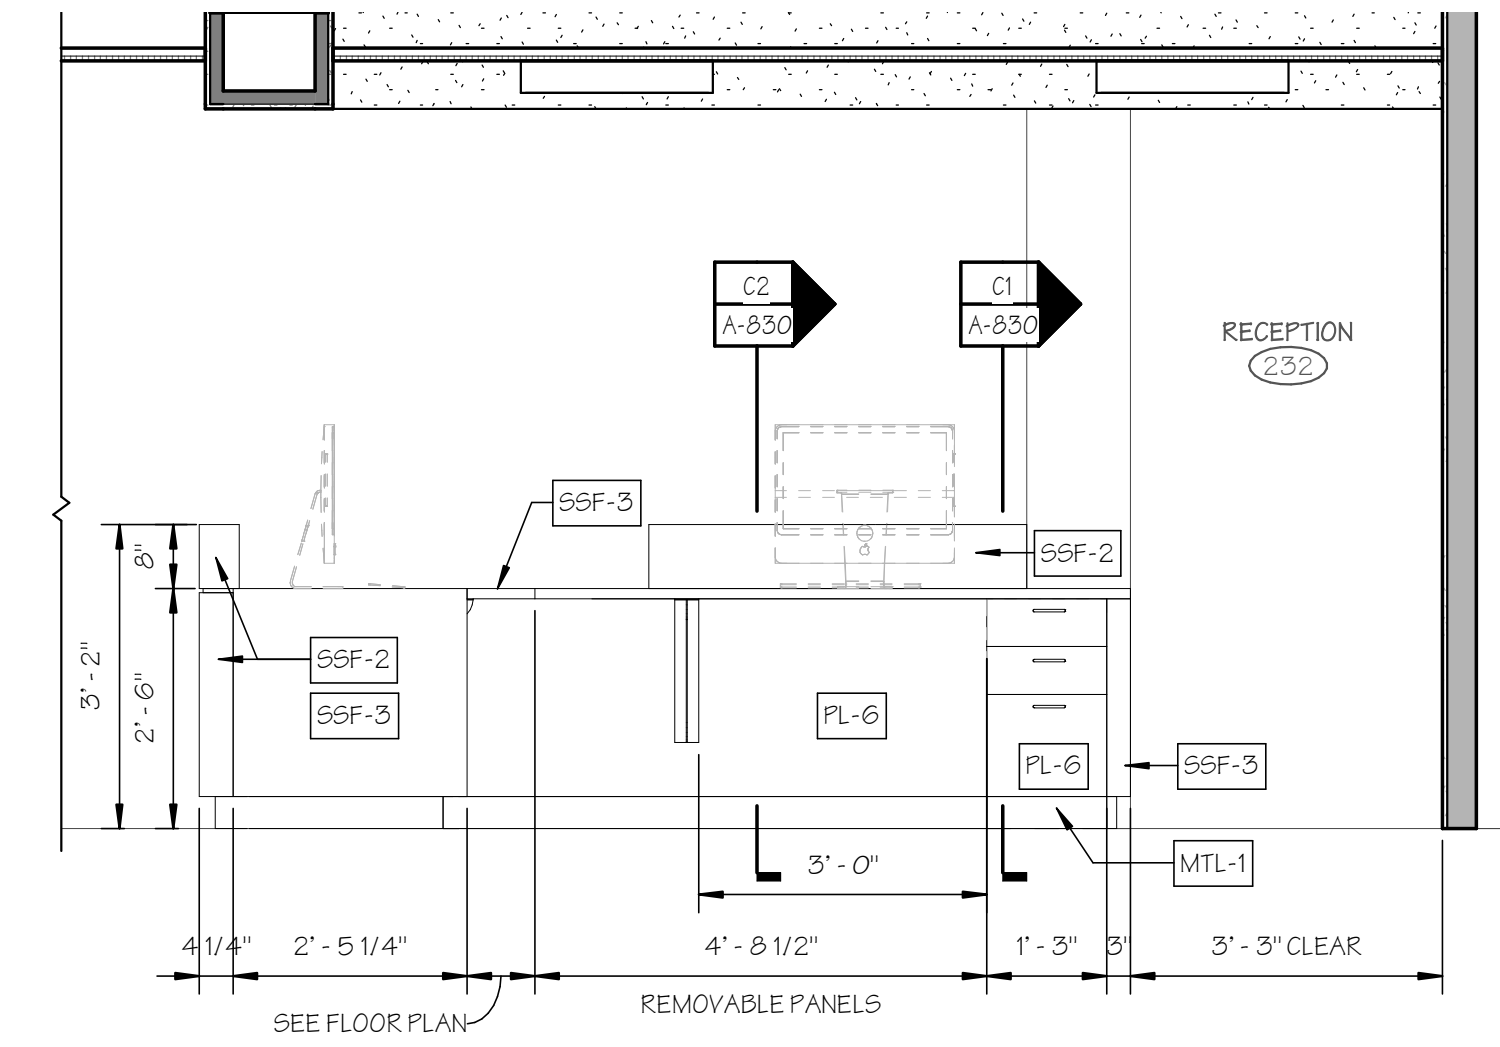


**B2 INTERIOR ELEVATION**  
SCALE: 1/2"=1'-0"

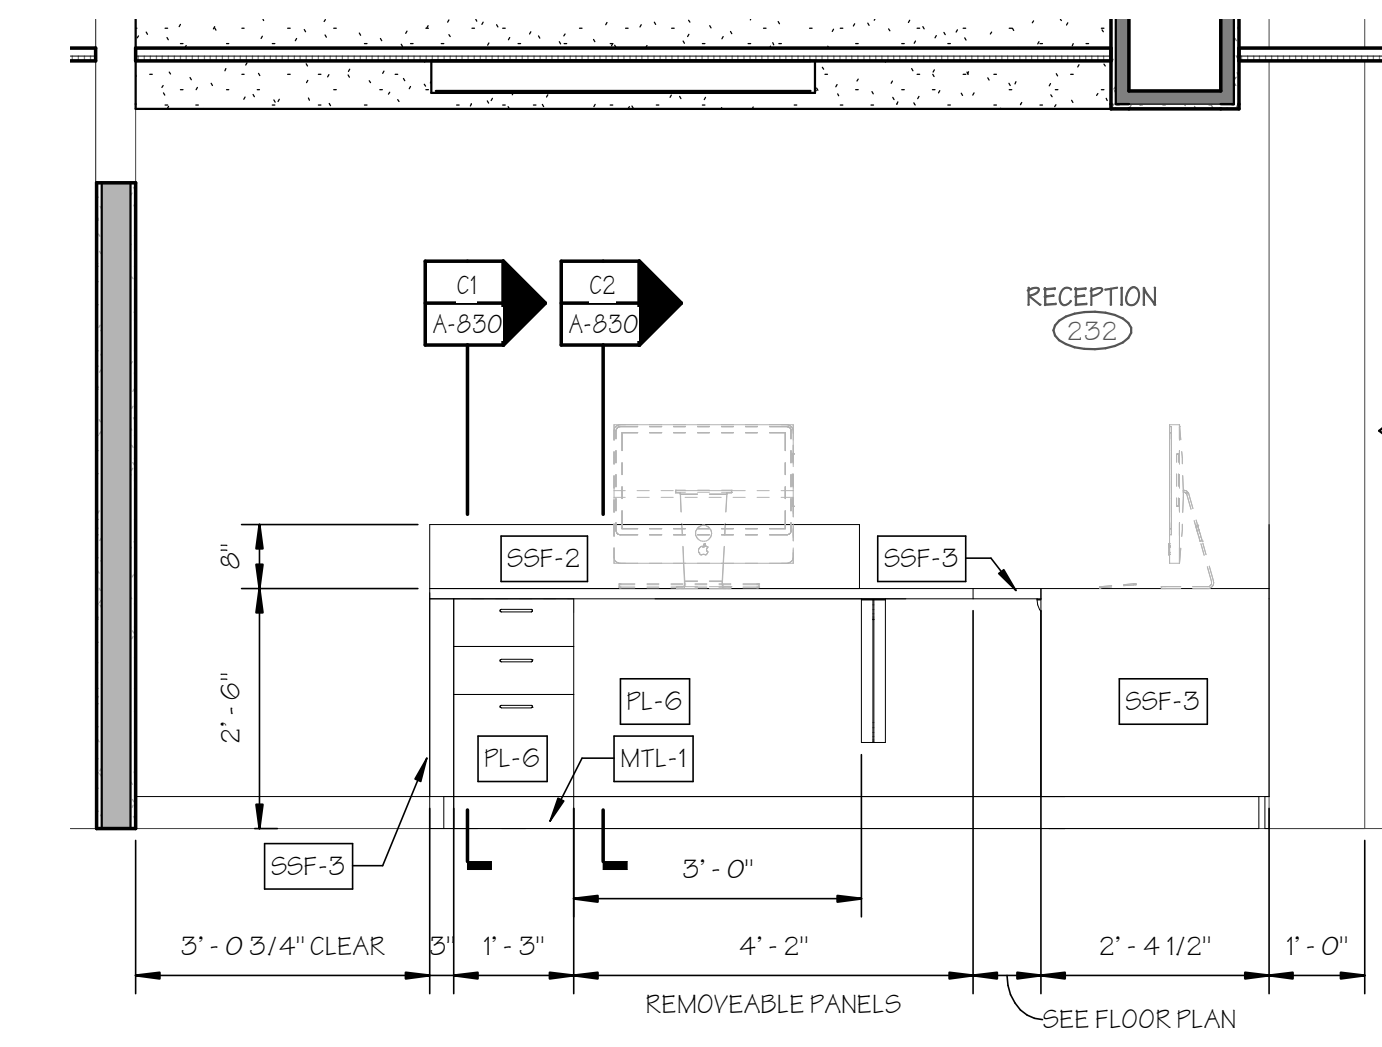


**B3 INTERIOR ELEVATION**  
SCALE: 1/2"=1'-0"

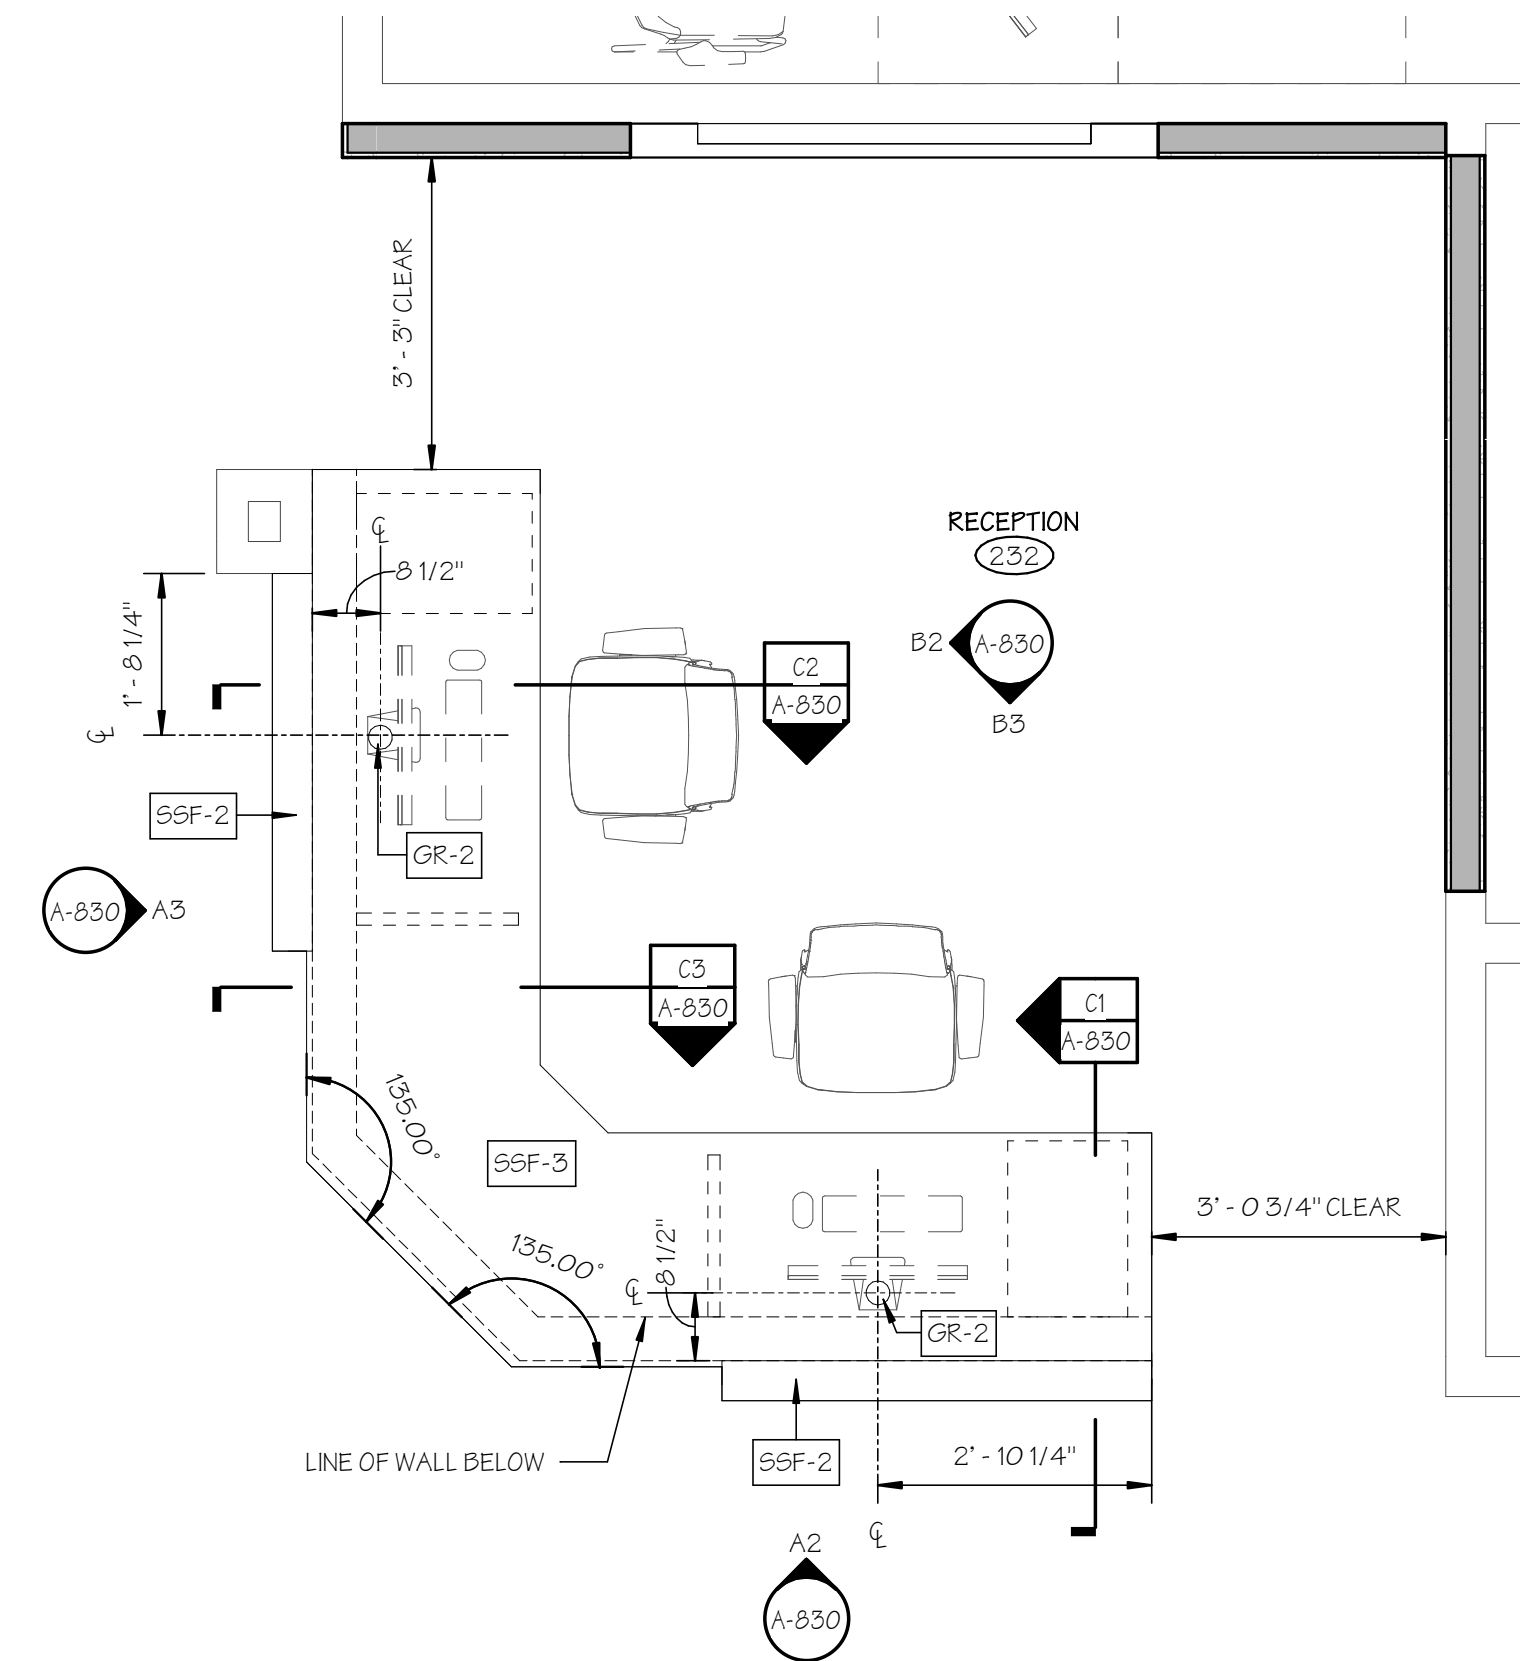

**A1 RECEPTION/STAFF DESK ENLARGED FLOOR PLAN**  
SCALE: 1/2"=1'-0"

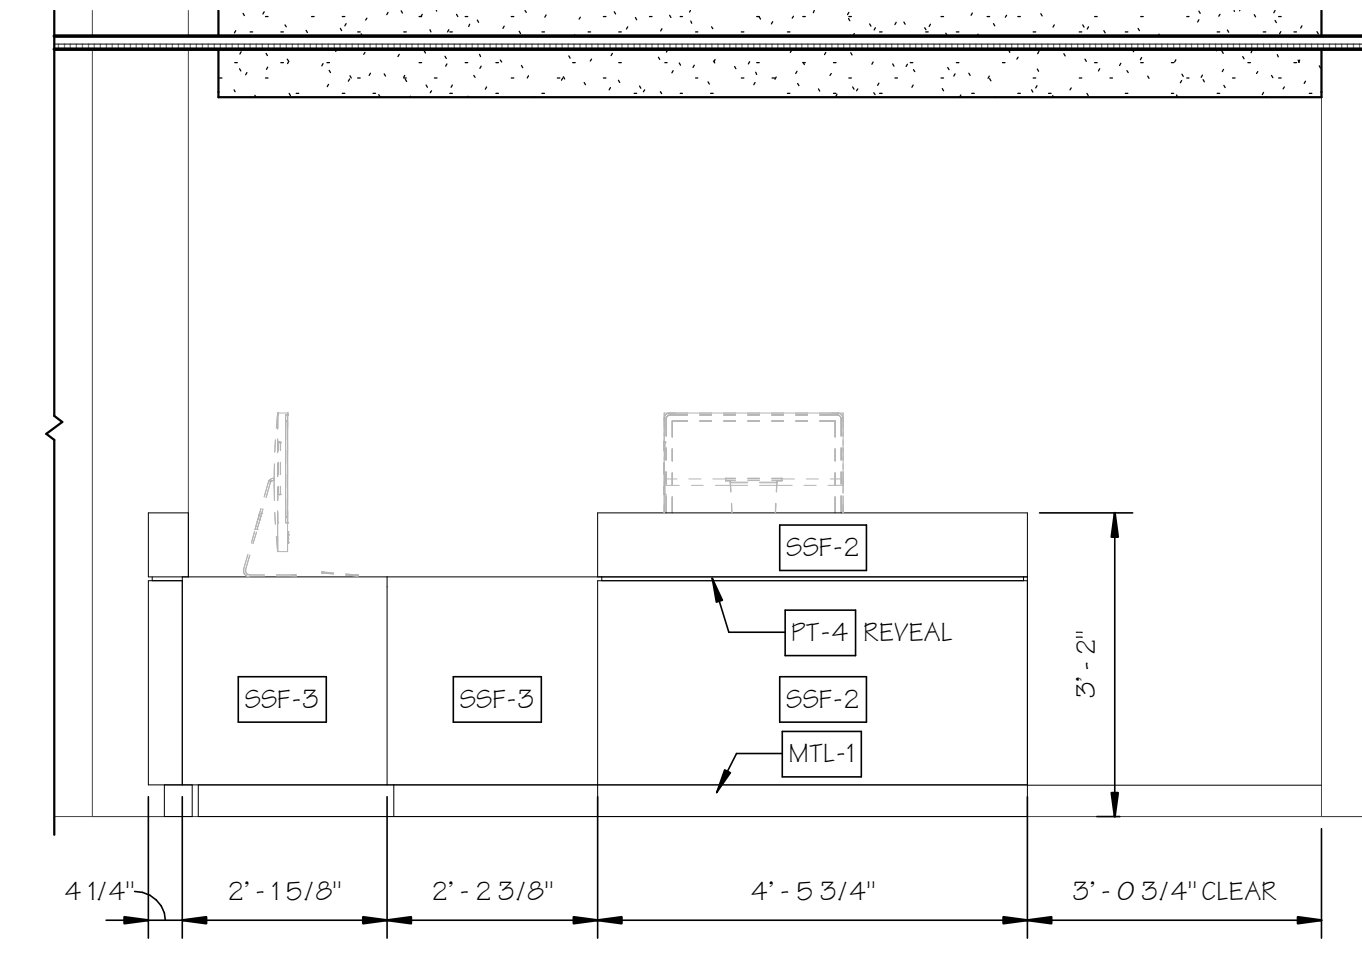

**A2 INTERIOR ELEVATION**  
SCALE: 1/2"=1'-0"

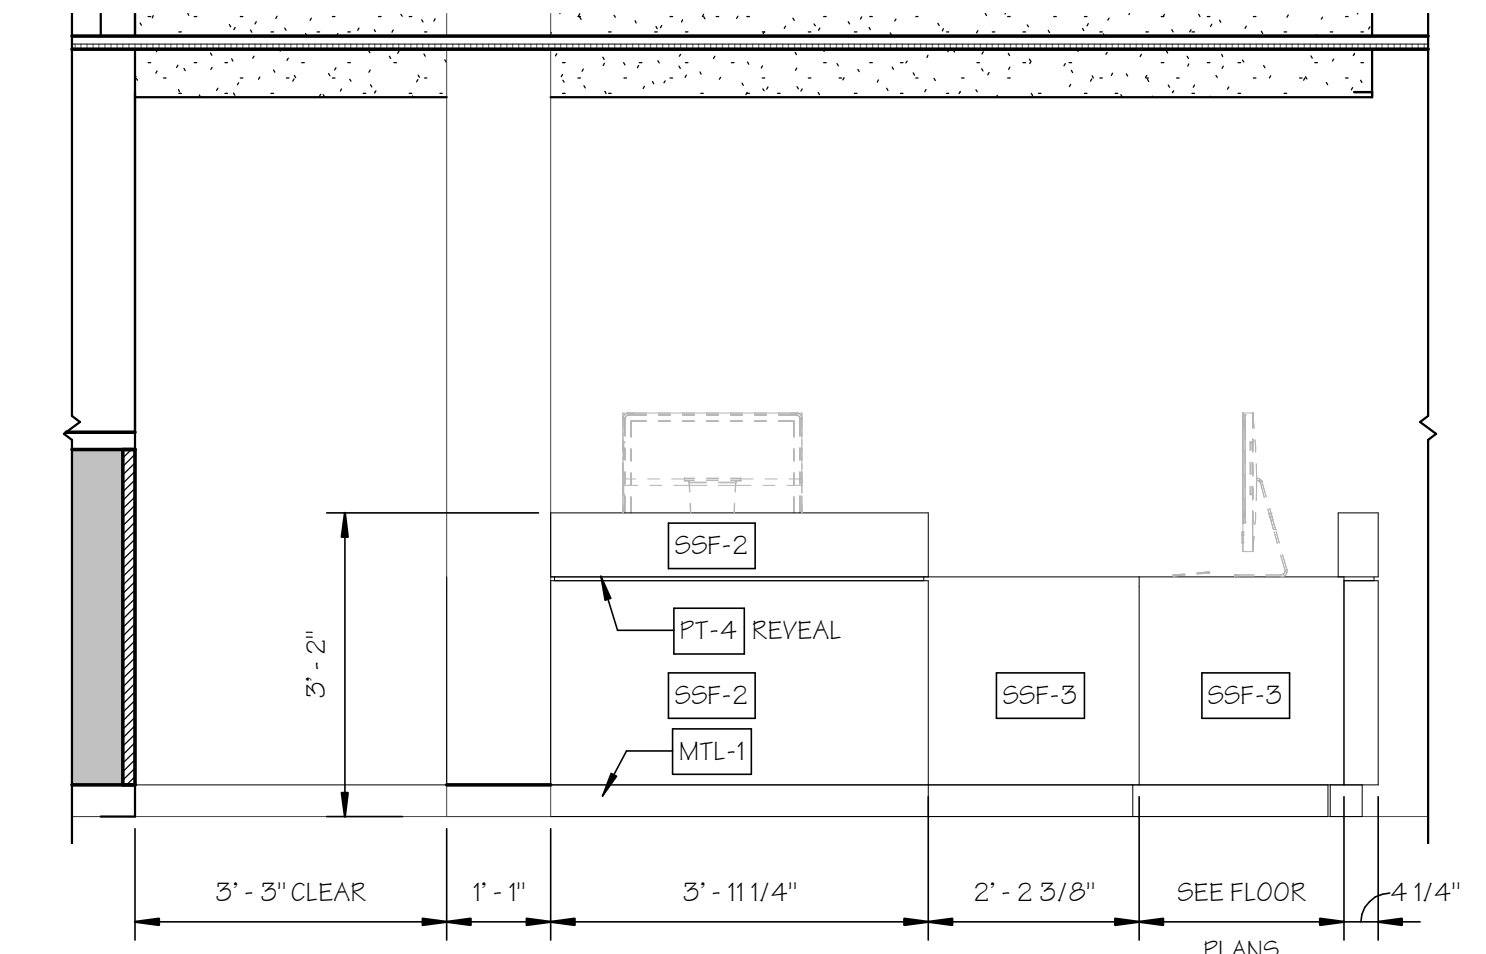

**A3 INTERIOR ELEVATION**  
SCALE: 1/2"=1'-0"

DOOR SCHEDULE

Table with columns: DOOR NO., DOUBLE LEAF, LEAF WIDTH, HEIGHT, DOOR TYPE, DOOR MATERIAL, DOOR FINISH, FRAME TYPE, FRAME MATERIAL, FRAME FINISH, JAMB DETAIL, HEAD DETAIL, FIRE RATING (45 Min, 60 Min, 90 Min), FIRE CODE (FIRE EXIT HW, PANIC RELEASE, POSITIVE LATCH, AUTO. CLOSER, HOLD OPEN, LEVER HAND, PUSH/PULL HW, KICK PLATES, LOCKSET), ACCESSIBILITY REQUIREMENTS (ACC. THRESHOLD, DOOR VIEWER, CARD READER, ELEC. STRIKE), SIGN DESIGNATION, SIGN NUMBER, COMMENTS.

DOOR SCHEDULE (CONTINUED)

Continuation of the Door Schedule table with columns: DOOR NO., DOUBLE LEAF, LEAF WIDTH, HEIGHT, DOOR TYPE, DOOR MATERIAL, DOOR FINISH, FRAME TYPE, FRAME MATERIAL, FRAME FINISH, JAMB DETAIL, HEAD DETAIL, FIRE RATING (45 Min, 60 Min, 90 Min), FIRE CODE (FIRE EXIT HW, PANIC LATCH, POS. LATCHING, AUTO. CLOSER, HOLD OPEN, LEVER HAND, PUSH/PULL HW, KICK PLATES, LOCKSET), ACCESSIBILITY REQUIREMENTS (ACC. THRESHOLD, DOOR VIEWER, CARD READER, ELEC. STRIKE), SIGN DESIGNATION, SIGN NUMBER, COMMENTS.

GENERAL DOOR AND HARDWARE NOTES

- A. ALL HARDWARE SHALL MEET ADA STANDARDS. G.C. SHALL PROVIDE HARDWARE (U.O.N.), INCLUDING CONSTRUCTION CYLINDERS.
B. ALL DOORS LEADING TO HAZARDOUS SPACES SHALL HAVE TACTILE WARNINGS.
C. ALL DOORS EXITING 100 OR MORE PERSONS SHALL HAVE PANIC EXIT DEVICES.
D. SEE SPECIFICATIONS FOR ADDITIONAL DOOR AND HARDWARE INFORMATION.
E. ALL INTERIOR HOLLOW METAL DOORS AND FRAMES SHALL BE PAINTED. SEE FINISH DRAWINGS.
F. REPAIR & PAINT ALL EXISTING DOOR FRAMES TO REMAIN.

DOOR ABBREVIATIONS

Table mapping abbreviations to materials: AN - ANODIZED ALUMINUM, CL - CLEAR FINISH, F - FACTORY FINISH, FRP - FIBER REINFORCED PLASTIC, GALV - GALVANIZED, HM - HOLLOW METAL, H.W. - HARDWARE, PT - PAINT, PMFR - PRE-MANUFACTURED, S5 - STAINLESS STEEL, S - FACTORY STAINED, STL - STEEL, WD - WOOD, MTL - METAL.



COPYRIGHT 2017 BY: ANTIINOZZI ASSOCIATES, P.C. 271 Fairfield Avenue Bridgeport CT Tel: (203) 377-1300 Fax: (203) 378-3002

301 Merritt 7 New York, Connecticut 06851 Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.



REVISIONS

Table with columns: NO., DATE, DESCRIPTION. Revision 00: 04.16.20 CM BID.

JOEL SMILOW CARE CENTER BRIDGEPORT RESCUE MISSION PHASE II: INTERIOR RENOVATIONS & NEW CONSTRUCTION 725 PARK AVENUE BRIDGEPORT, CONNECTICUT

DRAWING TITLE: DOOR SCHEDULE

Table with columns: SCALE (1/2" = 1'-0"), DRAWN BY (KWG), REVIEWED BY (DCF), DRAWING NO.

A-901 04.16.2020 - CM BID DATE: 31 JANUARY 2020 JOB NUMBER: 18052

2/7/2020 1:07:32 PM C:\Users\rosenm\OneDrive\Documents\18052 Bridgeport Rescue Mission\_Phase 2\_Architecture\_rozenm.dwg



ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002  
301 Merritt 7  
Newark, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:  
**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
04.16.2020 - CM BID

REVISIONS		
NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT


DRAWING TITLE:  
DOOR & FRAME TYPES & DETAILS

SCALE: As indicated  
DRAWN BY: KWG  
REVIEWED BY: DCF


DRAWING NO.:

**A-950**  
04.16.2020 - CM BID


DATE: 31 JANUARY 2020  
JOB NUMBER: 18052

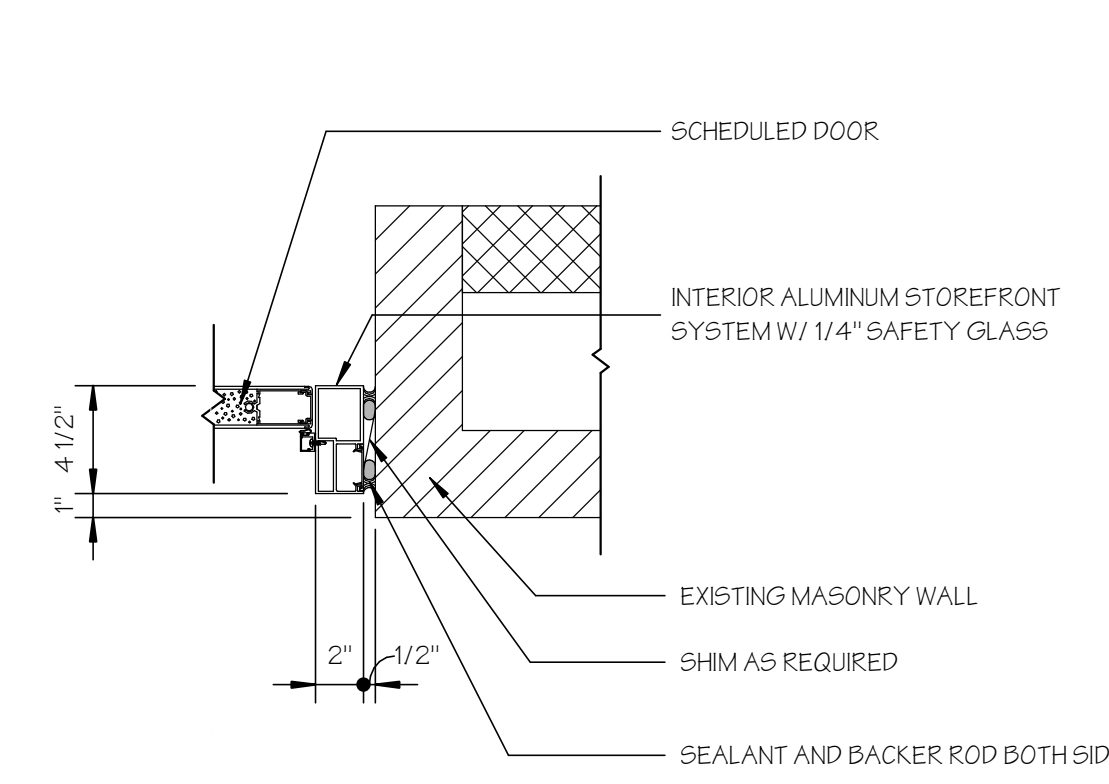


**J13 JAMB DETAIL**  
SCALE: 1 1/2" = 1'-0"

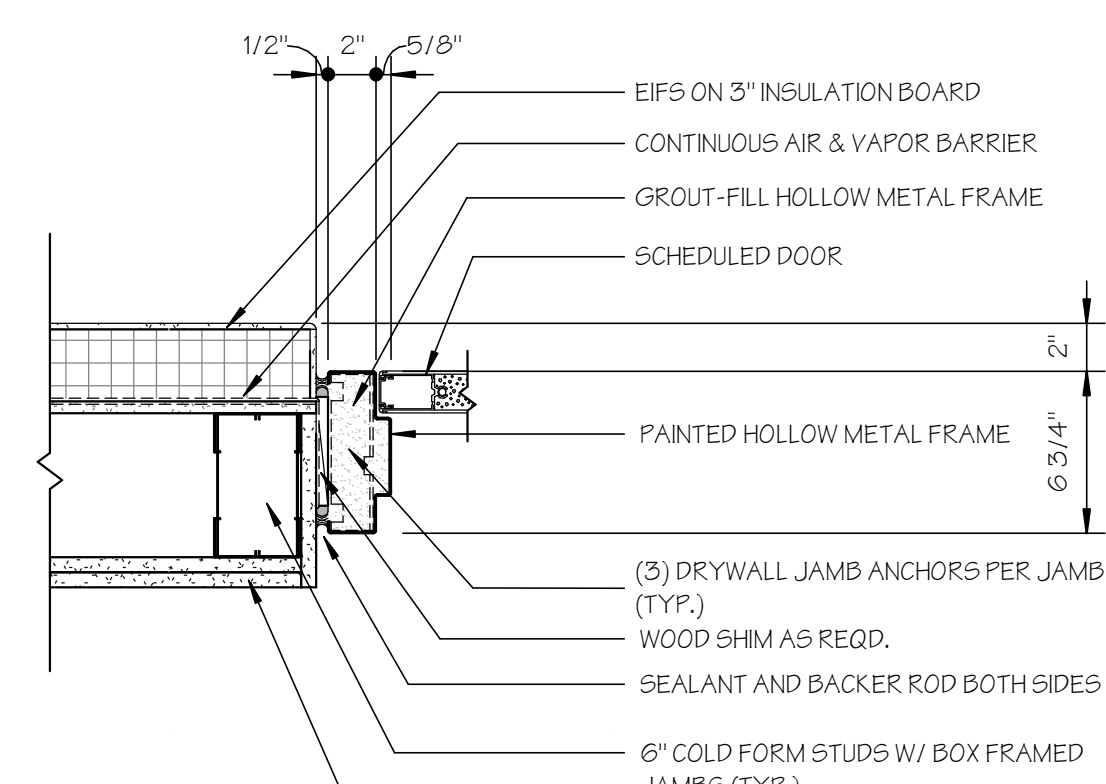


**J14 JAMB DETAIL**  
SCALE: 1 1/2" = 1'-0"

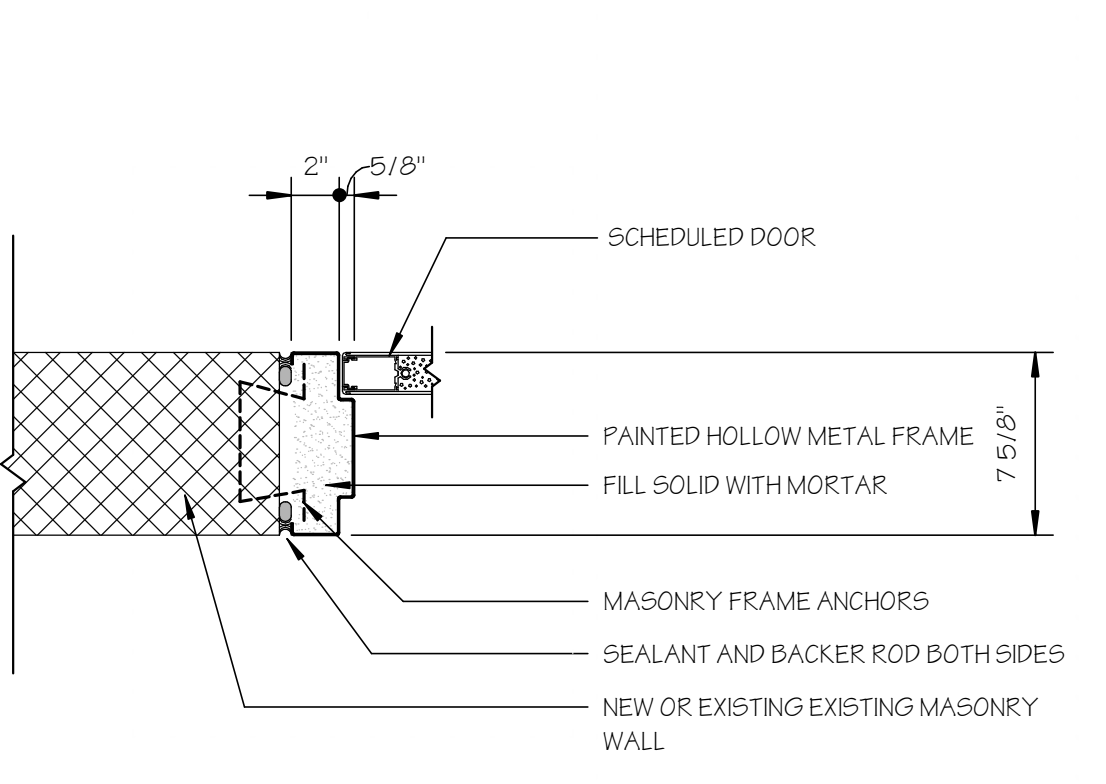


**J15 JAMB DETAIL**  
SCALE: 1 1/2" = 1'-0"

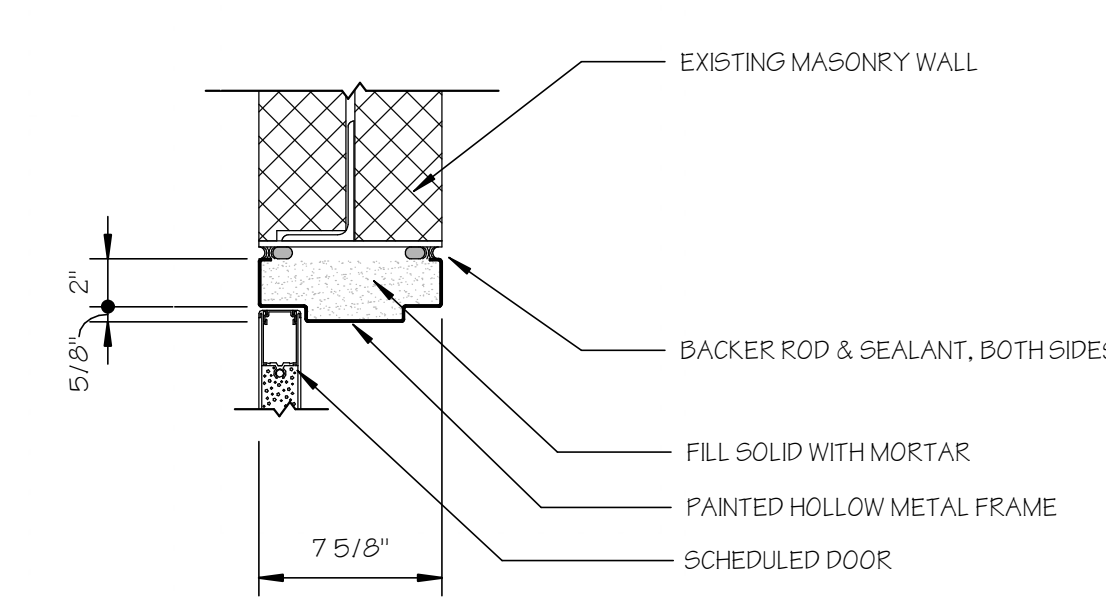


**H13 HEAD DETAIL**  
SCALE: 1 1/2" = 1'-0"

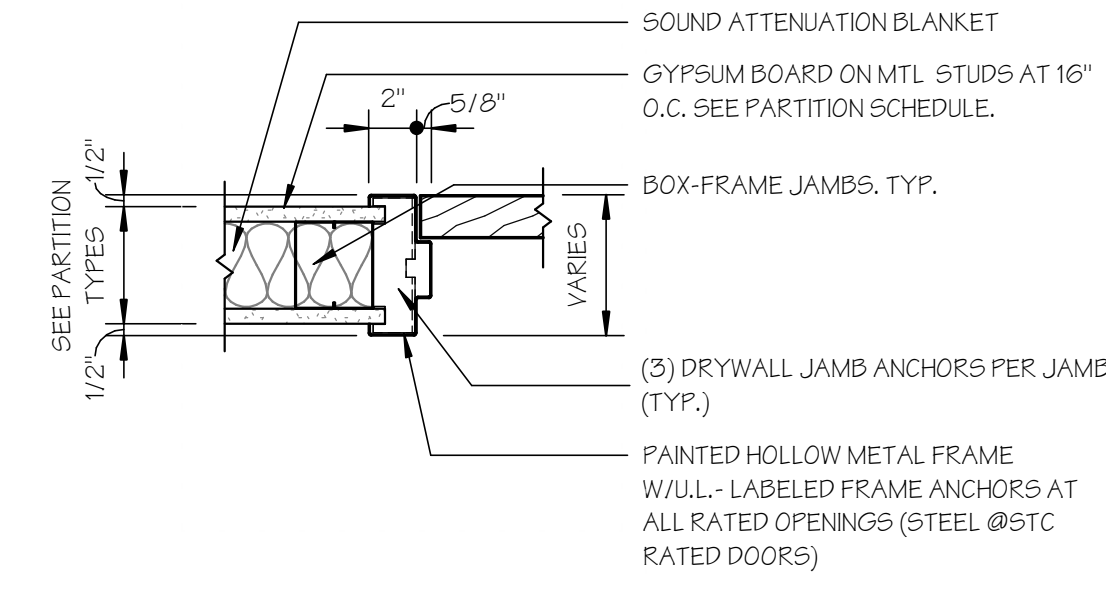


**J11 JAMB DETAIL**  
SCALE: 1 1/2" = 1'-0"

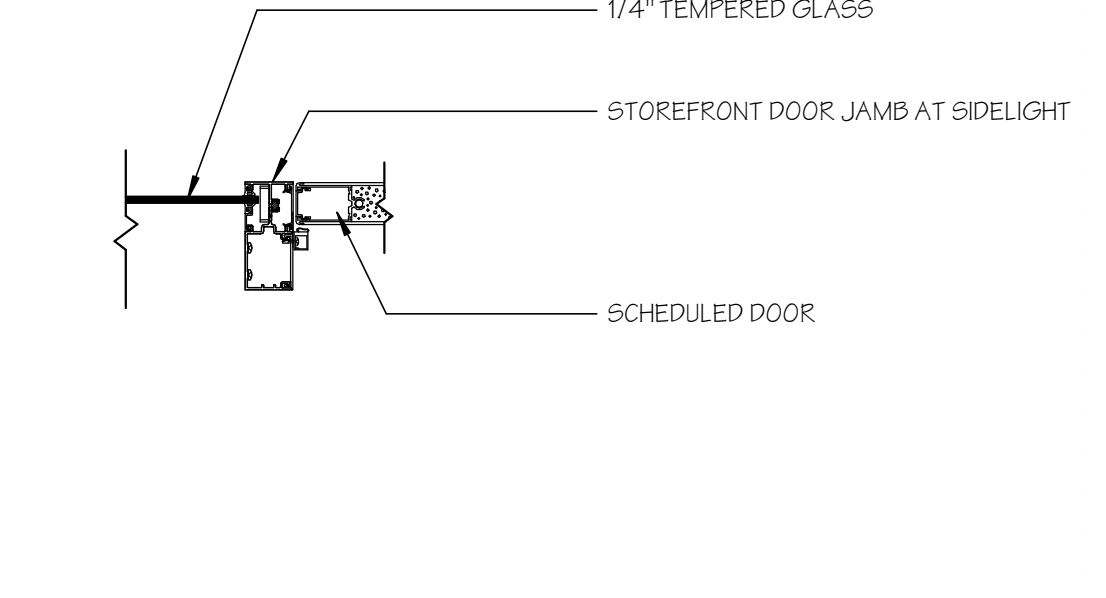


**J18 JAMB DETAIL**  
SCALE: 1 1/2" = 1'-0"

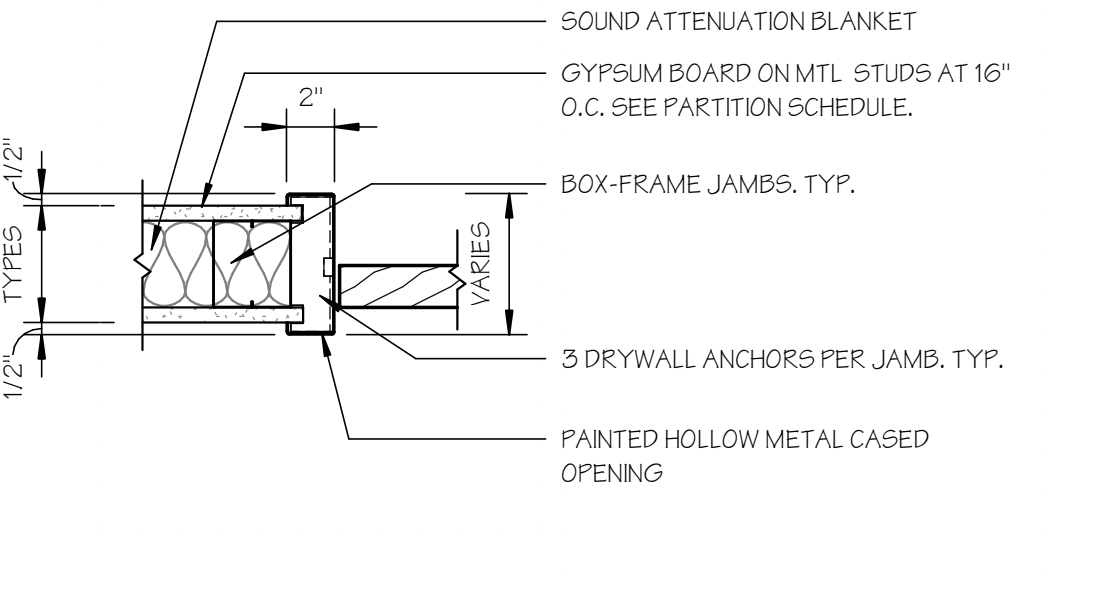


**J11 JAMB DETAIL**  
SCALE: 1 1/2" = 1'-0"

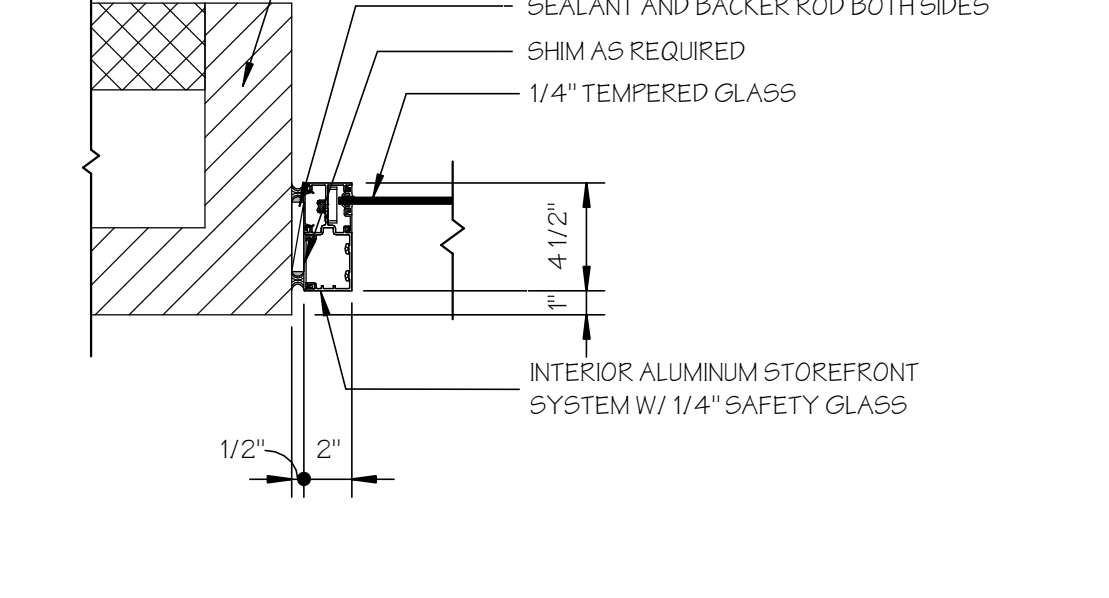


**J12 JAMB DETAIL**  
SCALE: 1 1/2" = 1'-0"

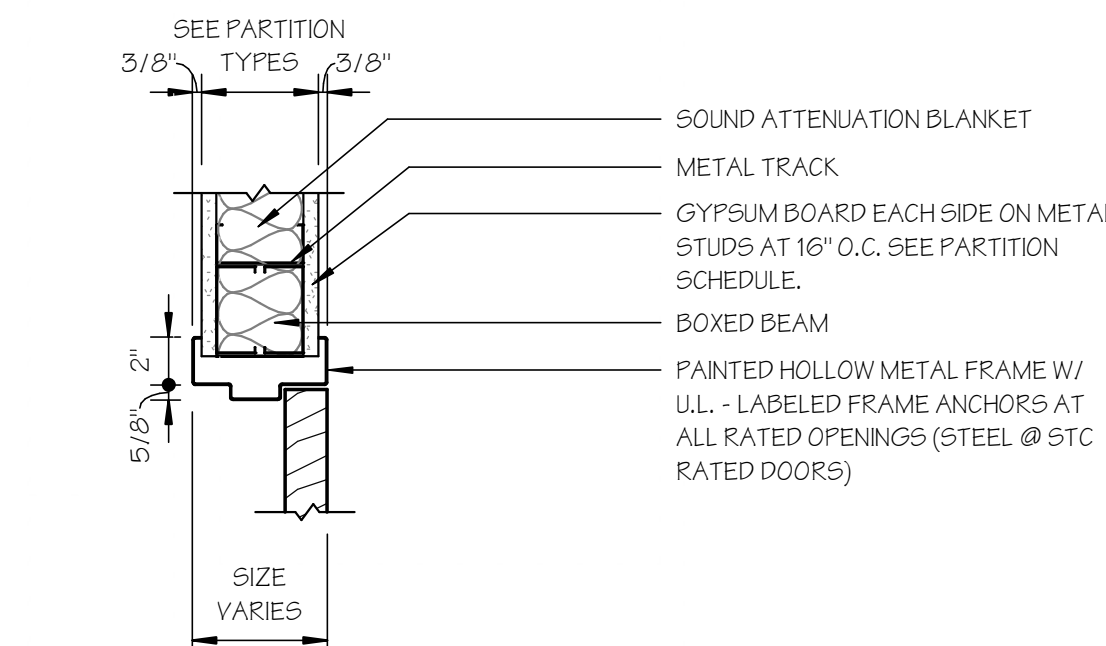


**H11 HEAD DETAIL**  
SCALE: 1 1/2" = 1'-0"

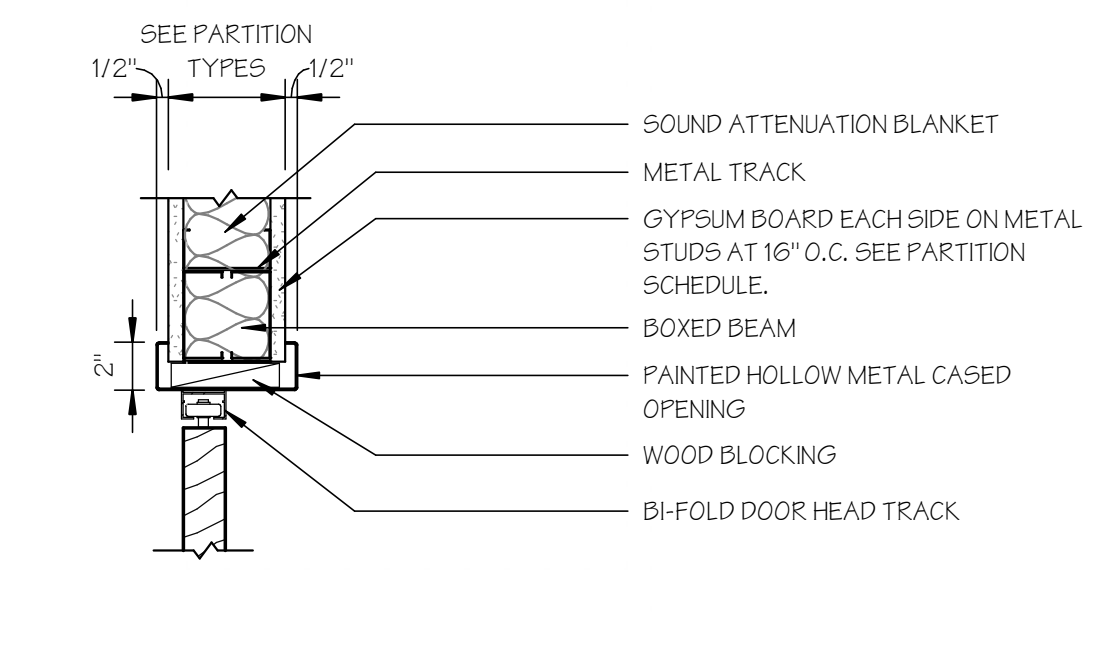


**H19 HEAD DETAIL**  
SCALE: 1 1/2" = 1'-0"

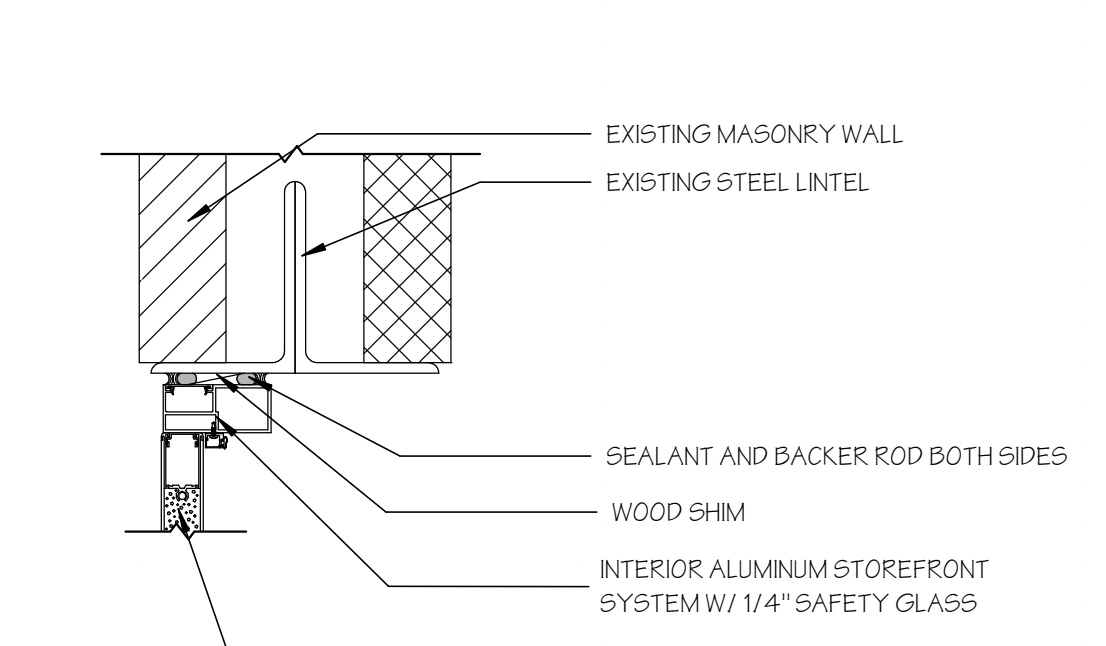


**H10 HEAD DETAIL**  
SCALE: 1 1/2" = 1'-0"

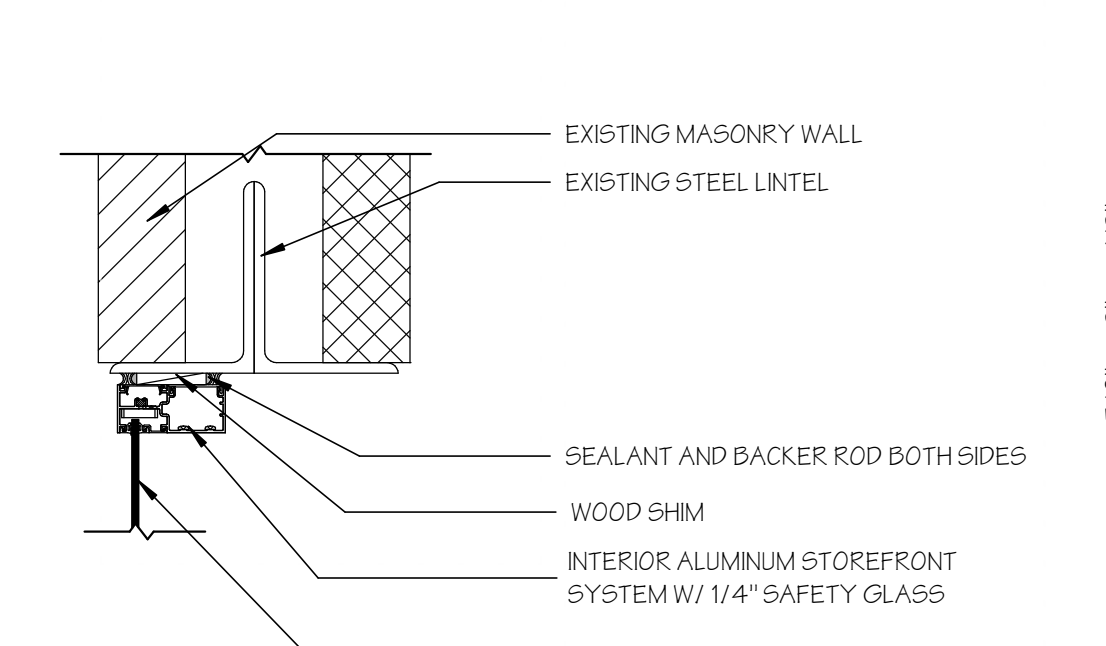


**H11 HEAD DETAIL**  
SCALE: 1 1/2" = 1'-0"

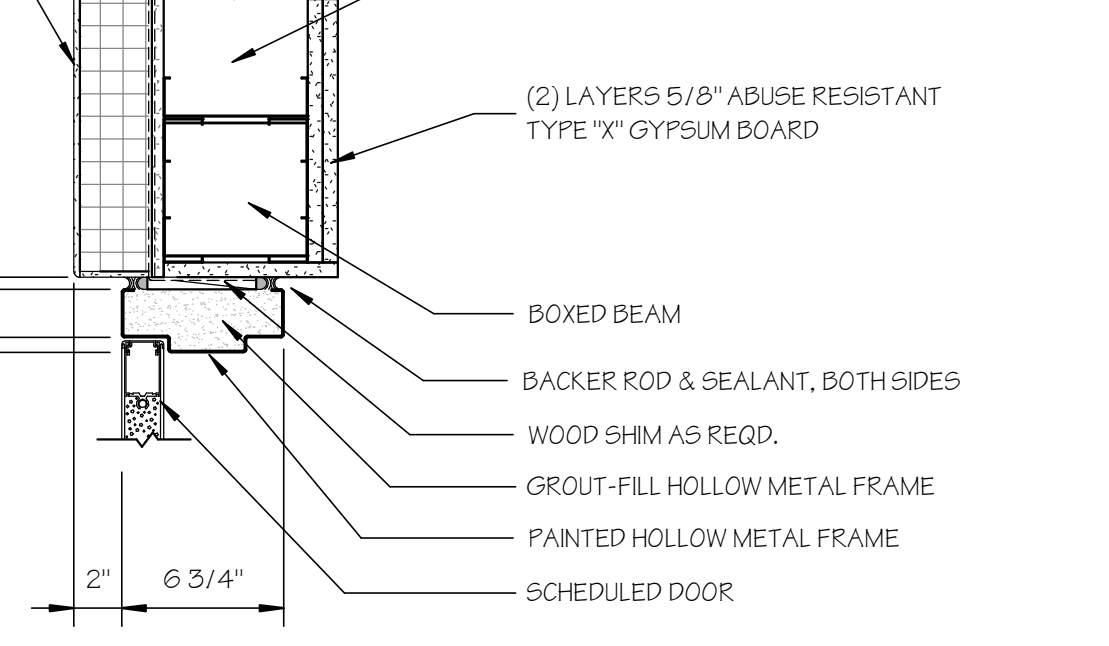

**H12 HEAD DETAIL**  
SCALE: 1 1/2" = 1'-0"

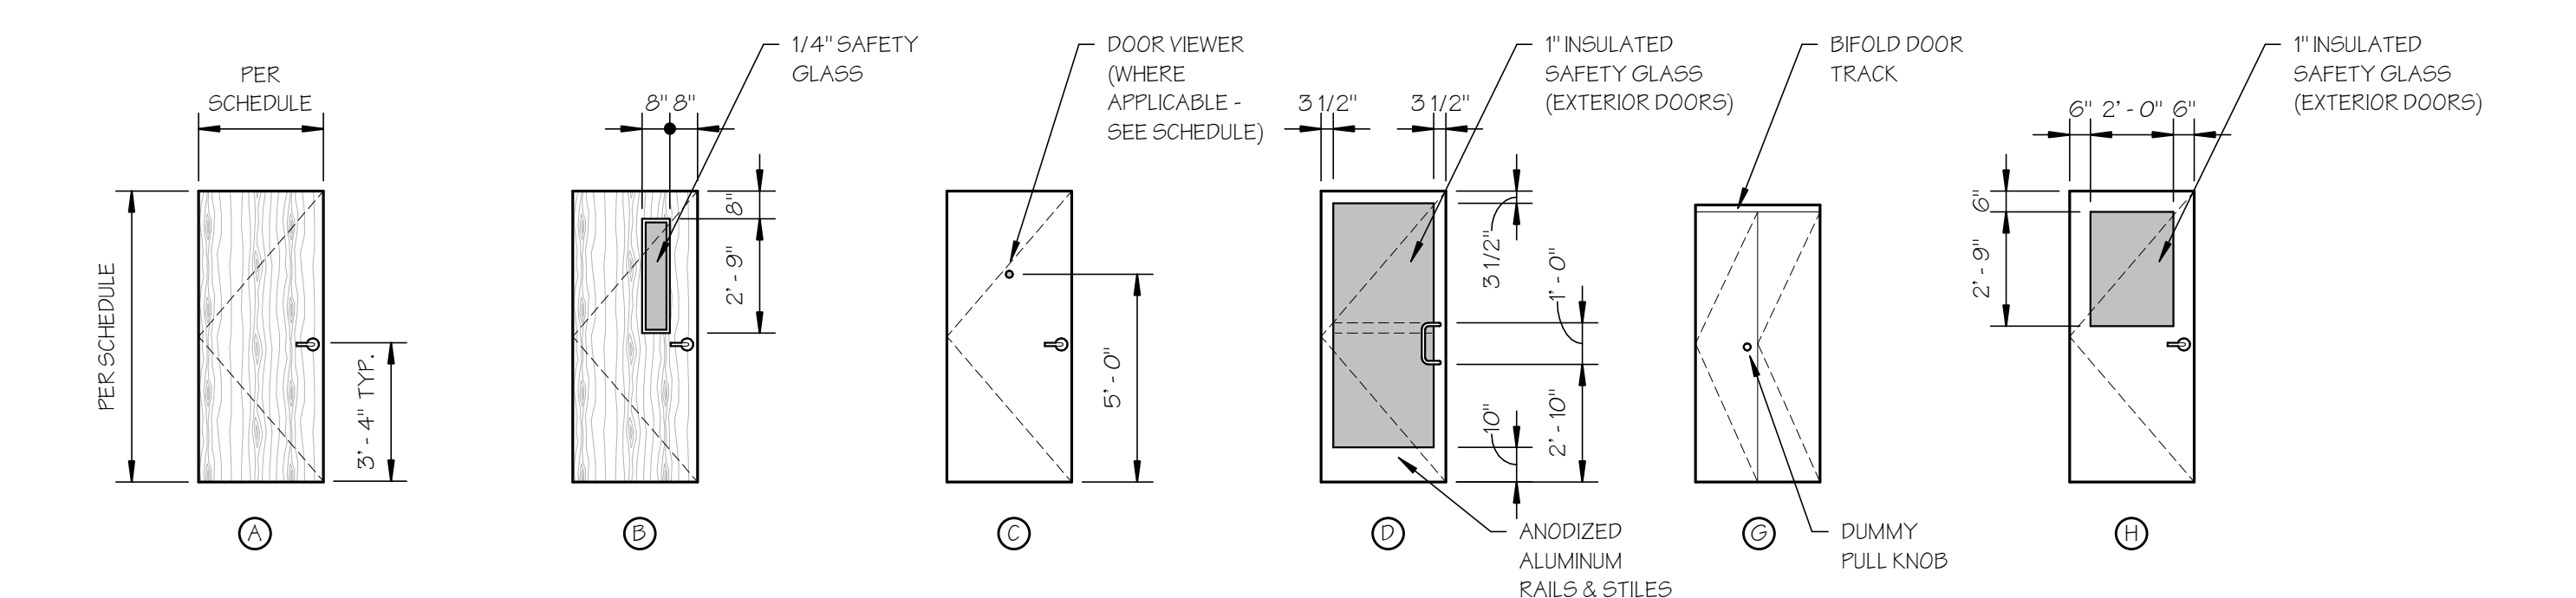

**DOOR TYPES**  
SCALE: 1/4" = 1'-0"

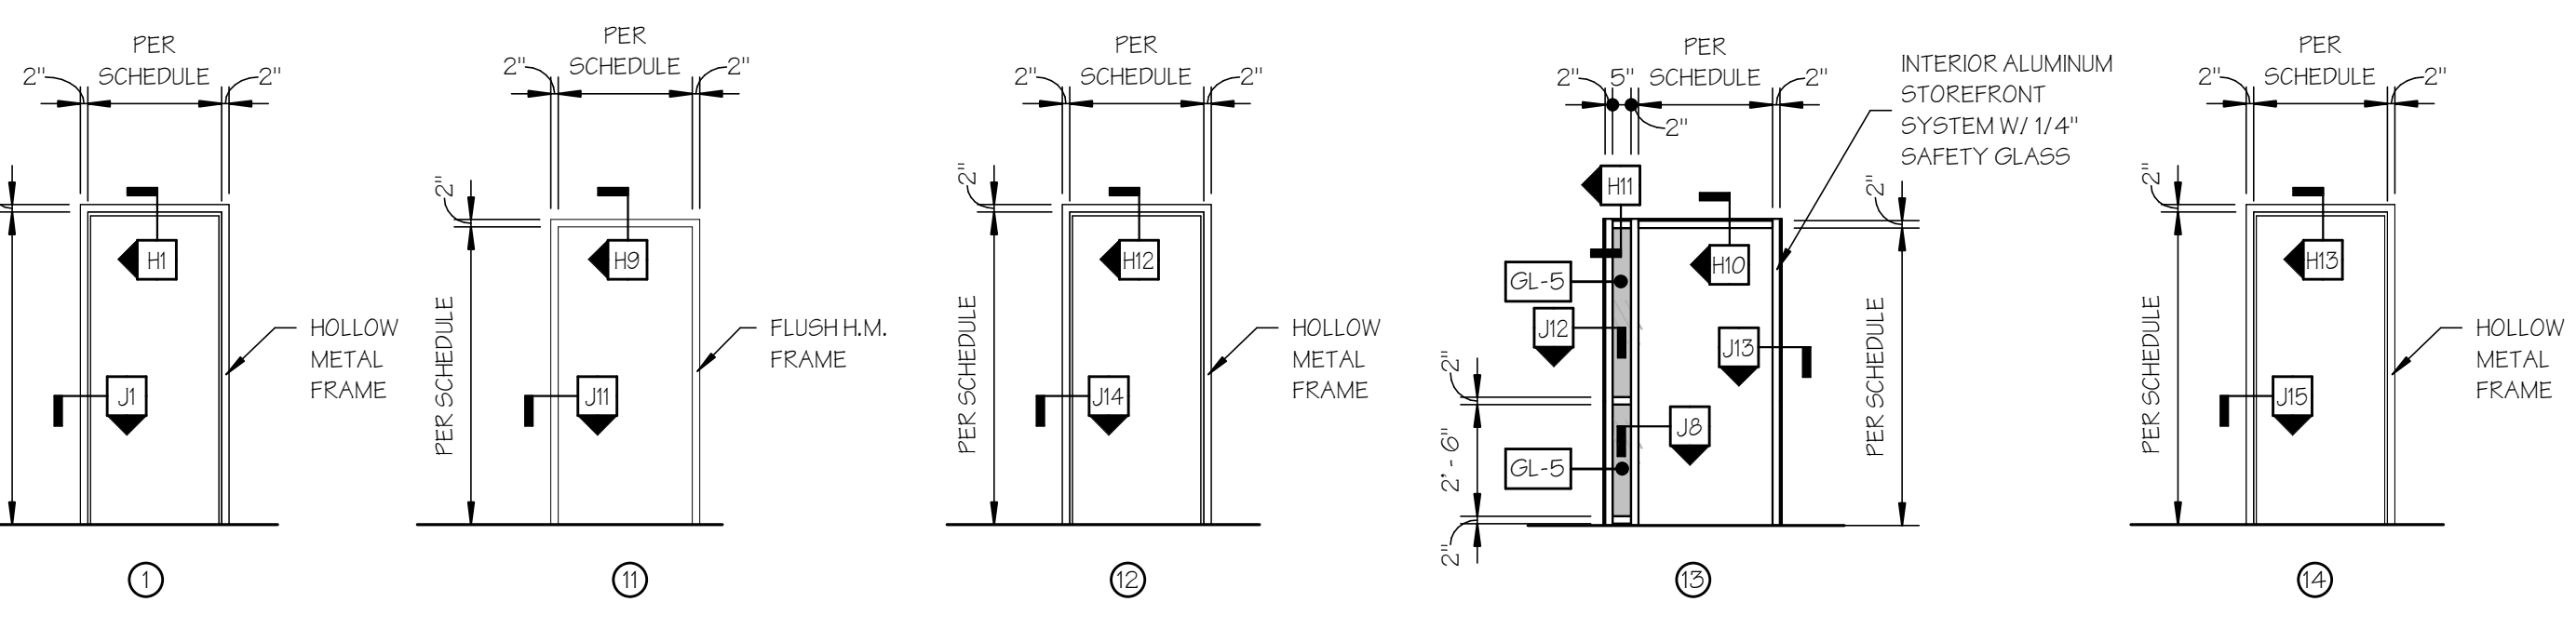

**FRAME TYPES**  
SCALE: 1/4" = 1'-0"

2/27/2020 1:07:35 PM C:\Users\rosenthal\Documents\18052\_Bridgeport Rescue Mission\_Phase 2\_Architecture\_roseenthal.rvt



These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:  
**BID SET**  
31 JANUARY 2020  
**04.16.2020 - CM BID**

REVISIONS		
NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
INTERIOR SIGNAGE DETAILS

SCALE: As indicated	DRAWN BY: BMD	REVIEWED BY: DCF
------------------------	------------------	---------------------

DRAWING NO.  
**A-990**

**A-990**  
**04.16.2020 - CM BID**  
DATE:  
31 JANUARY 2020  
JOB NUMBER:  
18052

### GENERAL SIGNAGE NOTES

- A. FONT MUST COMPLY WITH CHARACTER PARAMETERS AS LISTED FOR VISUAL AND TACTILE CHARACTERS. CHARACTER WIDTH OF THE UPPERCASE LETTER 'O' SHALL BE 55% MIN. & 110% MAX. OF THE UPPERCASE LETTER 'T'.
- B. TEXT SHALL HAVE WIDTH TO HEIGHT RATIO BETWEEN 3:5 & 1:1 AND STROKE WIDTH TO HEIGHT RATIO BETWEEN 1:5 & 1:10.
- C. LINE SPACING BETWEEN THE BASELINES OF SEPARATE LINES OF CHARACTERS WITHIN A MESSAGE SHALL BE 135% MIN. & 170% MAX. OF THE CHARACTER HEIGHT.
- D. ALL CHARACTERS AND PICTOGRAMS TO HAVE A NON-GLARE FINISH AND SHALL CONTRAST WITH THE BACKGROUND COLOR (70% MIN. CONTRAST BASED ON LIGHT REFLECTANCE VALUES). ALL COLORS TO BE SELECTED BY ARCHITECT AND OWNER.
- E. FOR EASE OF FABRICATION, ALL VISUAL CHARACTERS AND PICTOGRAMS SHALL BE RAISED 1/32" MIN. ABOVE THEIR BACKGROUND.
- F. FULL-HEIGHT PICTOGRAMS TO BE 5-1/4" HIGH.
- G. ROOM NUMBERING & LABELING SHOWN ON DRAWINGS IS FOR ORGANIZATIONAL PURPOSES ONLY. SIGNAGE VENDOR MUST COORDINATE FINAL ROOM NUMBERS, NAMES, AND VERBIAGE WITH ARCHITECT, OWNER, AND FIRE MARSHAL.


SEE DOOR SCHEDULES AND FINISH PLANS FOR SIGN LOCATIONS, TYPES, ROOM NUMBERS, AND DESIGNATIONS AS WELL AS EXTERIOR-GRADE SIGNS.

### RAISED TACTILE CHARACTERS

- A. CHARACTER HEIGHT: 5/8" MINIMUM MEASURED FROM BASELINE U.O.N.
- B. PROVIDE UPPERCASE, SANS SERIF CHARACTERS, RAISED 1/32" MIN. ABOVE THEIR BACKGROUND.
- C. STROKE WIDTH OF UPPERCASE LETTER 'T' SHALL BE 10% MIN. OF THE CHARACTER HEIGHT TO 15% MAX. MEASURED AT THE TOP SURFACE OF THE CHARACTER AND 30% MAX. OF THE CHARACTER HEIGHT MEASURED AT THE BASE OF THE CHARACTER.
- D. CHARACTER SPACING, MEASURED BETWEEN THE TWO CLOSEST POINTS OF ADJACENT CHARACTERS, SHALL BE 1/8" MIN. MEASURED AT THE TOP SURFACE OF THE CHARACTERS, 1/16" MIN. MEASURED AT THE BASE OF THE CHARACTERS, AND FOUR (4) TIMES THE CHARACTER STROKE WIDTH MAX.
- E. SIGN LOCATIONS:  
SINGLE-LEAF DOORS: LATCH SIDE  
PAIRED DOORS WITH 1 ACTIVE LEAF: ON INACTIVE LEAF  
PAIRED DOORS WITH 2 ACTIVE LEAFS: TO THE RIGHT OF THE RIGHT-HAND LEAF
- F. IF THERE IS INSUFFICIENT WALL SPACE, PLACE SIGN ON NEAREST ADJACENT WALL.
- G. DO NOT INSTALL SIGNS ON GLASS. IF THERE IS NO OTHER OPTION, ANY SIGNAGE MOUNTED TO GLASS SHALL BE ACCOMPANIED WITH APPROPRIATE BACKING MATERIAL ON OPPOSITE FACE OF GLASS.


### VISUAL CHARACTERS

- A. CHARACTER HEIGHT: 5/8" U.O.N. PROVIDE UPPERCASE OR LOWERCASE AS SHOWN.
- B. STROKE WIDTH OF UPPERCASE LETTER 'T' SHALL BE 10% MIN. & 30% MAX. OF THE CHARACTER HEIGHT.
- C. CHARACTER SPACING, MEASURED BETWEEN INDIVIDUAL CHARACTERS, MUST BE 10% MIN. & 35% MAX. OF THE CHARACTER HEIGHT.

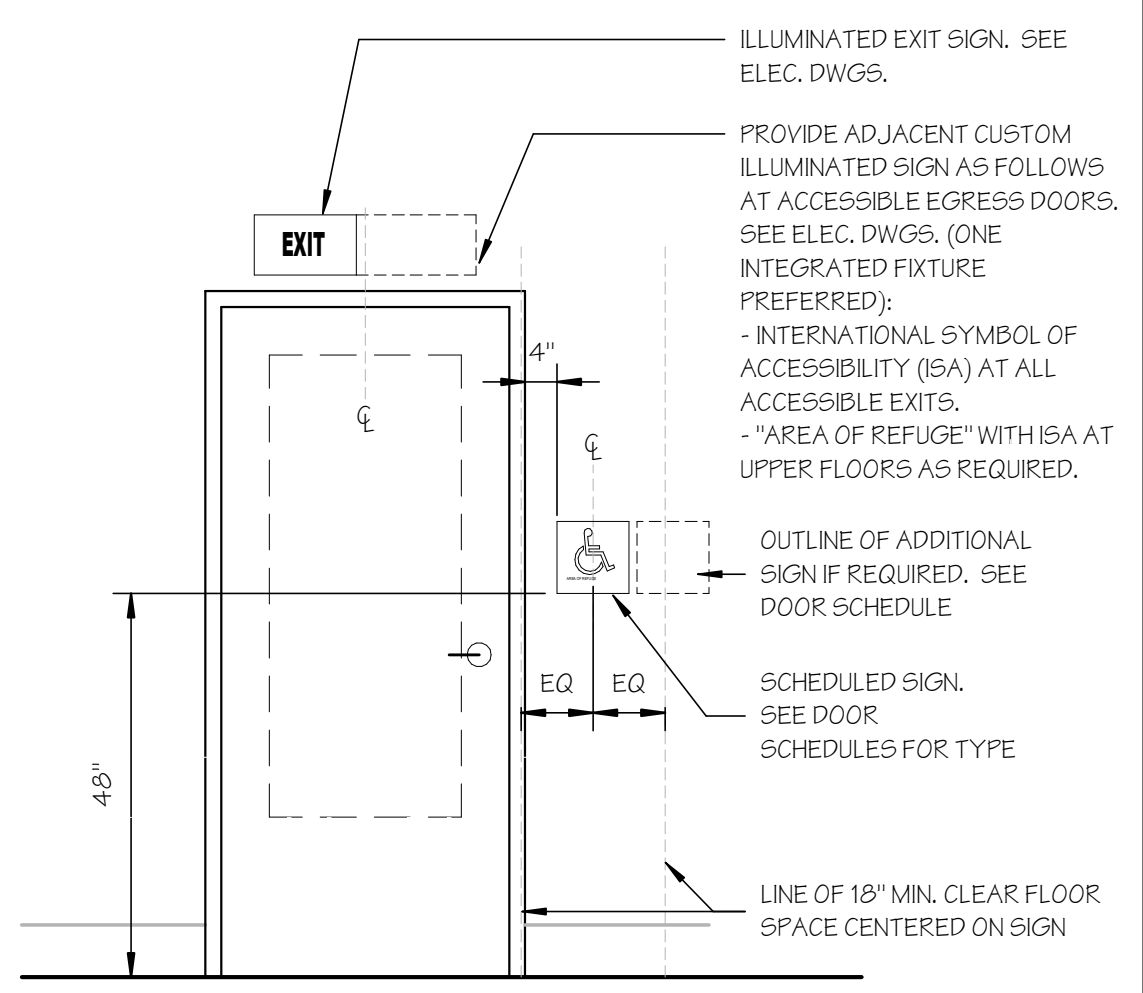


### TYPICAL SIGN LOCATION

SCALE: 1/2" = 1'-0"

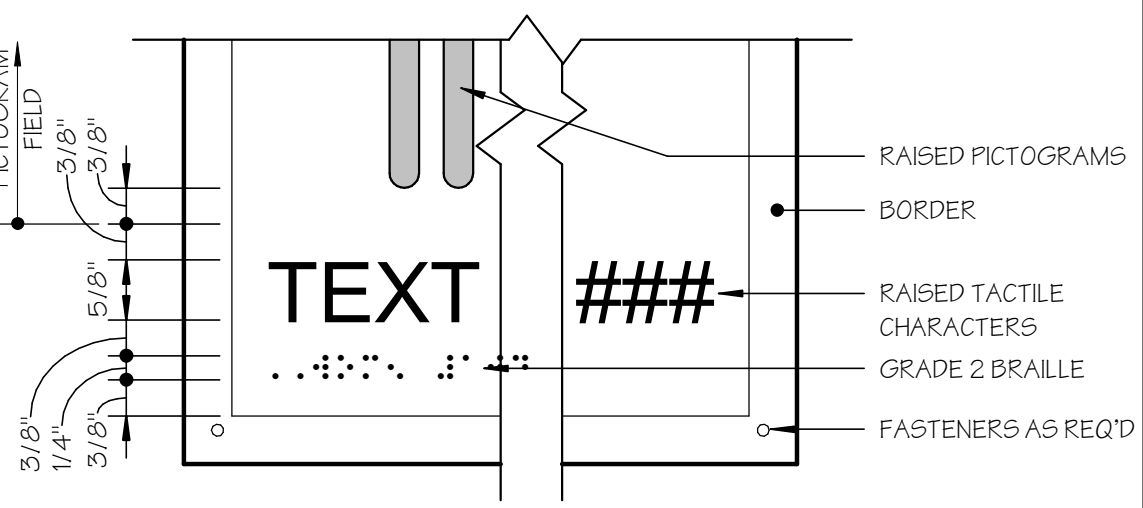


### TYPICAL SIGN LAYOUT GUIDELINES

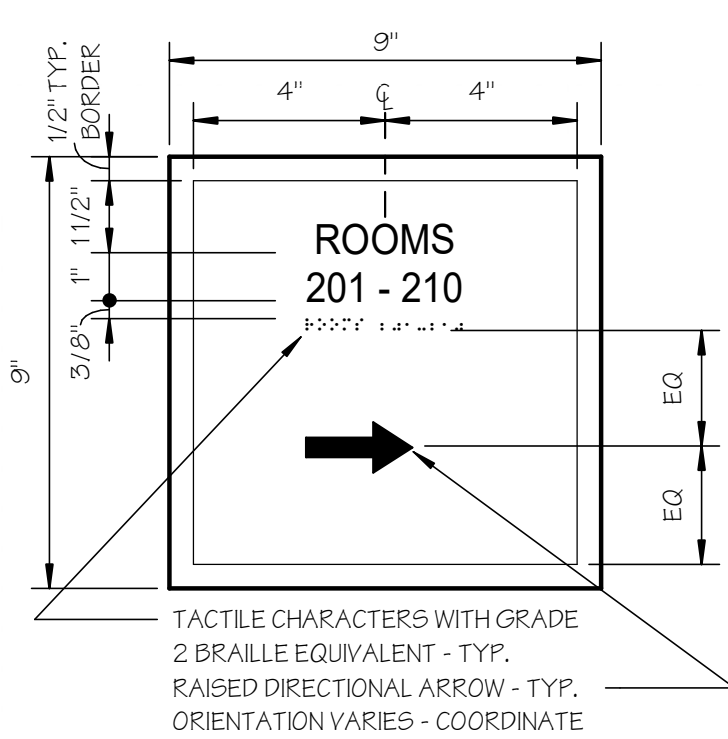

- 1. JUSTIFY SIGN TEXT AS SHOWN.
- 2. TEXT SHOWN ON THIS SIGN IS NOT REPRESENTATIVE OF ACTUAL SIGN MESSAGE. COORDINATE WITH FLOOR PLANS.
- 3. TEXT HEIGHT: 5/8"
- 4. PROVIDE AT ALL CORRIDOR INTERSECTIONS UP/STRAIGHT AHEAD ARROW
- 5. A1 = OPPOSITE HAND ARROW

### SIGN TYPE SERIES 'A' & 'A1'


SCALE: 3" = 1'-0"

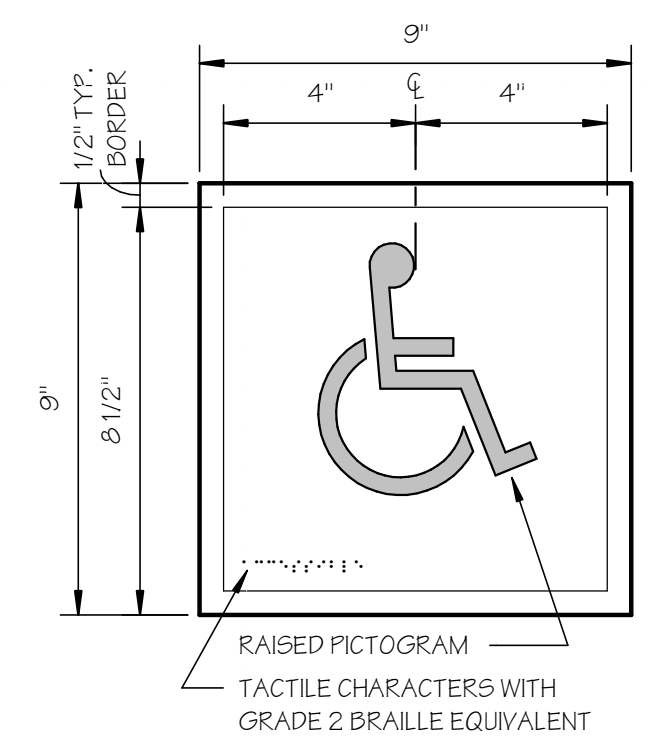

- 1. TEXT TO BE LEFT-JUSTIFIED.
- 2. TEXT SHOWN ON THIS SIGN IS REPRESENTATIVE OF ACTUAL SIGN MESSAGE.
- 3. TEXT HEIGHT: 5/8"
- 4. PROVIDE AT ALL ACCESSIBLE SPACES AND AT ALL ACCESSIBLE EXITS LEADING TO ACCESSIBLE PATHS OF EXIT DISCHARGE.

### SIGN TYPE 'B'


SCALE: 3" = 1'-0"

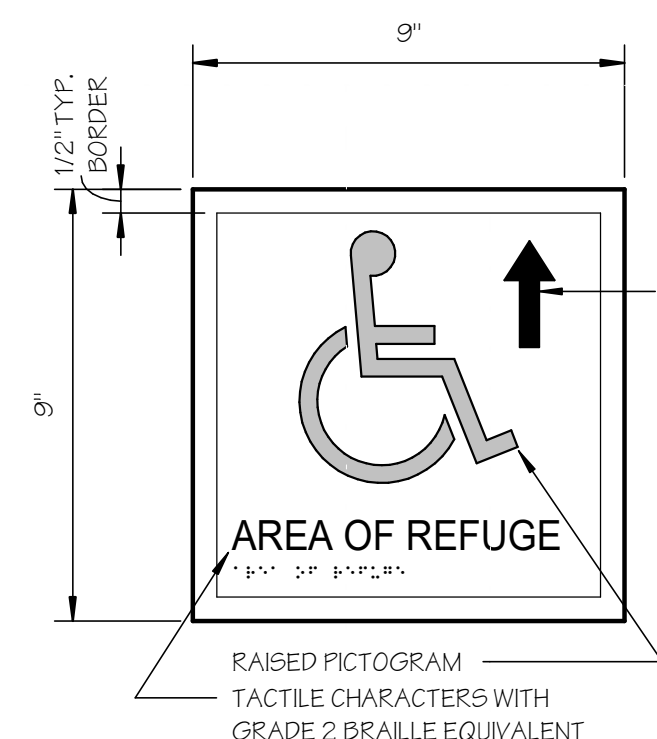

- 1. TEXT TO BE LEFT-JUSTIFIED.
- 2. TEXT SHOWN ON THIS SIGN IS REPRESENTATIVE OF ACTUAL SIGN MESSAGE.
- 3. TEXT HEIGHT: 5/8"
- 4. C1 = OPPOSITE HAND (MIRRORED) - LEFT JUSTIFIED (LOCATE @ AREA OF REFUGE)
- 5. C2 = OMIT ARROW - SIGN TO BE 6" WIDE
- 6. PROVIDE AT ALL CORRIDORS TO INDICATE DIRECTION OF AREA OF REFUGE.

### SIGN TYPE SERIES 'C', 'C1' & 'C2'


SCALE: 3" = 1'-0"

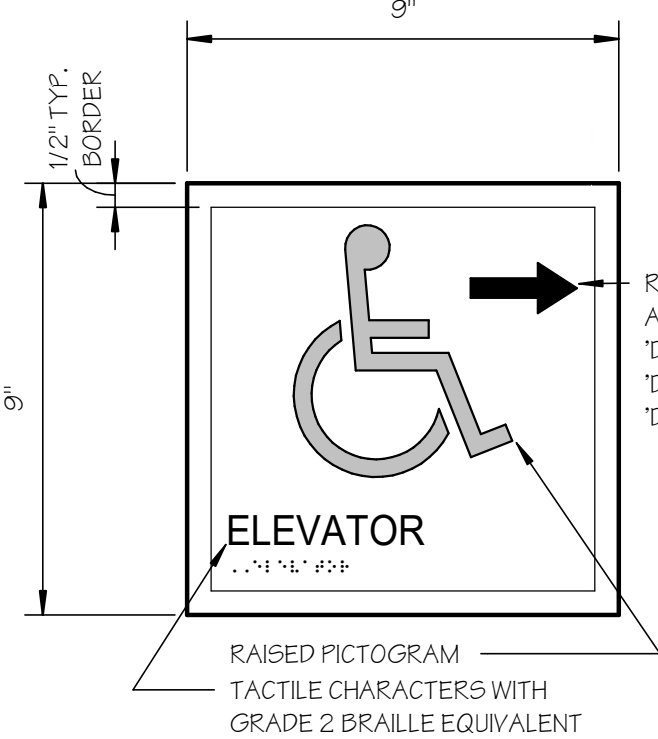

- 1. TEXT TO BE LEFT-JUSTIFIED.
- 2. TEXT SHOWN ON THIS SIGN IS REPRESENTATIVE OF ACTUAL SIGN MESSAGE.
- 3. TEXT HEIGHT: 5/8"
- 4. D1 = OPPOSITE HAND, D2 = UP ARROW AND D3 = NO ARROW

### SIGN TYPE SERIES 'D'


SCALE: 3" = 1'-0"

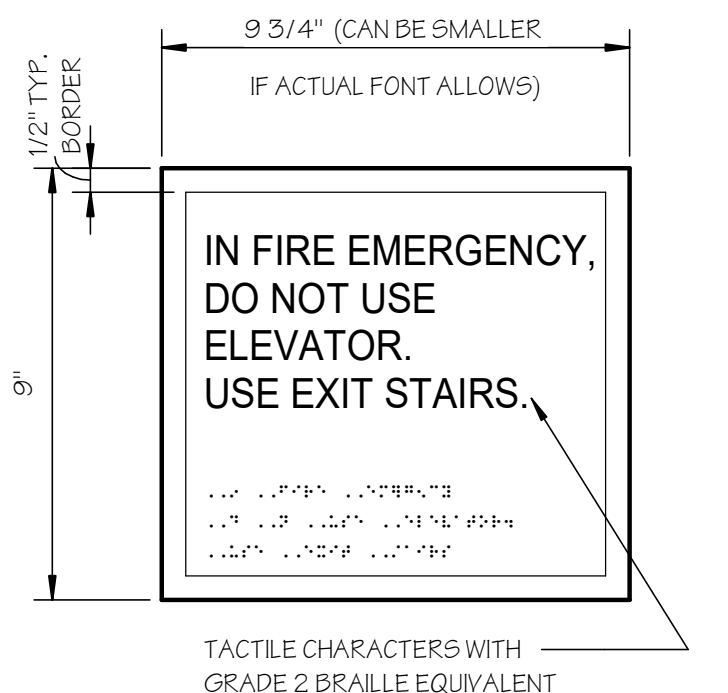

- 1. TEXT TO BE LEFT-JUSTIFIED.
- 2. TEXT SHOWN ON THIS SIGN IS REPRESENTATIVE OF ACTUAL SIGN MESSAGE.
- 3. TEXT HEIGHT: 5/8", WITH 1" SPACING

### SIGN TYPE SERIES 'E'


SCALE: 3" = 1'-0"

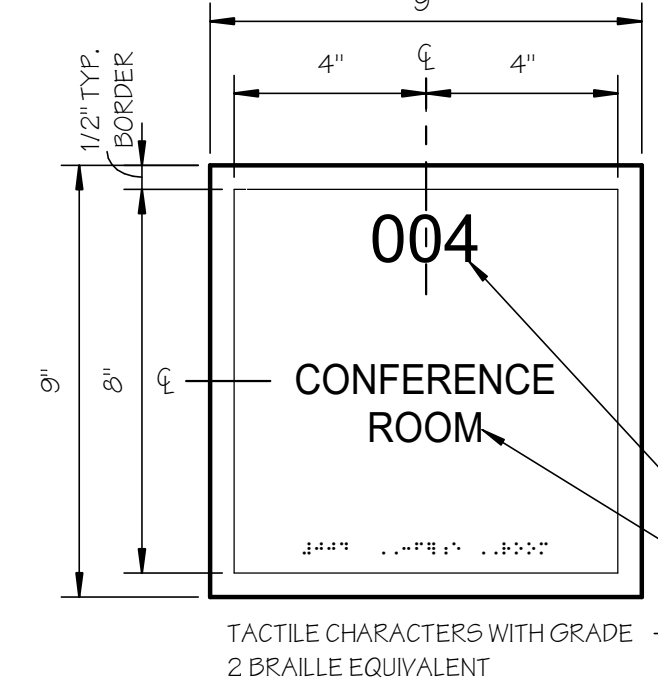

- 1. ALL TEXT TO BE CENTER-JUSTIFIED.
- 2. TEXT SHOWN ON THIS SIGN IS NOT REPRESENTATIVE OF ACTUAL SIGN MESSAGE. COORDINATE WITH DOOR SCHEDULES.
- 3. ROOM NUMBER HEIGHT: 1"
- 4. ROOM NAME HEIGHT: 5/8", WITH 1" SPACING

### SIGN TYPE SERIES 'F'


SCALE: 3" = 1'-0"

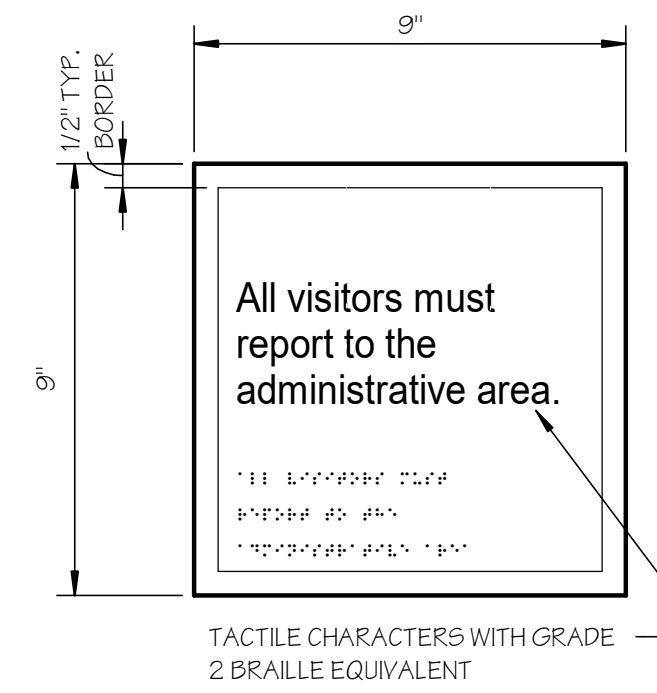

- 1. TEXT TO BE LEFT-JUSTIFIED.
- 2. TEXT SHOWN ON THIS SIGN IS REPRESENTATIVE OF ACTUAL SIGN MESSAGE.
- 3. TEXT HEIGHT: 5/8"

### SIGN TYPE 'G'


SCALE: 3" = 1'-0"

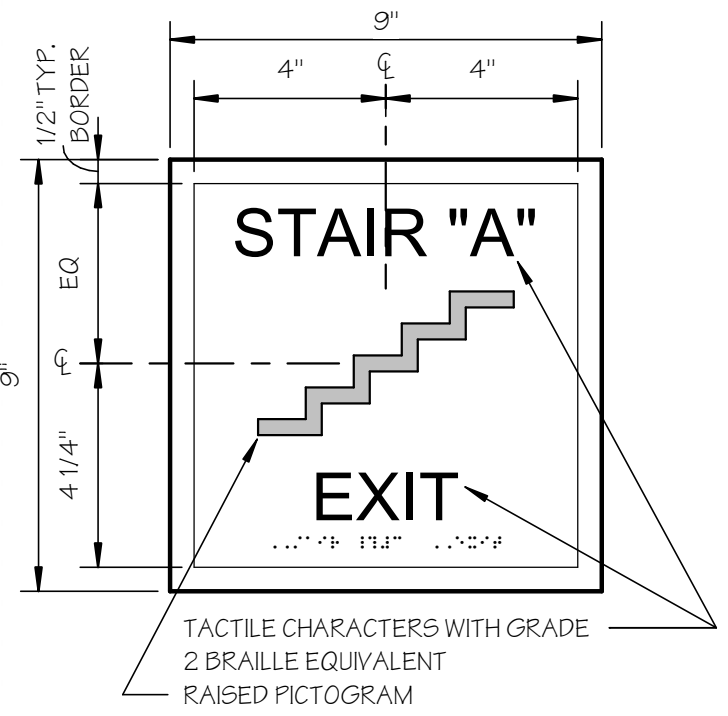

- 1. ALL TEXT TO BE CENTER-JUSTIFIED.
- 2. STAIR NAME SHOWN ON THIS SIGN IS NOT REPRESENTATIVE OF ACTUAL SIGN MESSAGE. COORDINATE WITH DOOR SCHEDULES AND SIGNAGE PLANS.
- 3. TEXT HEIGHT: 1"
- 4. PROVIDE NEW SIGNAGE AT ALL STAIR ENCLOSURES AS PER LIFE SAFETY CODE 5.2.2.6.6.
- 5. L1 - OPPOSITE HAND
- 6. L2 = OMIT ARROW

### SIGN TYPE 'L', 'L1' & 'L2'


SCALE: 3" = 1'-0"

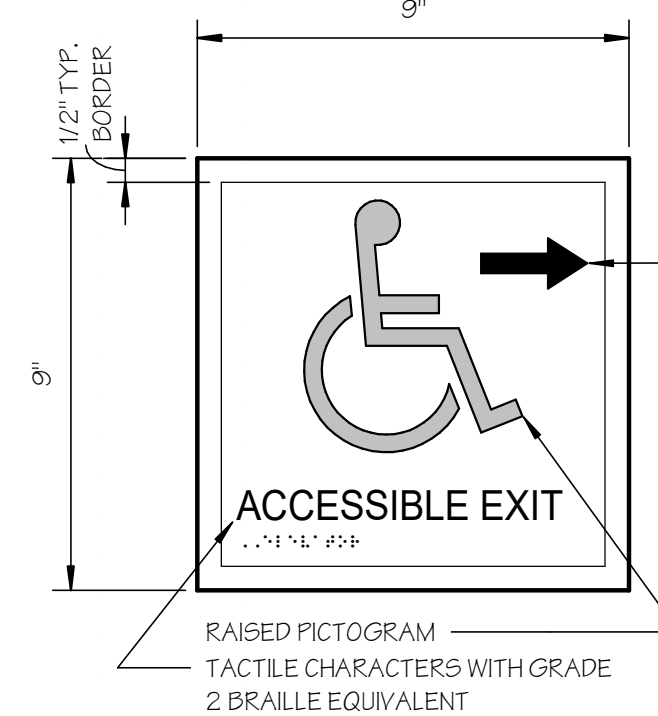

- 1. TEXT TO BE LEFT-JUSTIFIED.
- 2. TEXT SHOWN ON THIS SIGN IS REPRESENTATIVE OF ACTUAL SIGN MESSAGE.
- 3. TEXT HEIGHT: 5/8"
- 4. M1 = OPPOSITE HAND.

### SIGN TYPE SERIES 'M' & 'M1'


SCALE: 3" = 1'-0"

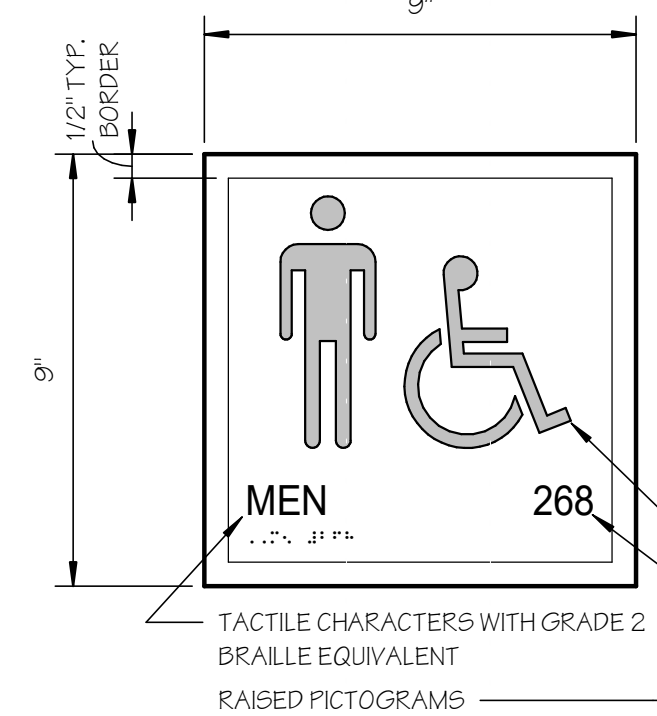

- 1. TEXT TO BE LEFT-JUSTIFIED.
- 2. ROOM NUMBER TO BE RIGHT-JUSTIFIED.
- 3. TEXT SHOWN ON THIS SIGN IS NOT REPRESENTATIVE OF ACTUAL SIGN MESSAGE. COORDINATE WITH DOOR SCHEDULES.
- 4. TEXT HEIGHT: 5/8"

### SIGN TYPE SERIES 'O' & 'O1'

SCALE: 3" = 1'-0"

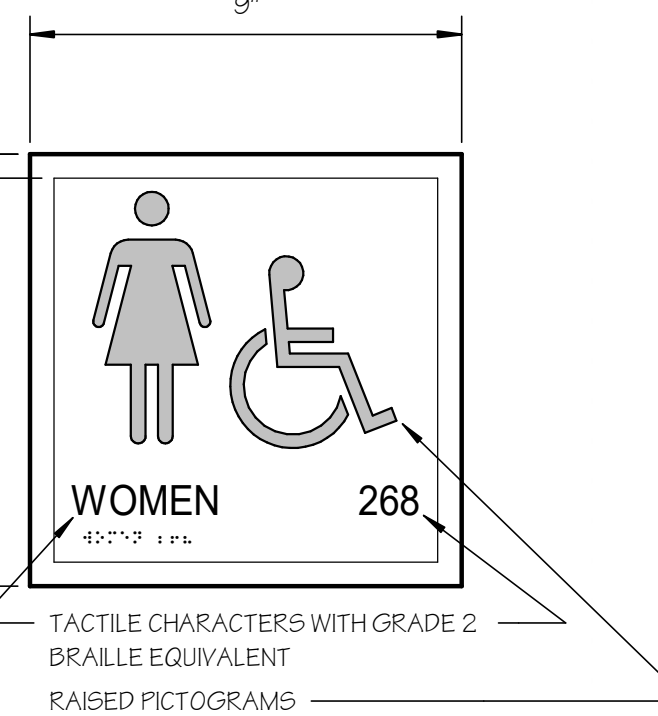

- 1. TEXT TO BE LEFT-JUSTIFIED.
- 2. ROOM NUMBER TO BE RIGHT-JUSTIFIED.
- 3. TEXT SHOWN ON THIS SIGN IS NOT REPRESENTATIVE OF ACTUAL SIGN MESSAGE. COORDINATE WITH DOOR SCHEDULES.
- 4. TEXT HEIGHT: 5/8"

### SIGN TYPE SERIES '0' & '01'

SCALE: 3" = 1'-0"





COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com





These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:

**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
**04.16.2020 - CM BID**

REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

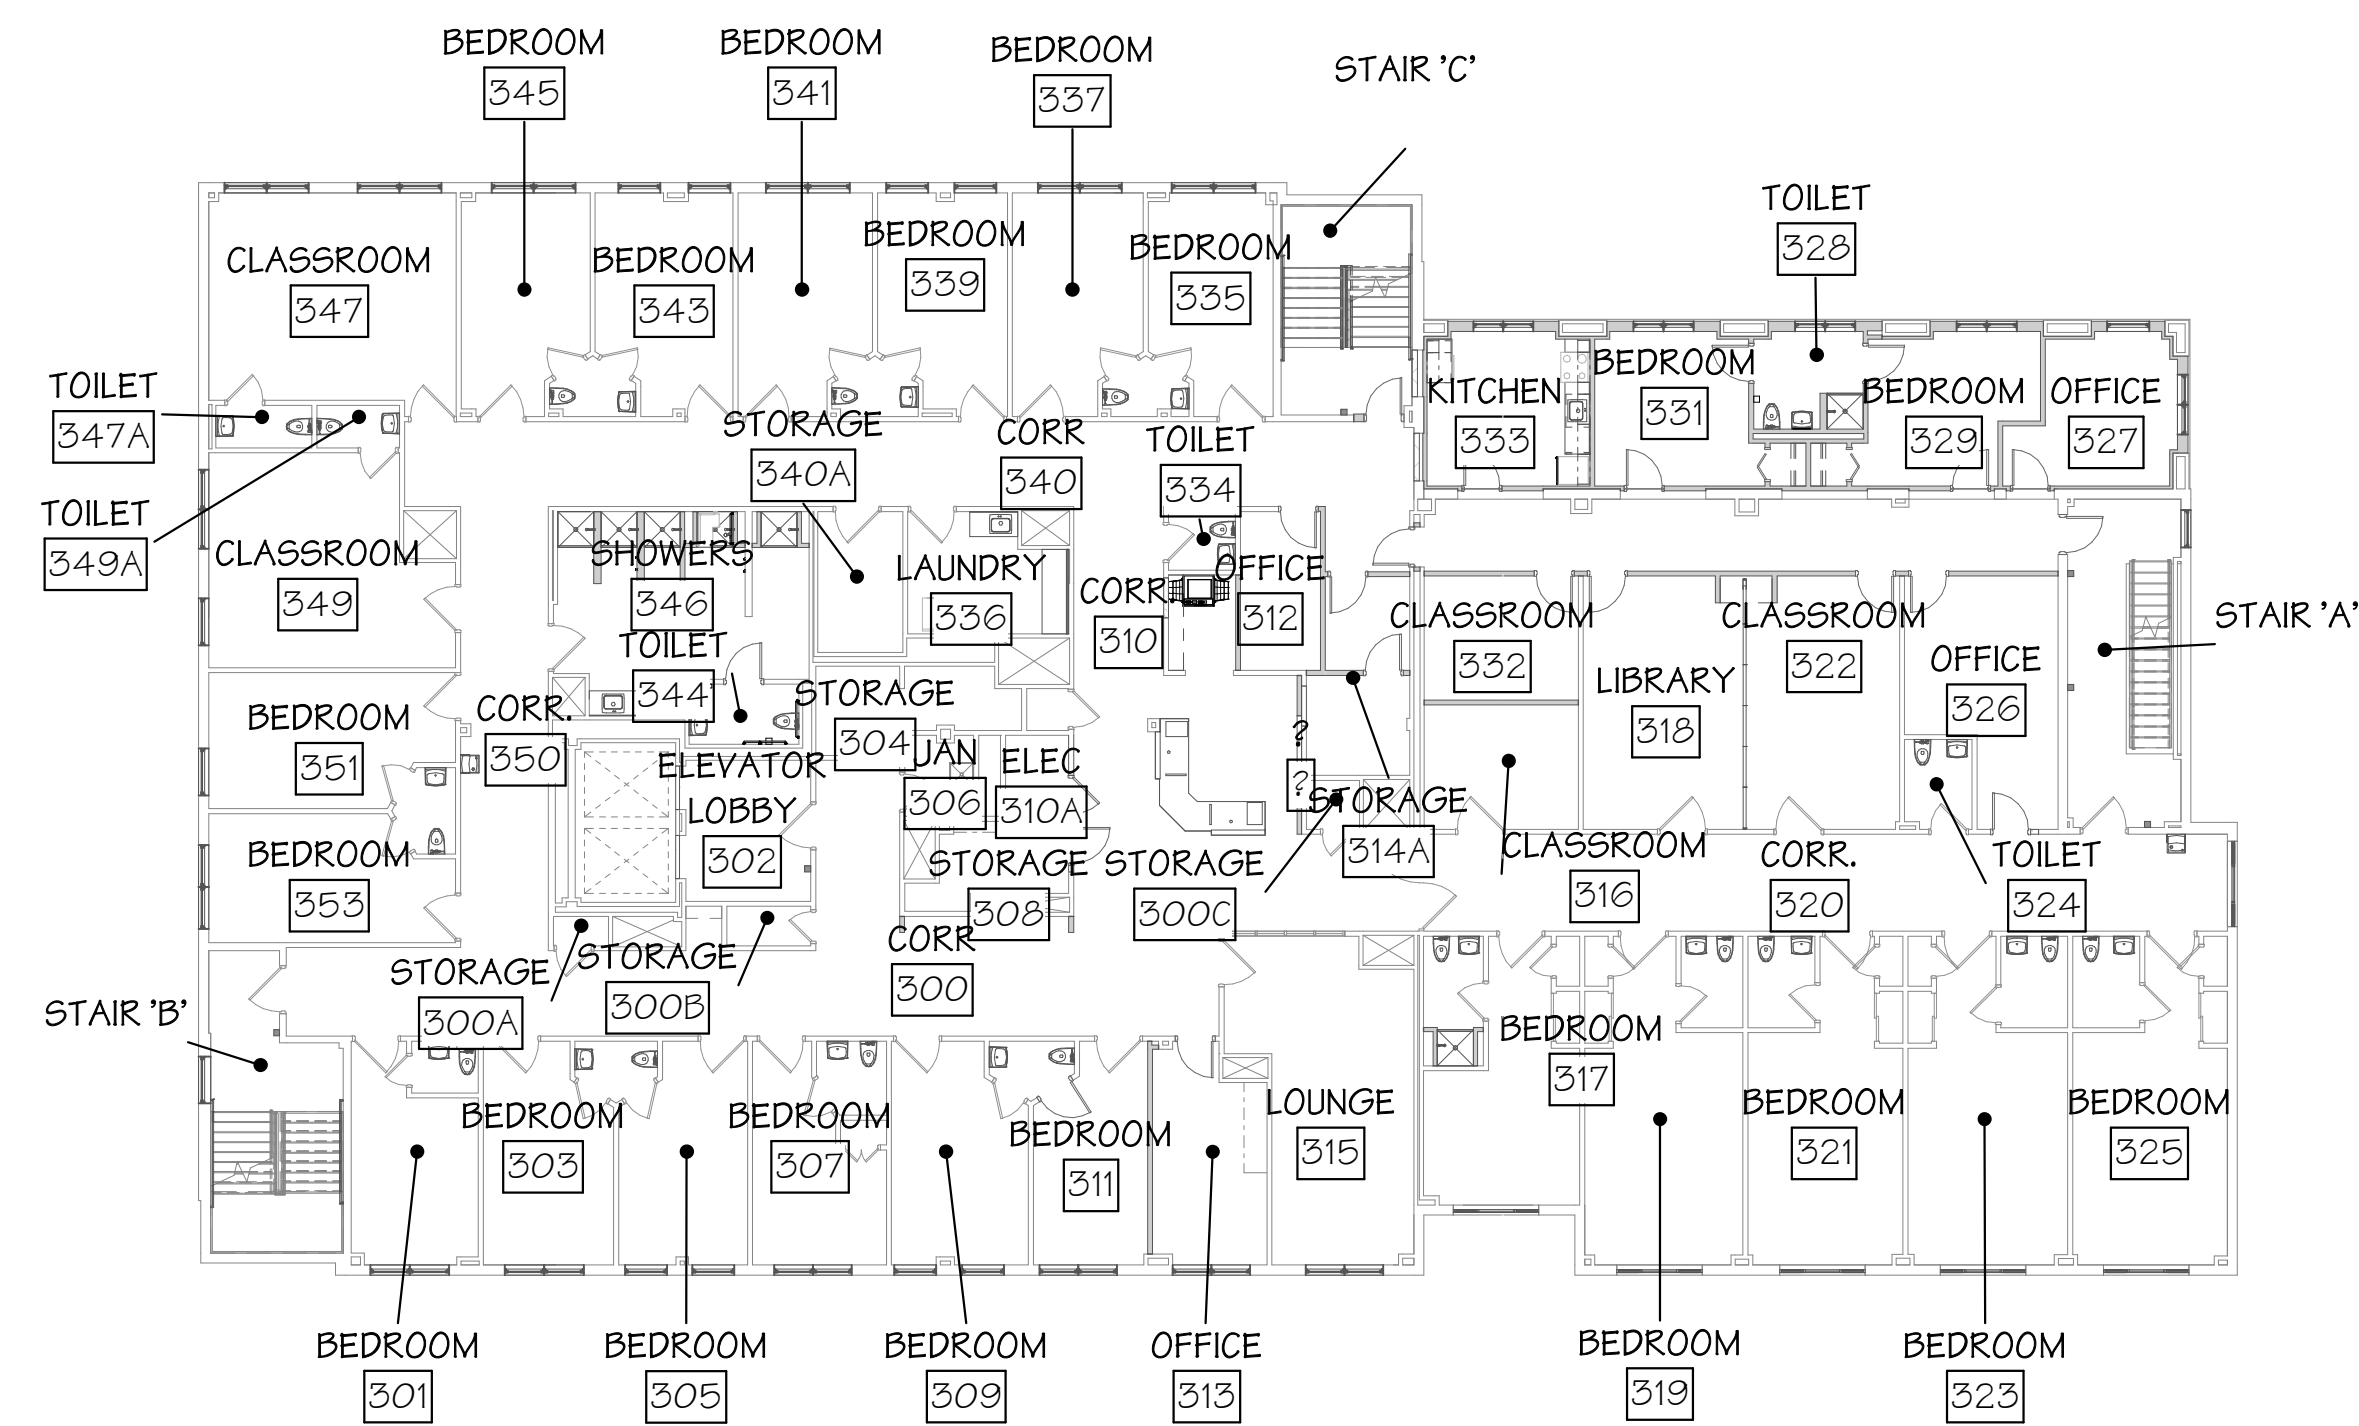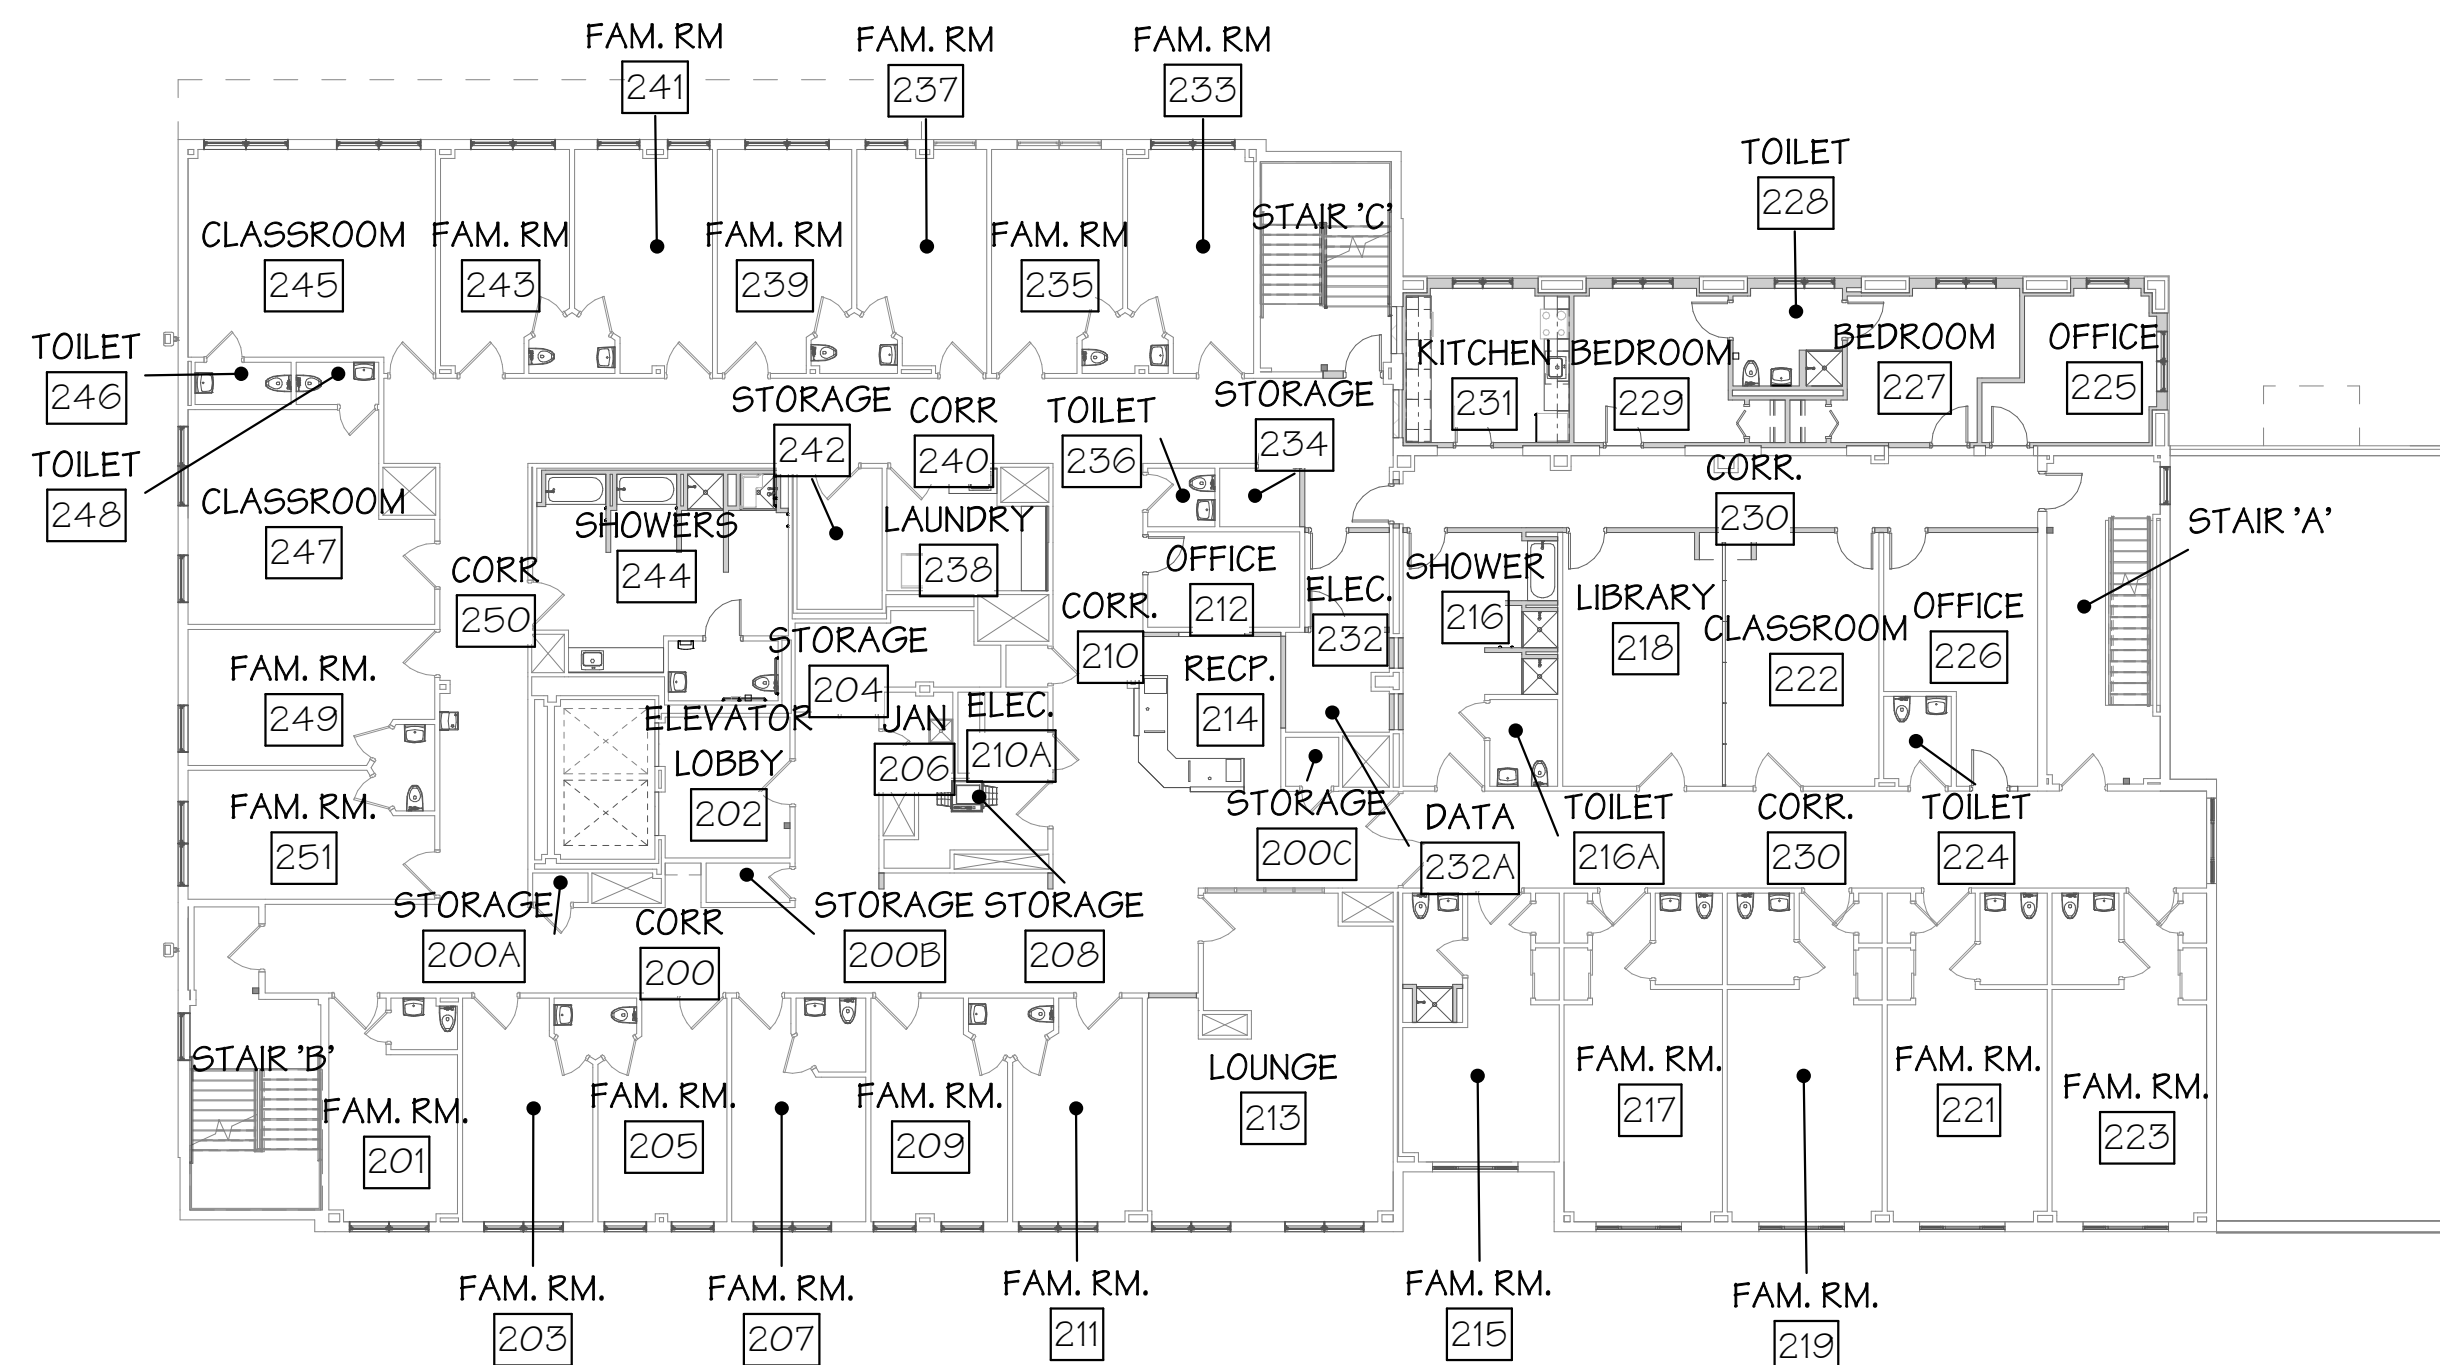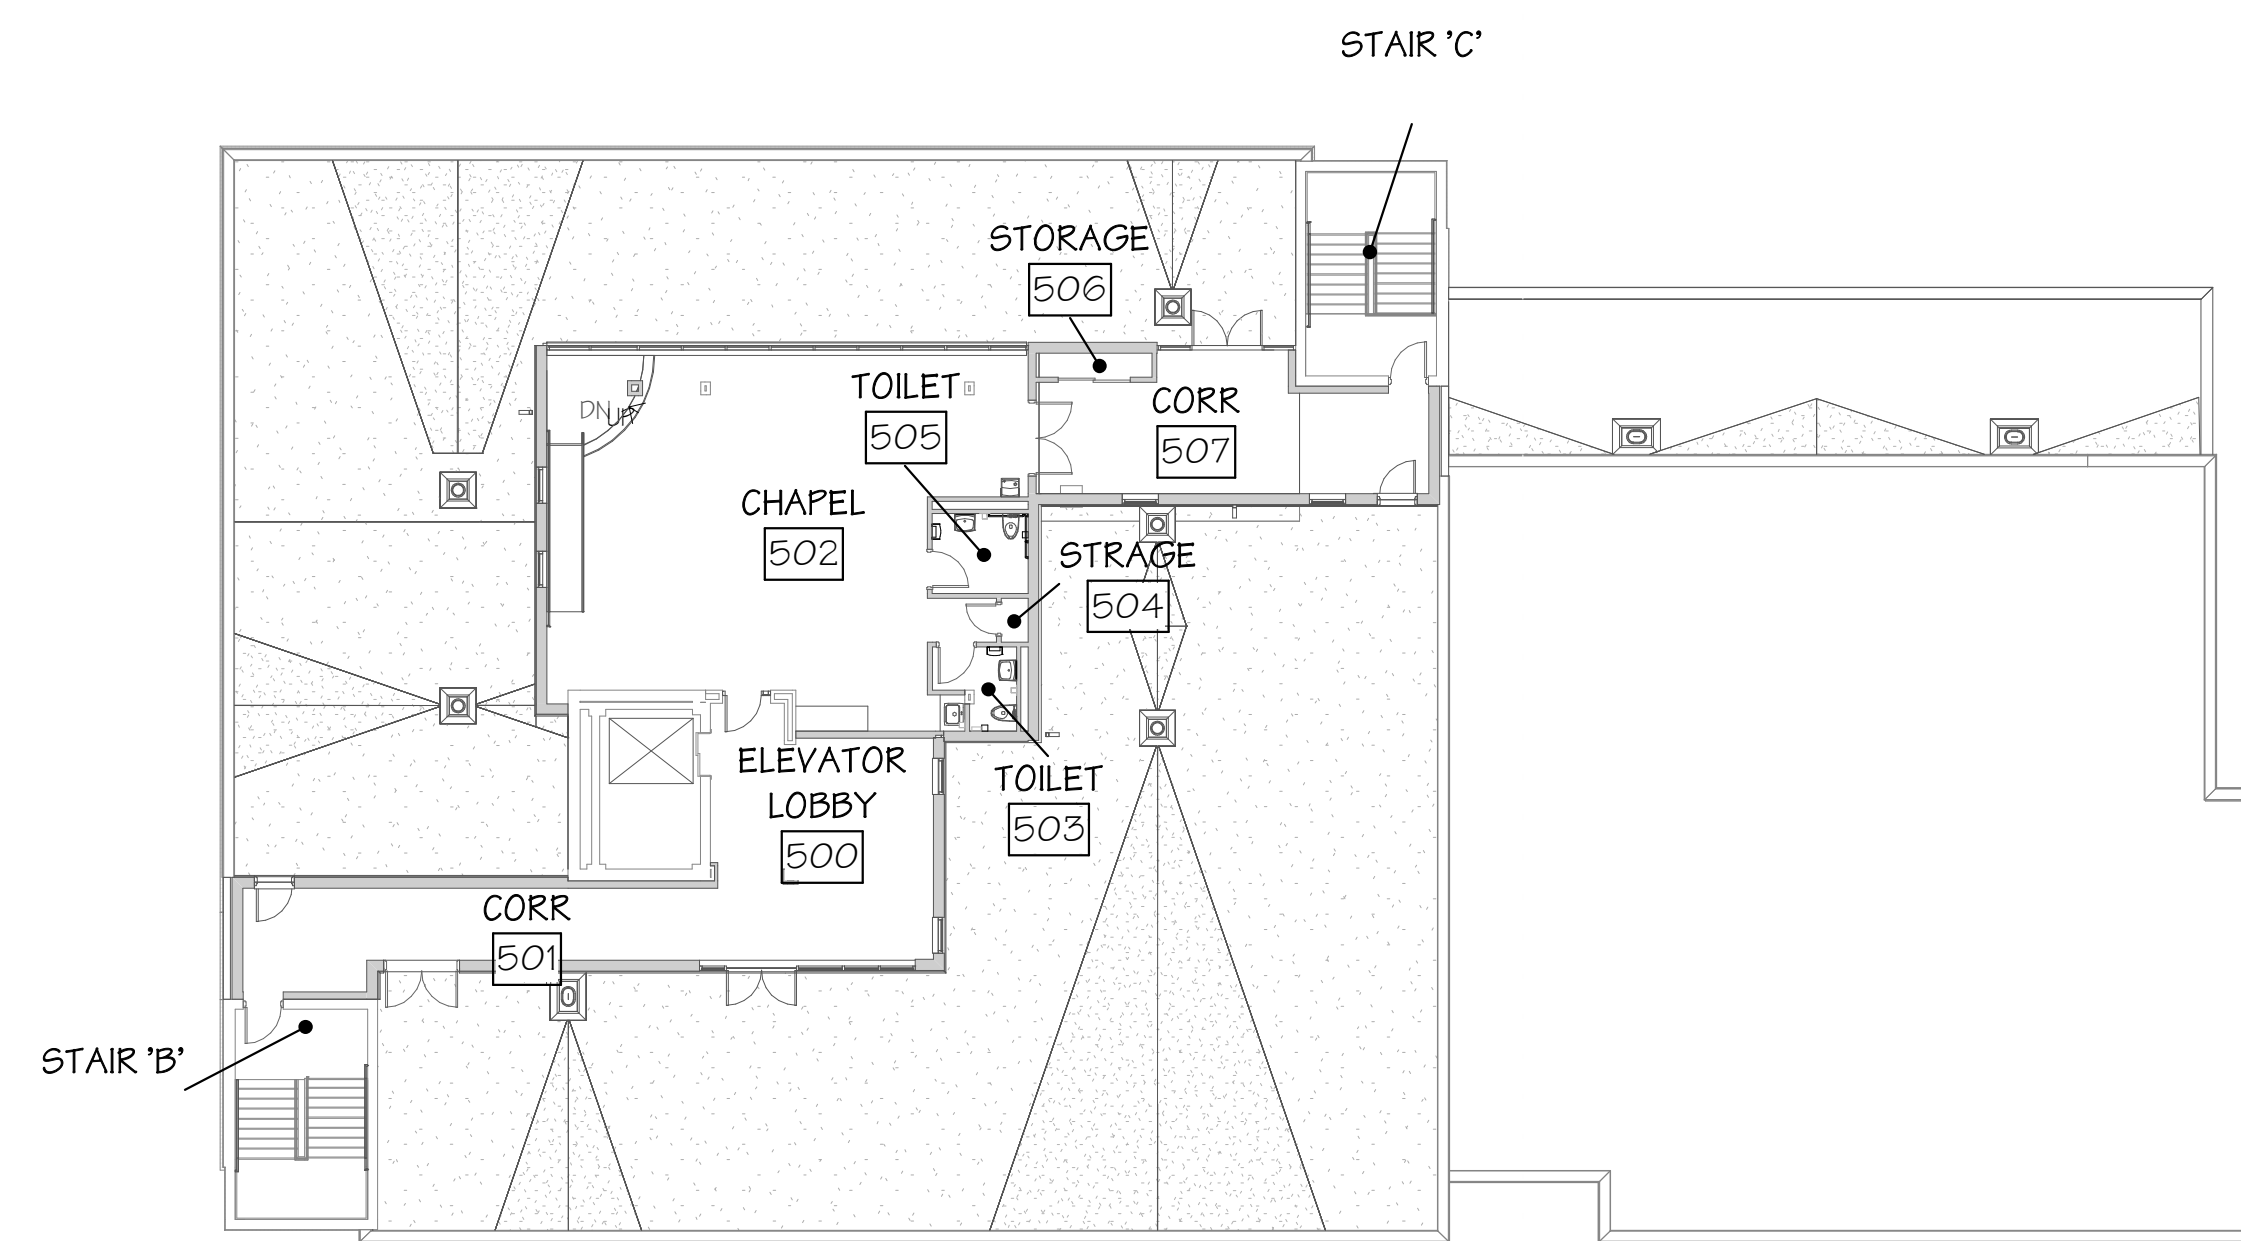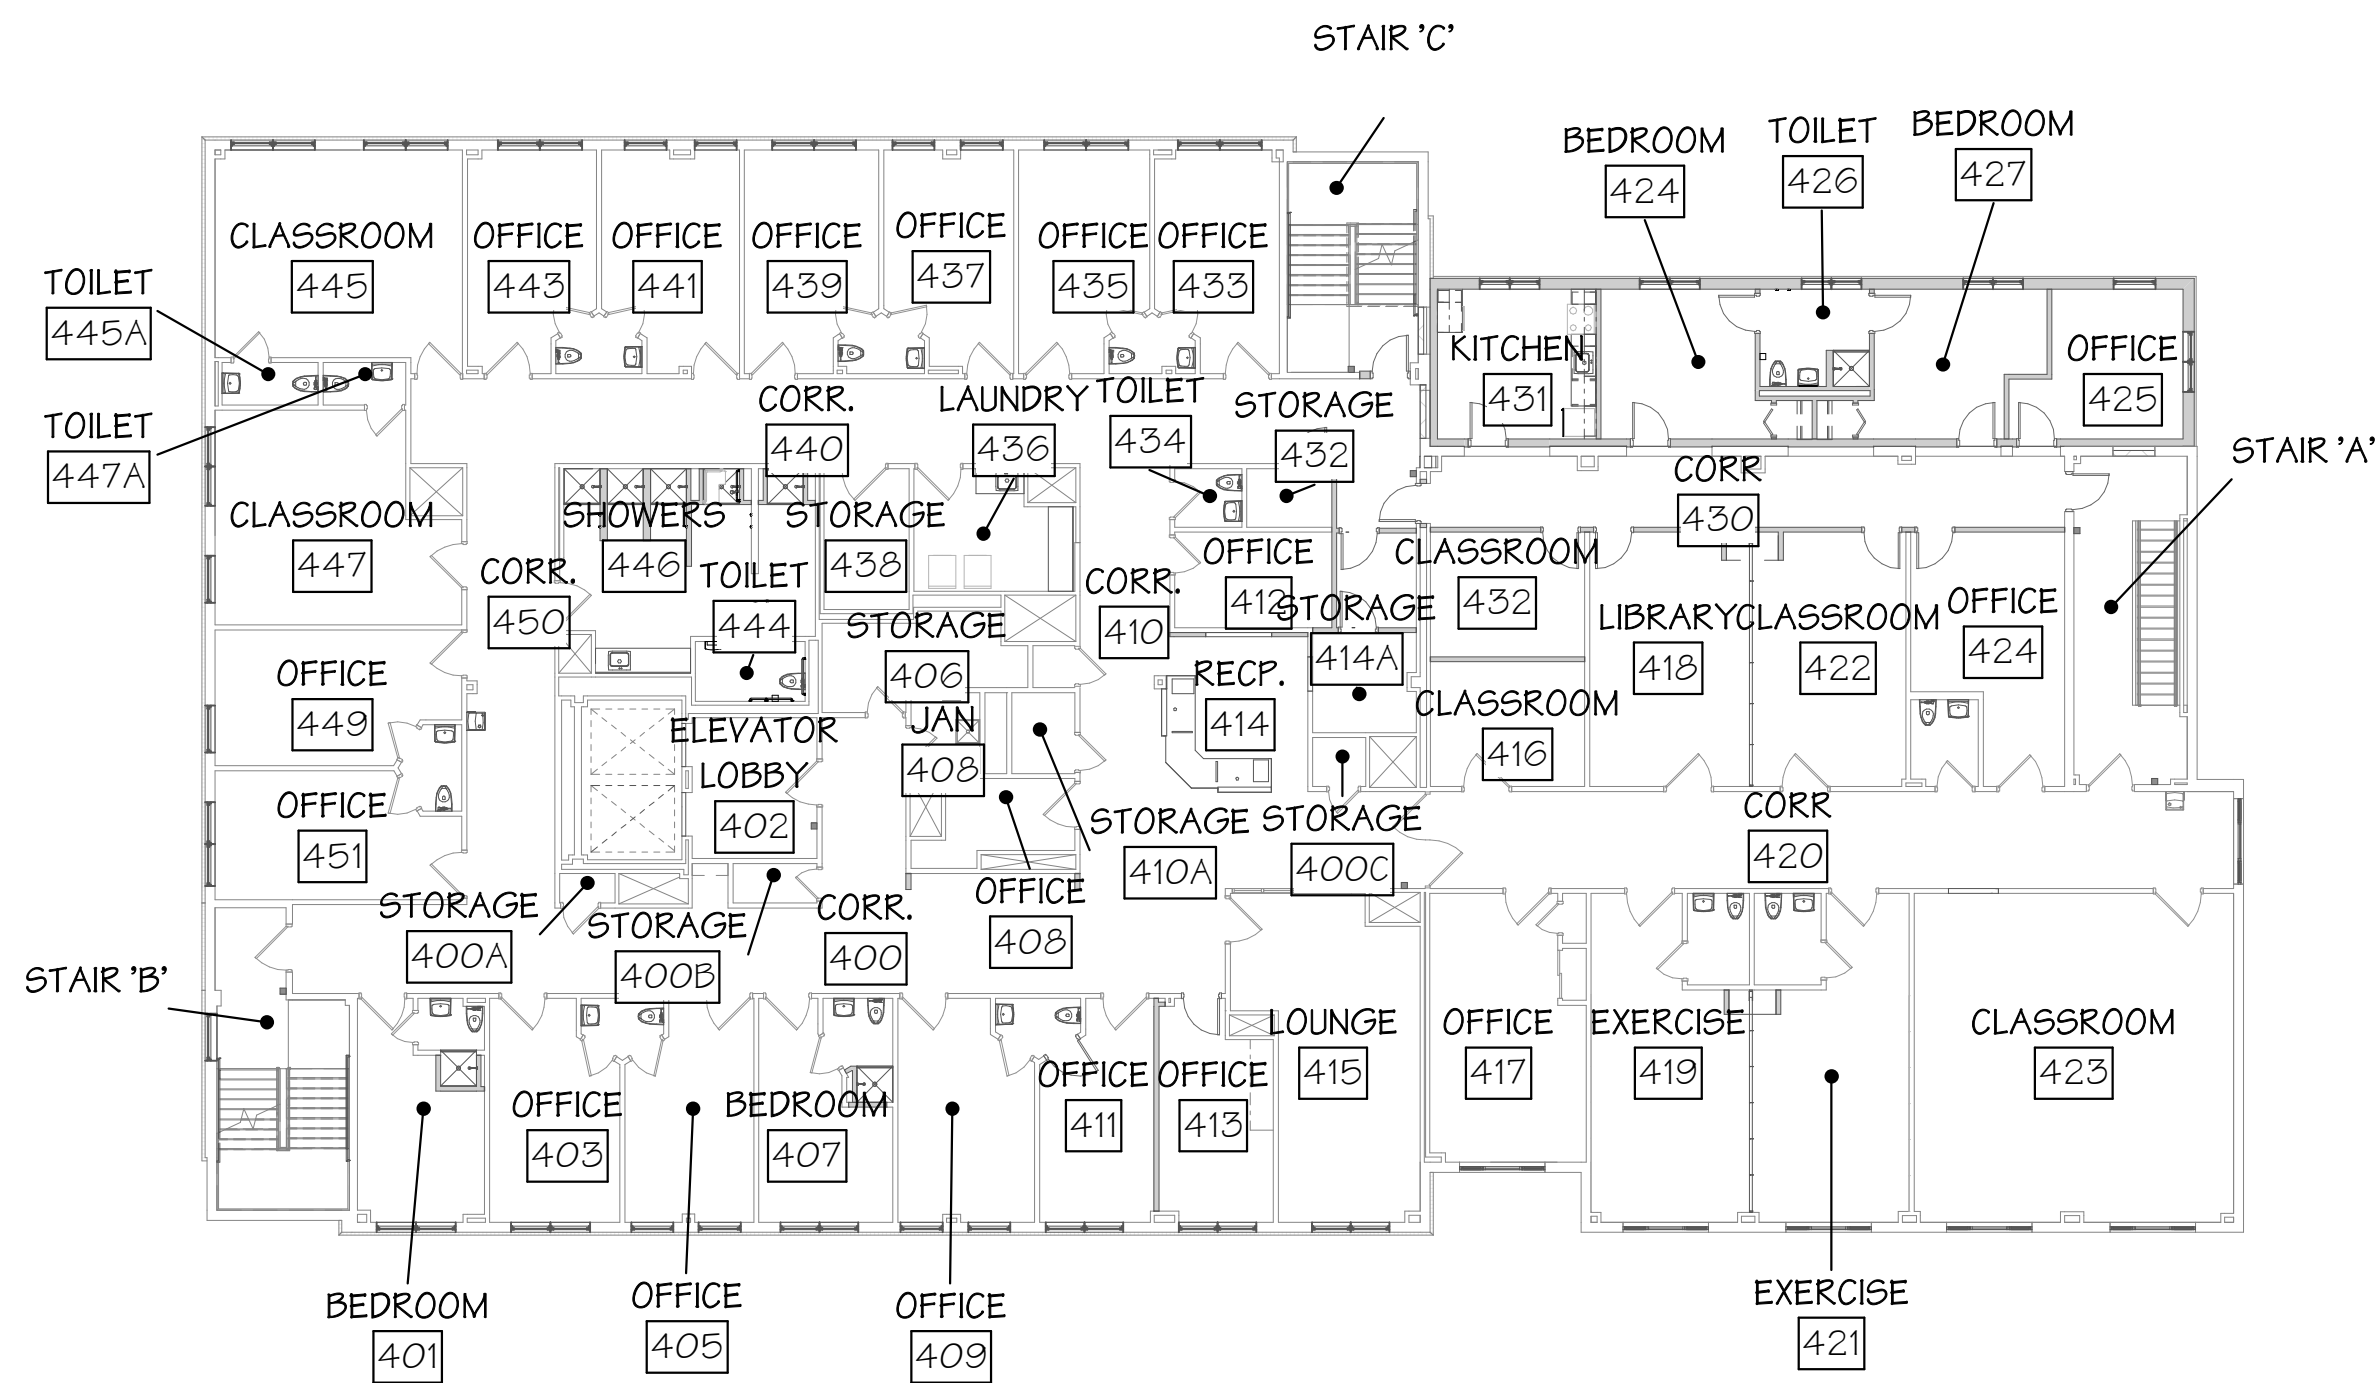

**JOEL SMILOV CARE CENTER  
BRIDGEPORT RESCUE MISSION**  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
SIGNAGE - PLANS

SCALE: 1/16" = 1'-0" DRAWN BY: Author REVIEWED BY: Approver

DRAWING NO.

**A-991**  
**04.16.2020 - CM BID**

DATE: 31 JANUARY 2020 JOB NUMBER: 18052



ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:

**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
**04.16.2020 - CM BID**

REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
SECOND FLOOR FINISH & SIGNAGE  
PLAN

SCALE: As indicated  
DRAWN BY: BMD  
REVIEWED BY: DCF

DRAWING NO.  
**FI-102**  
04.16.2020 - CM BID  
DATE: 31 JANUARY 2020  
JOB NUMBER: 18052


GENERAL FINISH NOTES

- FINISH FLOOR PLANS SHALL BE USED IN CONJUNCTION WITH INTERIOR ELEVATIONS AND DETAILS. SHOULD THERE BE A DISCREPANCY BETWEEN INFORMATION GIVEN CONTRACTOR SHALL CONTACT ARCHITECT FOR CLARIFICATION.
- EXISTING FINISHES SHALL REMAIN AT ALL LOCATIONS WHERE FINISH TAG CALLS OUT FOR (EX).
- PAINTING SCHEDULE: ALL PAINTING SHALL BE AS INDICATED BY PLAN, NOTES, AND FINISH SCHEDULE.
  - WALLS, GYP. BD. SURFACES AND OTHER PAINTED SURFACES (EGGSHELL FINISH)
    - ONE (1) PRIME COAT & TWO (2) FINISH COATS
  - DOOR FRAMES (SEMI-GLOSS)
    - ONE (1) PRIME COAT & TWO (2) FINISH COATS (U.O.N.)
  - GYP. BD. CEILINGS (FLAT FINISH)
    - ONE (1) PRIME COAT & TWO (2) FINISH COATS (U.O.N.)
- ALL TRANSITIONS IN FLOORING TO OCCUR AT CENTERLINE OF DOOR. PROVIDE TRANSITION STRIP WHERE CHANGE IN FLOOR MATERIAL OCCURS. TRANSITION FINISH TO MATCH ADJACENT FLOOR COLOR. U.O.N. REFER TO SHEET FI-951.
- ALL RUBBER BASE IN AREAS WITH CARPET TO BE 4" HIGH "STRAIGHT" BASE.
- ALL RUBBER BASE IN AREAS WITH VCT TO BE 4" HIGH "COVER" BASE.
- ALL GYP. BD. WALLS RECEIVING WALL COVERING SHALL RECEIVE LEVEL 5 FINISH.
- ALL DOORS NEW SHALL RECEIVE WOOD FINISH (WD-1), U.O.N. REFER TO DOOR SCHEDULE.
- ALL NEW & EXISTING HOLLOW METAL DOOR FRAMES SHALL BE PAINTED (PT-1), U.O.N.
- ALL OUTLETS, WALL PLATES, & SWITCHES SHALL BE WHITE FINISH.
- NO CARPET TILE SHALL BE CUT OR INSTALLED LESS THAN 4".
- ALL WINDOWS SHALL RECEIVE NEW WINDOW SHADES (WT-1) & FACIAS (U.O.N.)
- ALL ROLLER SHADE PANELS TO RUN FROM CENTER LINE OF MULLION TO CENTER LINE OF MULLION & TO BE SIZED TO FIT AT LOCATIONS ADJACENT PARTITIONS AND/OR COLUMN ENCLOSURES. ALL EXTERIOR WINDOWS AND INTERIOR STOREFRONT SYSTEMS SCHEDULED FOR ROLLER SHADES TO BE FIELD VERIFIED BEFORE ORDER PLACEMENT.

FINISH NOTES

- EXISTING FINISHES SHALL REMAIN.
- REPLACE DAMAGED COUNTERTOP WITH (PL-1). EXISTING BASE AND UPPER CABINETS SHALL BE CLEANED, PATCHED AND REPAIRED AS NEEDED.
- ADD NEW PULLS (HD-1) & NEW MATCHING LOCKS TO EXISTING UPPER AND LOWER CABINETS. LOCKS KEYED ALIKE PER ROOM AND MASTER KEYED.
- TILE TO EXTEND FULL HEIGHT OF WET WALL. REFER TO B2/A-601.
- ALL STAIR RAILINGS, HAND RAILS AND EXPOSED STRUCTURE SHALL HAVE EXISTING CHIPPING PAINT REMOVED. ALL RAILINGS, HAND RAILS AND EXPOSED STRUCTURE SHALL BE SANDED AND RE-PAINTED (PT-5).
- TILE SHALL BE APPLIED TO ALL WALLS WITHIN SHOWER AND EXTEND FULL HEIGHT.
- SHALL RECEIVE SAME FINISHES AS ADJACENT SPACE.
- RESILIENT FLOORING TO EPOXY FLOORING TRANSITION (TRS-1).
- RESILIENT FLOORING TO RESILIENT FLOORING TRANSITION (TRS-2).
- RESILIENT FLOORING TO CARPET TRANSITION (TRS-4).
- RESILIENT FLOORING TO RESILIENT FLOORING TRANSITION (TRS-5).
- RESILIENT FLOORING TO CARPET TRANSITION (TRS-6).
- ALL WALLS RECEIVING HIGH IMPACT WALL COVERING SHALL RECEIVE LEVEL 5 FINISH.

ALL LVT MATERIAL SHALL BE OWNER  
FURNISHED / CONTRACTOR INSTALLED

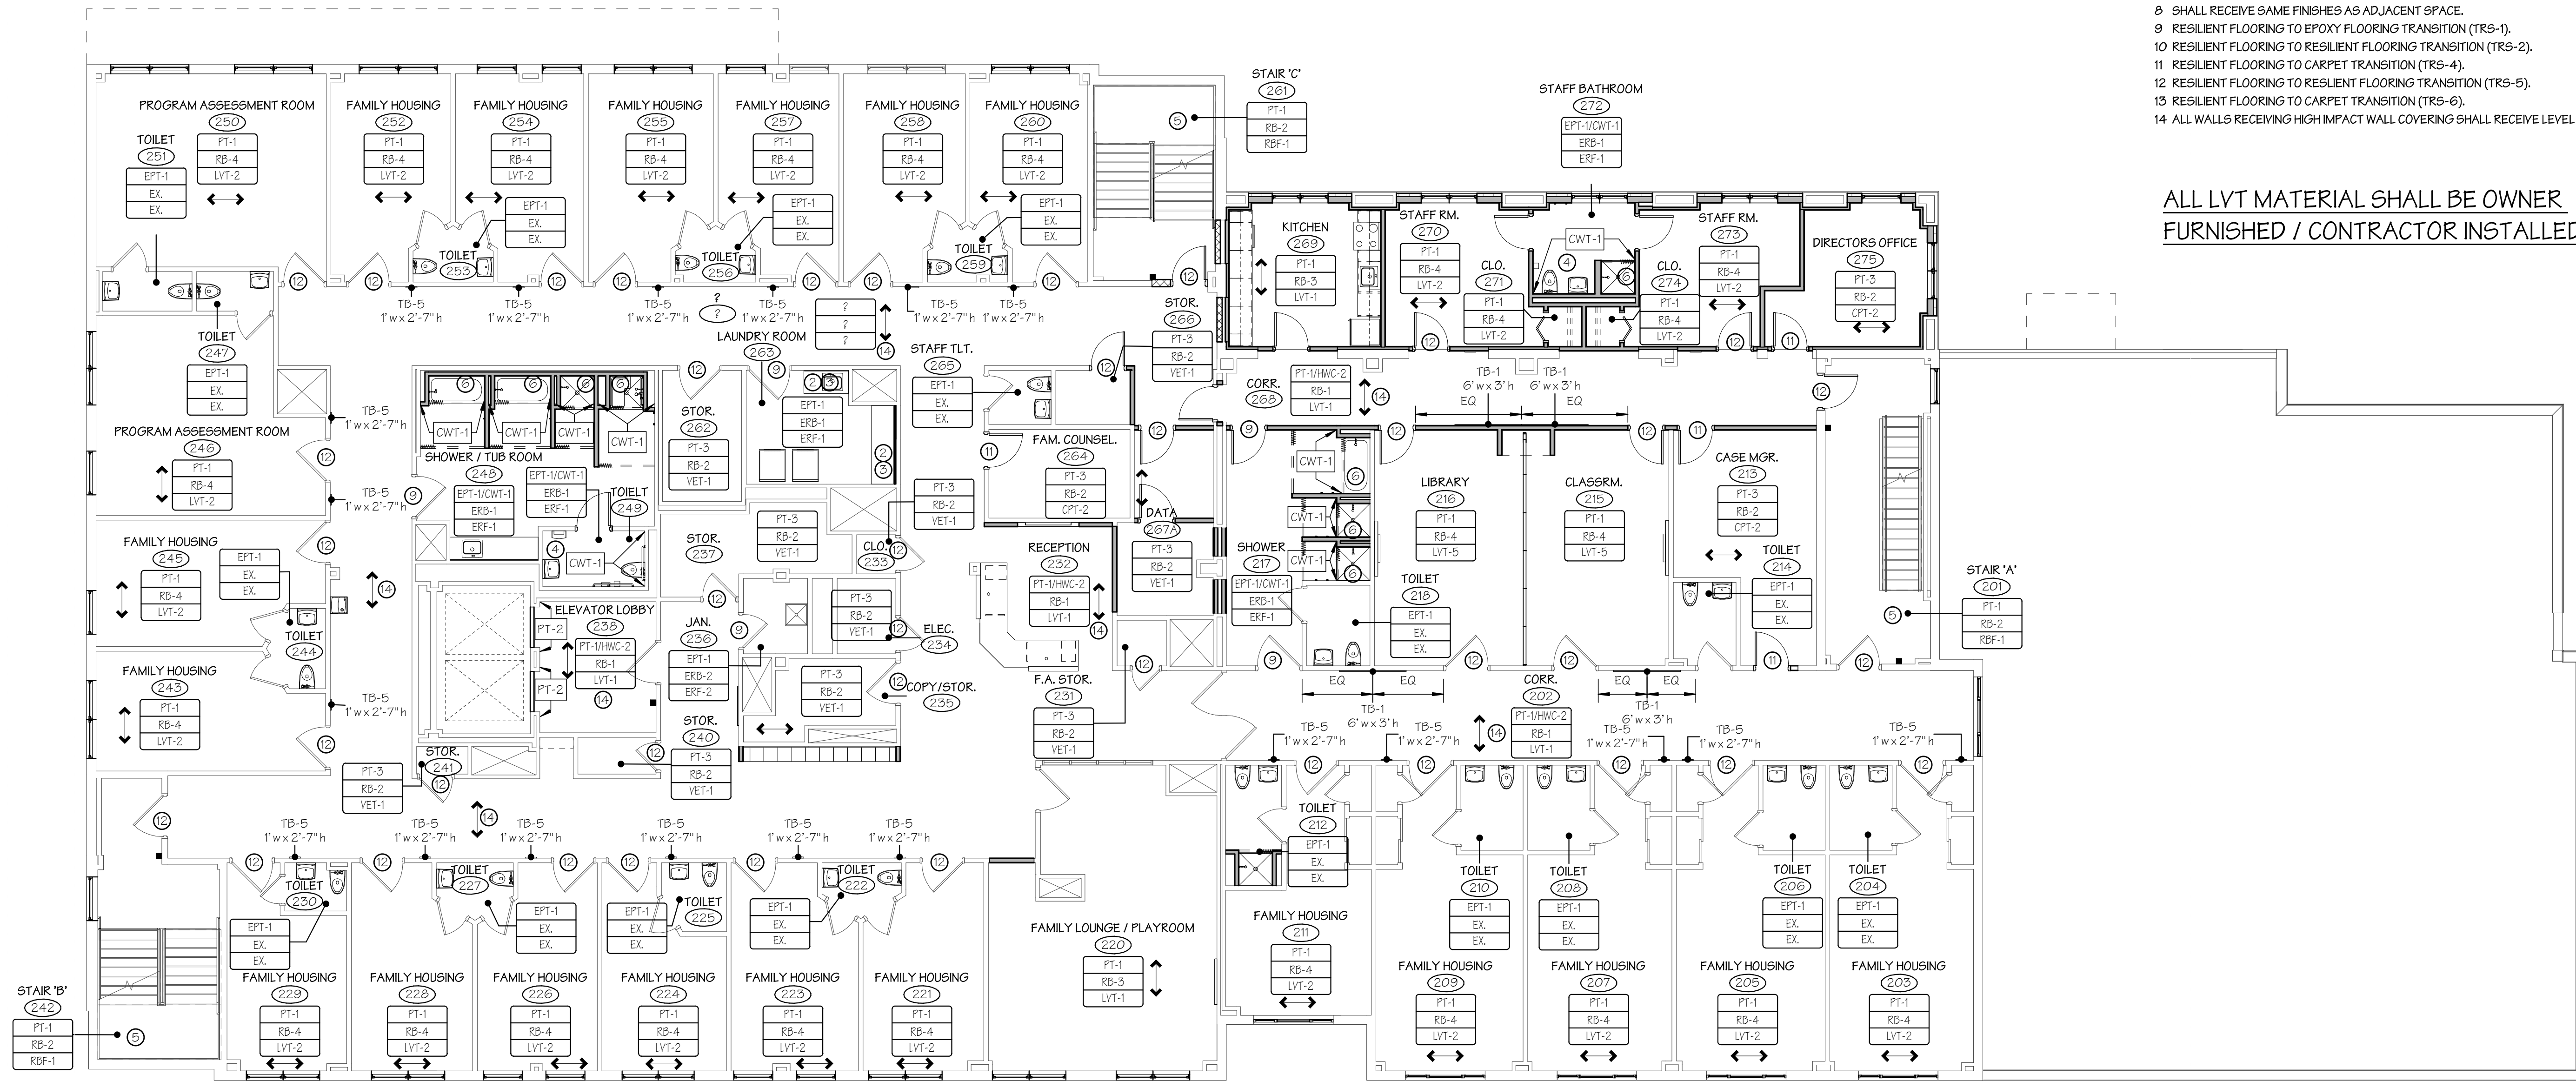

SECOND FLOOR FINISH & SIGNAGE PLAN  
SCALE: 1/8" = 1'-0"



2/27/2020 1:08:13 PM C:\Users\rosenthan\OneDrive\Documents\18052\_Bridgeport Rescue Mission\_Phase 2\_Architecture\_rosehan.rvt



ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

GENERAL FINISH NOTES


- A. FINISH FLOOR PLANS SHALL BE USED IN CONJUNCTION WITH INTERIOR ELEVATIONS AND DETAILS. SHOULD THERE BE A DISCREPANCY BETWEEN INFORMATION GIVEN CONTRACTOR SHALL CONTACT ARCHITECT FOR CLARIFICATION.
- B. EXISTING FINISHES SHALL REMAIN AT ALL LOCATIONS WHERE FINISH TAG CALLS OUT FOR (EX).
- C. PAINTING SCHEDULE: ALL PAINTING SHALL BE AS INDICATED BY PLAN, NOTES, AND FINISH SCHEDULE.
  - a. WALLS, GYP. BD. SURFACES AND OTHER PAINTED SURFACES (EGGSHELL FINISH)
    - ONE (1) PRIME COAT & TWO (2) FINISH COATS
  - b. DOOR FRAMES (SEMI-GLOSS)
    - ONE (1) PRIME COAT & TWO (2) FINISH COATS (U.O.N.)
  - c. GYP. BD. CEILINGS (FLAT FINISH)
    - ONE (1) PRIME COAT & TWO (2) FINISH COATS (U.O.N.)
- D. ALL TRANSITIONS IN FLOORING TO OCCUR AT CENTERLINE OF DOOR. PROVIDE TRANSITION STRIP WHERE CHANGE IN FLOOR MATERIAL OCCURS. TRANSITION FINISH TO MATCH ADJACENT FLOOR COLOR. U.O.N. REFER TO SHEET FI-951.
- E. ALL RUBBER BASE IN AREAS WITH CARPET TO BE 4" HIGH "STRAIGHT" BASE.
- F. ALL RUBBER BASE IN AREAS WITH VCT TO BE 4" HIGH "COVE" BASE.
- G. ALL GYP. BD. WALLS RECEIVING WALL COVERING SHALL RECEIVE LEVEL 5 FINISH.
- H. ALL DOORS NEW SHALL RECEIVE WOOD FINISH (WD-1), U.O.N. REFER TO DOOR SCHEDULE.
- I. ALL NEW & EXISTING HOLLOW METAL DOOR FRAMES SHALL BE PAINTED (PT-1), U.O.N.
- J. ALL OUTLETS, WALL PLATES, & SWITCHES SHALL BE WHITE FINISH.
- K. NO CARPET TILE SHALL BE CUT OR INSTALLED LESS THAN 4".
- L. ALL WINDOWS SHALL RECEIVE NEW WINDOW SHADES (WT-1) & FACIAS (U.O.N.)
- M. ALL ROLLER SHADE PANELS TO RUN FROM CENTER LINE OF MULLION TO CENTER LINE OF MULLION & TO BE SIZED TO FIT AT LOCATIONS ADJACENT PARTITIONS AND/OR COLUMN ENCLOSURES. ALL EXTERIOR WINDOWS AND INTERIOR STOREFRONT SYSTEMS SCHEDULED FOR ROLLER SHADES TO BE FIELD VERIFIED BEFORE ORDER PLACEMENT.

FINISH NOTES

- 1. EXISTING FINISHES SHALL REMAIN.
- 2. REPLACE DAMAGED COUNTERTOP WITH (PL-1). EXISTING BASE AND UPPER CABINETS SHALL BE CLEANED, PATCHED AND REPAIRED AS NEEDED.
- 3. ADD NEW PULLS (HD-1) & NEW MATCHING LOCKS TO EXISTING UPPER AND LOWER CABINETS. LOCKS KEYS ALIKE PER ROOM AND MASTER KEYS.
- 4. TILE TO EXTEND FULL HEIGHT OF WET WALL. REFER TO B2/A-601.
- 5. ALL STAIR RAILINGS, HAND RAILS AND EXPOSED STRUCTURE SHALL HAVE EXISTING CHIPPING PAINT REMOVED. ALL RAILINGS, HAND RAILS AND EXPOSED STRUCTURE SHALL BE SANDED AND RE-PAINTED (PT-5).
- 6. TILE SHALL BE APPLIED TO ALL WALLS WITHIN SHOWER AND EXTEND FULL HEIGHT.
- 8. SHALL RECEIVE SAME FINISHES AS ADJACENT SPACE.
- 9. RESILIENT FLOORING TO EPOXY FLOORING TRANSITION (TRS-1).
- 10. RESILIENT FLOORING TO RESILIENT FLOORING TRANSITION (TRS-2).
- 11. RESILIENT FLOORING TO CARPET TRANSITION (TRS-4).
- 12. RESILIENT FLOORING TO RESILIENT FLOORING TRANSITION (TRS-5).
- 13. RESILIENT FLOORING TO CARPET TRANSITION (TRS-6).
- 14. ALL WALLS RECEIVING HIGH IMPACT WALL COVERING SHALL RECEIVE LEVEL 5 FINISH.

ALL LVT MATERIAL SHALL BE OWNER  
FURNISHED / CONTRACTOR INSTALLED

**BASE BID - ADD ALLOWANCE  
FOR MATERIAL COST. TYP FOR  
LVT FLOORING PER OWNER'S  
04.07.2020 EMAIL**

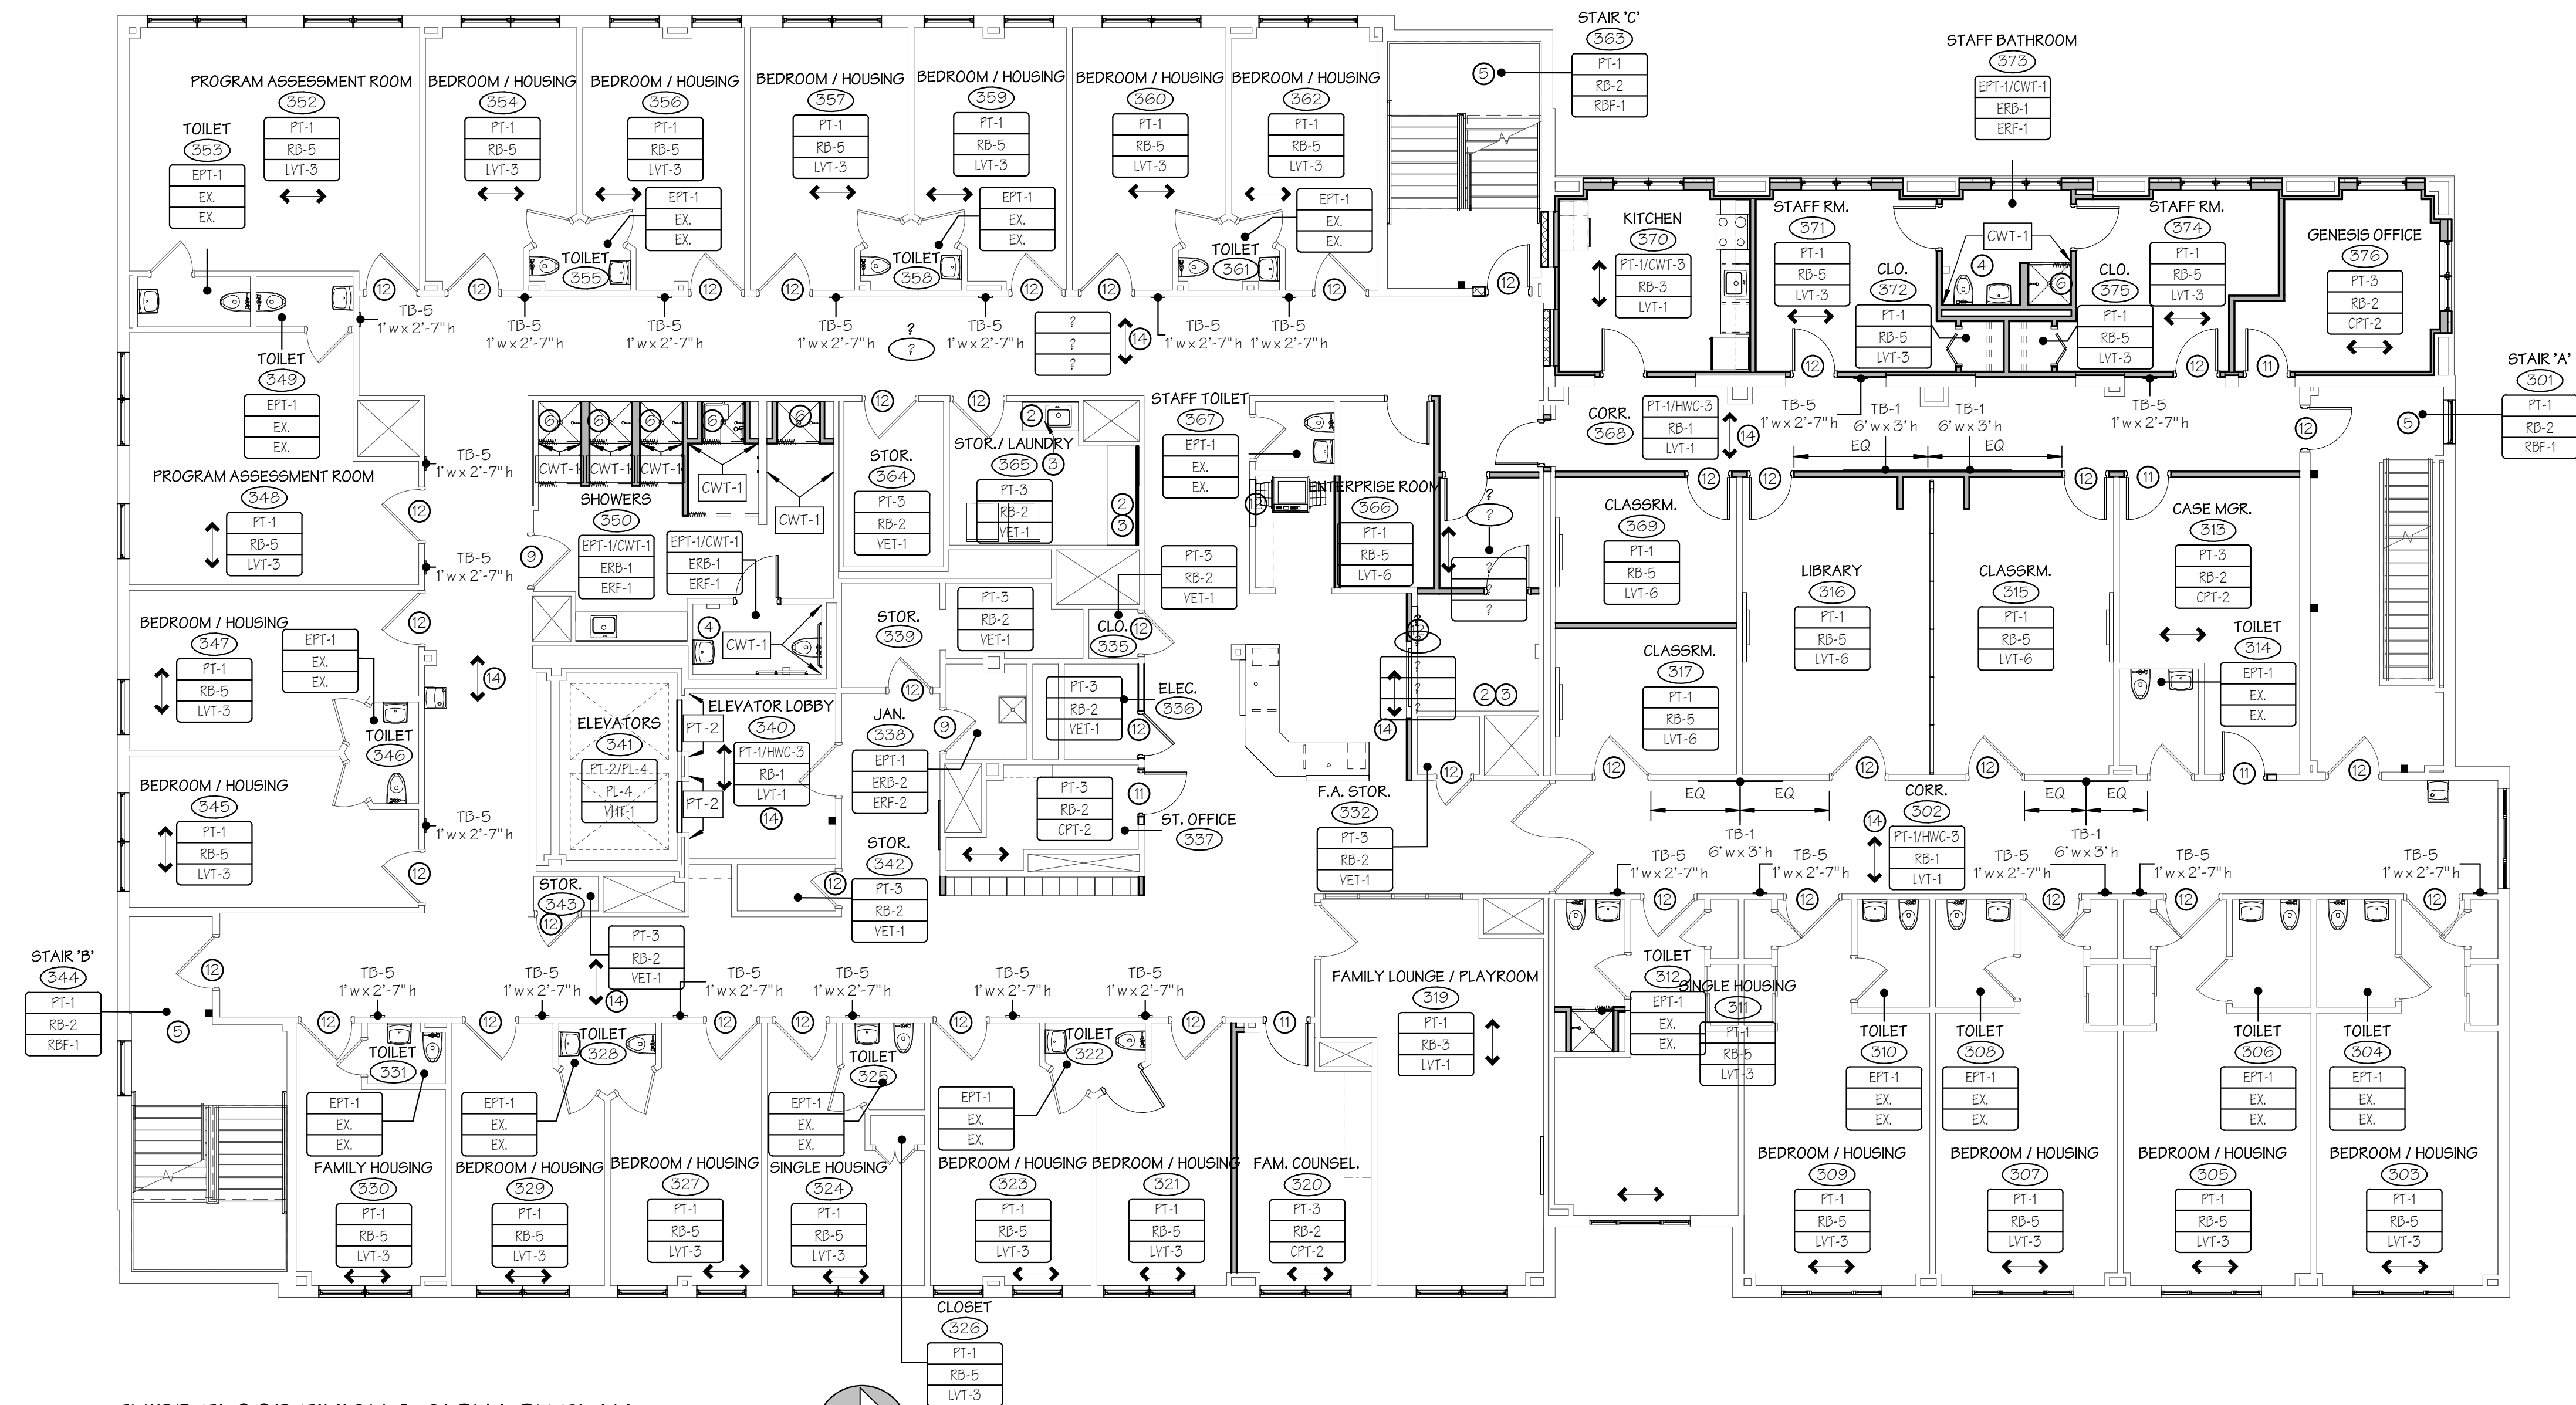

THIRD FLOOR FINISH & SIGNAGE PLAN  
SCALE: 1/8" = 1'-0"



COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:  
**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
**04.16.2020 - CM BID**

REVISIONS		
NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

**JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION**  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
THIRD FLOOR FINISH & SIGNAGE  
PLAN

SCALE: As indicated  
DRAWN BY: BMD  
REVIEWED BY: DCF


DRAWING NO.

**FI-103**  
04.16.2020 - CM BID

DATE: 31 JANUARY 2020  
JOB NUMBER: 18052

2/27/2020 1:08:18 PM  
C:\Users\rosenthan\OneDrive\Documents\18052\_Bridgeport\_Rescue Mission\_Phase 2\_Architecture\_rosehan.rvt

2/27/2020 1:08:24 PM  
C:\Users\rosentha\OneDrive\Documents\Bridgport Rescue Mission\_Phase 2\_Architecture\_rose.mxd

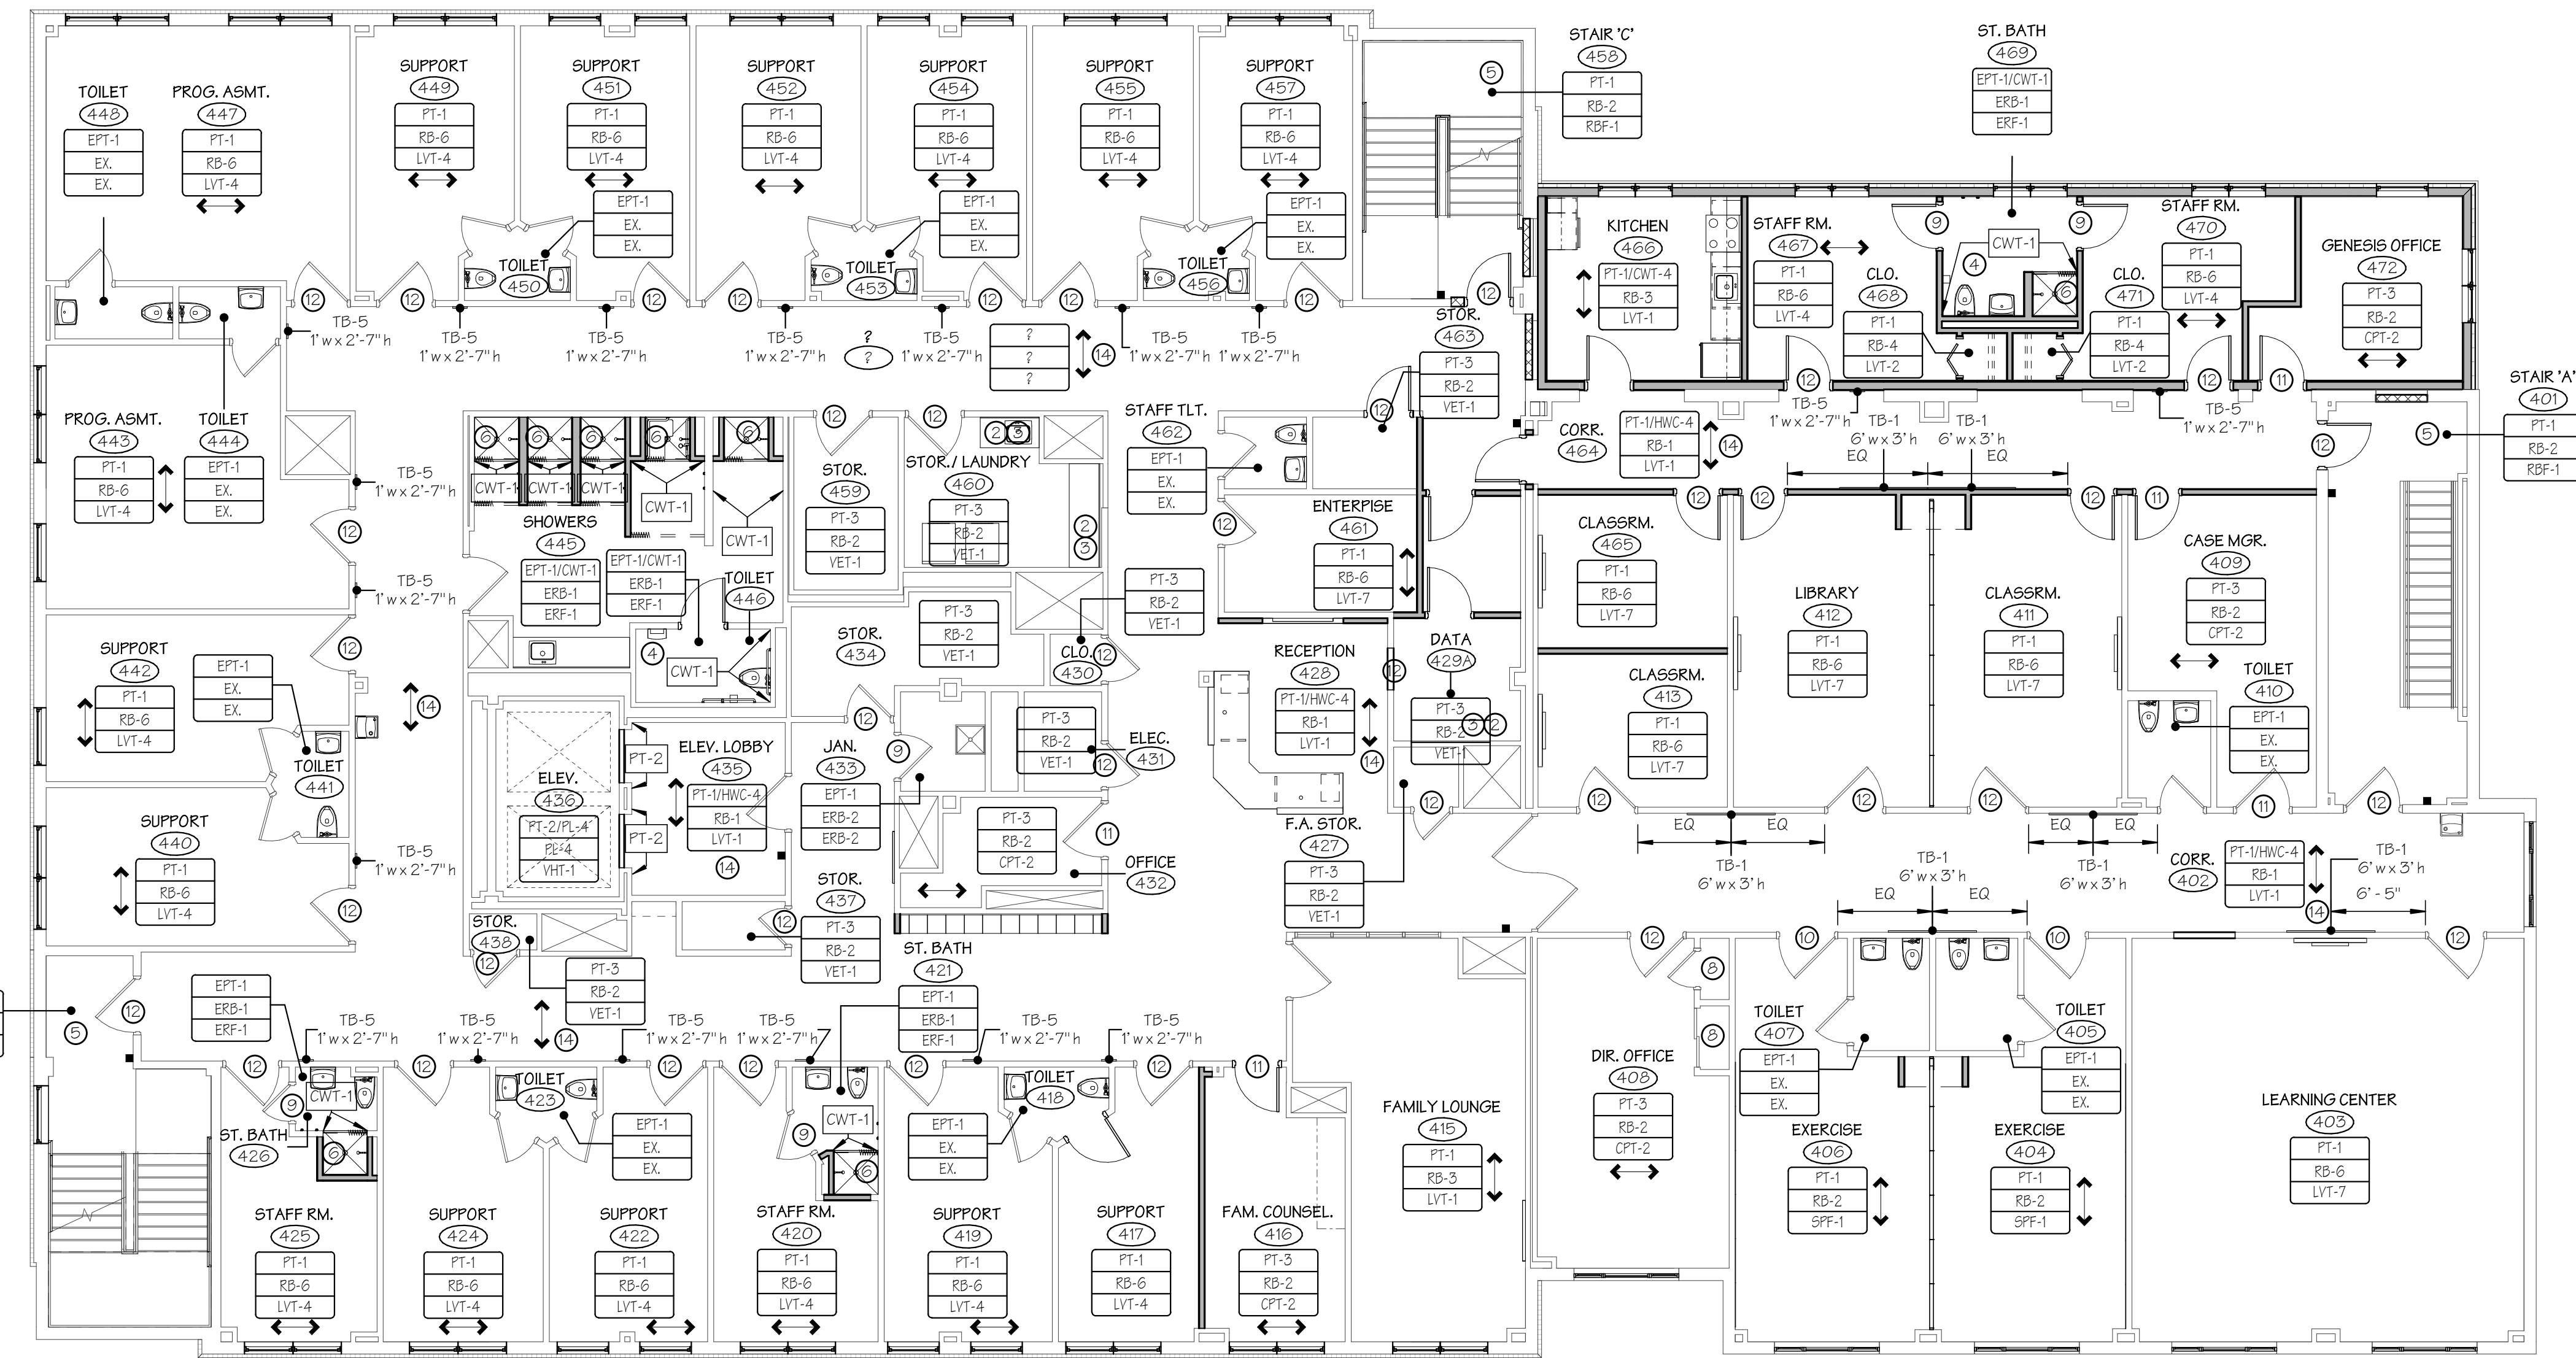

FOURTH FLOOR FINISH & SIGNAGE PLAN

SCALE: 1/8" = 1'-0"



PROJECT NORTH

GENERAL FINISH NOTES

- A. FINISH FLOOR PLANS SHALL BE USED IN CONJUNCTION WITH INTERIOR ELEVATIONS AND DETAILS. SHOULD THERE BE A DISCREPANCY BETWEEN INFORMATION GIVEN CONTRACTOR SHALL CONTACT ARCHITECT FOR CLARIFICATION.
- B. EXISTING FINISHES SHALL REMAIN AT ALL LOCATIONS WHERE FINISH TAG CALLS OUT FOR (EX).
- C. PAINTING SCHEDULE: ALL PAINTING SHALL BE AS INDICATED BY PLAN, NOTES, AND FINISH SCHEDULE.
  - a. WALLS, GYP. BD. SURFACES AND OTHER PAINTED SURFACES (EGG-SHELL FINISH)
    - ONE (1) PRIME COAT & TWO (2) FINISH COATS
  - b. DOOR FRAMES (SEMI-GLOSS)
    - ONE (1) PRIME COAT & TWO (2) FINISH COATS (U.O.N.)
  - c. GYP. BD. CEILING (FLAT FINISH)
    - ONE (1) PRIME COAT & TWO (2) FINISH COATS (U.O.N.)
- D. ALL TRANSITIONS IN FLOORING TO OCCUR AT CENTERLINE OF DOOR. PROVIDE TRANSITION STRIP WHERE CHANGE IN FLOOR MATERIAL OCCURS. TRANSITION FINISH TO MATCH ADJACENT FLOOR COLOR, U.O.N. REFER TO SHEET FI-951.
- E. ALL RUBBER BASE IN AREAS WITH CARPET TO BE 4" HIGH "STRAIGHT" BASE.
- F. ALL RUBBER BASE IN AREAS WITH LVT TO BE 4" HIGH "COVER" BASE.
- G. ALL GYP. BD. WALLS RECEIVING WALL COVERINGS SHALL RECEIVE LEVEL 5 FINISH.
- H. ALL DOORS NEW SHALL RECEIVE WOOD FINISH (WD-1), U.O.N. REFER TO DOOR SCHEDULE.
- I. ALL NEW & EXISTING HOLLOW METAL DOOR FRAMES SHALL BE PAINTED (PT-1), U.O.N.
- J. ALL OUTLETS, WALL PLATES, & SWITCHES SHALL BE WHITE FINISH.
- K. NO CARPET TILE SHALL BE CUT OR INSTALLED LESS THAN 4".
- L. ALL WINDOWS SHALL RECEIVE NEW WINDOW SHADES (WT-1) & FACIAS (U.O.N.)
- M. ALL ROLLER SHADE PANELS TO RUN FROM CENTER LINE OF MULLION TO CENTER LINE OF MULLION & TO BE SIZED TO FIT AT LOCATIONS ADJACENT PARTITIONS AND/OR COLUMN ENCLOSURES. ALL EXTERIOR WINDOWS AND INTERIOR STOREFRONT SYSTEMS SCHEDULED FOR ROLLER SHADES TO BE FIELD VERIFIED BEFORE ORDER PLACEMENT.

FINISH NOTES

- 1. EXISTING FINISHES SHALL REMAIN.
- 2. REPLACE DAMAGED COUNTERTOP WITH (PL-1). EXISTING BASE AND UPPER CABINETS SHALL BE CLEANED, PATCHED AND REPAIRED AS NEEDED.
- 3. ADD NEW PULLS (HP-1) & NEW MATCHING LOCKS TO EXISTING UPPER AND LOWER CABINETS. LOCKS KEYED ALIKE PER ROOM AND MASTER KEYED.
- 4. TILE TO EXTEND FULL HEIGHT OF WET WALL. REFER TO B2/A-601.
- 5. ALL STAIR RAILINGS, HAND RAILS AND EXPOSED STRUCTURE SHALL HAVE EXISTING CHIPPING PAINT REMOVED. ALL RAILINGS, HAND RAILS AND EXPOSED STRUCTURE SHALL BE SANDED AND RE-PAINTED (PT-5).
- 6. TILE SHALL BE APPLIED TO ALL WALLS WITHIN SHOWER AND EXTEND FULL HEIGHT.
- 8. SHALL RECEIVE SAME FINISHES AS ADJACENT SPACE.
- 9. RESILIENT FLOORING TO EPOXY FLOORING TRANSITION (TRS-1).
- 10. RESILIENT FLOORING TO RESILIENT FLOORING TRANSITION (TRS-2).
- 11. RESILIENT FLOORING TO CARPET TRANSITION (TRS-4).
- 12. RESILIENT FLOORING TO RESILIENT FLOORING TRANSITION (TRS-5).
- 13. RESILIENT FLOORING TO CARPET TRANSITION (TRS-6).
- 14. ALL WALLS RECEIVING HIGH IMPACT WALL COVERING SHALL RECEIVE LEVEL 5 FINISH.

ALL LVT MATERIAL SHALL BE OWNER  
FURNISHED / CONTRACTOR INSTALLED

BASE BID - ADD ALLOWANCE  
FOR MATERIAL COST. TYP FOR  
LVT FLOORING PER OWNER'S  
04.07.2020 EMAIL



ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:

BID SET  
31 JANUARY 2020  
FOR CONSTRUCTION  
04.16.2020 - CM BID

REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
FOURTH FLOOR FINISH & SIGNAGE  
PLAN

SCALE: As indicated  
DRAWN BY: BMD  
REVIEWED BY: DCF

DRAWING NO.

FI-104

04.16.2020 - CM BID

DATE: 31 JANUARY 2020  
JOB NUMBER: 18052



ANTINOZZI ASSOCIATES

ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:

**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
**04.16.2020 - CM BID**

REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
FIFTH FLOOR FINISH PLAN

SCALE: As indicated  
DRAWN BY: BMD  
REVIEWED BY: DCF

DRAWING NO.:

**FI-105**

04.16.2020 - CM BID

DATE: 31 JANUARY 2020  
JOB NUMBER: 18052

GENERAL FINISH NOTES


- A. FINISH FLOOR PLANS SHALL BE USED IN CONJUNCTION WITH INTERIOR ELEVATIONS AND DETAILS. SHOULD THERE BE A DISCREPANCY BETWEEN INFORMATION GIVEN CONTRACTOR SHALL CONTACT ARCHITECT FOR CLARIFICATION.
- B. EXISTING FINISHES SHALL REMAIN AT ALL LOCATIONS WHERE FINISH TAG CALLS OUT FOR (EX).
- C. PAINTING SCHEDULE: ALL PAINTING SHALL BE AS INDICATED BY PLAN, NOTES, AND FINISH SCHEDULE.
  - a. WALLS, GYP. BD. SURFACES AND OTHER PAINTED SURFACES (EGGSHELL FINISH)
    - ONE (1) PRIME COAT & TWO (2) FINISH COATS
  - b. DOOR FRAMES (SEMI-GLOSS)
    - ONE (1) PRIME COAT & TWO (2) FINISH COATS (U.O.N.)
  - c. GYP. BD. CEILINGS (FLAT FINISH)
    - ONE (1) PRIME COAT & TWO (2) FINISH COATS (U.O.N.)
- D. ALL TRANSITIONS IN FLOORING TO OCCUR AT CENTERLINE OF DOOR. PROVIDE TRANSITION STRIP WHERE CHANGE IN FLOOR MATERIAL OCCURS. TRANSITION FINISH TO MATCH ADJACENT FLOOR COLOR, U.O.N. REFER TO SHEET FI-951.
- E. ALL RUBBER BASE IN AREAS WITH CARPET TO BE 4" HIGH "STRAIGHT" BASE.
- F. ALL RUBBER BASE IN AREAS WITH VCT TO BE 4" HIGH "COVE" BASE.
- G. ALL GYP. BD. WALLS RECEIVING WALL COVERING SHALL RECEIVE LEVEL 5 FINISH.
- H. ALL DOORS NEW SHALL RECEIVE WOOD FINISH (WD-1), U.O.N. REFER TO DOOR SCHEDULE.
- I. ALL NEW & EXISTING HOLLOW METAL DOOR FRAMES SHALL BE PAINTED (PT-1), U.O.N.
- J. ALL OUTLETS, WALL PLATES, & SWITCHES SHALL BE WHITE FINISH.
- K. NO CARPET TILE SHALL BE CUT OR INSTALLED LESS THAN 4".
- L. ALL WINDOWS SHALL RECEIVE NEW WINDOW SHADES (WT-1) & FACIAS (U.O.N.)
- M. ALL ROLLER SHADE PANELS TO RUN FROM CENTER LINE OF MULLION TO CENTER LINE OF MULLION & TO BE SIZED TO FIT AT LOCATIONS ADJACENT PARTITIONS AND/OR COLUMN ENCLOSURES. ALL EXTERIOR WINDOWS AND INTERIOR STOREFRONT SYSTEMS SCHEDULED FOR ROLLER SHADES TO BE FIELD VERIFIED BEFORE ORDER PLACEMENT.

FINISH NOTES

- 1 EXISTING FINISHES SHALL REMAIN.
- 2 REPLACE DAMAGED COUNTERTOP WITH (PL-1). EXISTING BASE AND UPPER CABINETS SHALL BE CLEANED, PATCHED AND REPAIRED AS NEEDED.
- 3 ADD NEW PULLS (HD-1) & NEW MATCHING LOCKS TO EXISTING UPPER AND LOWER CABINETS. LOCKS KEYED ALIKE PER ROOM AND MASTER KEYED.
- 4 TILE TO EXTEND FULL HEIGHT OF WET WALL. REFER TO B2/A-601.
- 5 ALL STAIR RAILINGS, HAND RAILS AND EXPOSED STRUCTURE SHALL HAVE EXISTING CHIPPING PAINT REMOVED. ALL RAILINGS, HAND RAILS AND EXPOSED STRUCTURE SHALL BE SANDED AND RE-PAINTED (PT-5).
- 6 TILE SHALL BE APPLIED TO ALL WALLS WITHIN SHOWER AND EXTEND FULL HEIGHT.
- 8 SHALL RECEIVE SAME FINISHES AS ADJACENT SPACE.
- 9 RESILIENT FLOORING TO EPOXY FLOORING TRANSITION (TRS-1).
- 10 RESILIENT FLOORING TO RESILIENT FLOORING TRANSITION (TRS-2).
- 11 RESILIENT FLOORING TO CARPET TRANSITION (TRS-4).
- 12 RESILIENT FLOORING TO RESILIENT FLOORING TRANSITION (TRS-5).
- 13 RESILIENT FLOORING TO CARPET TRANSITION (TRS-6).
- 14 ALL WALLS RECEIVING HIGH IMPACT WALL COVERING SHALL RECEIVE LEVEL 5 FINISH.


**ALL LVT MATERIAL SHALL BE OWNER  
FURNISHED / CONTRACTOR INSTALLED**

**BASE BID - ADD ALLOWANCE  
FOR MATERIAL COST. TYP FOR  
LVT FLOORING PER OWNER'S  
04.07.2020 EMAIL**

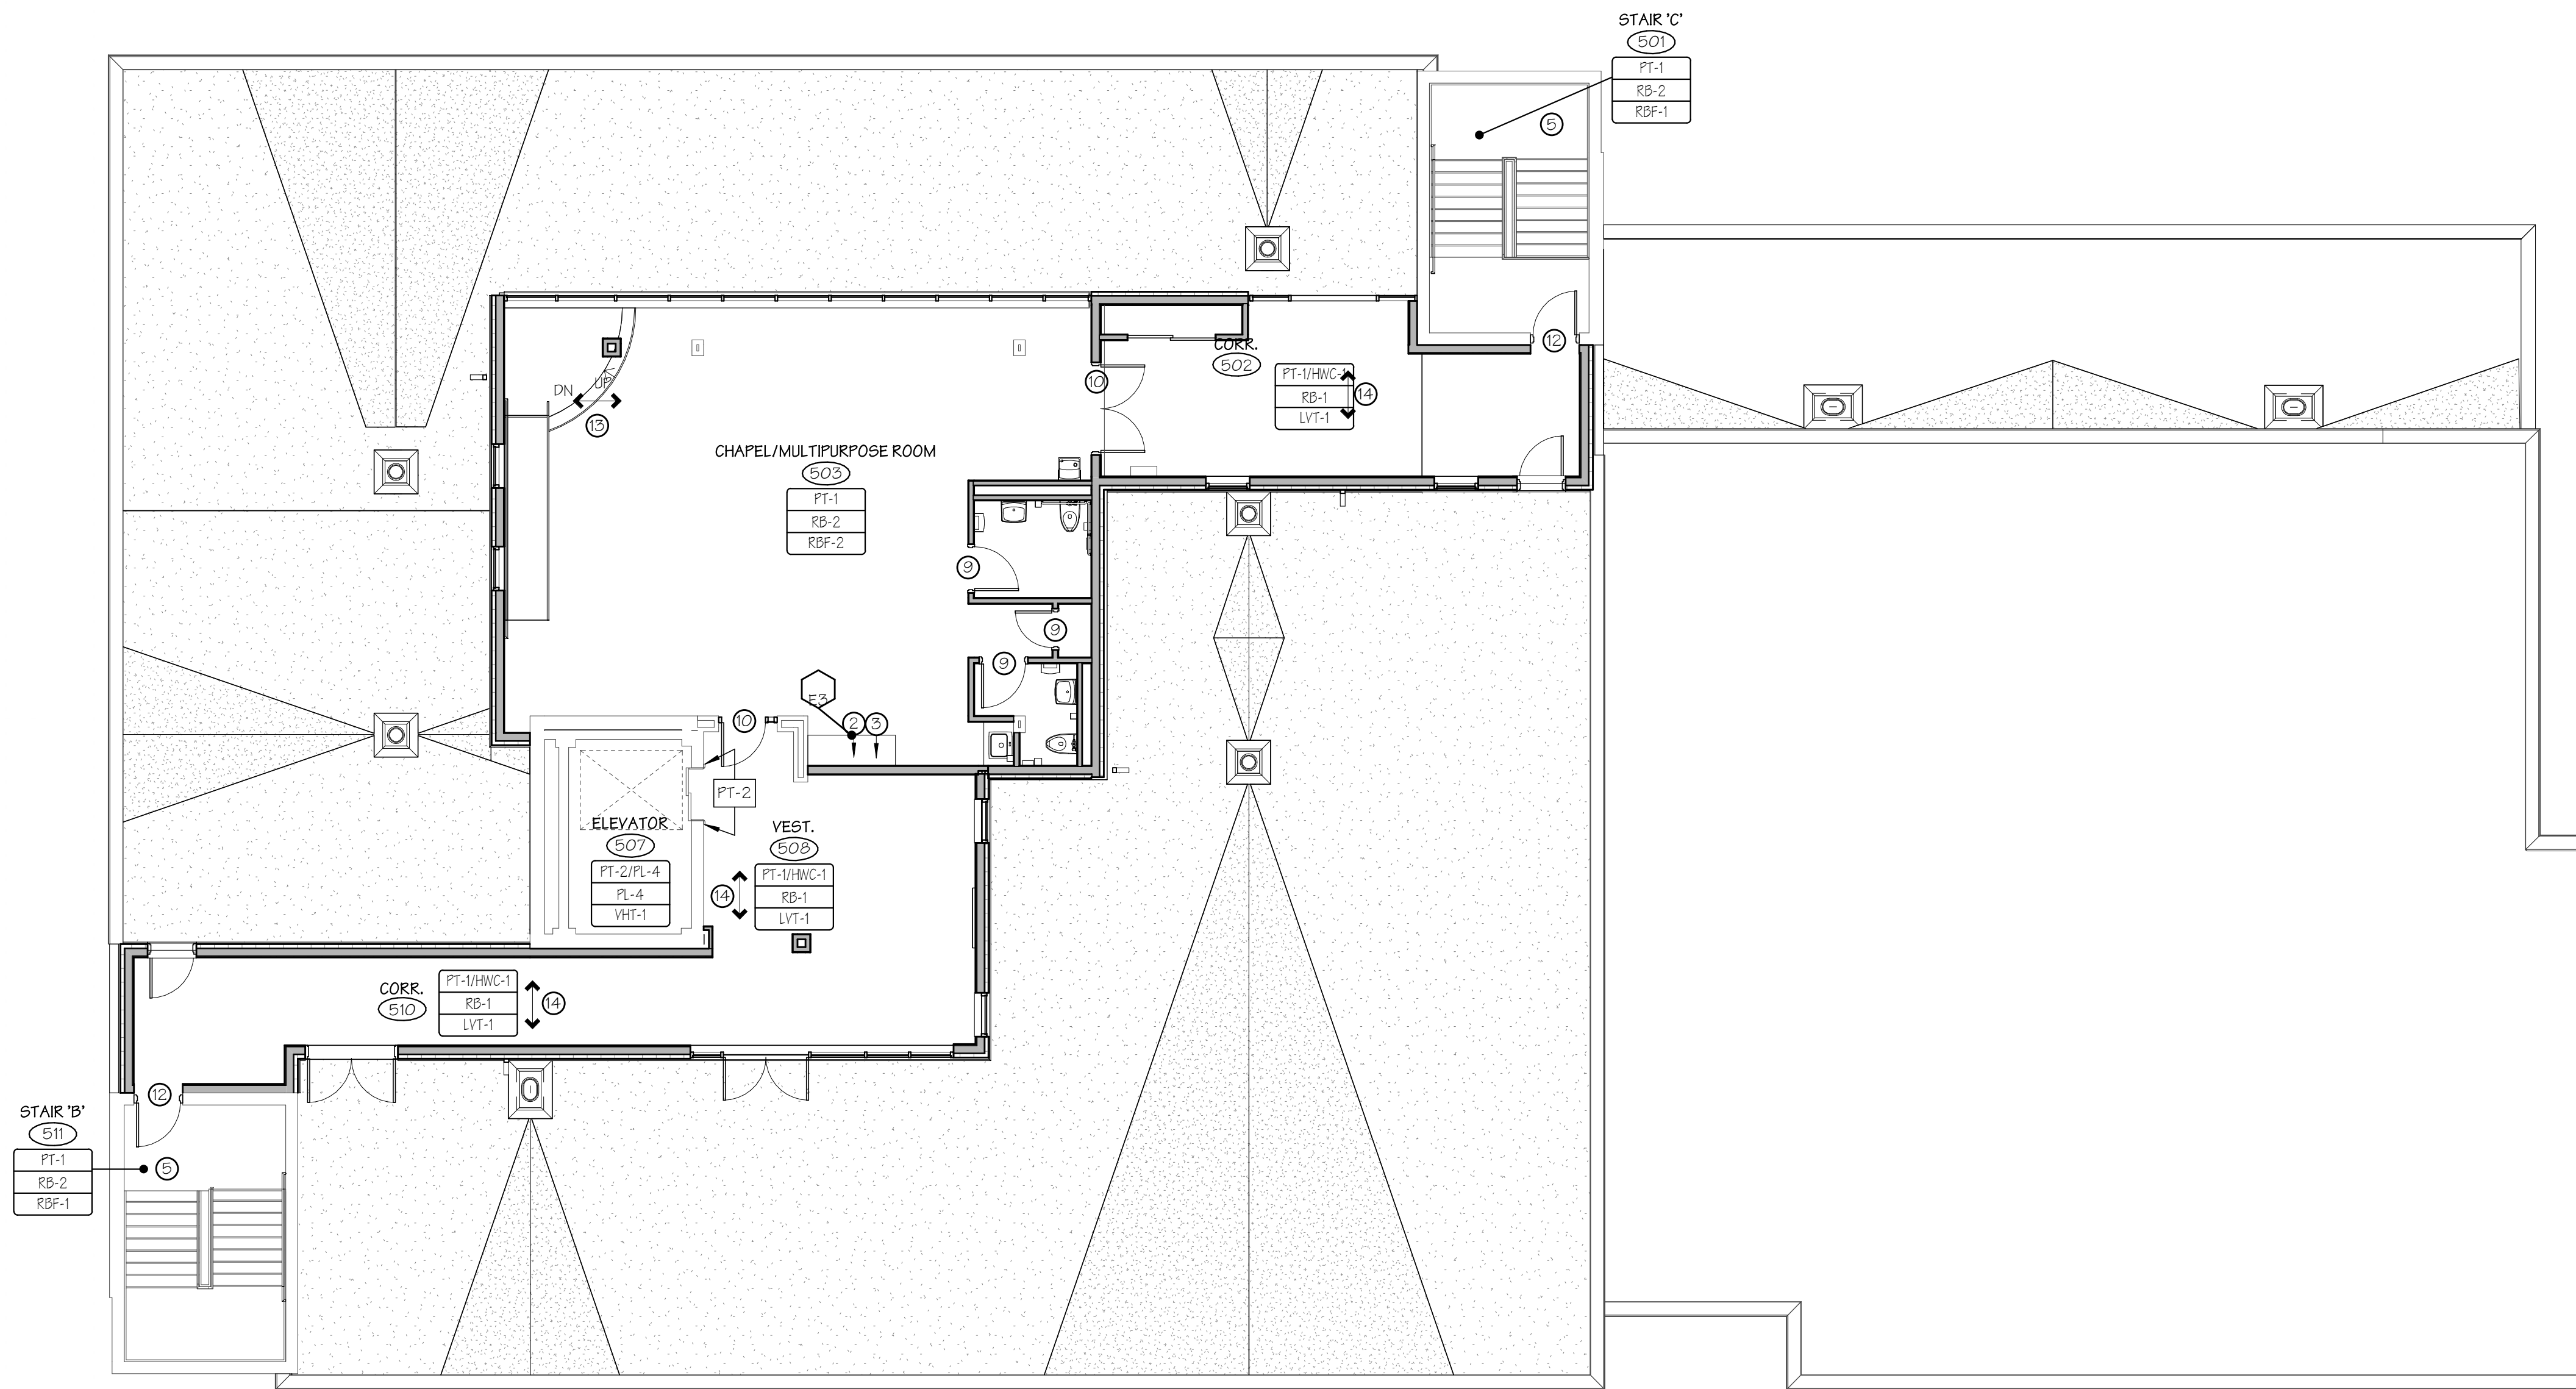

FIFTH FLOOR FINISH PLAN

SCALE: 1/8" = 1'-0"



PROJECT NORTH

CARPET

CPT-1 MANUF: PATCRAFT COLLECTION: ARTEFACT STYLE NAME: FATINA #10511 COLOR: RENEWED ELEMENT #00500

CPT-2 MANUF: PATCRAFT COLLECTION: ARTEFACT STYLE NAME: RELIC #10513 COLOR: RENEWED ELEMENT #00500

CERAMIC WALL TILE

CWT-1 MANUF: DAL TILE STYLE NAME: COLOR WHEEL COLLECTION COLOR: ARTIC WHITE #0790 FINISH: MATTE

CWT-2 MANUF: GARDEN STATE TILE STYLE NAME: ARKSTONE MARZO COLOR: MAY AZURE #512006

CWT-3 MANUF: GARDEN STATE TILE STYLE NAME: ARKSTONE MARZO COLOR: MAY WHITE #512001

CWT-4 MANUF: GARDEN STATE TILE STYLE NAME: MARZO COLOR: MAY BEIGE #512002

CHAIR RAIL

CR-1 MANUF: KOROSEAL COLLECTION: CHAIR RAILS MODEL: CR20 COLOR: TBD

CORNER GUARD

CG-1 MANUF: KOROSEAL COLLECTION: KOROGARD CORNER GUARDS MODEL: G815 COLOR: TBD

CG-2 MANUF: KOROSEAL COLLECTION: KOROGARD CORNER GUARDS MODEL: G875 COLOR: CLEAR

CEILING

CLG-A MANUF: ROCKFON STYLE NAME: TROPIC STYLE NUMBER: #1020 COLOR: WHITE

CLG-B MANUF: ROCKFON STYLE NAME: ARTIC STYLE NUMBER: #620 COLOR: WHITE

CLG-C MANUF: ROCKFON STYLE NAME: HYGENIC PLUS STYLE NUMBER: #31100 COLOR: WHITE

CLG-D MANUF: ROCKFON STYLE NAME: SONAR STYLE NUMBER: #16200 COLOR: WHITE

EPOXY PAINT

EPT-1 MANUF: SHERWIN WILLIAMS COLOR: IBIS WHITE #5W7000 AREAS: REST ROOMS, SHOWER & TUB ROOMS,

EPOXY RESIN BASE

ERB-1 MANUF: DUR-A-FLEX STYLE: HYBRI-FLEX EC COLOR: FEWTER SIZE: 6" INTEGRAL BASE

ERB-2 MANUF: DUR-A-FLEX STYLE: POLY-CRETE MDB COLOR: LIGHT GREY SIZE: 6" INTEGRAL BASE

EPOXY RESIN FLOORING

ERF-1 MANUF: DUR-A-FLEX STYLE: HYBRI-FLEX EC COLOR: FEWTER SIZE: 6" INTEGRAL BASE

ERF-2 MANUF: DUR-A-FLEX STYLE: POLY-CRETE MDB COLOR: LIGHT GREY SIZE: 6" INTEGRAL BASE

GROMMET

GR-1 MANUF: DOUG MOCKETT STYLE: POP-UP POWER GROMMET (2 POWER, 1 DUAL USB CHARGER)

GR-2 MANUF: DOUG MOCKETT STYLE: 2" FLIP TOP GROMMET SET MODEL NUMBER: X65

HARDWARE (MILLWORK)

HD-1 MANUF: DOUG MOCKETT STYLE: #DP157-566-4-23/32" ANGLED DRAWER PULL

HIGH IMPACT WALLCOVERING

NOTE: ALL WALLS RECEIVING HIGH IMPACT WALLCOVERING SHALL BE LEVEL 5 FINISH. ALL SEAMS SHALL HAVE KOROSEAL INTERIOR PRODUCTS W/ ALUM DIVIDER BAR IN COLOR TO MATCH ADJACENT WALLCOVERING.

HWC-1 MANUF: KOROSEAL COLLECTION: KOROGARD WALL PROTECTION SYSTEMS STYLE: TRAFFIC PATTERNS

HWC-2 MANUF: KOROSEAL COLLECTION: KOROGARD WALL PROTECTION SYSTEMS STYLE: TRAFFIC PATTERNS

HWC-3 MANUF: KOROSEAL COLLECTION: KOROGARD WALL PROTECTION SYSTEMS STYLE: TRAFFIC PATTERNS

HWC-4 MANUF: KOROSEAL COLLECTION: KOROGARD WALL PROTECTION SYSTEMS STYLE: TRAFFIC PATTERNS

LOCKERS

L-1 MANUF: Penco STYLE: VARIES - SEE LOCKER SCHEDULE ACCESSORIES: CONTINUOUS SLOPE HOOD, ZEE BASE

LUXURY VINYL TILE

LVT-1 MANUF: SHAW CONTRACT COLLECTION: SOLITUDE #D0648V COLOR: MINK #48720

LVT-2 MANUF: MANNINGTON COLLECTION: PRIMARY ELEMENTS; STRUCTURE COLOR: IRON PE140

LVT-3 MANUF: MANNINGTON COLLECTION: PRIMARY ELEMENTS; STRUCTURE COLOR: CRYSTAL PE13B

LVT-4 MANUF: MANNINGTON COLLECTION: PRIMARY ELEMENTS; STRUCTURE COLOR: HELIOS PE133

LVT-5 MANUF: MANNINGTON COLLECTION: PRIMARY ELEMENTS; BOND COLOR: IRON PE120

LVT-6 MANUF: MANNINGTON COLLECTION: PRIMARY ELEMENTS; BOND COLOR: CRYSTAL PE11B

LVT-7 MANUF: MANNINGTON COLLECTION: PRIMARY ELEMENTS; BOND COLOR: HELIOS PE113

METAL FINISH

MTL-1 MANUF: CHEMETAL COLOR: DEEP BRONZE ALUMINUM #601

PAINT

PT-1 MANUF: WOLF GORDON COLLECTION: SCUFF MASTER FINISH: SCRUB TROUGH

PT-2 MANUF: WOLF GORDON COLLECTION: ENVIRONMENTAL FINISH: ROLL

PT-3 MANUF: BENJAMIN MOORE COLOR: TBD AREAS: ALL OFFICES, MEETING ROOMS AND STORAGE ROOMS

PT-4 MANUF: WOLF GORDON COLLECTION: SCUFF MASTER FINISH: SCRUB TROUGH

PT-5 MANUF: WOLF GORDON COLLECTION: ENVIRONMENTAL FINISH: BRUSHED

PLASTIC LAMINATE

PL-1 MANUF: WILSONART LAMINATE COLOR: FROSTY WHITE #1573-60

PL-2 MANUF: WILSONART LAMINATE COLOR: GINGER ROOT MAPLE #7288-58

PL-3 MANUF: WILSONART LAMINATE COLOR: CLOUD ZEPHYR #4856-60

PL-4 MANUF: WILSONART LAMINATE COLOR: ALLMASTEEL #6281 (419)

PL-5 MANUF: WILSONART LAMINATE COLOR: INKY INDIGO Y0498-60

PLASTIC LAMINATE CONTINUED

PL-6 MANUF: WILSONART LAMINATE COLOR: ALABASTER #D431-60

PL-7 MANUF: WILSONART LAMINATE COLOR: SLATE GREY D91-60

PORCELAIN FLOOR TILE

PFT-1 MANUF: DAL TILE COLLECTION NAME: REMINISCENT COLOR: SOLVNER GRAY #RM22

PORCELAIN WALL TILE

PWT-1 MANUF: DAL TILE COLLECTION NAME: REMINISCENT COLOR: SOLVNER GRAY #RM22

RUBBER BASE

RB-1 MANUF: JOHNSONITE STYLE: DELNEATE COLOR: TBD

RB-2 MANUF: JOHNSONITE COLOR: SILVER GREY #55

RB-3 MANUF: JOHNSONITE COLOR: SANDAL WOOD #45

RB-4 MANUF: JOHNSONITE COLOR: CHARCOAL #20

RB-5 MANUF: JOHNSONITE COLOR: MACADAMIA #TG5

RB-6 MANUF: JOHNSONITE COLOR: SHORELINE #280

RUBBER FLOORING

RBF-1 MANUF: TAKIRON SERIES: PATHWAYS & STAIR TREADS

LANDINGS: PATHWAYS COLOR: GREY #91

STAIR TREADS & RISERS: RUBBER TREADS WITH INTEGRATED RISER AND PHOTOLUMINESCENT STRIP

RBF-2 MANUF: CENTAUR FLOORING SYSTEM SERIES: TRIPLE THREAT

SEALED CONCRETE

SCF-1 PROVIDE CONCRETE SEALER @ BACK OF HOUSE SPACES & MECHANICAL SPACES AS CALLED OUT ON DRAWINGS.

SPORTS FLOORING

SFF-1 MANUF: JOHNSONITE COLOR: SILVER #TRUMP MULTI-FUNCTIONAL FLOOR TILE

SOLID SURFACE

SSF-1 MANUF: DUPONT STYLE: CORIAN COLOR: ARROWROOT

SSF-2 MANUF: DUPONT STYLE: CORIAN COLOR: FOSFIL

SSF-3 MANUF: DUPONT STYLE: CORIAN COLOR: RICE PAPER

TOILET PARTITIONS

TP-1 MANUF: SCRANTON COLLECTION: HINY HIDERS

TACKBOARD

TB-1 MANUF: AARCO FABRIC: CARNEIGE XOREL, METEOR #6427-765

TB-2 MANUF: AARCO FABRIC: CARNEIGE XOREL, METEOR #6427-765

TB-3 MANUF: AARCO FABRIC: CARNEIGE XOREL, METEOR #6427-765

TB-4 MANUF: AARCO STYLE: VIC CORK COLOR: OYSTER SHELL #2206

TB-5 MANUF: POTTERY BARN COLLECTION: DAILY SYSTEM

TRANSITION STRIP

TRS-1 MANUF: SCHULTER STYLE: RENO-U

TRS-2 MANUF: JOHNSONITE STYLE: CTA-45-K

TRS-3 MANUF: JOHNSONITE STYLE: SSR-45-B

TRS-4 MANUF: JOHNSONITE STYLE: CTA-45-H

TRS-5 MANUF: JOHNSONITE STYLE: CTA-45-N

TRS-6 MANUF: JOHNSONITE STYLE: CTA-55-L

VINYL ENHANCED TILE

VET-1 MANUF: JOHNSONITE COLLECTION: COLOR ESSENCE

VINYL HETEROGENOUS TILE

VHT-1 MANUF: RASKIN COLLECTION: ELEVATIONS INTERWOVEN

VINYL SHEET FLOORING

VSF-1 MANUF: CENTAUR COLLECTION: HALL PASS

WALK OFF MAT

WOM-1 MANUF: VG INCORPORATED COLLECTION: NYLON CONTRACT CARPET ROLLS & TILES

WHITEBOARD

WB-1 MANUF: AARCO STYLE: MULTI-PURPOSE INSTITUTIONAL SERIES

WB-2 MANUF: AARCO STYLE: MULTI-PURPOSE INSTITUTIONAL SERIES

WINDOW TREATMENT

WT-1 MANUF: MECO SYSTEMS PRODUCT: MANUAL MECOSHADE, MECO/5 STANDARD

WT-2 MANUF: MECO SYSTEMS PRODUCT: MANUAL MECOSHADE, MECO/5 DOUBLE

WOOD FINISH

WD-1 MANUF: MASONITE ARCHITECTURAL SPECIES: WHITE MAPLE (PLAIN SLICED)



ANTINOZZI ASSOCIATES ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY: ANTINOZZI ASSOCIATES, P.C. 271 Fairfield Avenue

301 Meritt 7 Norwalk, Connecticut 06851 Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect

CERTIFICATION: BID SET 31 JANUARY 2020 FOR CONSTRUCTION 04.16.2020 - CM BID

Table with 3 columns: NO., DATE, DESCRIPTION. Row 1: 00, 04.16.20, CM BID

JOEL SMILOW CARE CENTER BRIDGEPORT RESCUE MISSION PHASE II: INTERIOR RENOVATIONS & NEW CONSTRUCTION 725 PARK AVENUE BRIDGEPORT, CONNECTICUT

Table with 3 columns: SCALE, DRAWN BY, REVIEWED BY. Row 1: As indicated, BMD, DCF

DRAWING NO. FI-901 04.16.2020 - CM BID DATE: 31 JANUARY 2020 JOB NUMBER: 18052



CERTIFICATION:

**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
04.16.2020 - CM BID

**REVISIONS**

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

**JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT**


DRAWING TITLE:  
FLOOR TRANSITION DETAILS

SCALE: As indicated     DRAWN BY: BMD     REVIEWED BY: DCF


DRAWING NO.:

**FI-951**  
04.16.2020 - CM BID


DATE: 31 JANUARY 2020     JOB NUMBER: 18052

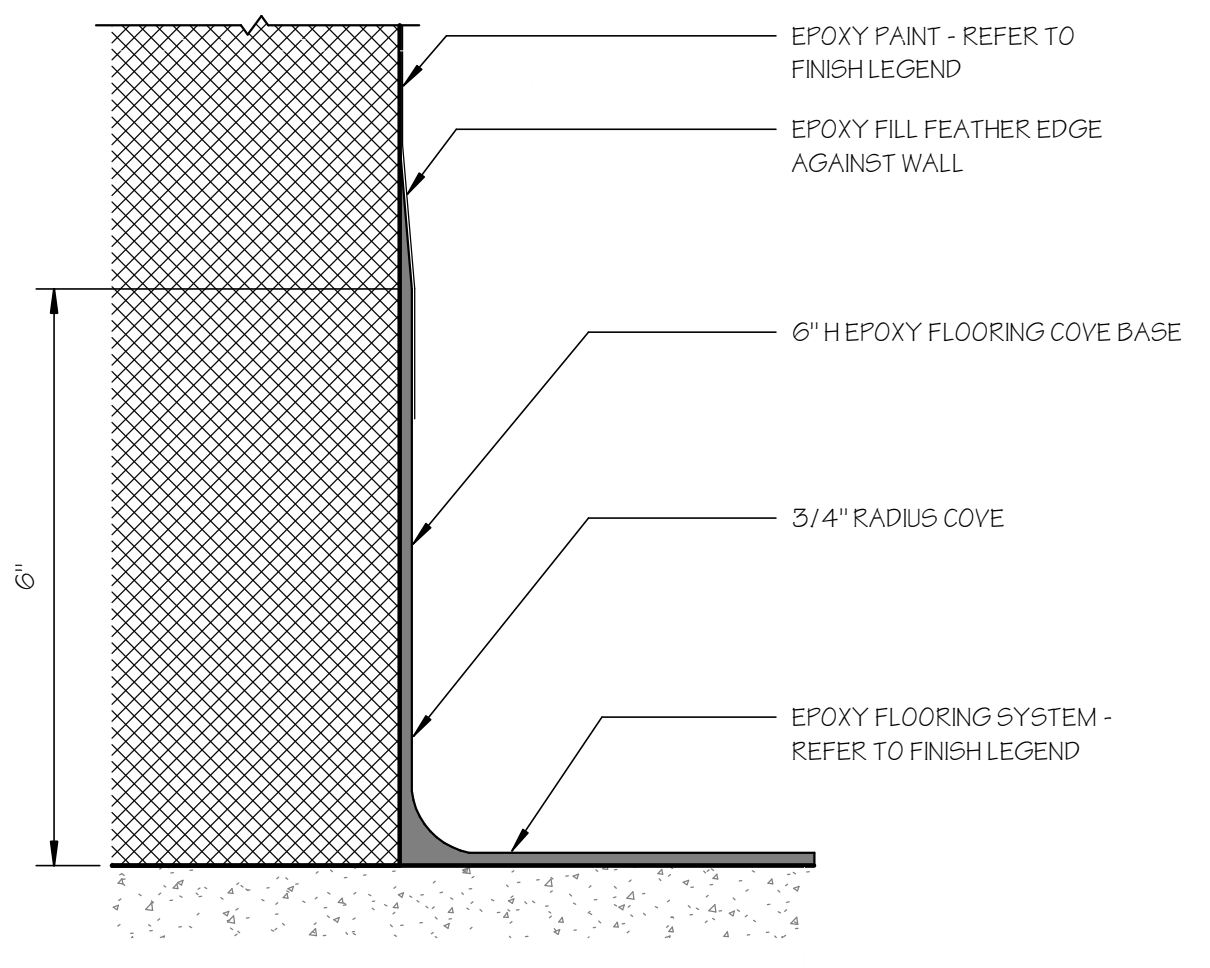


**C1** TYPICAL 6" EPOXY BASE  
SCALE: 6" = 1'-0"

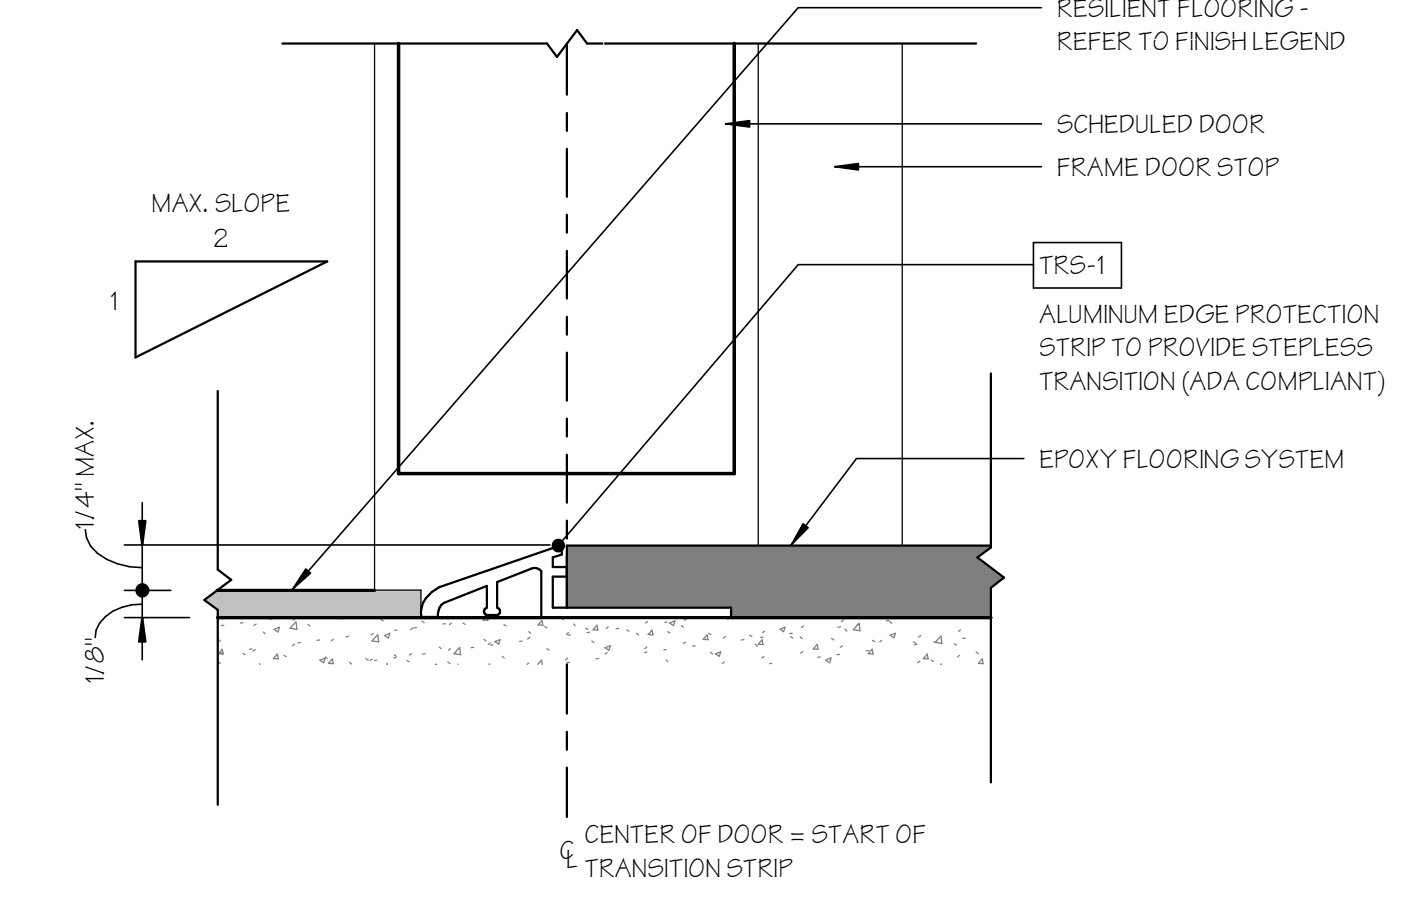


**C2** RESILIENT FLOORING TO EPOXY FLOORING  
SCALE: 12" = 1'-0"

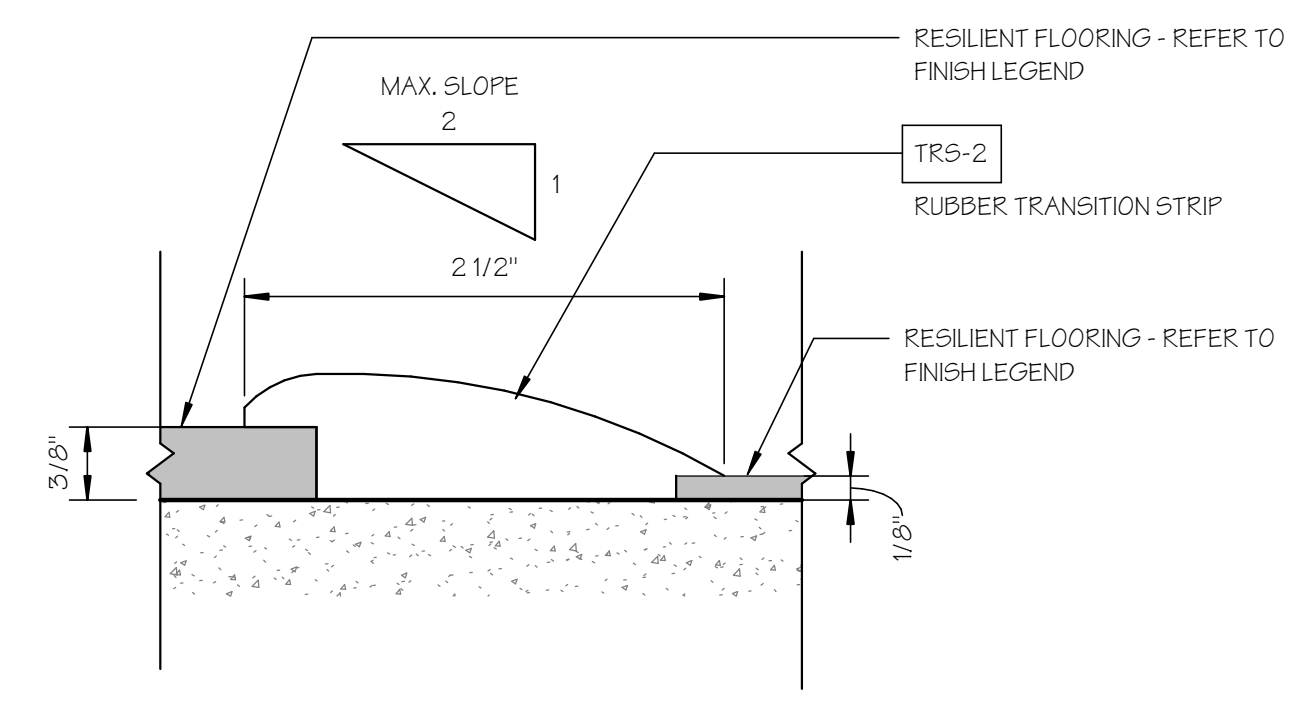


**C3** RESILIENT FLOORING TO RESILIENT FLOORING  
SCALE: 12" = 1'-0"

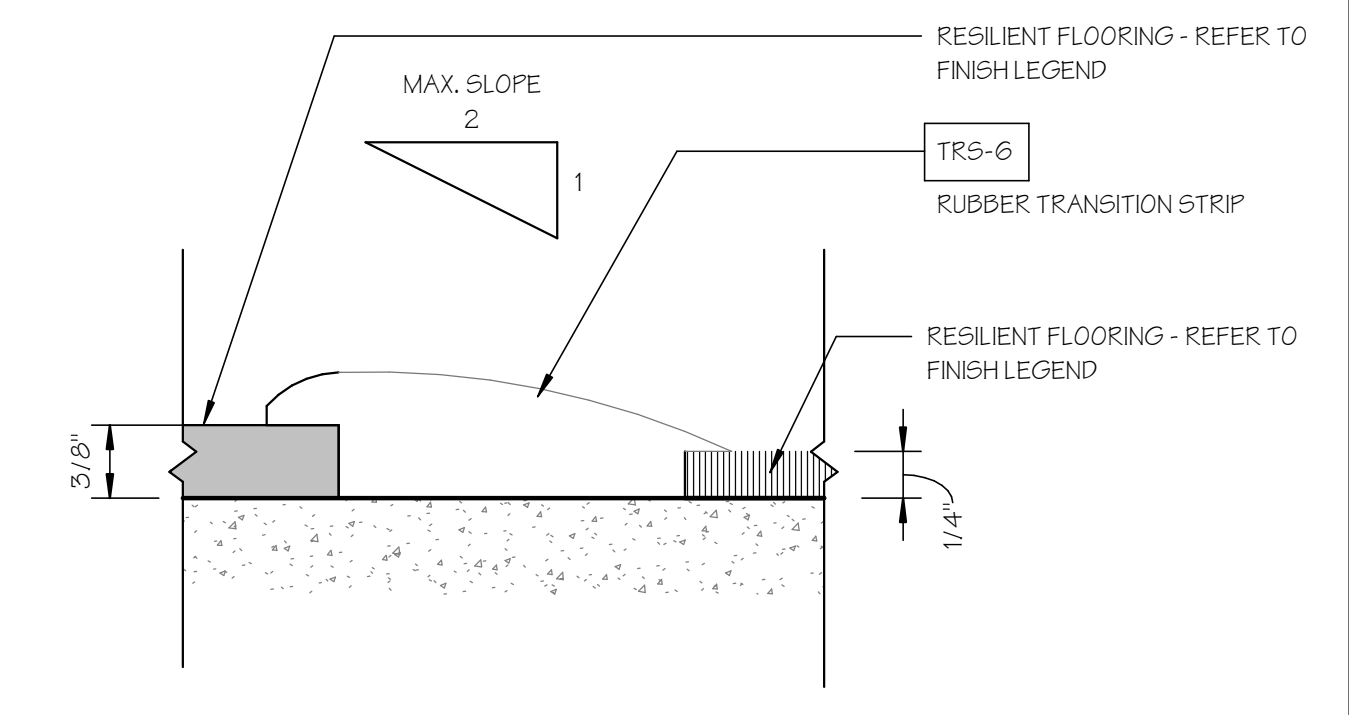

**C4** RESILIENT FLOORING TO CARPET  
SCALE: 12" = 1'-0"

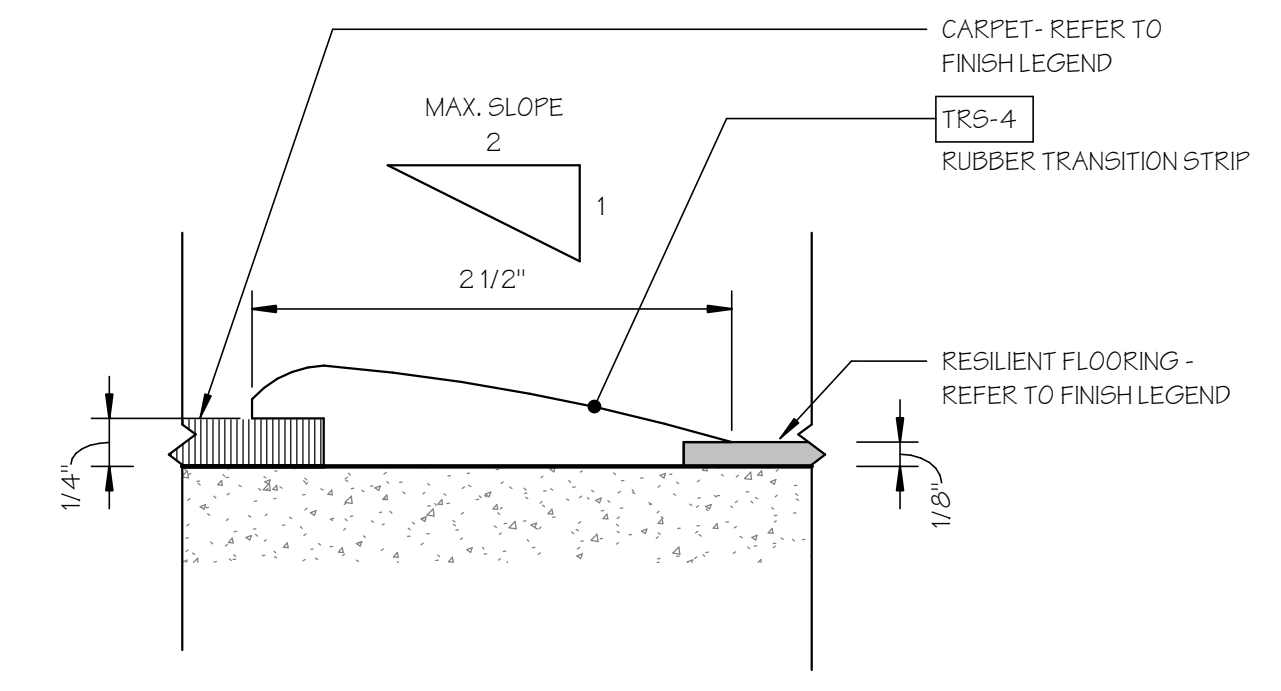

**B3** CARPET TO RESILIENT FLOORING  
SCALE: 12" = 1'-0"

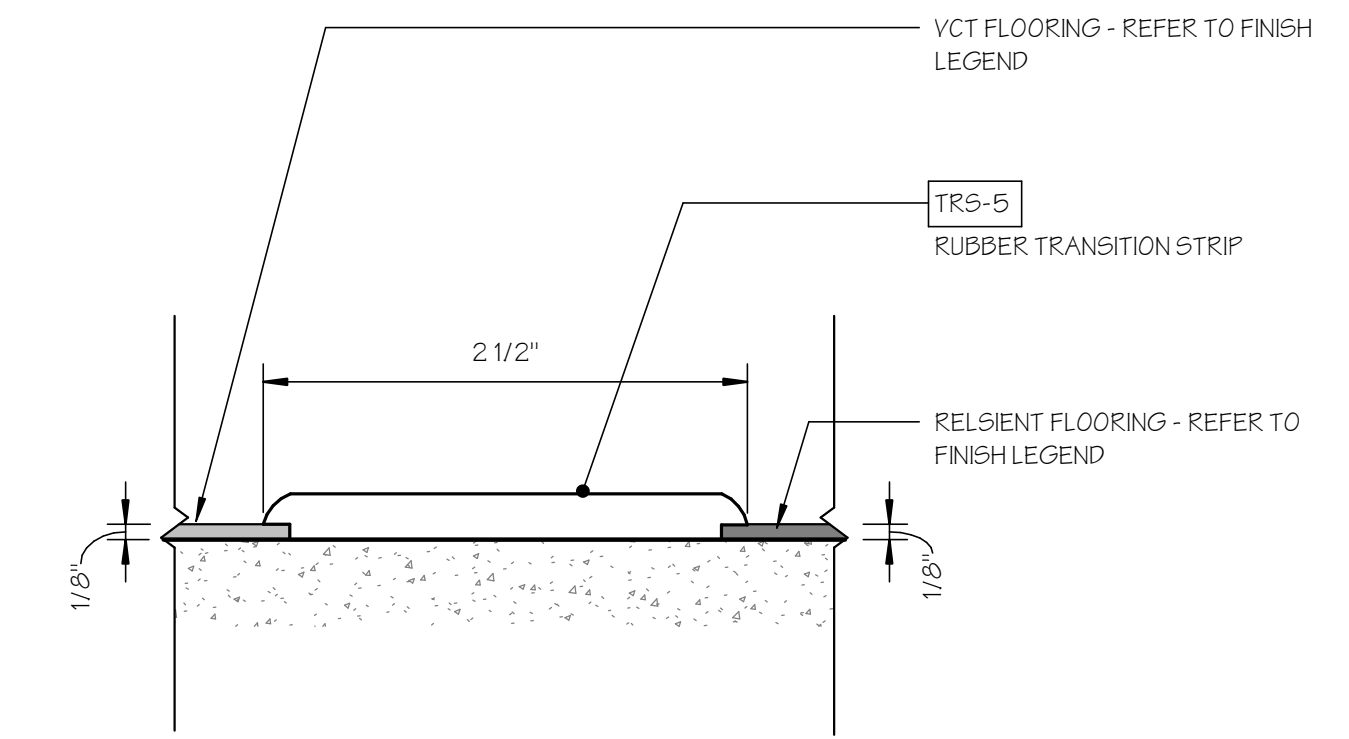

**B4** RESILIENT FLOORING TO RESILIENT FLOORING  
SCALE: 12" = 1'-0"

NOTE: FURNITURE DRAWINGS  
ARE FOR REFERENCE ONLY



ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:

**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
**04.16.2020 - CM BID**

REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT


DRAWING TITLE:  
SECOND FLOOR FURNITURE &  
EQUIPMENT PLAN

SCALE: 1/8" = 1'-0"  
DRAWN BY: BMD  
REVIEWED BY: DCF


DRAWING NO.

**FR-102**  
**04.16.2020 - CM BID**

DATE: 31 JANUARY 2020  
JOB NUMBER: 18052

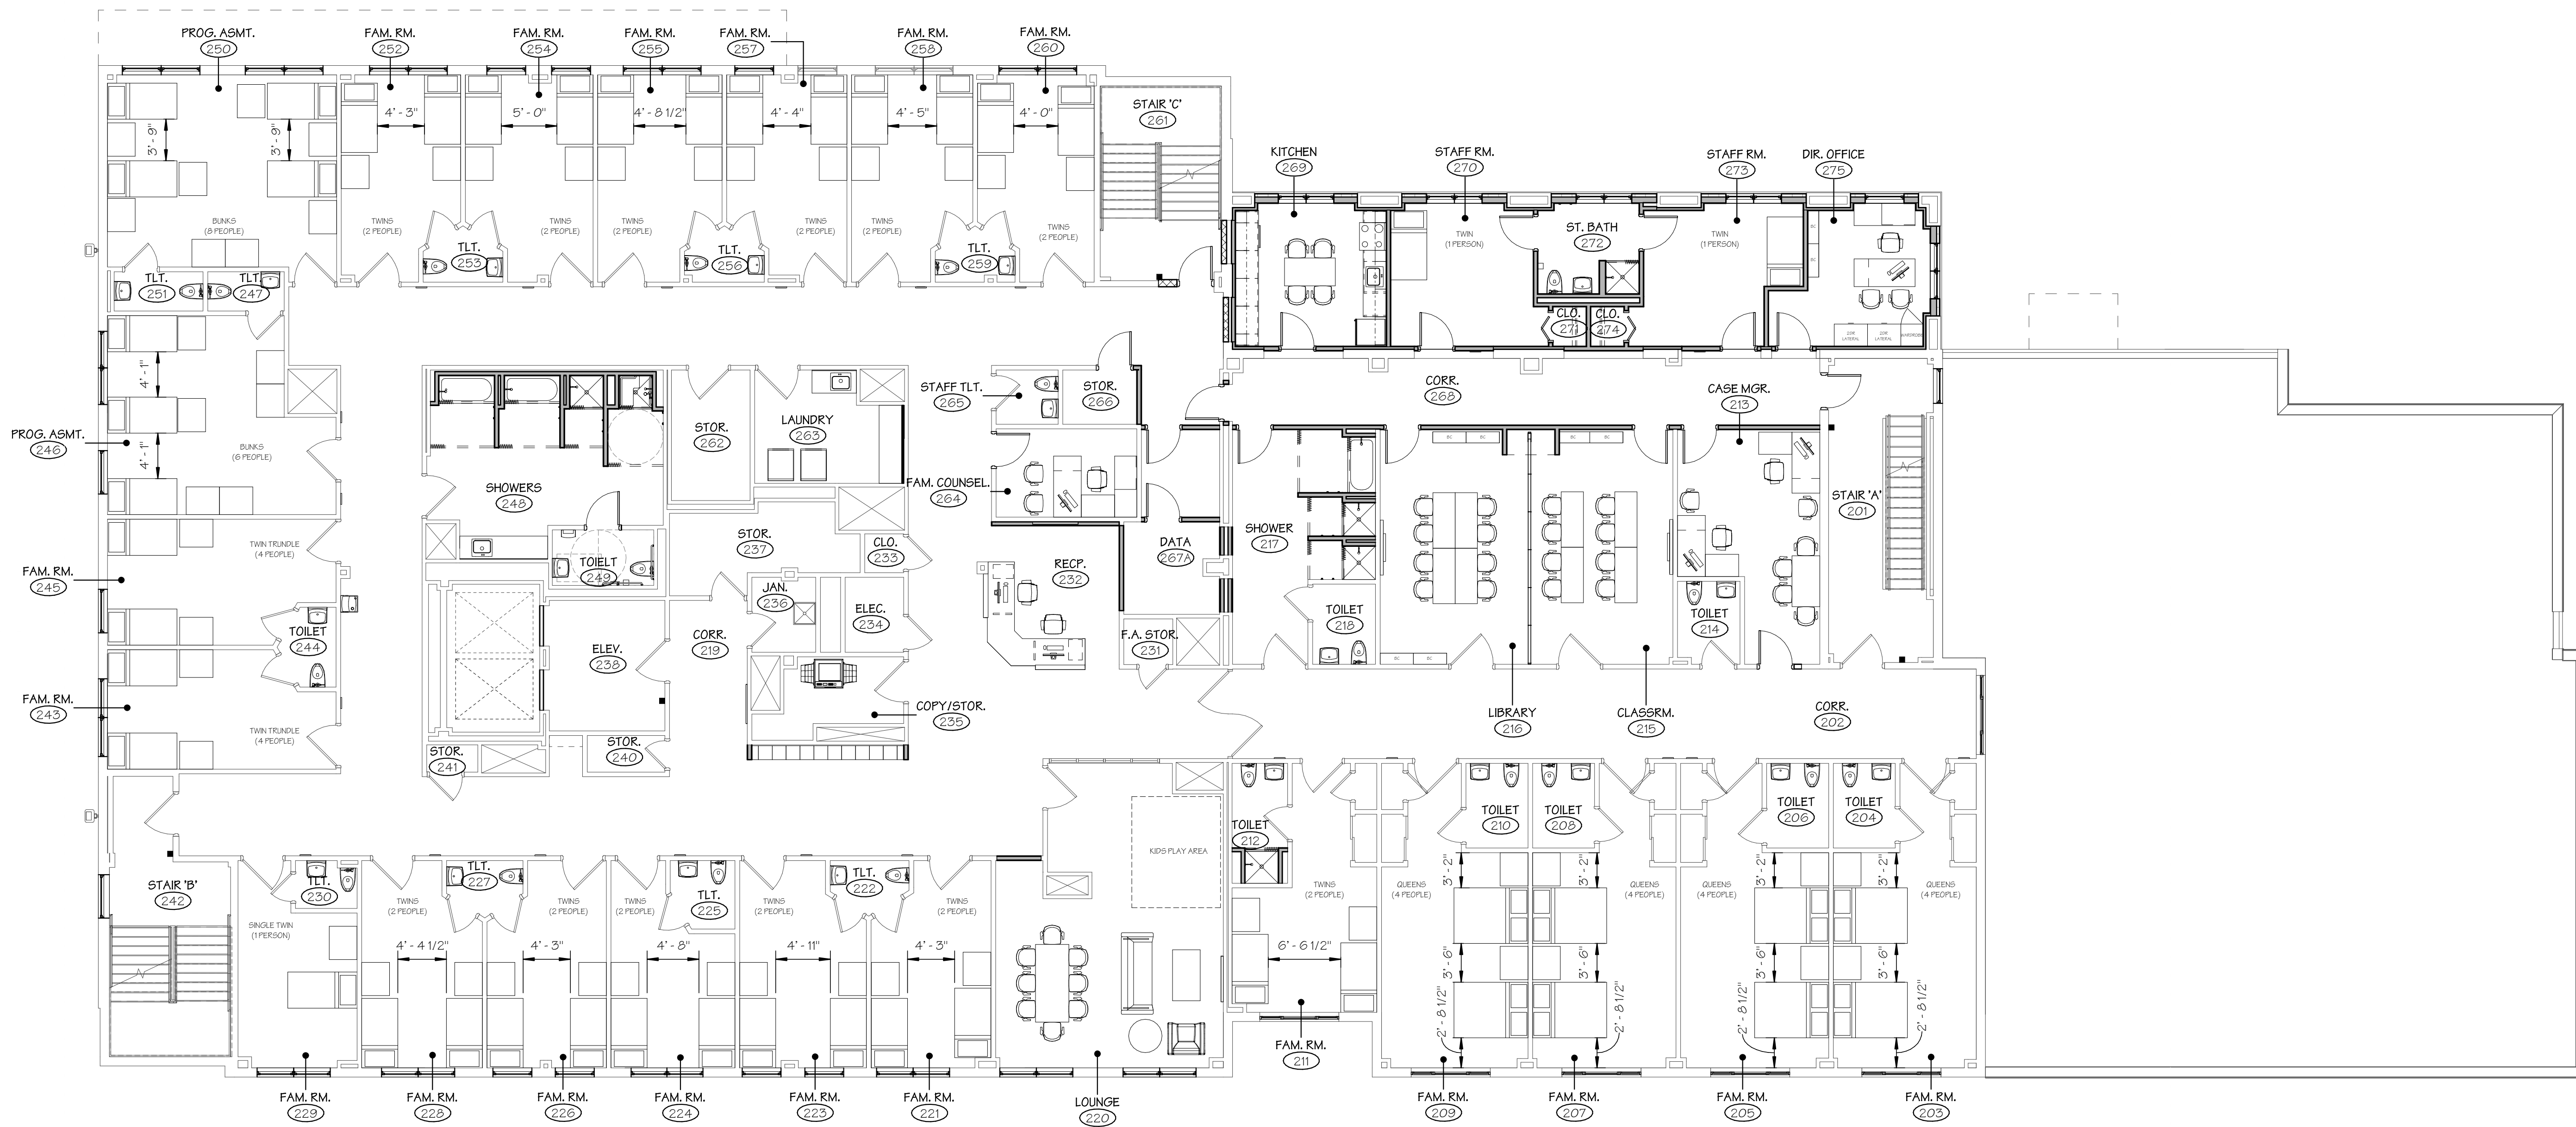

SECOND FLOOR FURNITURE & EQUIPMENT PLAN  
SCALE: 1/8" = 1'-0"



PROJECT NORTH

2/27/2020 1:08:34 PM C:\Users\rosenthan\OneDrive\Documents\Rescue Mission\_Phase 2\_Architecture\_rosehan.rvt



NOTE: FURNITURE DRAWINGS  
ARE FOR REFERENCE ONLY



ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:

**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
**04.16.2020 - CM BID**

REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT


DRAWING TITLE:  
THIRD FLOOR FURNITURE &  
EQUIPMENT PLAN

SCALE: 1/8" = 1'-0"  
DRAWN BY: BMD  
REVIEWED BY: DCF


DRAWING NO.

**FR-103**  
**04.16.2020 - CM BID**

DATE: 31 JANUARY 2020  
JOB NUMBER: 18052

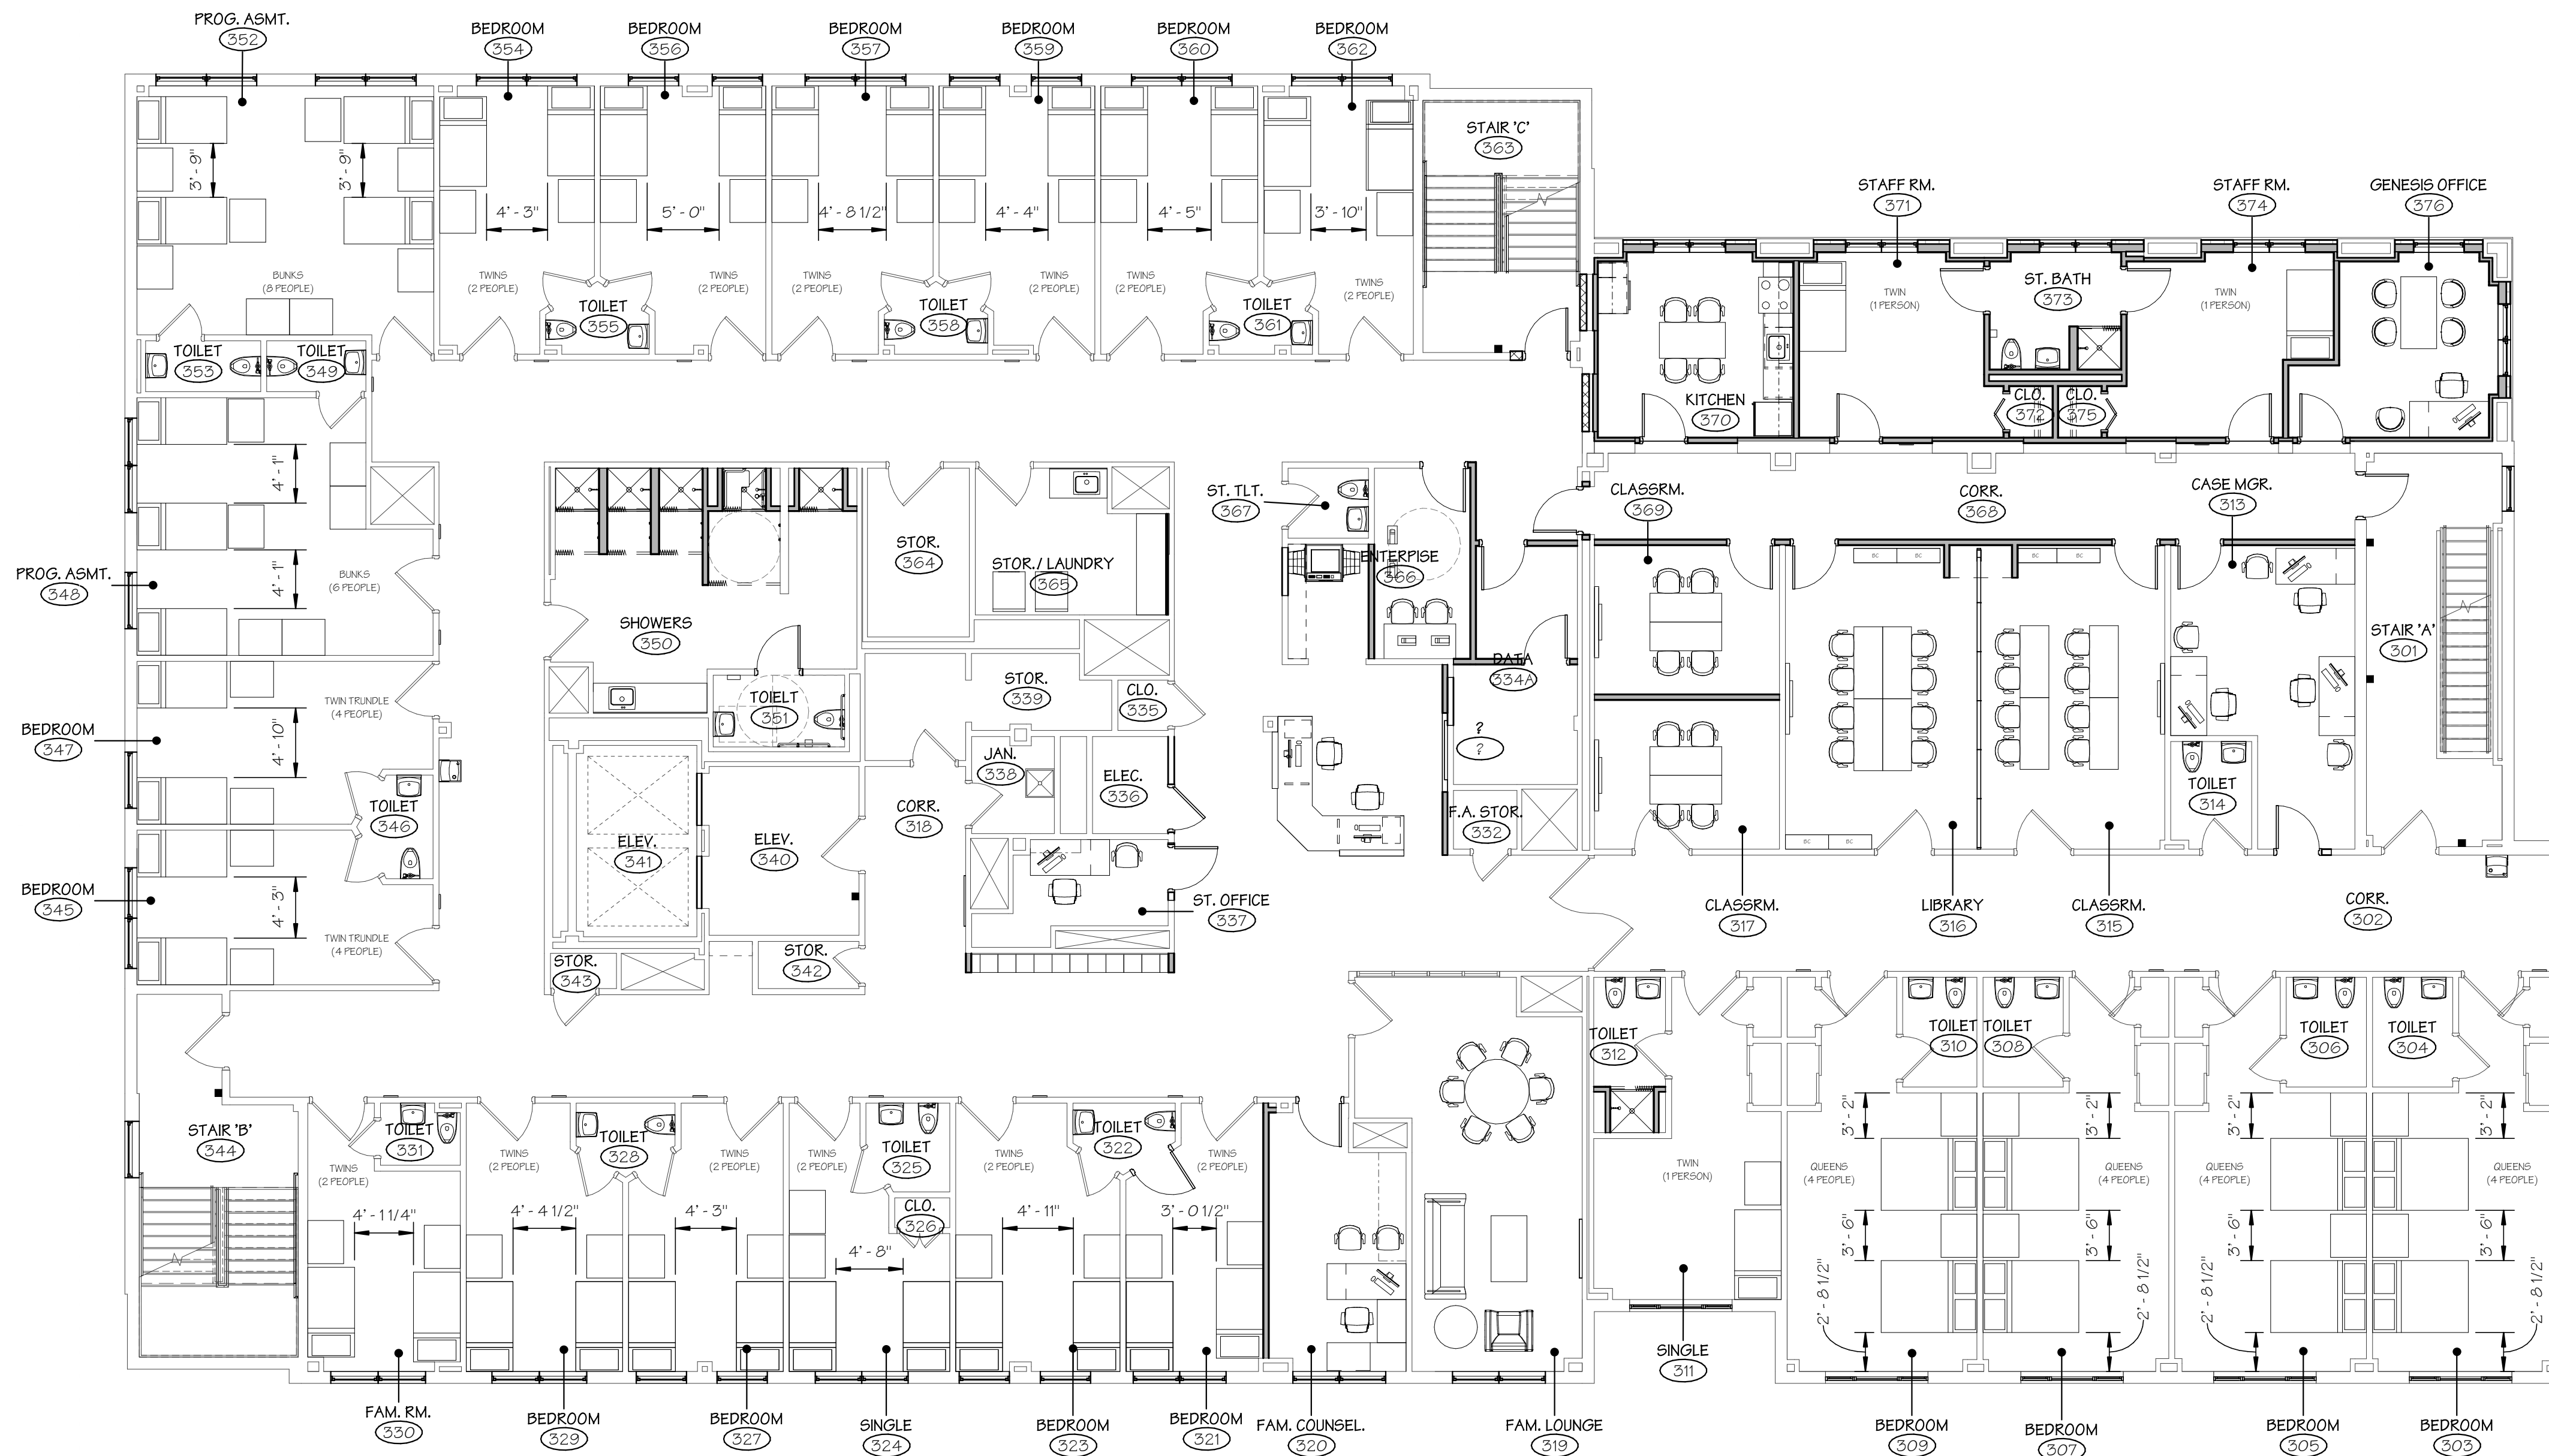

THIRD FLOOR FURNITURE & EQUIPMENT PLAN  
SCALE: 1/8" = 1'-0"



PROJECT NORTH

2/27/2020 1:08:37 PM C:\Users\rosenthan\OneDrive\Documents\18052\_Bridgeport\_Rescue Mission\_Phase 2\_Architecture\_rosesthan.rvt

NOTE: FURNITURE DRAWINGS  
ARE FOR REFERENCE ONLY



ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:

**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION

04.16.2020 - CM BID

REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT


DRAWING TITLE:  
FOURTH FLOOR FURNITURE &  
EQUIPMENT PLAN

SCALE: 1/8" = 1'-0" DRAWN BY: BMD REVIEWED BY: DCF


DRAWING NO.

**FR-104**  
04.16.2020 - CM BID

DATE: 31 JANUARY 2020 JOB NUMBER: 18052

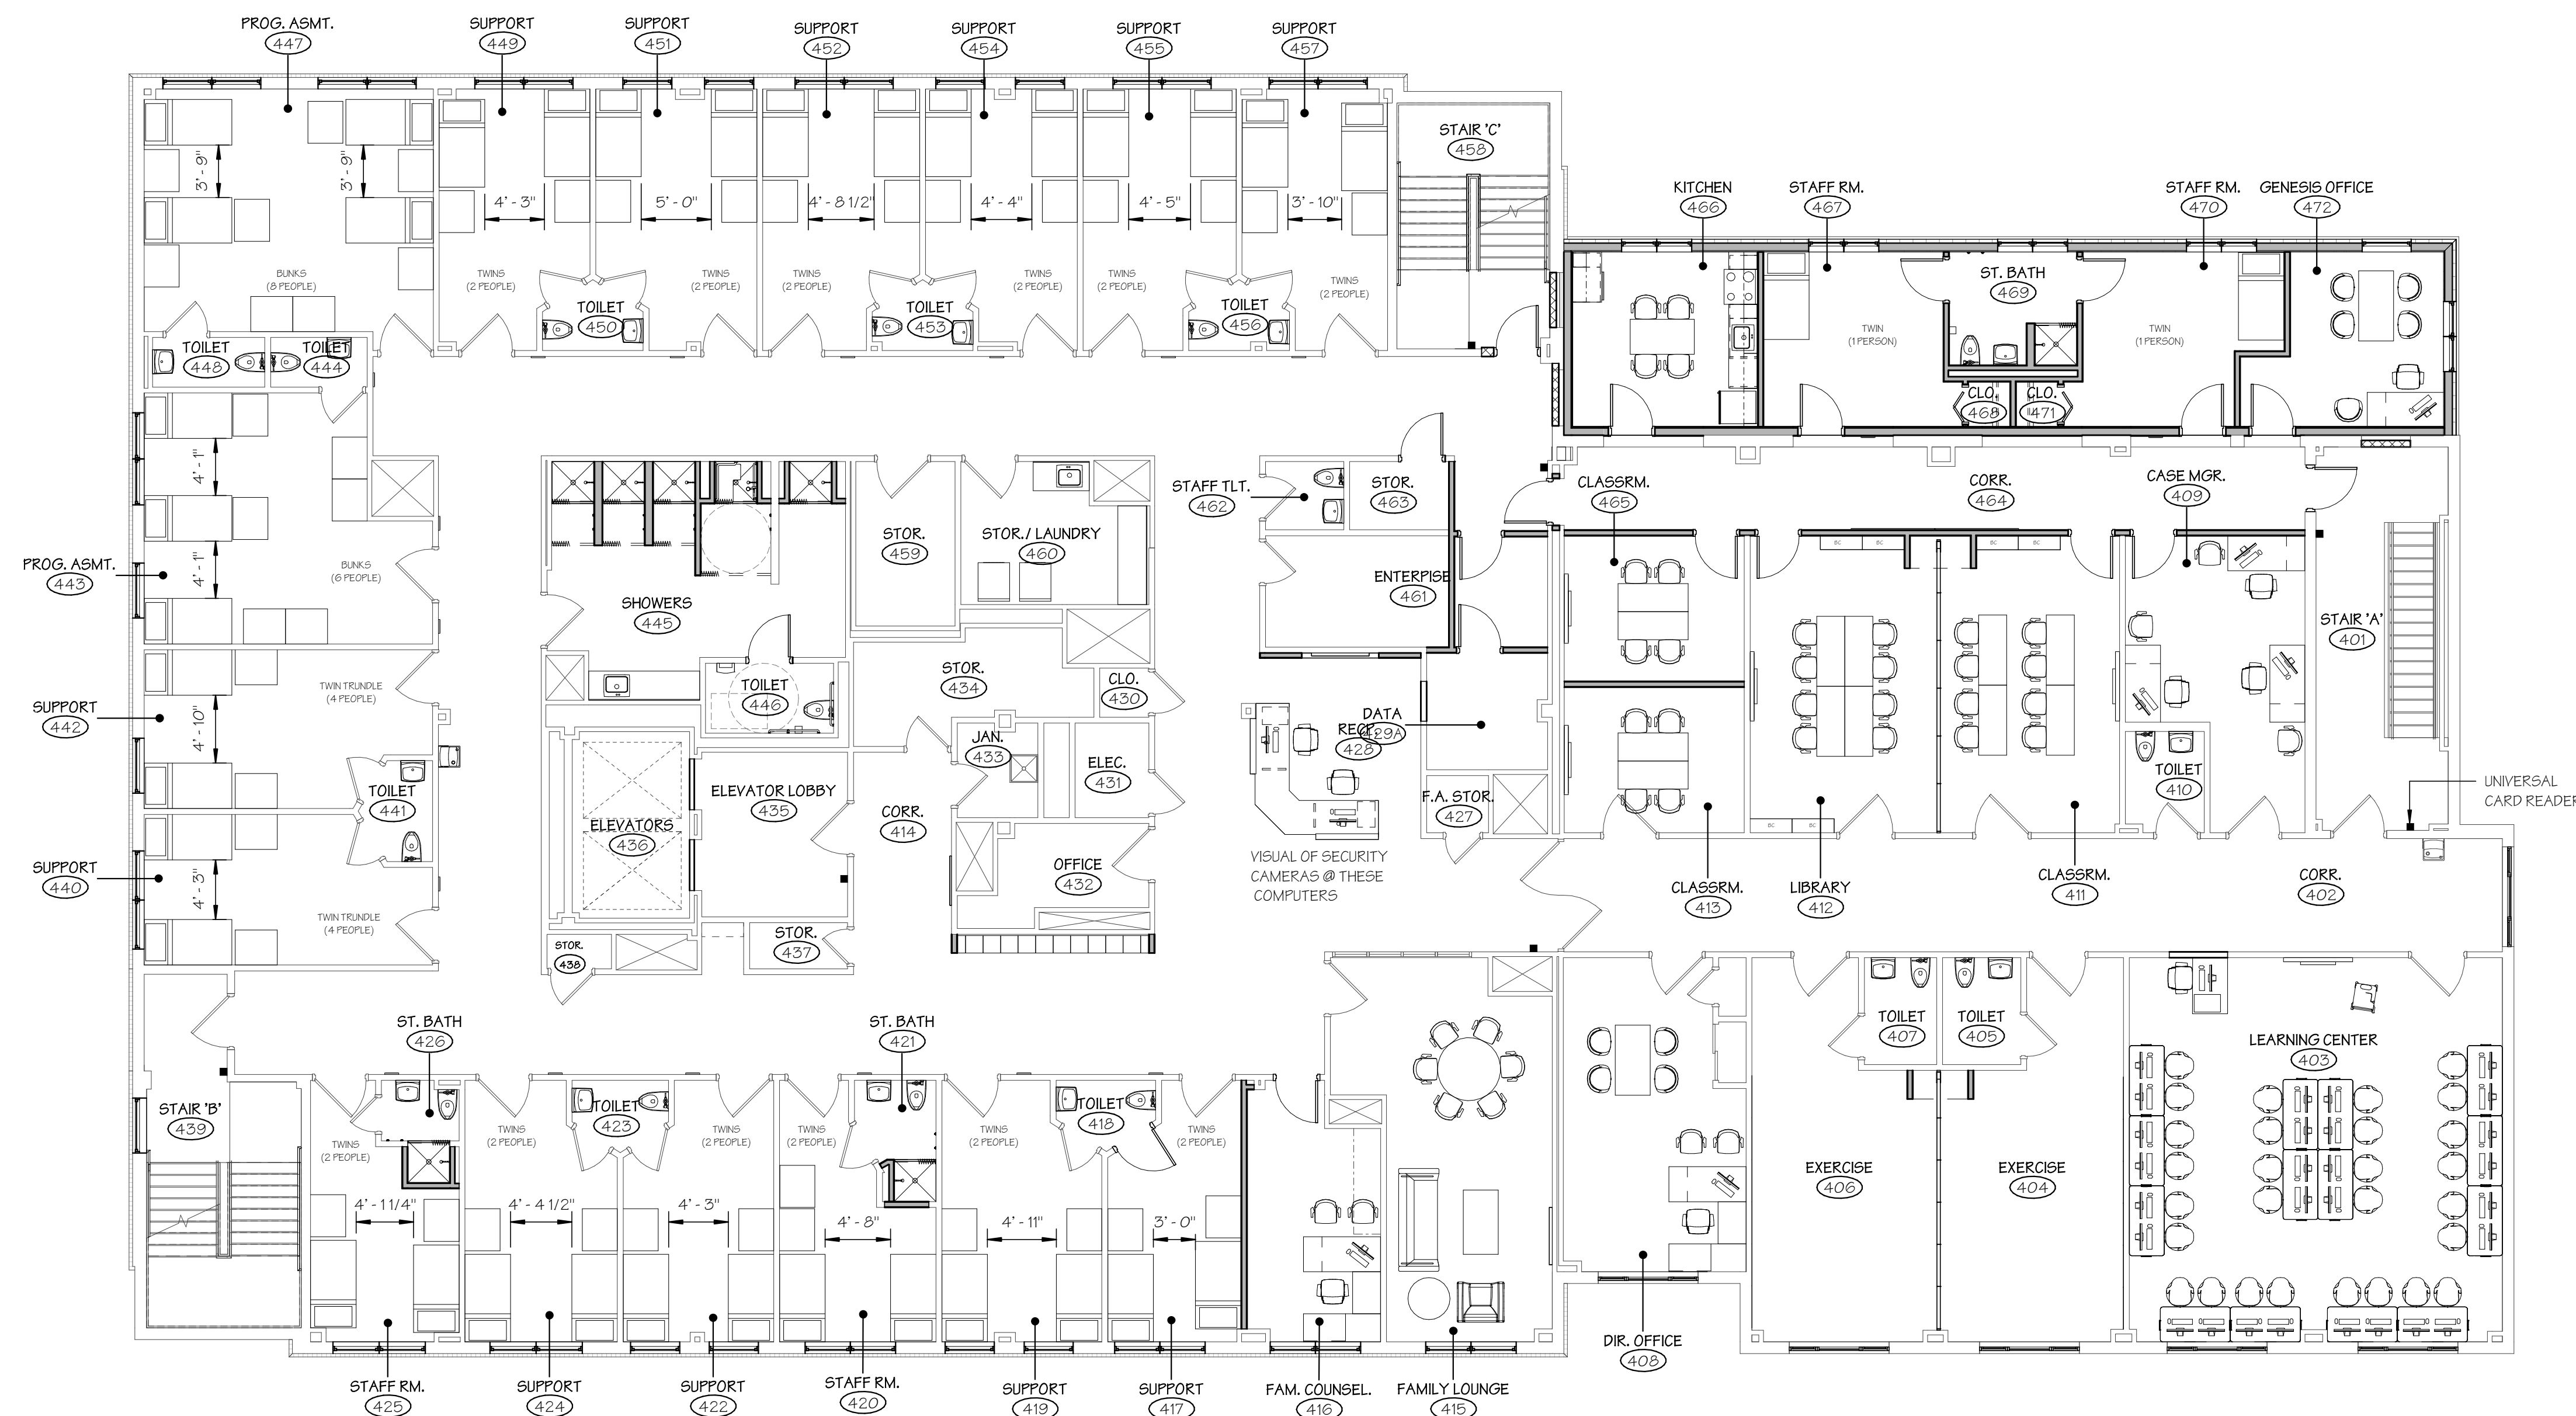

FOURTH FLOOR FURNITURE & FINISH PLAN  
SCALE: 1/8" = 1'-0"



PROJECT NORTH

NOTE: FURNITURE DRAWINGS  
ARE FOR REFERENCE ONLY



ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002  
  
301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:

**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
04.16.2020 - CM BID

REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT


DRAWING TITLE:  
FIFTH FLOOR FURNITURE PLAN &  
EQUIPMENT PLAN

SCALE: 1/8" = 1'-0"  
DRAWN BY: BMD  
REVIEWED BY: DCF

DRAWING NO.


**FR-105**  
04.16.2020 - CM BID

DATE: 31 JANUARY 2020  
JOB NUMBER: 18052

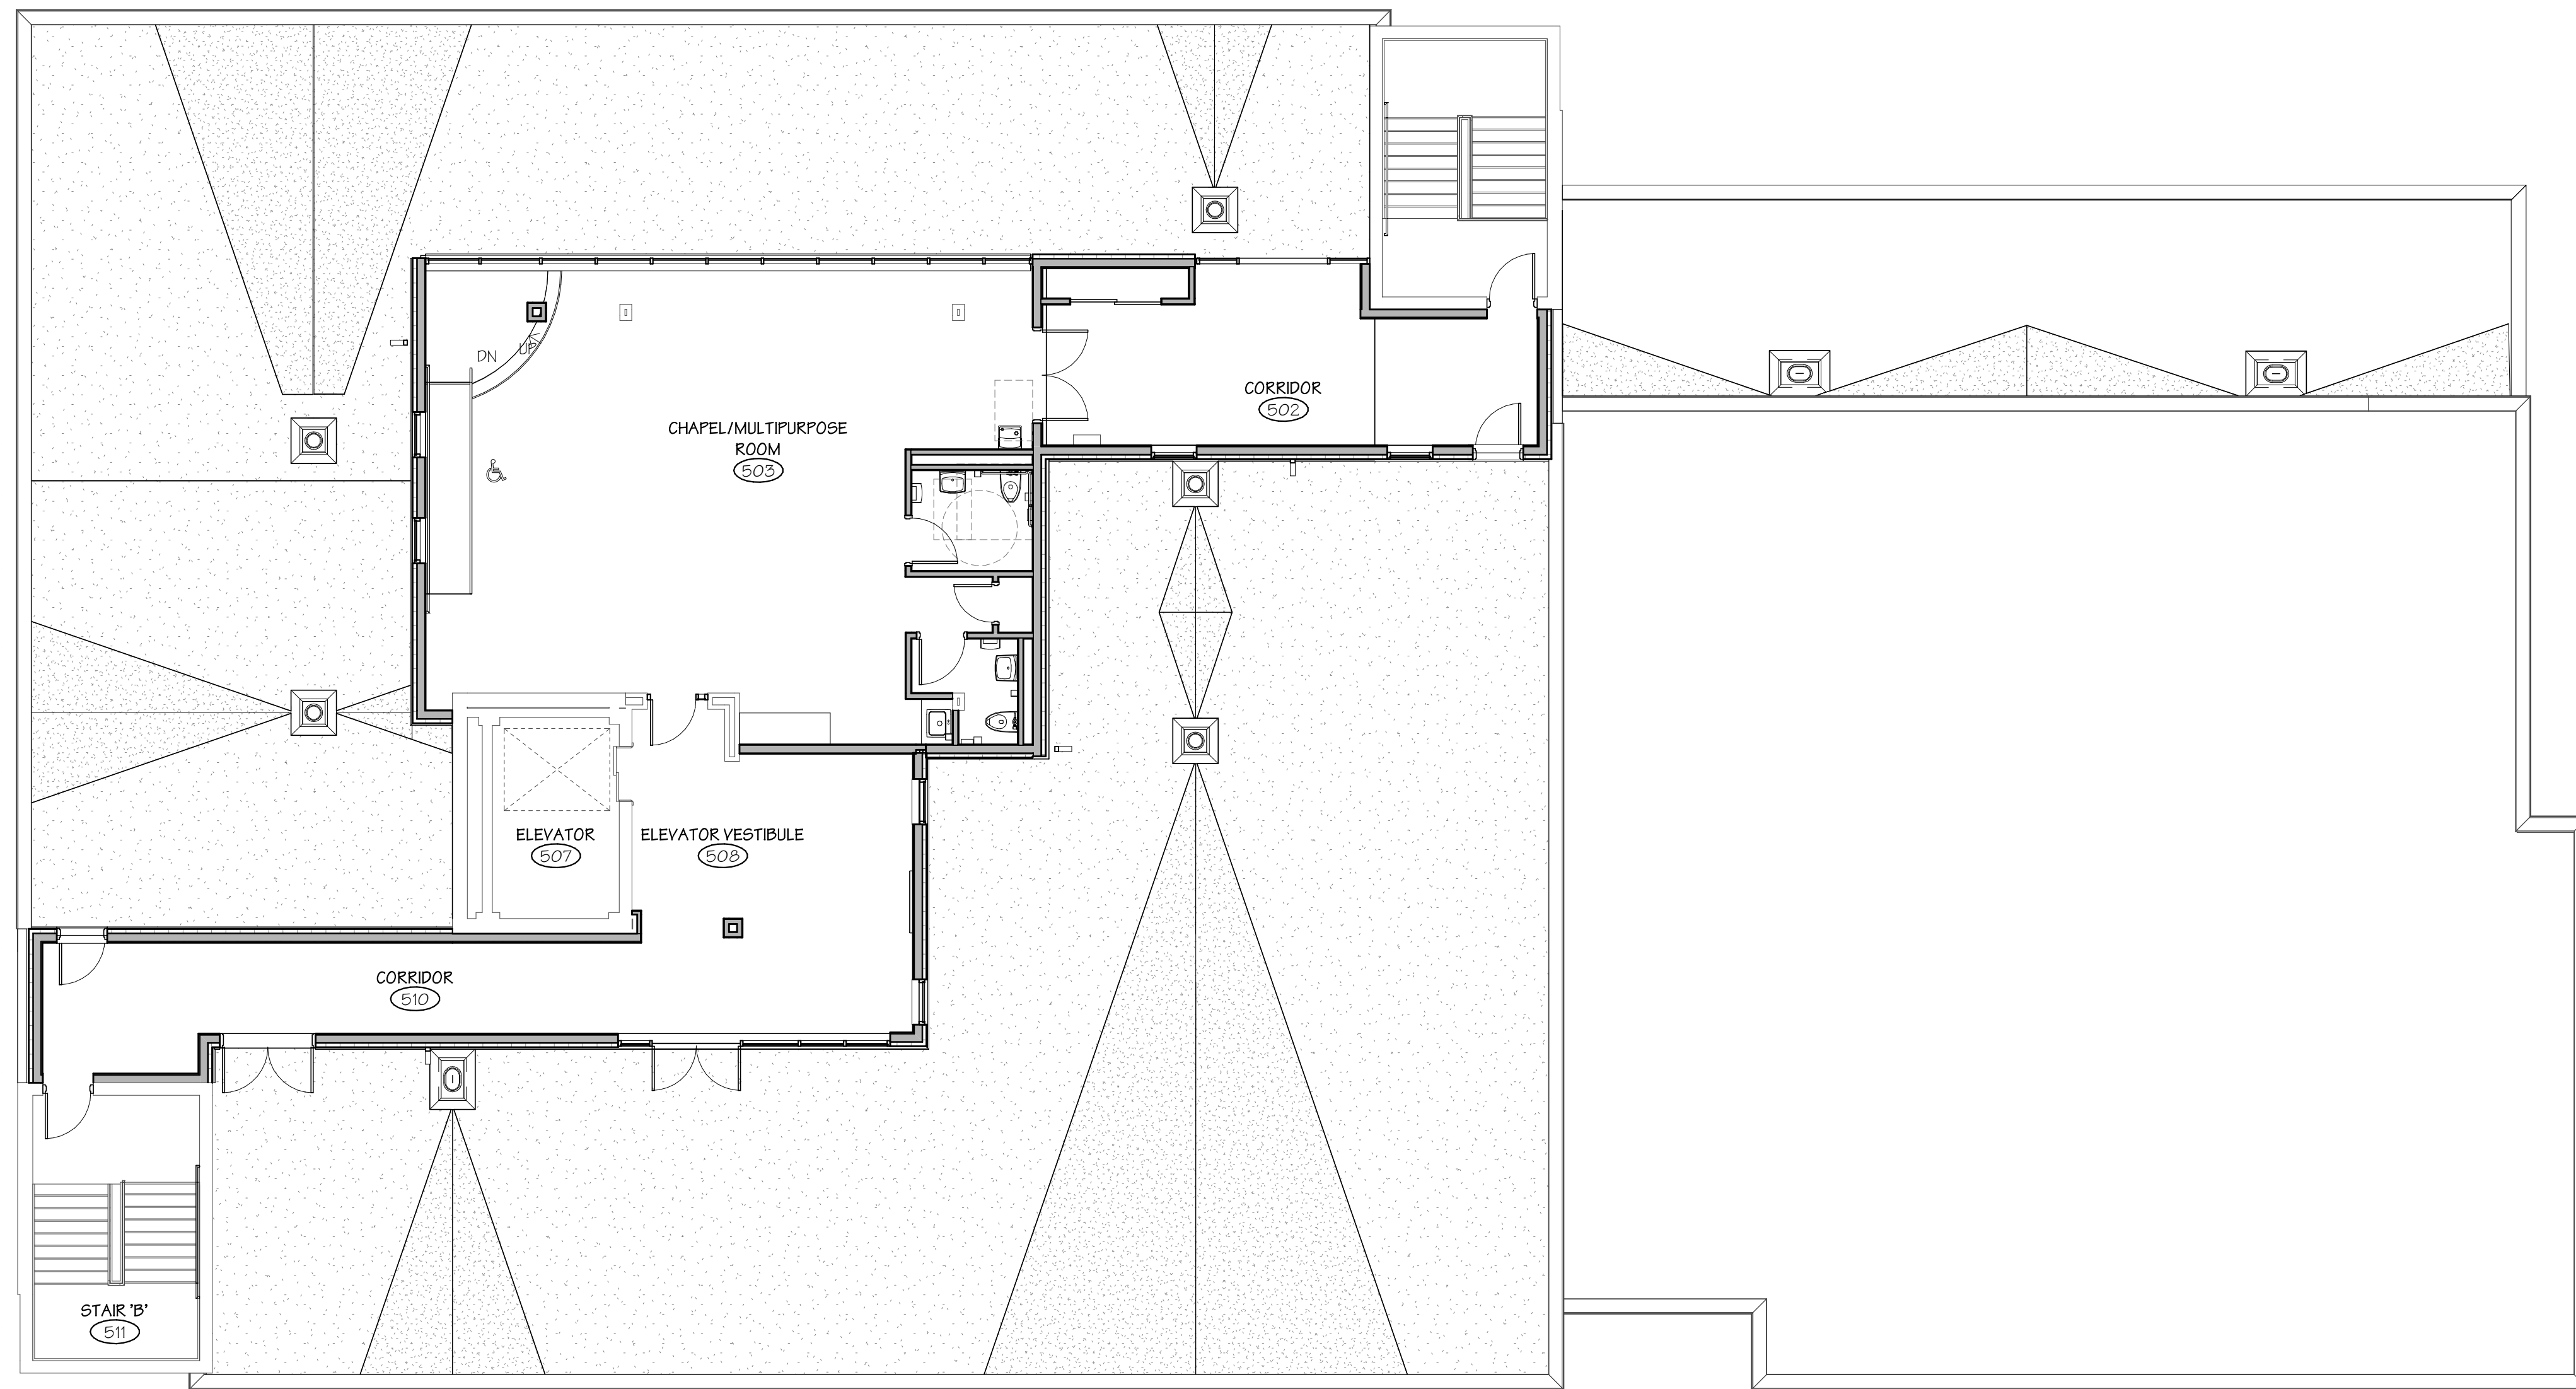

FIFTH FLOOR FURNITURE PLAN

SCALE: 1/8" = 1'-0"



PROJECT NORTH

2/27/2020 1:08:41 PM  
C:\Users\rosentha1\OneDrive\Documents\Rescue Mission\_Phase 2\_Architecture\_rose1\dwg



ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport CT  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Architect.

CERTIFICATION:

**BID SET**  
31 JANUARY 2020  
FOR CONSTRUCTION  
**04.16.2020 - CM BID**

REVISIONS

NO.	DATE	DESCRIPTION
00	04.16.20	CM BID



JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
STRUCTURAL ROOF DETAILS



SCALE: As indicated  
DRAWN BY: RMR  
REVIEWED BY: Approver

**S-580**  
04.16.2020 - CM BID


DATE: 31 JANUARY 2020  
JOB NUMBER: 18052

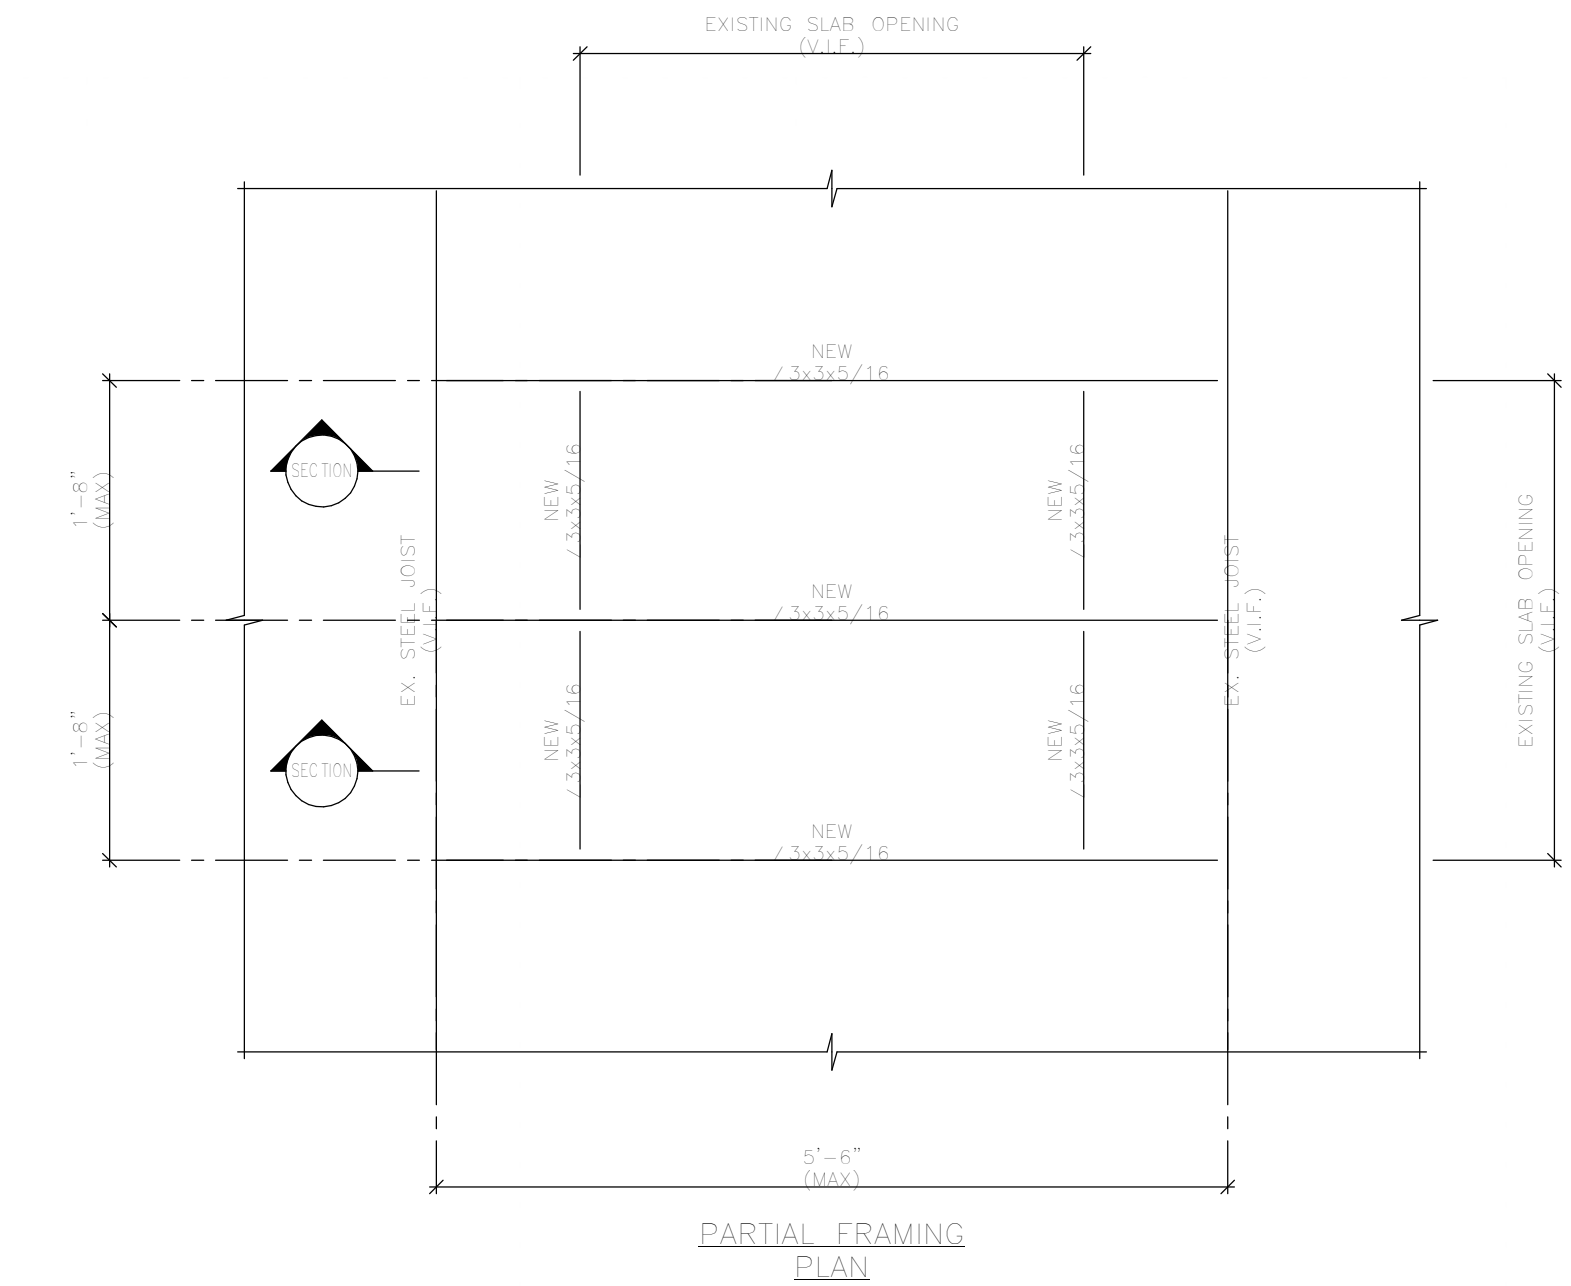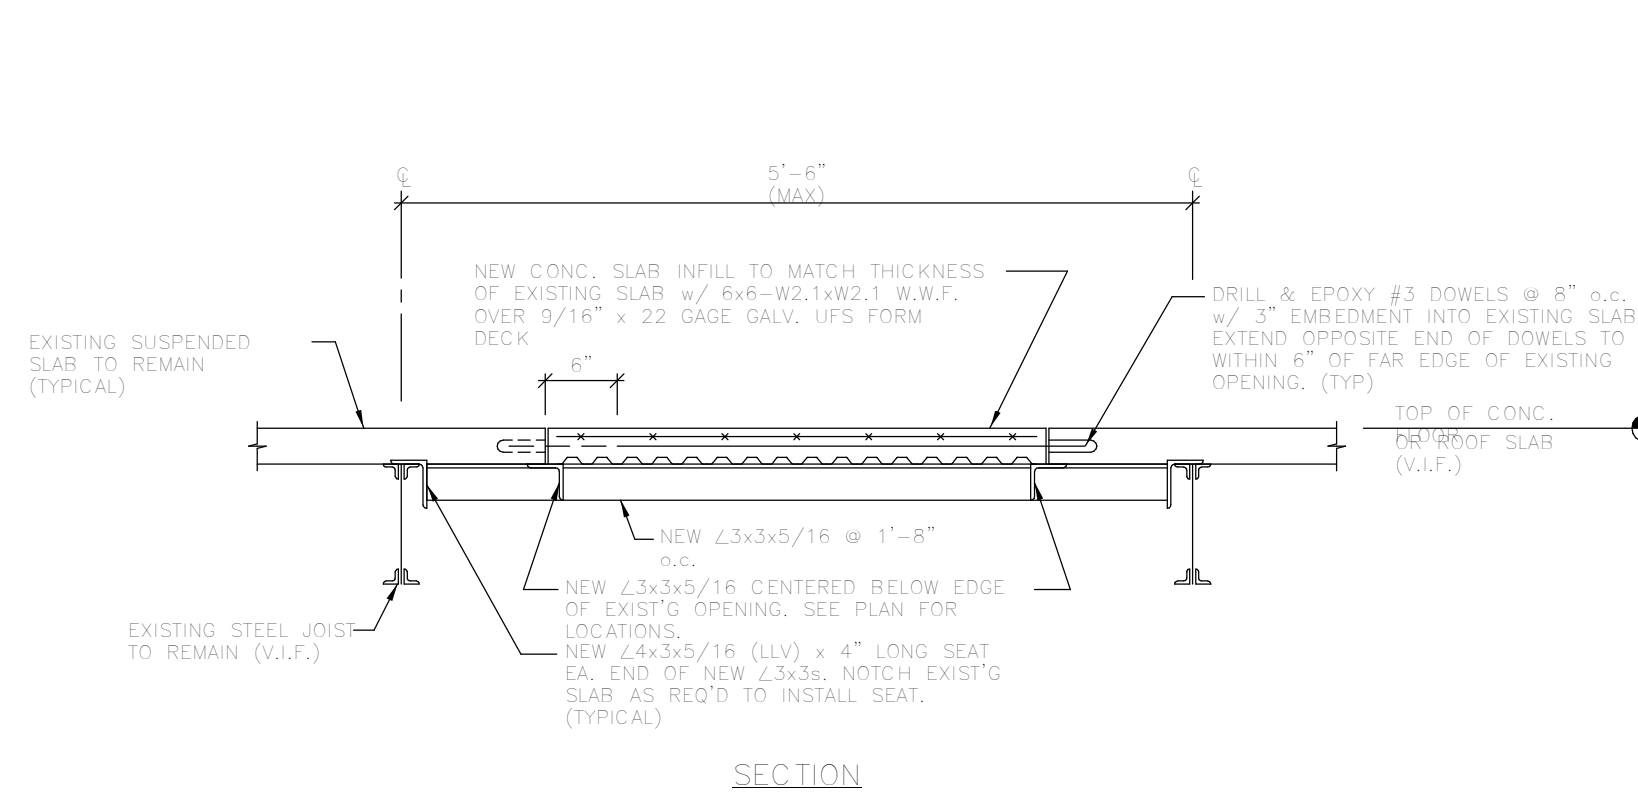

**S4** TYPICAL SLAB - INFILL DETAIL  
SCALE: 3/4" = 1'-0"

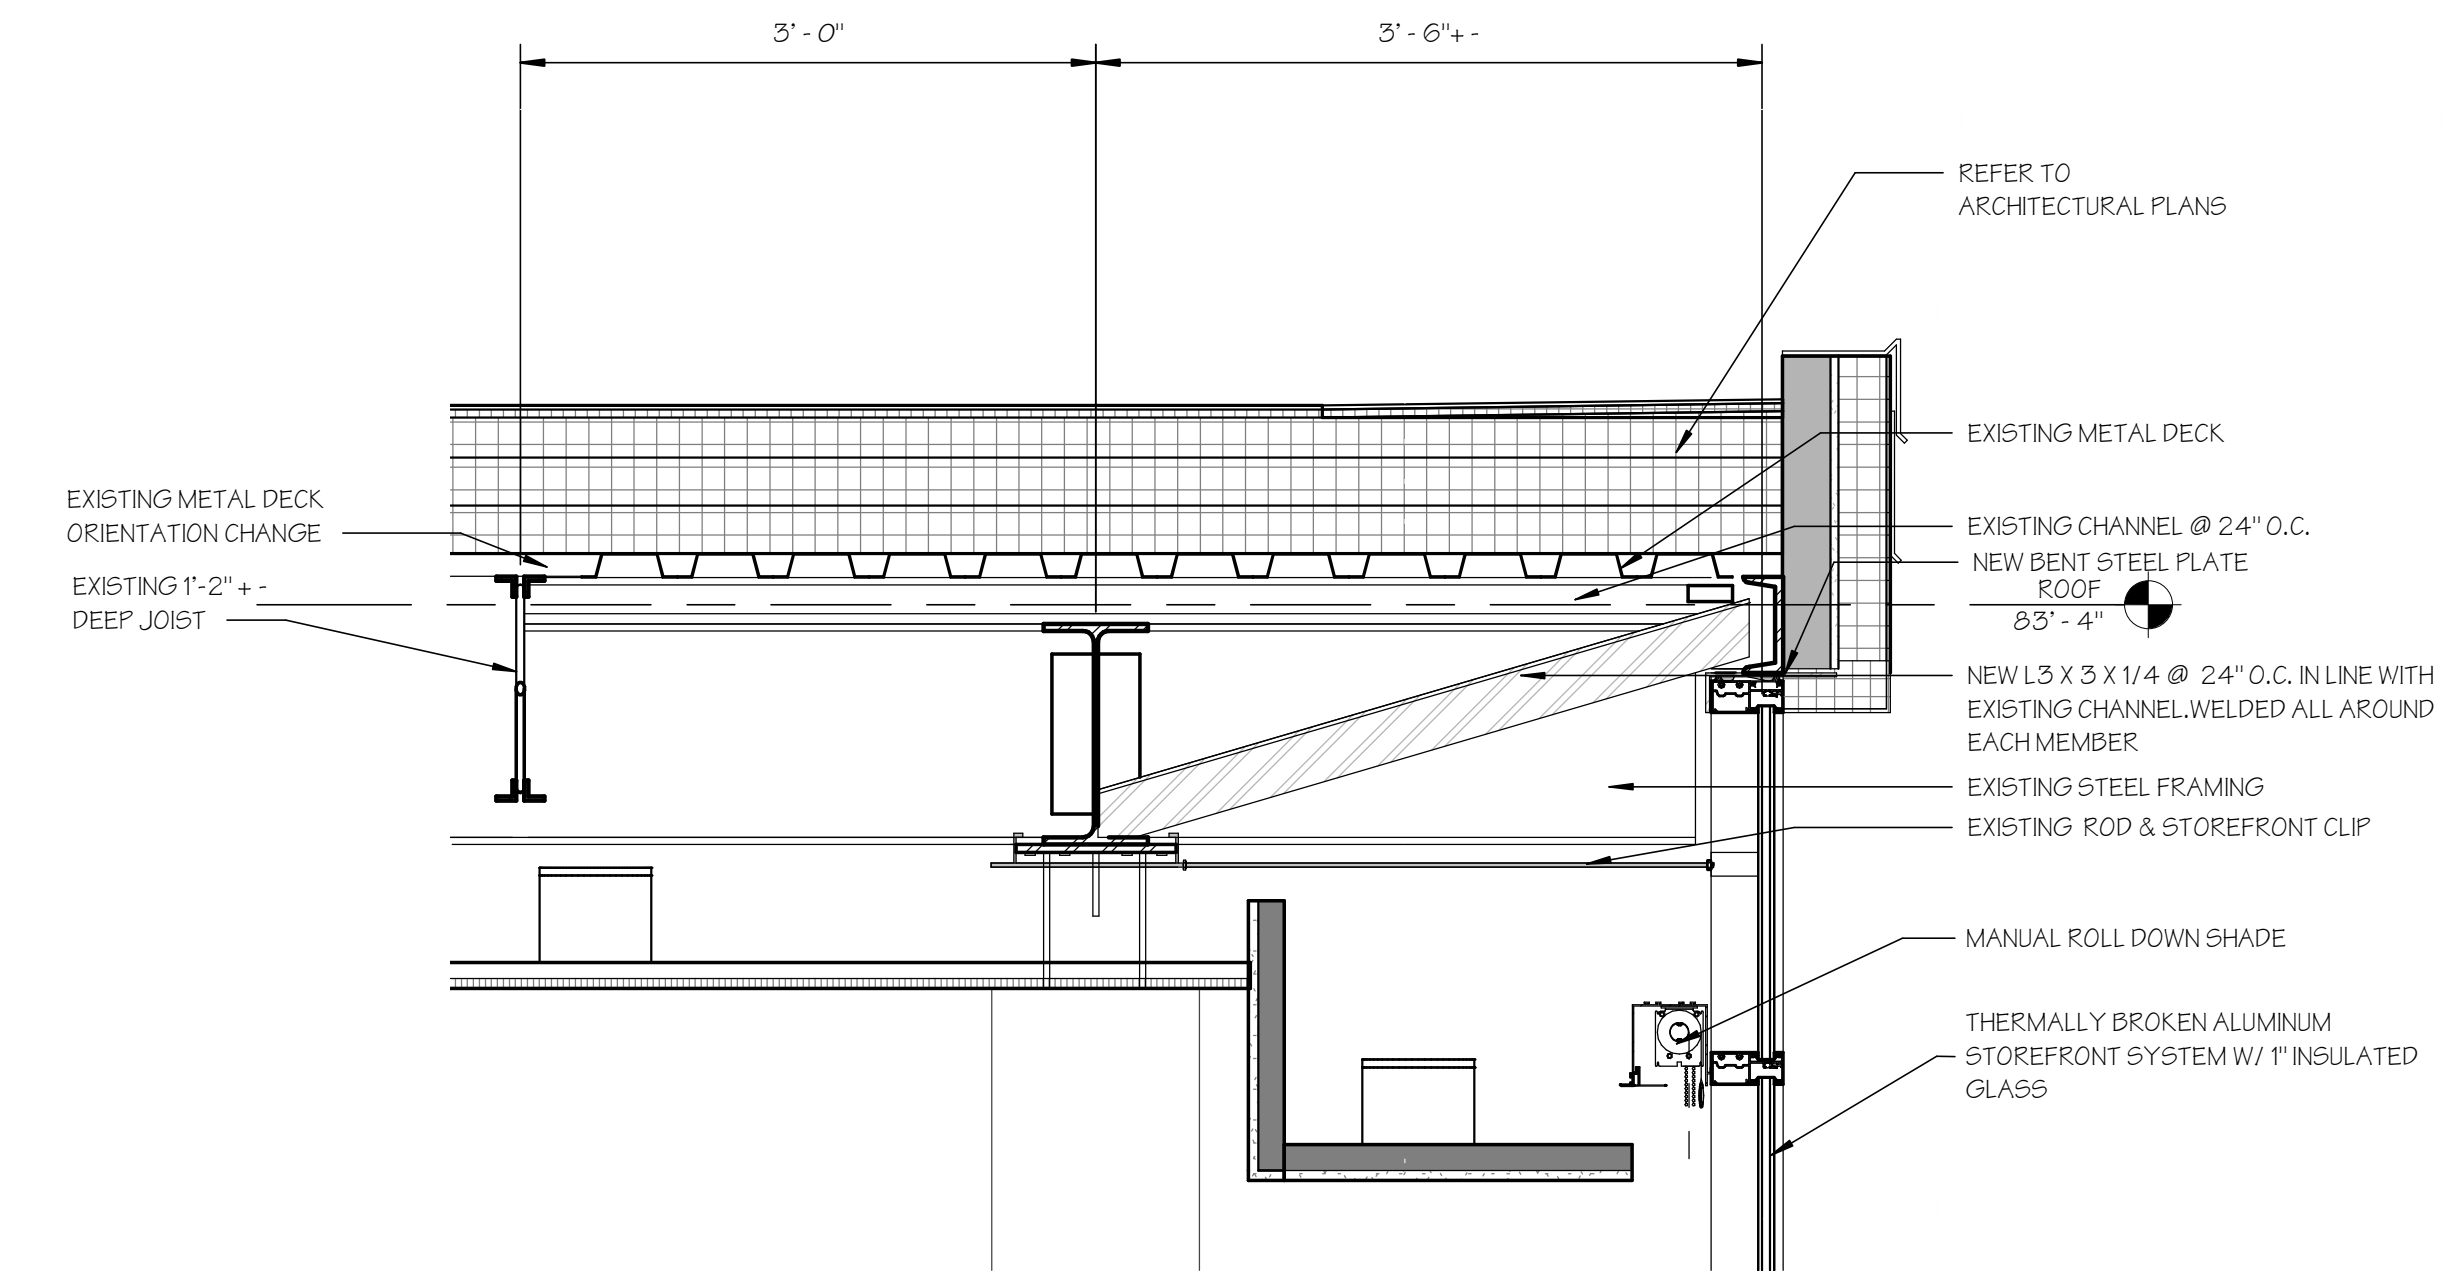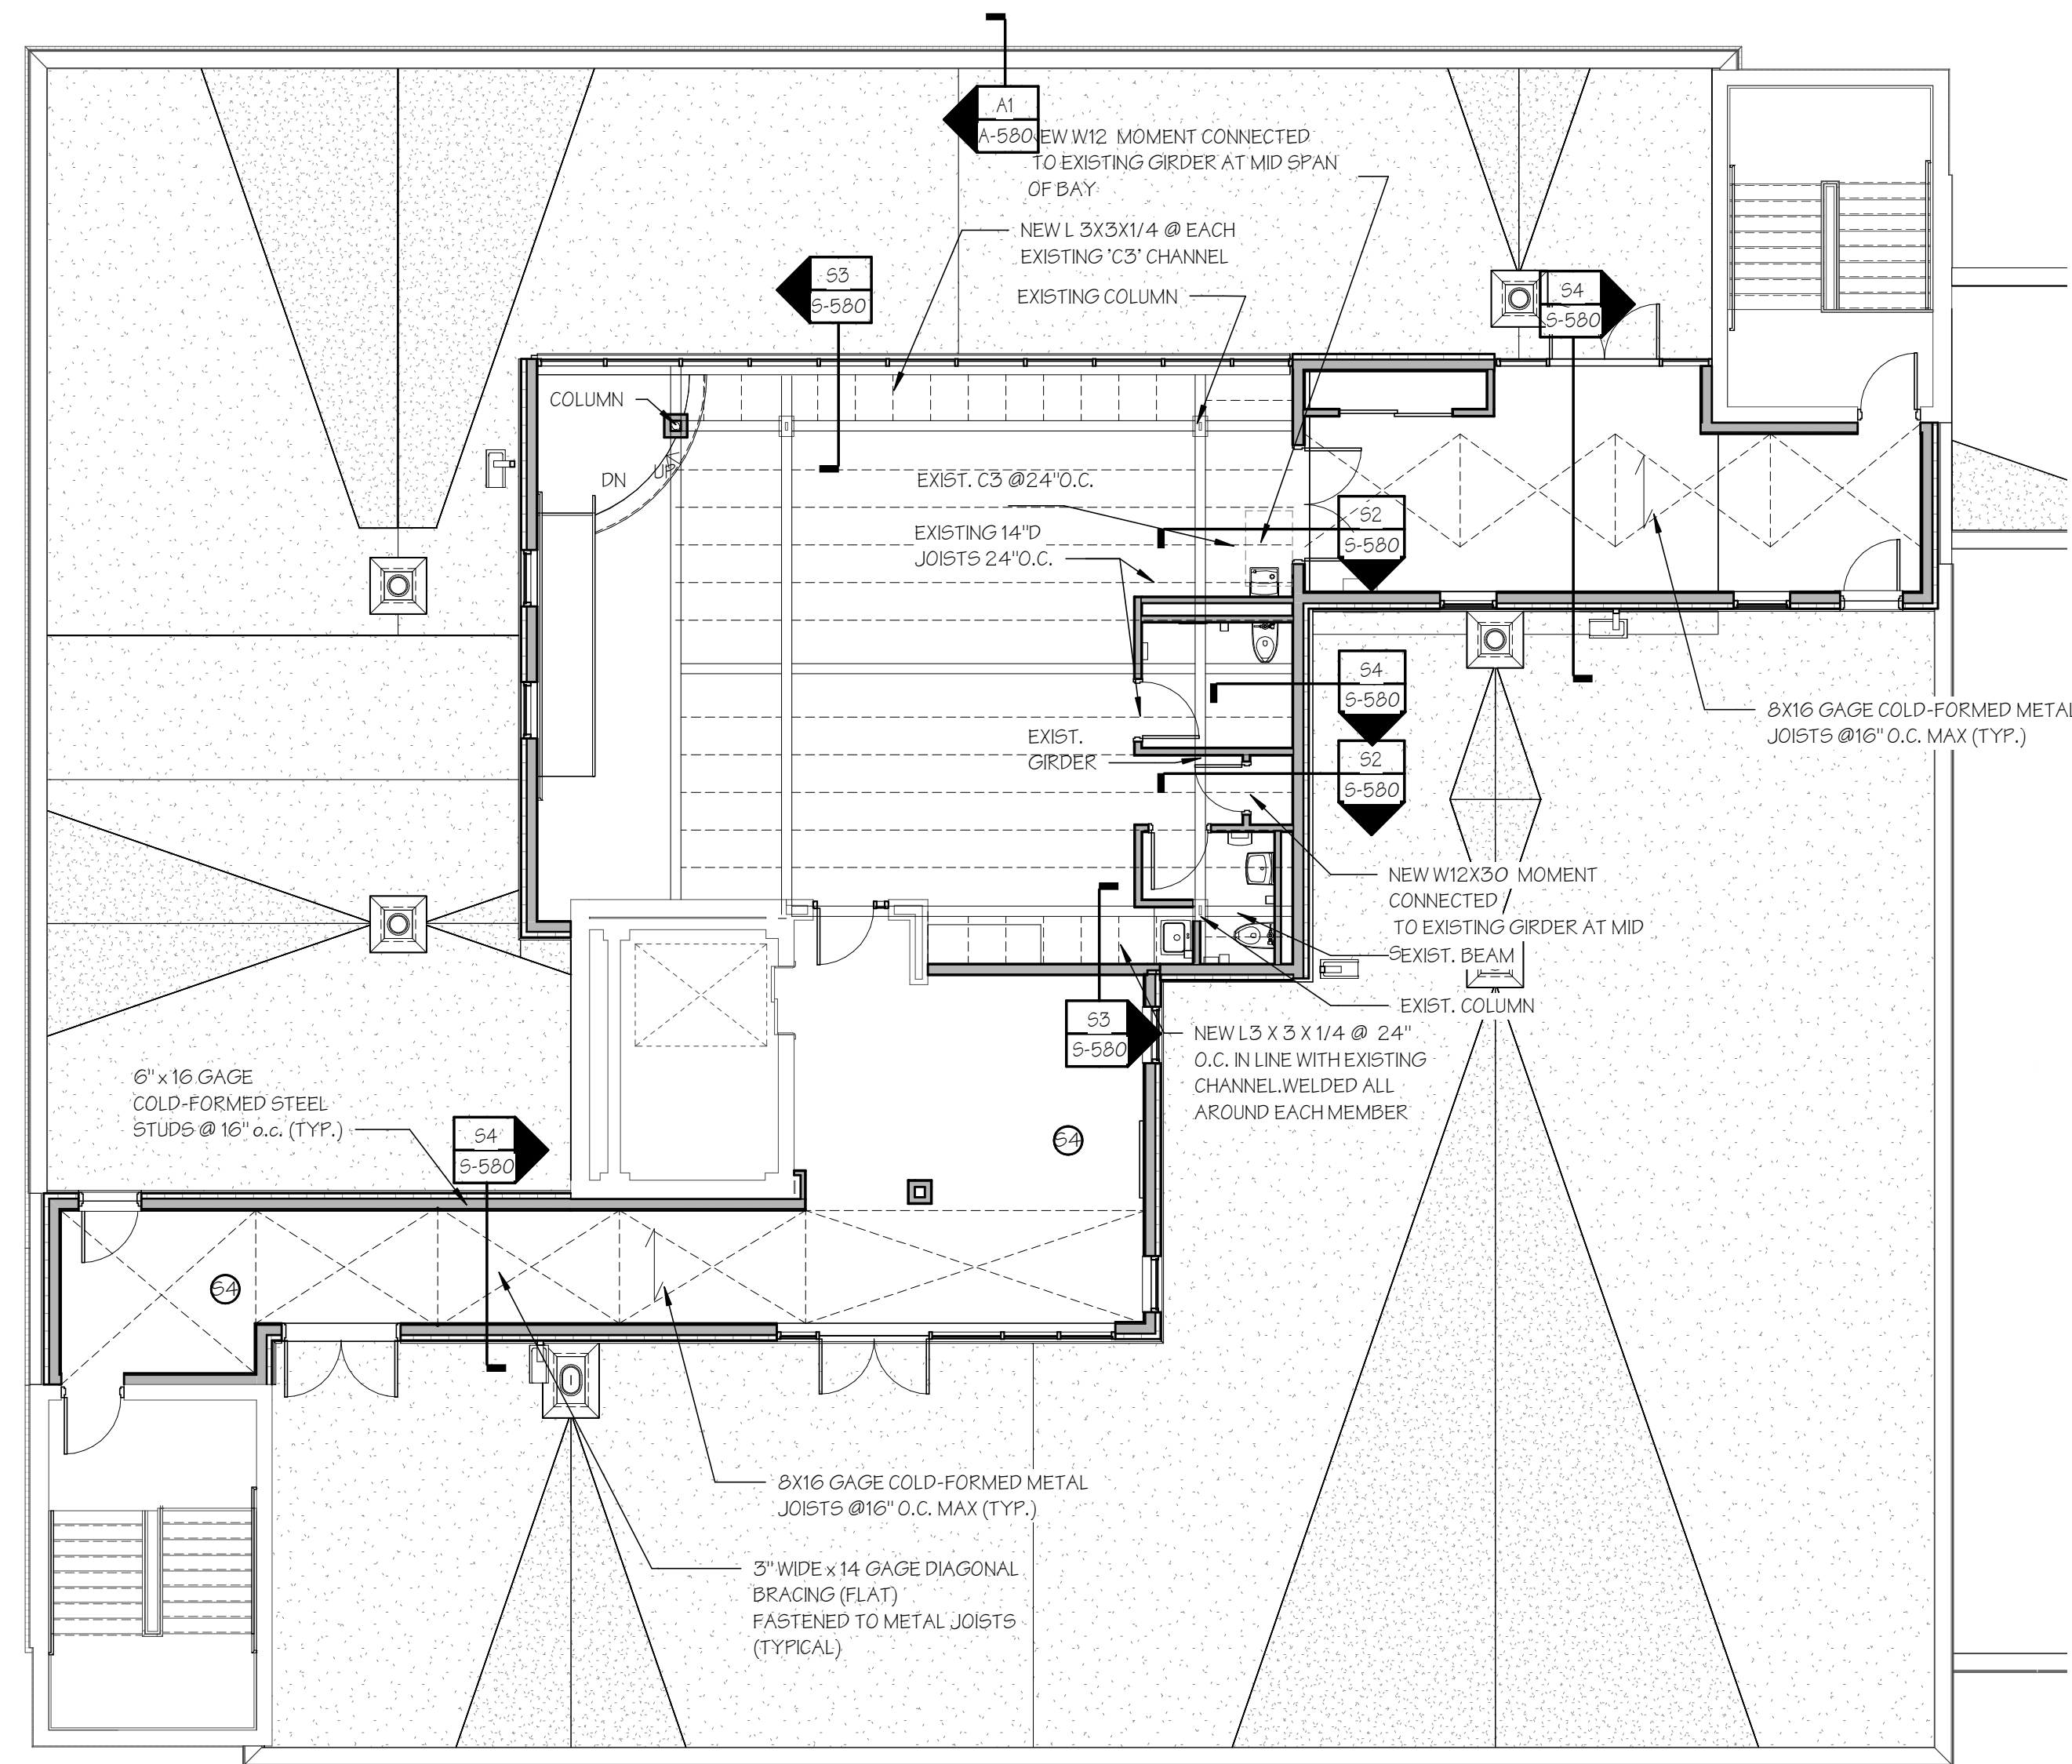

**S3** PENTHOUSE ROOF DETAIL  
SCALE: 1" = 1'-0"

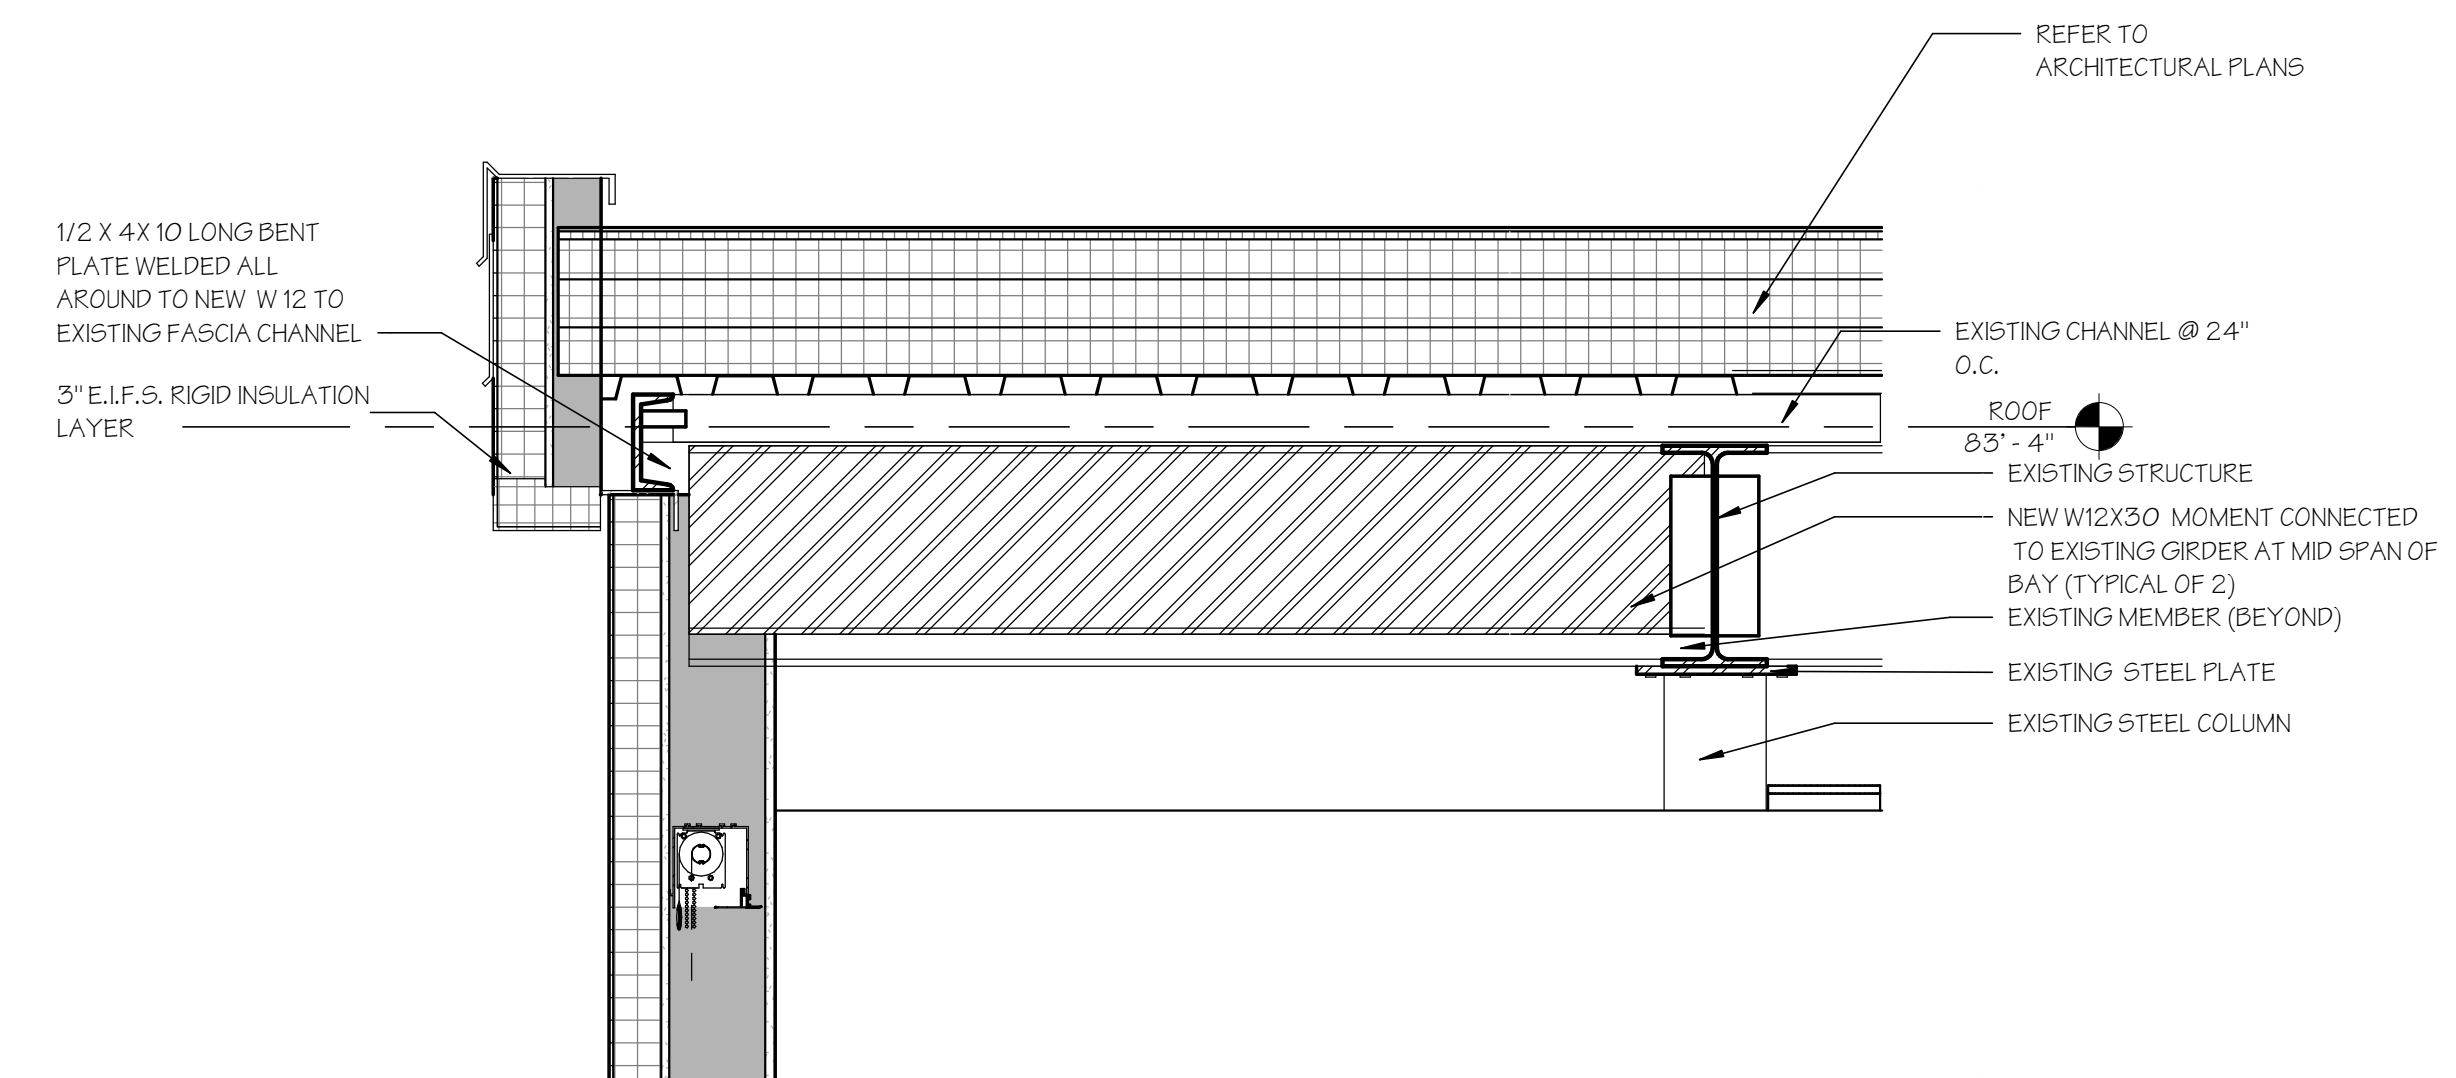

**S2** PENTHOUSE ROOF DETAIL  
SCALE: 1" = 1'-0"

**S1** FIFTH FLOOR FRAMING PLAN  
SCALE: 1/8" = 1'-0"



**ANTINOZZI ASSOCIATES**  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460  
www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:

**GENERAL DRAFTING & DESIGN, INC.**  
CONSULTING ENGINEERS  
140 Washington Avenue, 3rd Floor  
North Haven, Connecticut 06473  
P: 203.238.8276 F: 203.238.2276  
e: gdd@net.net

REVISIONS:

NO.	DATE	DESCRIPTION
1	08.21.19	REVISED FOR BULLETIN 02
2	03.30.20	REVISED FOR KITCHEN EQUIPMENT

**JOEL SMILOW CARE CENTER OF  
THE BRIDGEPORT RESCUE MISSION**  
INTERIOR RENOVATIONS  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT


**PARTIAL FIRST FLOOR PLAN - MECHANICAL**

SCALE: 1/8" = 1'-0"  
DRAWN BY: BIC  
REVIEWED BY: GDD

DRAWING NO. **M-5a**  
04.16.2020 - CM BID  
DATE: 07 MAY 2019  
GDD JOB NUMBER: 19469

**PLUMBING / KITCHEN GENERAL NOTES**


- PLUMBING CONTRACTOR SHALL OBTAIN CERTIFIED PRINTS OF ROUGHING DRAWINGS OF EQUIPMENT BEFORE STARTING WORK. IF ANY DISCREPANCIES EXIST BETWEEN THE PLUMBING DRAWINGS AND KITCHEN EQUIPMENT DRAWINGS, THE PLUMBING CONTRACTOR SHALL NOTIFY THE ENGINEER IMMEDIATELY.
- EXACT LOCATION OF ALL HOT, COLD, WASTE AND GAS PIPING SHALL BE DETERMINED FROM FINAL EQUIPMENT ROUGHING DRAWINGS AND SPECIFICATIONS.
- KITCHEN EQUIPMENT AS LISTED IN SCHEDULE SHALL BE FURNISHED AND SET BY GENERAL CONTRACTOR EXCEPT, PLUMBING CONTRACTOR SHALL INSTALL AND PIPE HAND SINK.
  - FAUCETS, SINK STRAINERS AND TAILPIECES SHALL BE PROVIDED BY GENERAL CONTRACTOR.
  - PLUMBING CONTRACTOR SHALL FURNISH AND INSTALL TRAPS, BACKFLOW PREVENTERS, SHOCK ABSORBERS, GAS COCKS, GAS REGULATORS AND STOP VALVES AND INSTALL FAUCETS AND TAILPIECES AND CONNECT TO PLUMBING SERVICES AS REQUIRED.
  - PLUMBING CONTRACTOR SHALL MAKE ALL INTERCONNECTIONS BETWEEN KITCHEN EQUIPMENT AND BETWEEN COMPONENTS OF KITCHEN EQUIPMENT.
  - PLUMBING CONTRACTOR SHALL PROVIDE AND INSTALL STOP VALVES AT EVERY FIXTURE.
  - 'P' TRAPS ARE REQUIRED ON ALL SINKS. TRAPS ARE NOT REQUIRED ON INDIRECT WASTES.
  - PLUMBING CONTRACTOR SHALL FORM A GAS SERVICE LINE LOOP WHEN SEVERAL PIECES OF COOKING EQUIPMENT ARE SUPPLIED BY MANIFOLD CONNECTION.
- PLUMBER SHALL USE COPPER PIPING FOR HAND SINK WASTE PIPING. PVC WILL NOT BE ALLOWED.
- PLUMBER SHALL RUN ALL INDIRECT WASTE LINES FROM EQUIPMENT TO FLOOR DRAINS SIZES AND EQUIPMENT SHALL BE DETERMINED FROM EQUIPMENT SCHEDULE. EXACT LOCATION SHALL BE DETERMINED FROM FINAL KITCHEN EQUIPMENT ROUGHING DRAWINGS. INDIRECT WASTE LINES SHALL BE TYPE 'L' COPPER TUBING. INDIRECT WASTE LINES SHALL DISCHARGE OVER FLOOR DRAIN THROUGH A 90 DEGREE ELBOW WITH AIR GAP BETWEEN OUTLET OF ELBOW AND TOP OF FLOOR DRAIN AS REQUIRED BY CODE. CUT INDIRECT WASTE PIPES AT 45 DEGREE ANGLE TO MINIMIZE SPLASH.

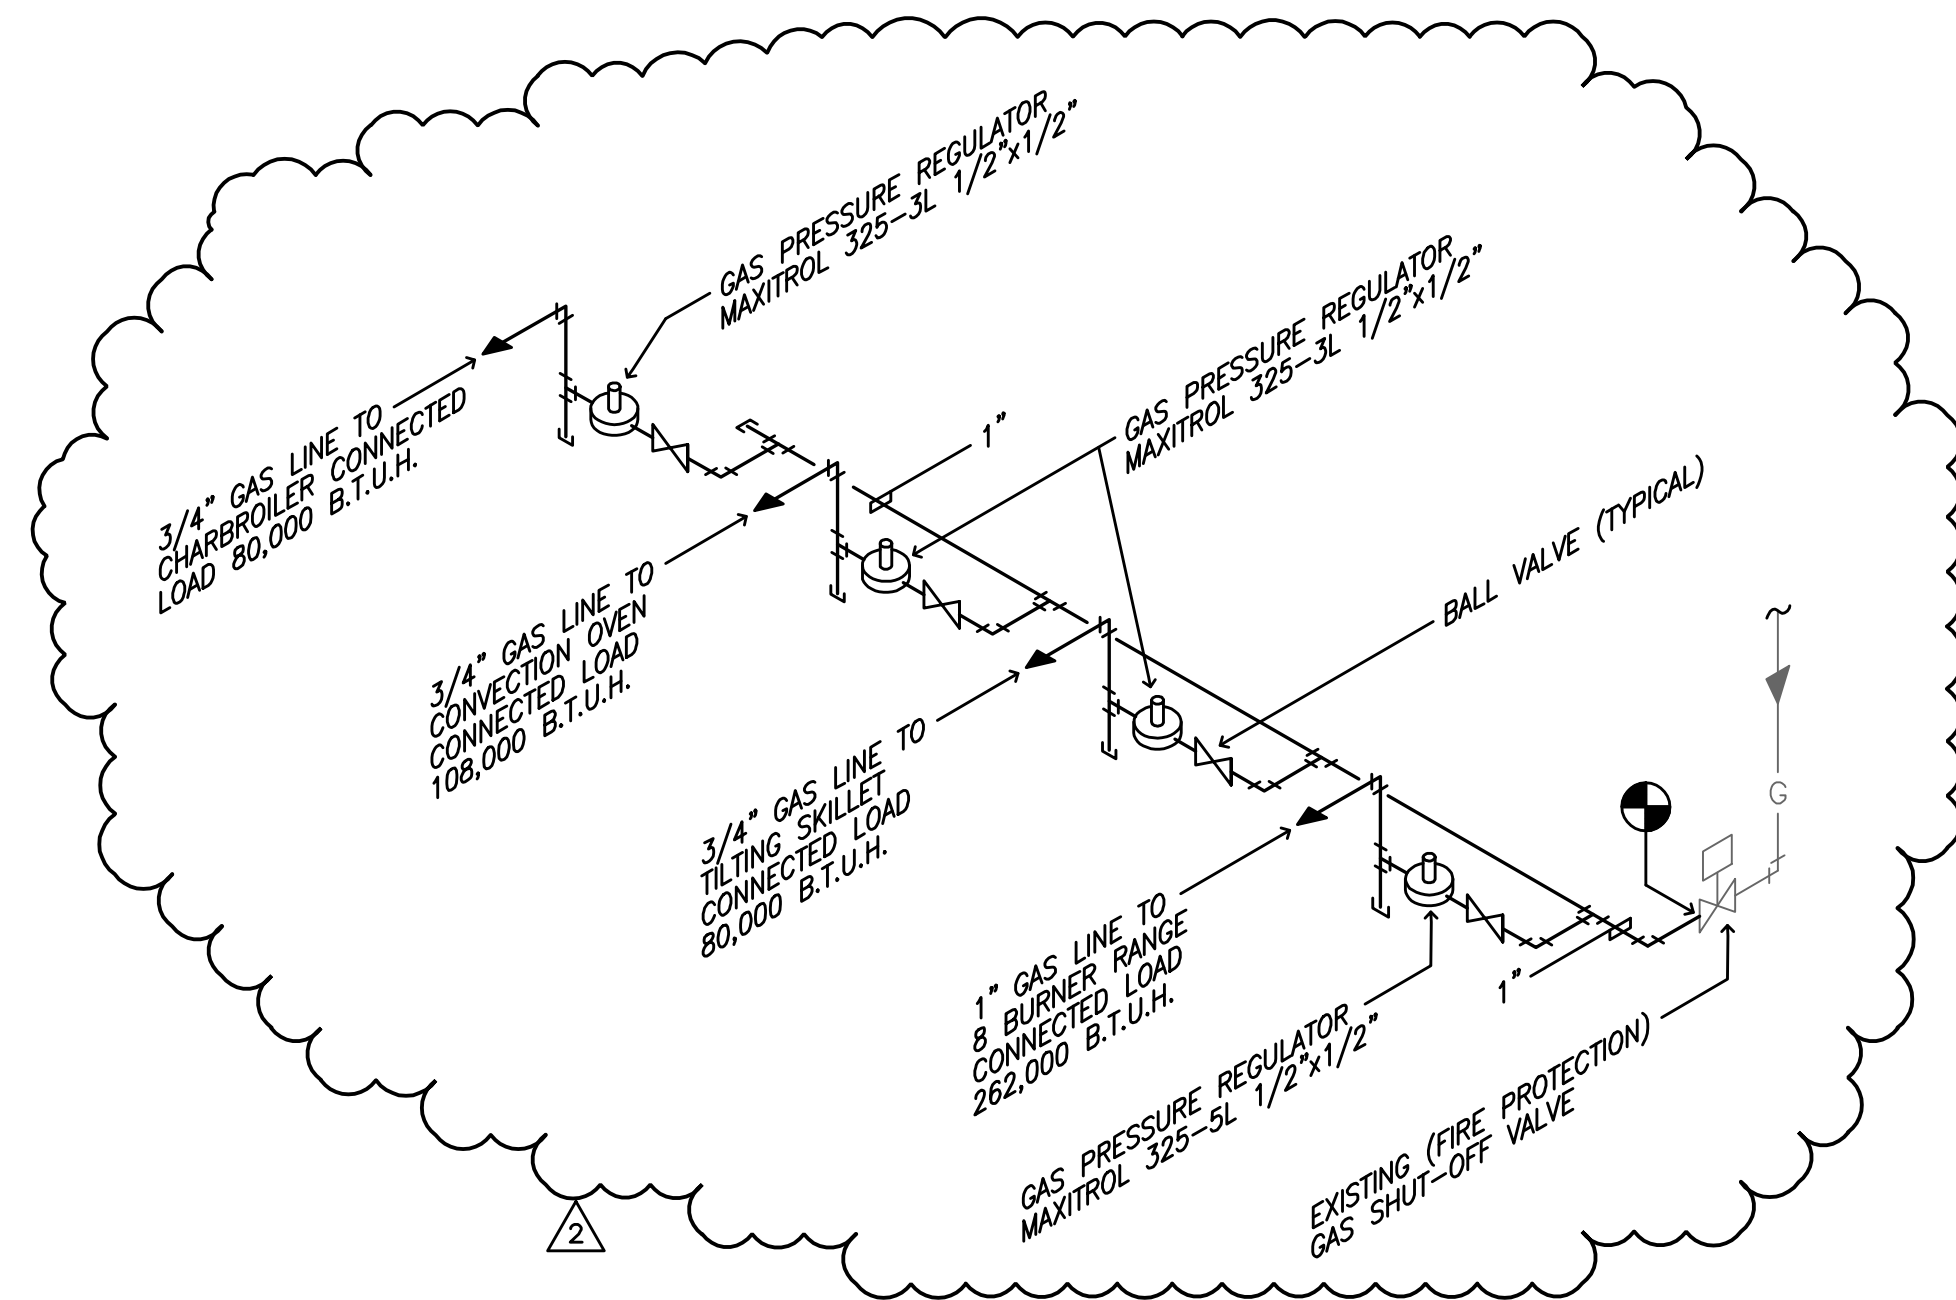

**NEW GAS PIPING BELOW KITCHEN HOOD**  
N.T.S.

NOTE: GAS PRESSURE REGULATORS SHALL BE SET FOR 2 P.S.I. INLET PRESSURE AND 10" W.C. OUTLET PRESSURE. REGULATORS SHALL BE COMPLETE WITH VENT LIMITING DEVICE.

EQUIPMENT SCHEDULE									
ITEM	DESCRIPTION	QUANTITY	HOT WATER	COLD WATER	WASTE	I.D. WASTE	GAS	B.T.U.'S	REMARKS
8	ICE MACHINE	1		1/2" WITH ARCTIC PURE FILTER		(2) 3/4"			3/4" I.D. CONDENSATE DRAIN AND 3/4" BIN DRAIN. OPEN-END OVER FLOOR DRAIN
9	HAND SINK	1	1/2"	1/2"	1-1/2"				WITH FAUCET AND DRAIN 115°F. HOT WATER
18	GREASE INTERCEPTOR	1			2"				PLUMBING CONTRACTOR ROUGH AND CONNECT ONLY
19	CONVECTION OVEN	1					3/4"	108,000	NATURAL GAS WITH INDIVIDUAL SHUT-OFF VALVE.
19A	CHARBROILER	1					3/4"	80,000	NATURAL GAS WITH INDIVIDUAL SHUT-OFF VALVE.
21	TILTING SKILLET	1					3/4"	80,000	NATURAL GAS WITH INDIVIDUAL SHUT-OFF VALVE.
22	8-BURNER RANGE	1					1"	262,000	NATURAL GAS WITH INDIVIDUAL SHUT-OFF VALVE.
23	EXISTING S.S. WORK TABLE WITH SINK	1	1/2"	1/2"	1-1/2"				DISCONNECT AND RECONNECT IN NEW LOCATION
26	GREASE INTERCEPTOR	1			2"				PLUMBING CONTRACTOR ROUGH AND CONNECT ONLY

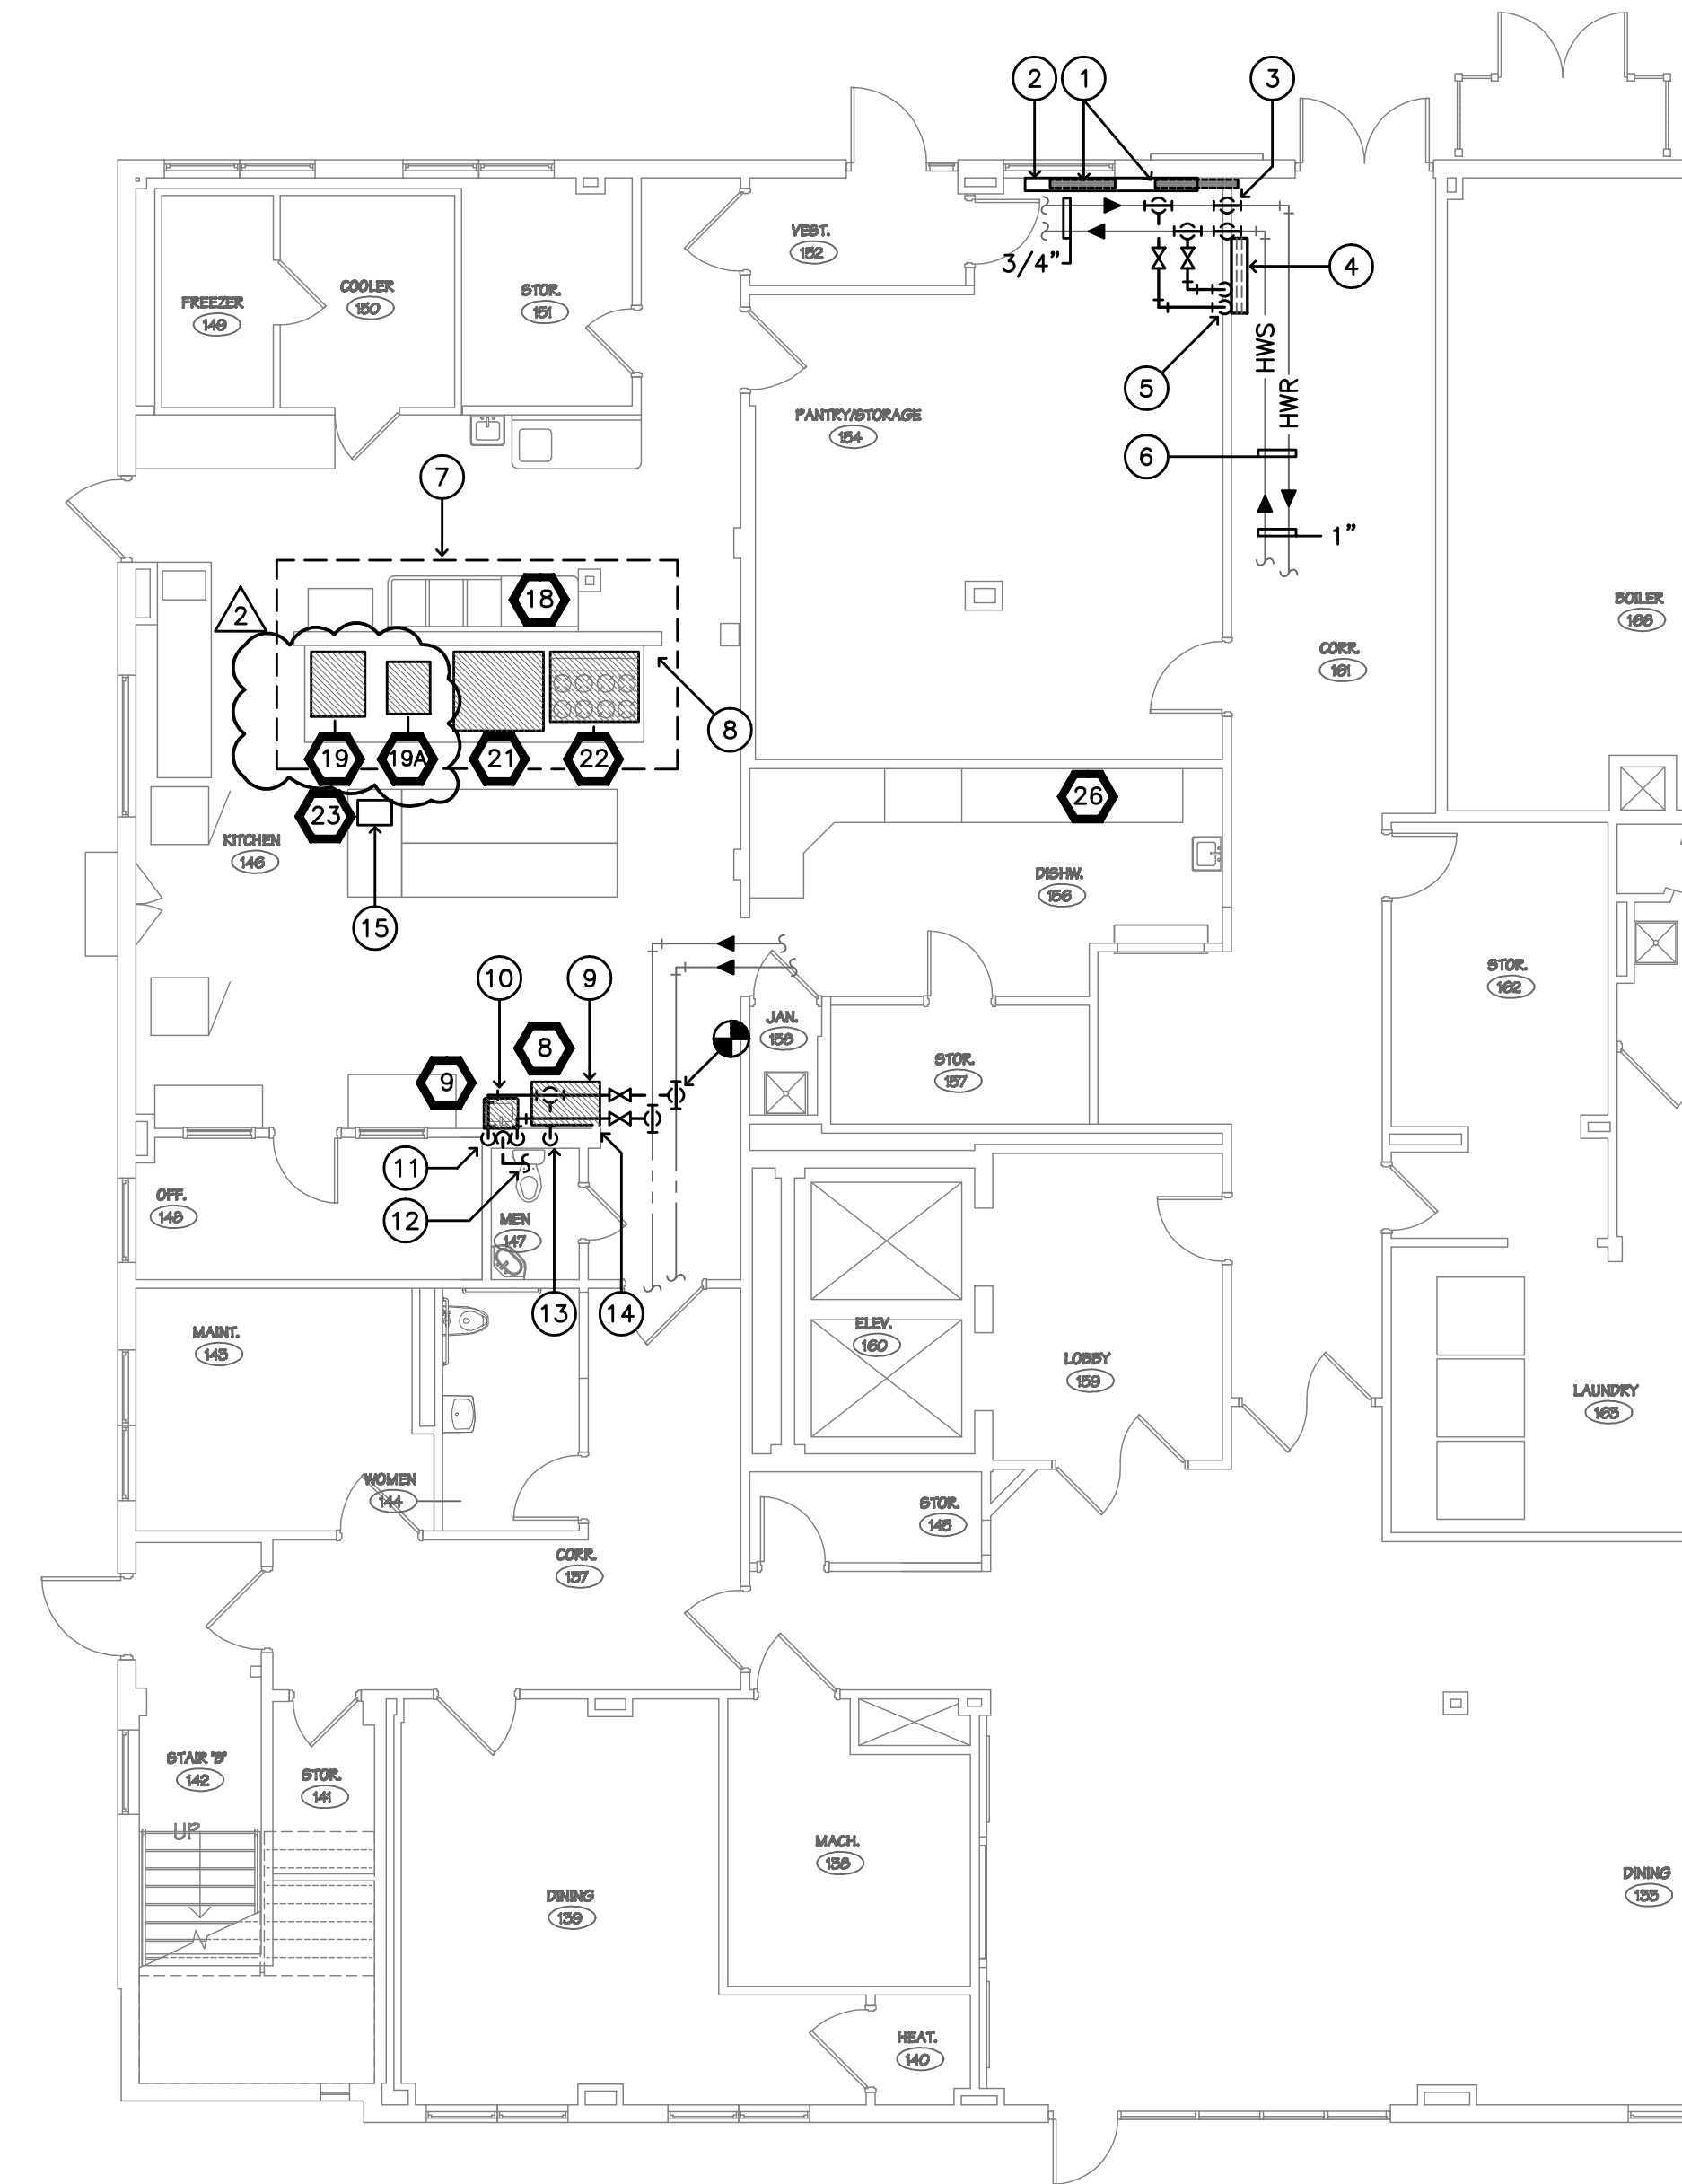

**PARTIAL FIRST FLOOR PLAN - MECHANICAL**  
SCALE: 1/8" = 1'-0"

**LEGEND**

- EXISTING RADIATION (2 SECTIONS) TO BE REMOVED AND DISCARDED.
- PROVIDE NEW 8'-0" SECTION OF HEAVY DUTY, HIGH OUTPUT BASEBOARD RADIATION EQUAL TO "SLANT FIN" MULTI-PAK 80 MODEL B3-A2 BASEBOARD WITH H-3 ELEMENT IN 80 ENCLOSURE. RADIATION SHALL BE COMPLETE WITH SUPPORT ACCESSORIES AND END CAPS.
- NEW 3/4" HOT WATER SUPPLY AND RETURN PIPING DOWN TO RADIATION.
- NEW "MODINE" HOT WATER CABINET UNIT HEATER FLOOR MOUNTED MODEL-C (SIZE 006) 620 C.F.M. WITH INLET AND OUTLET ARRANGEMENT - 08.
- 3/4" HOT WATER SUPPLY AND RETURN PIPING DOWN TO NEW CABINET UNIT HEATER.
- NEW 1" HOT WATER SUPPLY AND RETURN PIPING ABOVE CEILING. ORIGINAL 3/4" PIPE SIZE AS SHOWN ON CONTRACT DOCUMENTS TO BE INCREASED TO 1".
- FOR NEW GAS PIPING ARRANGEMENT FOR EQUIPMENT BELOW THE HOOD SEE GAS PIPING DETAIL.
- EXISTING 2" GAS FEED TO KITCHEN EQUIPMENT.
- NEW ICE MACHINE, PIPE 1/2" COLD WATER THROUGH A BALL VALVE SHUT-OFF, BACKFLOW PREVENTER AND ARCTIC PURE WATER FILTER (SEE EQUIPMENT CUTS).
- NEW HAND SINK, 1/2" HOT AND COLD WATER, 1-1/2" WASTE AND VENT.
- 1/2" HOT AND COLD WATER DOWN TO HAND SINK, 1-1/2" VENT UP. CONNECT WASTE PIPING TO EXISTING BELOW FLOOR.
- CONNECT NEW 1-1/2" VENT TO EXISTING ABOVE CEILING.
- 1/2" COLD WATER DOWN TO NEW ICE MACHINE. ALSO SEE CIRCLE NOTE 9 ABOVE.
- REMOVE EXISTING EXPOSED COLD WATER FEED TO EXISTING ICE MACHINE AND CAP BACK AT ACTIVE MAIN.
- EXISTING RELOCATED COUNTER AND SINK UNIT. PLUMBER TO DISCONNECT AND RECONNECT IN FULL OPERATING ORDER IN NEW LOCATION.

NEW DRAWING



**ANTINOZZI ASSOCIATES**  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:

**GENERAL DRAFTING & DESIGN, INC.**  
CONSULTING ENGINEERS  
140 Washington Avenue, 3rd Floor  
North Haven, Connecticut 06473  
P. 203.239.8175 F. 203.239.8275  
GDD@GDDNET.COM


REVISION	DATE	DESCRIPTION
1	02.21.20	FAN COIL UNIT AND PLUMBING FIXTURE REVISIONS
2	04.16.20	DRAWING REVISION

**JOEL SMILOW CARE CENTER**  
**BRIDGEPORT RESCUE MISSION**  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
**SECOND FLOOR PLAN - PLUMBING**

SCALE: 1/8"=1'-0"  
DRAWN BY: BJC  
REVIEWED BY: GDD

DRAWING NO:  
**M-8**  
04.16.2020 - CM BID  
DATE: 05 MARCH 2020  
GDD JOB NUMBER: 19469

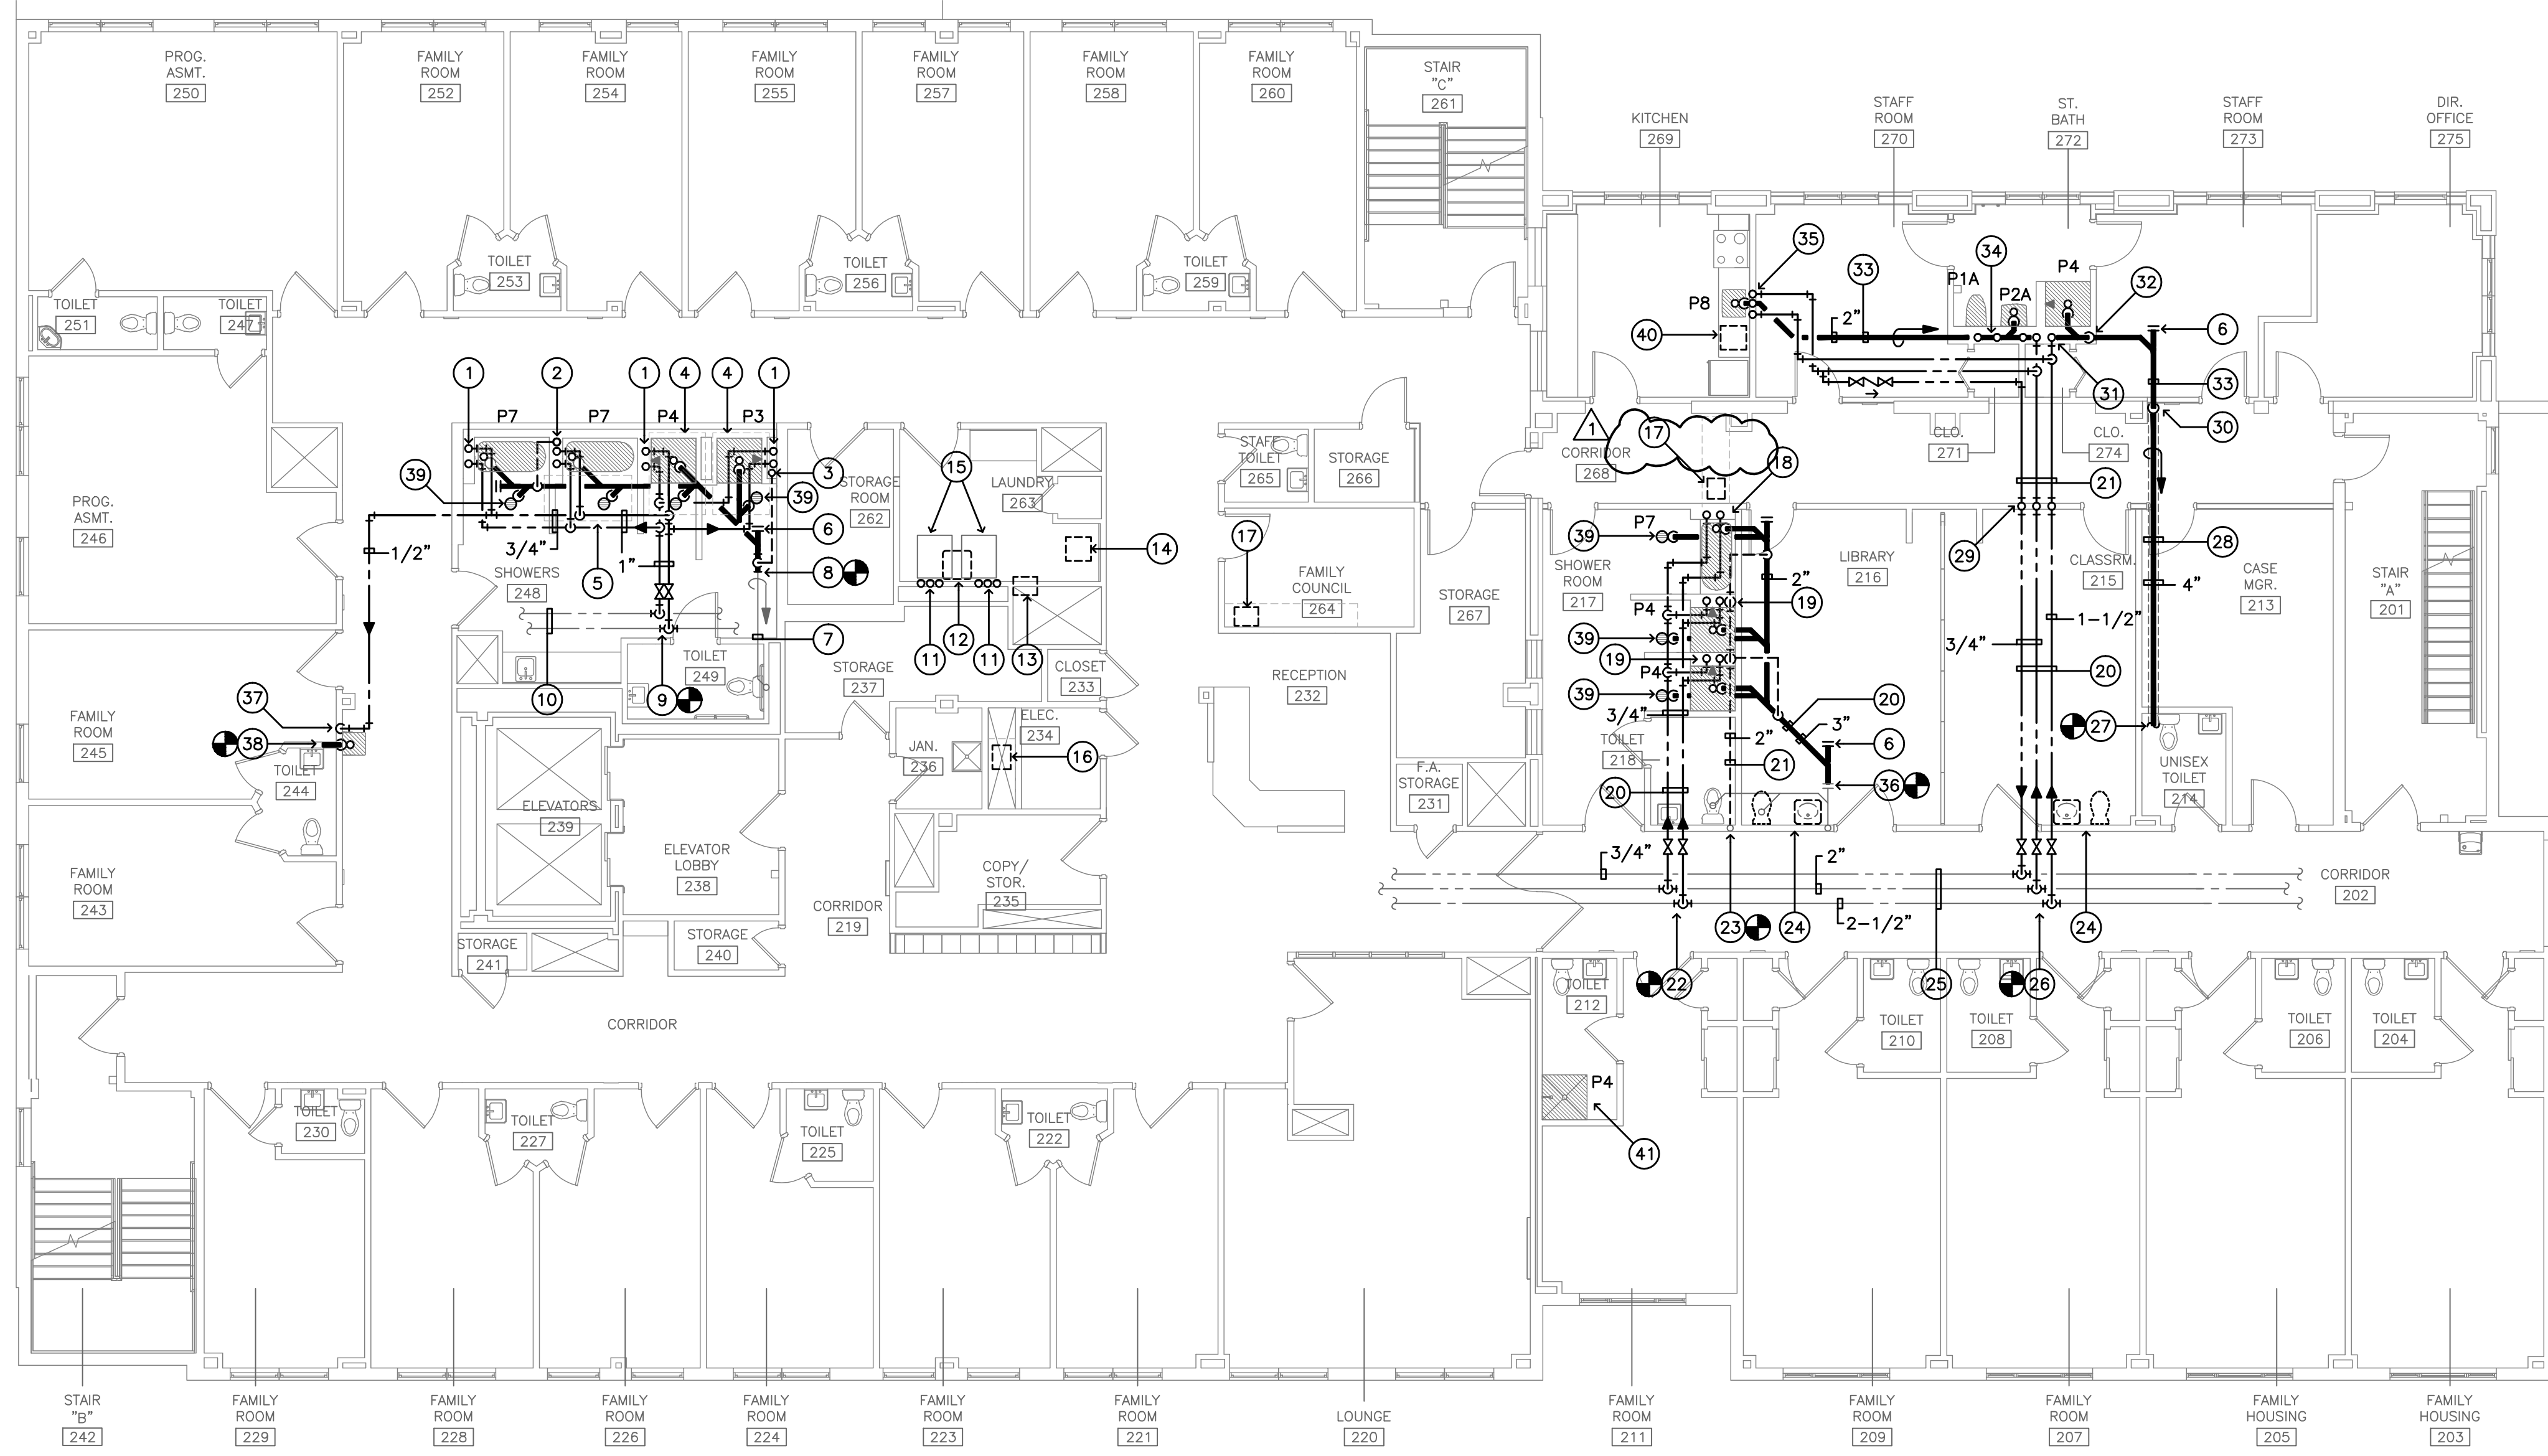

**SECOND FLOOR PLAN - PLUMBING**

SCALE: 1/8" = 1'-0"



**LEGEND**

- 1) 1/2" HOT AND COLD WATER DOWN AND 1/2" HOT AND COLD WATER UP.
- 2) 2" VENT UP IN CHASE TO THIRD FLOOR AND 1/2" HOT AND COLD WATER UP AND DOWN.
- 3) 2" VENT UP IN CHASE.
- 4) EXISTING (ROLL-IN) SHOWER STALLS TO BE REMOVED, REMOVE SHOWER HEAD, SHOWER VALVE, FLOOR DRAINS AND ACCESSORIES, REMOVE EXISTING HOT, COLD AND WASTE PIPING. NEW SHOWER STALLS AND BATHTUBS TO BE SUPPLIED FROM NEW MAINS.
- 5) REMOVE EXISTING HYDROTHERAPY BATHTUB, LIFT AND ALL ACCESSORIES. REMOVE EXISTING HOT, COLD AND WASTE PIPING.
- 6) CLEANOUT.
- 7) APPROXIMATE LOCATION OF EXISTING 3" WASTE LINE ABOVE FIRST FLOOR CEILING.
- 8) CONNECT NEW 3" WASTE LINE TO EXISTING 3" WASTE LINE ABOVE FIRST FLOOR CEILING.
- 9) CONNECT NEW 1" HOT AND COLD WATER PIPING TO EXISTING ABOVE SECOND FLOOR CEILING.
- 10) APPROXIMATE LOCATION OF EXISTING 1" HOT AND COLD WATER ABOVE CEILING.
- 11) 1/2" HOT AND COLD WATER AND 2" X 24" STANDPIPE WITH TRAP BEHIND CLOTHES WASHER AND 1-1/2" VENT. PROVIDE AND INSTALL (ACCESSIBLE) BEHIND WASHER A RECESSED WASHING MACHINE VALVE AND DRAIN FIXTURE EQUAL TO SYMMONS "LAUNDRY-MATE" MODEL #602. CONNECT TO EXISTING SERVICES FROM REMOVED FLUSHING RIM SERVICE SINK, MODIFY AS REQUIRED.
- 12) REMOVE EXISTING FLUSHING RIM SERVICE SINK, FAUCET, FLUSH VALVE AND ACCESSORIES. MODIFY EXISTING SERVICES FOR CONNECTION TO NEW CLOTHES WASHERS.
- 13) REMOVE EXISTING BEDPAN WASHER/SANITIZER AND ASSOCIATED PIPING.
- 14) REMOVE EXISTING HOT WATER BOOSTER (BELOW COUNTER) AND ASSOCIATED PIPING.
- 15) NEW STACKED WASHERS/DRYERS OWNERS EQUIPMENT, PLUMBING CONTRACTOR SHALL ROUGH FOR AND CONNECT ONLY.
- 16) EXISTING COUNTER SINK PREVIOUSLY REMOVED.
- 17) REMOVE EXISTING COUNTER SINK, FAUCET, ACCESSORIES AND ALL ASSOCIATED HOT, COLD, WASTE AND VENT PIPING.
- 18) 1/2" HOT AND COLD WATER UP TO BATHTUB/SHOWER AND 2" WASTE.
- 19) 2" VENT AND 1-1/2" HOT AND COLD WATER UP IN CHASE.
- 20) ABOVE FIRST FLOOR SUSPENDED CEILING.
- 21) RUN ABOVE SECOND FLOOR SUSPENDED CEILING.
- 22) CONNECT NEW 3/4" HOT AND COLD WATER TO EXISTING 2" HOT AND 2-1/2" COLD WATER MAINS ABOVE FIRST FLOOR SUSPENDED CEILING, VALVE NEW CONNECTIONS.
- 23) CONNECT NEW 2" VENT TO EXISTING VENT STACK.
- 24) REMOVE EXISTING WATER CLOSET AND WALL HUNG LAVATORY, REMOVE ALL ASSOCIATED HOT, COLD AND SOIL/WASTE PIPING. CAP EXISTING BRANCH SERVICES BACK AT ACTIVE MAINS.
- 25) APPROXIMATE LOCATION OF EXISTING 2" HOT, 2-1/2" COLD AND 3/4" RECIRC. HOT WATER PIPING ABOVE FIRST FLOOR SUSPENDED CEILING.
- 26) CONNECT NEW 3/4" HOT, 1-1/2" COLD AND 3/4" RECIRC. HOT WATER TO EXISTING MAINS ABOVE FIRST FLOOR SUSPENDED CEILING, VALVE NEW CONNECTIONS.
- 27) CONNECT NEW 4" SANITARY TO EXISTING AT FIRST FLOOR MEN'S TOILET ROOM #109.
- 28) NEW 4" SANITARY PIPING BELOW FIRST FLOOR CONCRETE SLAB. SHOWN ON THIS SHEET FOR CLARITY.
- 29) 3/4" HOT, 1-1/2" COLD AND 3/4" RECIRC. HOT WATER UP TO ABOVE SECOND FLOOR CEILING IN NEW PARTITION.
- 30) 4" SANITARY DOWN IN CORNER TO BELOW FIRST FLOOR CONCRETE SLAB. VERTICAL PIPING TO BE BOXED-IN.
- 31) 1/2" HOT AND 1-1/2" COLD WATER UP AND DOWN.
- 32) 4" SANITARY DOWN AND 2" VENT UP.
- 33) RUN ABOVE FIRST FLOOR CEILING AND ABOVE BUILDING INSULATION OF EXTERIOR OVERHANG.
- 34) 4" SANITARY STACK AND 2" VENT STACK.
- 35) 1/2" HOT AND COLD WATER UP AND DOWN, 2" WASTE STACK AND 1-1/2" VENT UP.
- 36) CONNECT NEW 3" WASTE PIPING TO EXISTING 3" PIPING ABOVE FIRST FLOOR SUSPENDED CEILING.
- 37) 1/2" COLD WATER DOWN TO NEW WATER COOLER.
- 38) CONNECT NEW 1-1/2" WASTE AND VENT PIPING TO EXISTING LAVATORY WASTE PIPING IN PARTITION, MODIFY PIPING AS REQUIRED.
- 39) 2" FLOOR DRAIN (IN DRYING AREA) TYPICAL FOR ALL NEW BATHTUBS AND/OR SHOWERS. ALL FLOOR DRAIN WILL BE PROTECTED BY "SURE SEAL" TRAP SEALER.
- 40) UNDER COUNTER DISHWASHER, 1/2" HOT WATER CONNECT TO SINK RISER AND FLEX WASTE TO DISHWASHER TAIL PIECE AT ADJACENT SINK. VALVE HOT WATER TO DISHWASHER INDEPENDENTLY BELOW COUNTER.
- 41) FOR ADDITIONAL INFORMATION ON SHOWER STALL SEE DRAWING M-9.

SYMBOL	FIXTURE TYPE	FIXTURE SPECIFICATIONS	COMMENTS
P1	WATER CLOSET ADA ACCESSIBLE	WATER CLOSET SHALL BE "KOHLER" KINGSTON MODEL #K-4325, ADA WALL HUNG VITREOUS CHINA, WITH ELONGATED BOWL AND WHITE KOHLER STRONGHOLD COMMERCIAL TOILET SEAT #K-4731-C. FLUSH VALVE SHALL BE SLOAN ROYAL MODEL #111-1.28. CARRIER SHALL BE ZURN ADJUSTABLE VERTICAL MODEL #1200 SERIES.	WALL HUNG SET AT PROPER HEIGHT FOR ADA
P1A	WATER CLOSET REGULAR	WATER CLOSET AND ACCESSORIES SHALL BE THE SAME AS NOTED ABOVE EXCEPT MOUNT AT STANDARD FIXTURE HEIGHT.	MOUNT FIXTURE AT STANDARD HEIGHT
P2	LAVATORY ADA ACCESSIBLE	LAVATORY SHALL BE KOHLER "GREENWICH" VITREOUS CHINA #K-2032 20" X 18" WALL MOUNTED WITH 4" FAUCET CENTERS. FAUCET SHALL BE "SYMMONS" SYMMETREX #S-20-C-FR-VP-W. SUPPLIES SHALL BE #K-7807. TRAP SHALL BE #K-9000. LAVATORY REQUIRES OFF-SET DRAIN NUMBER K-1388. INSURE TRAP AND SUPPLIES BELOW LAVATORY WITH "HAND LAV-GUARD" PRE-FORMED INSULATING KIT AS MANUFACTURED BY TRU BRO, INC. SET LAV AT PROPER HEIGHT FOR HANDICAPPED. LAVATORY SHALL BE SUPPORTED ON PROPER BLOCKING IN WALL.	MOUNT FIXTURE AT PROPER HEIGHT FOR ADA
P2A	LAVATORY REGULAR	LAVATORY AND ACCESSORIES SHALL BE THE SAME AS NOTED ABOVE EXCEPT DELETE OFF-SET DRAIN AND PRE-FORMED INSULATING KIT.	MOUNT AT STANDARD FIXTURE HEIGHT
P3	SHOWER STALL ADA ACCESSIBLE	SHOWER STALLS SHALL BE PREFABRICATED MODULES AS MANUFACTURED BY STERLING PLUMBING GROUP, INC. UNIT SHALL BE MADE OF SOLID "VIRELL" COMPRESSION MOLDED FIBERGLAS REINFORCED RESIN. MODULES SHALL BE MADE UP OF FOUR (4) PIECE SHOWER STALLS. FINISH SHALL BE HIGH GLOSS COLOR SHALL BE SELECTED BY ARCHITECT. SHOWER STALL SHALL BE MODEL #6250015ADA, 39-3/8"X39-3/8"X72" RIGHT OR LEFT HAND AS REQUIRED. SHOWER ASSEMBLY SHALL BE "SYMMONS" TEMPROLL #96-500-B30-L-VX PRESSURE-BALANCING MIXING VALVE WITH INTEGRAL STOPS. SINGLE BLADE HANDLE AND ADJUSTABLE STOP SCREW TO LIMIT HANDLE TURN. LEVERTOL 4-458 DIVERTER, SHOWER HEAD WITH ARM AND FLANGE. SHOWER HEAD MUST HAVE 1.5 G.P.M. FLOW RESTRICTOR. WALL/HAND SHOWER WITH FLEXIBLE METAL HOSE, IN-LINE VACUUM BREAKER, 30" SLIDE BAR FOR HAND SHOWER MOUNTING. PROVIDE FACTORY INSTALLED STAINLESS STEEL GRAB BARS AND FOLDING SEAT. NOTE RIGHT OR LEFT HAND UNIT REQUIREMENTS INDICATED ON DRAWINGS. SHOWER UNIT MUST BE SET IN A MUD BASE AND EVENLY SUPPORTED FOR ITS ENTIRE LENGTH AND WIDTH FOR PROPER INSTALLATION.	STERLING IS A "KOHLER" CO.
P4	SHOWER STALL	SHOWER STALLS SHALL BE PREFABRICATED MODULES AS MANUFACTURED BY STERLING PLUMBING GROUP, INC. UNIT SHALL BE MADE OF SOLID "VIRELL" COMPRESSION MOLDED FIBERGLAS REINFORCED RESIN. MODULES SHALL BE MADE UP OF FOUR (4) PIECE SHOWER STALLS. FINISH SHALL BE HIGH GLOSS COLOR SHALL BE SELECTED BY ARCHITECT. SHOWER STALL SHALL BE MODEL #6200100, 36"X34"X73.25" RIGHT OR LEFT HAND AS REQUIRED. SHOWER ASSEMBLY SHALL BE "SYMMONS" TEMPROLL #96-1-X1 PRESSURE-BALANCING MIXING VALVE WITH INTEGRAL STOPS. SINGLE BLADE HANDLE AND ADJUSTABLE STOP SCREW TO LIMIT HANDLE TURN. LEVERTOL 4-458 DIVERTER, SHOWER HEAD WITH ARM AND FLANGE. SHOWER HEAD MUST HAVE 1.5 G.P.M. FLOW RESTRICTOR. SHOWER UNIT MUST BE SET IN A MUD BASE AND EVENLY SUPPORTED FOR ITS ENTIRE LENGTH AND WIDTH FOR PROPER INSTALLATION.	STERLING IS A "KOHLER" CO.
P5	FLOOR RECEPTOR	FLOOR RECEPTOR SHALL BE FLAT MOLDED STONE MOP SERVICE BASIN #MSB 2424, 24" X 24" X 10", #830-AA SERVICE FAUCET WITH INTEGRAL VACUUM BREAKER, #889-CC MOP HANGER, #E-88-AA BUMPER GUARD, #832-AA HOSE AND HOSE BRACKET.	FAUCET CONTAINS VACUUM BREAKER
P6	HAND WASHING LAVATORY	LAVATORY SHALL BE KOHLER "GREENWICH" VITREOUS CHINA #K-2032 20" X 18" WALL MOUNTED WITH 4" FAUCET CENTERS. FAUCET SHALL BE "ELKAY" MODEL #JK406GN00SL2 GOOSENECK FAUCET WITH LEVER HANDLES, PROVIDE SEMI-CAST TRAP AND FLEX RISERS. LAVATORY SHALL BE SUPPORTED ON PROPER BLOCKING IN WALL.	STANDARD LAVATORY
P7	BATHTUB/SHOWER	BATHTUB UNIT SHALL BE PREFABRICATED MODULES AS MANUFACTURED BY STERLING PLUMBING GROUP, INC. UNIT SHALL BE MADE OF SOLID "VIRELL" COMPRESSION MOLDED FIBERGLAS REINFORCED RESIN. MODULES SHALL BE MADE UP OF FOUR (4) PIECE TUB AND WALLS. FINISH SHALL BE HIGH GLOSS COLOR SHALL BE SELECTED BY ARCHITECT. BATHTUB UNIT SHALL BE MODEL #71220211/12 (ABOVE FLOOR ROUGH) 60"X30"X72". RIGHT OR LEFT HAND AS REQUIRED. SHOWER BATH ASSEMBLY SHALL BE "SYMMONS" TEMPROLL #96-600-B30-L-VX PRESSURE-BALANCING MIXING VALVE WITH INTEGRAL STOPS. SINGLE BLADE HANDLE AND ADJUSTABLE STOP SCREW TO LIMIT HANDLE TURN. LEVERTOL 4-458 DIVERTER, SHOWER HEAD WITH ARM AND FLANGE. SHOWER HEAD MUST HAVE 1.5 G.P.M. FLOW RESTRICTOR. WALL/HAND SHOWER WITH FLEXIBLE METAL HOSE, IN-LINE VACUUM BREAKER, 30" SLIDE BAR FOR HAND SHOWER MOUNTING. PROVIDE FACTORY INSTALLED STAINLESS STEEL GRAB BARS.	4 PIECE BATH/SHOWER ENSEMBLE
P8	COUNTER SINK ADA ACCESSIBLE	COUNTER SINKS - STAINLESS STEEL COUNTER MOUNTED SELF-RIMMING WITH 3-HOLE INSTALLATION, 18 GAUGE ELKAY LUSTERTONE MODEL #LRAD 2521 6-1/2" DEEP, WITH STAINLESS STEEL GRID STRAINER, CHROME PLATED TRAP WITH SLIP-JOINT INLET AND WALL FLANGE. SUPPLIES SHALL BE FLEX RISERS WITH STOPS. FAUCET SHALL BE DELTA #120 SINGLE HANDLE (NO SPRAY) WITH 1.8 GPM V.R. AERATOR.	ADA ACCESSIBLE 3-HOLE INSTALLATION
P9	ELECTRIC WATER COOLER	WATER COOLER SHALL BE EQUAL TO "ELKAY" MODEL #LZ58WSP WITH BOTTLE FILLING STATION WITH FILTERED WATER. UNIT SHALL BE WIRED FOR 120V, 1PH AND BE CAPABLE OF 8 GPH OF 50°F. CHILLED DRINKING WATER.	BARRIER FREE AND LEAD-FREE DESIGN
P10	ELECTRIC WATER COOLER ADA ACCESSIBLE	WATER COOLER SHALL BE EQUAL TO "ELKAY" MODEL #LZ58 UNIT SHALL BE WIRED FOR 120V, 1PH AND BE CAPABLE OF 8 GPH OF 50°F. CHILLED DRINKING WATER.	CONNECT NEW WATER COOLER TO EXISTING SERVICES.
P11	LAVATORY CORNER DESIGN	LAVATORY SHALL BE "KOHLER" MARSTON MODEL # K-2766 WITH FACTORY INSTALLED TRITON FAUCET. ACCESSORIES SHALL BE THE SAME AS NOTED ABOVE (P2) EXCEPT DELETE OFF-SET DRAIN AND PRE-FORMED INSULATING KIT.	MOUNT AT STANDARD FIXTURE HEIGHT

- FIXTURE NOTES:**
- INCLUDED SHALL BE PLUMBING FIXTURES NOTED, ALL TRIM ITEMS AND ALL ACCESSORY ITEMS SHOWN OR REQUIRED FOR A COMPLETE INSTALLATION. UNLESS NOTED OTHERWISE.
  - THE FIXTURES SHALL BE COMPLETE WITH CHROME PLATING ON EXPOSED IRON OR PIPE, TRAPS, ANCHOR BOLTS, HANGERS, STRAINERS, LOOSE KEY STOP VALVES AT EVERY FIXTURE, FAUCET AND OTHER INCIDENTAL ITEMS FURNISHED AS STANDARD.
  - ALL FIXTURES ARE TO BE FIRST QUALITY, FREE OF CRACKS, BLEMISHES, OR OTHER IMPERFECTIONS AND TO BE "ACID RESISTING" QUALITY. SET AND PROPERLY CONNECT ALL FIXTURES WITH HOT AND COLD WATER, VENT AND DRAINAGE PIPING AND OTHER SERVICES AS REQUIRED AND PROTECT FIXTURES UNTIL FINAL ACCEPTANCE AND TEST.
  - THE PLUMBING CONTRACTOR SHALL FURNISH, SET AND CONNECT ALL FIXTURES AND ACCESSORIES SHOWN AND SPECIFIED TO FULLY COMPLETE THE PLUMBING INSTALLATION.

NOTE: PLUMBING FIXTURES TYPES ARE THE SAME AS NOTED IN PHASE 1 EXCEPT: P1A, P2A, P7, P8, P9 & P10 ARE NEW.

**PLUMBING SYMBOLS**

---	NEW COLD WATER LINE
---	HOT WATER LINE
---	RECIRC. HOT WATER LINE
---	VENT LINE
---	PIPING TO BE REMOVED
G	NATURAL GAS LINE
---	PITCH DIRECTION DOWN
---	SANITARY LINE
---	SANITARY LINE (BELOW FLOOR)
○	POINT OF CONNECTION
○	BALL VALVE
○	UNION
→	FLOW DIRECTION
□	NEW PLUMBING FIXTURE

**MECHANICAL DRAWING LIST - PHASE 2**


M-8	SECOND FLOOR PLAN - PLUMBING
M-9	SECOND, THIRD & FOURTH FLOOR PLANS - PLUMBING
M-10	SECOND FLOOR PLAN - HVAC
M-11	THIRD FLOOR PLAN - HVAC
M-12	FOURTH FLOOR PLAN - HVAC
M-13	ROOF AND FIFTH FLOOR PLAN - PLUMBING, HVAC & FIRE PROTECTION
M-14	REFRIGERANT RISER DIAGRAM
M-15	MECHANICAL SPECIFICATIONS
M-16	SECOND FLOOR PLAN - FIRE PROTECTION
M-17	THIRD FLOOR PLAN - FIRE PROTECTION
M-18	FOURTH FLOOR PLAN - FIRE PROTECTION





These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:

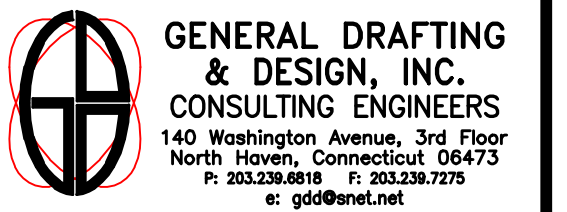

REVISION	DATE	DESCRIPTION
△	02.21.20	FAN COIL UNIT AND PLUMBING FIXTURE REVISIONS
△	04.16.20	DRAWING REVISION

**JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION**  
**PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION**  
**725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT**

**SECOND, THIRD & FOURTH FLOOR PLANS  
PLUMBING**


SCALE	DRAWN BY	REVIEWED BY
AS NOTED	BIC	GDD

DRAWING NO.


**M-9**

04.16.2020 - CM BID


DATE	GDD JOB NUMBER
05 MARCH 2020	19469

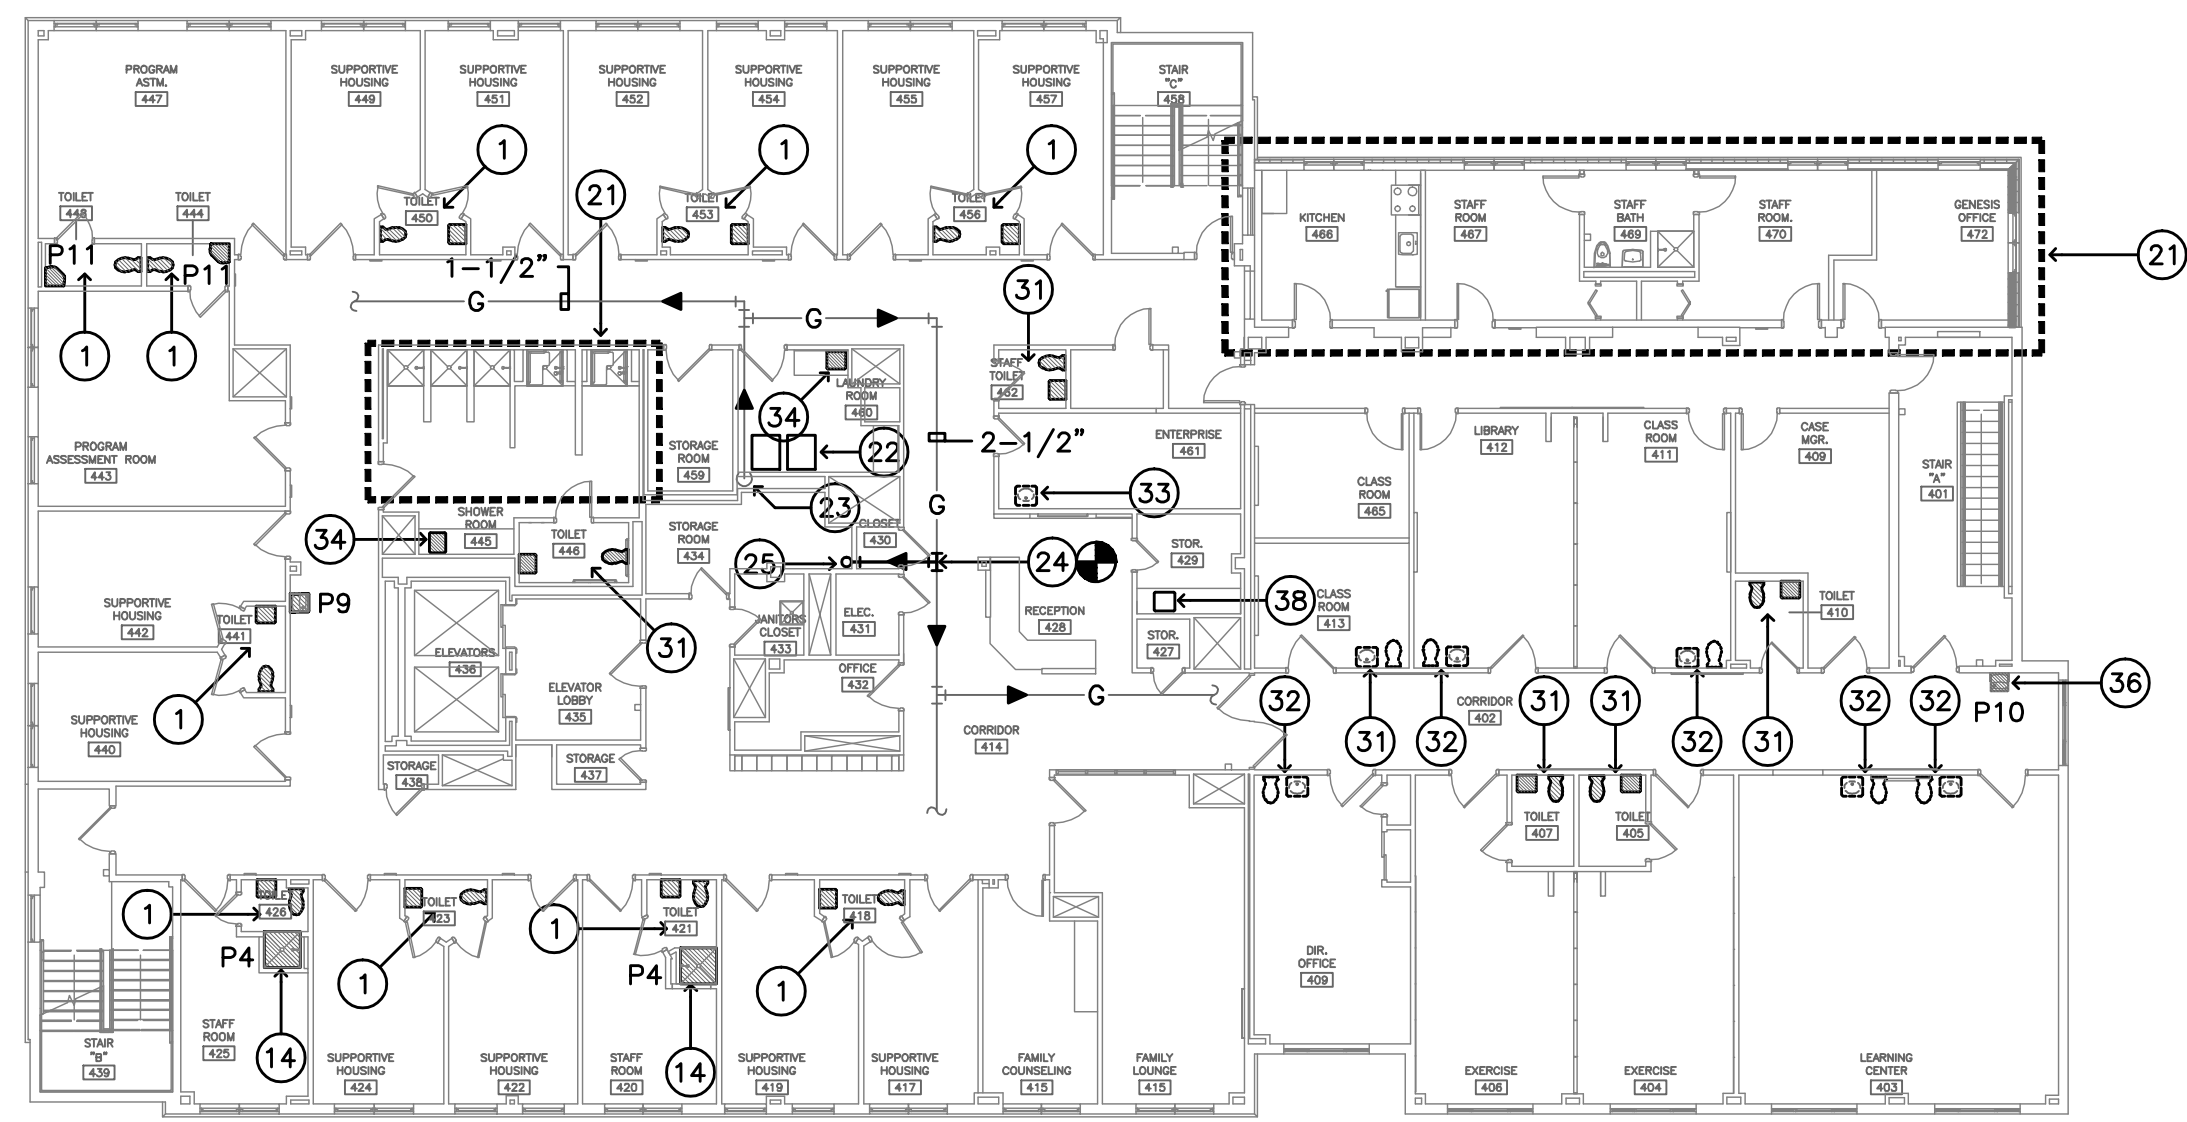


FOURTH FLOOR PLAN - PLUMBING  
SCALE: 1/16" = 1'-0"

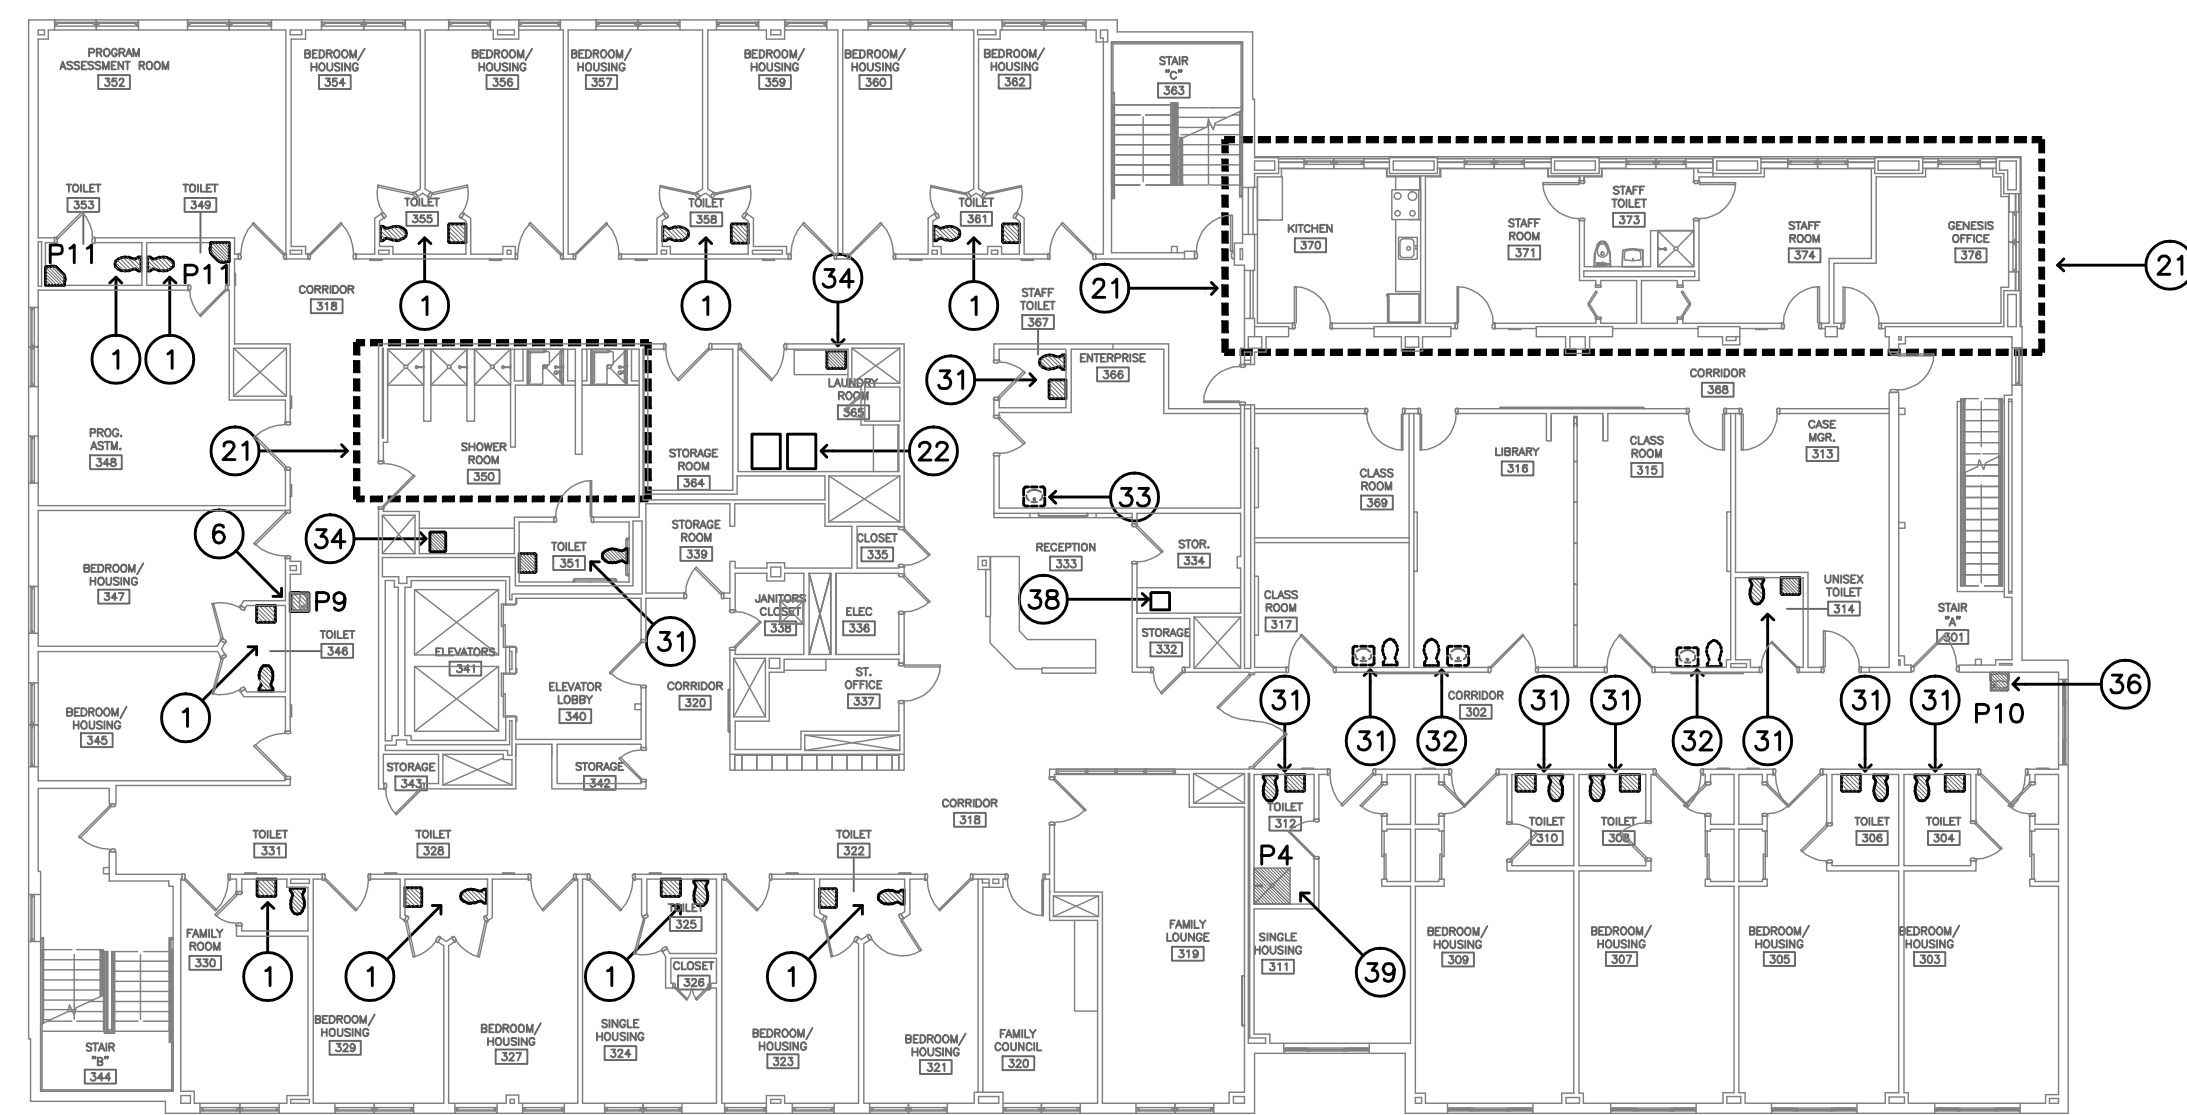


THIRD FLOOR PLAN - PLUMBING  
SCALE: 1/16" = 1'-0"

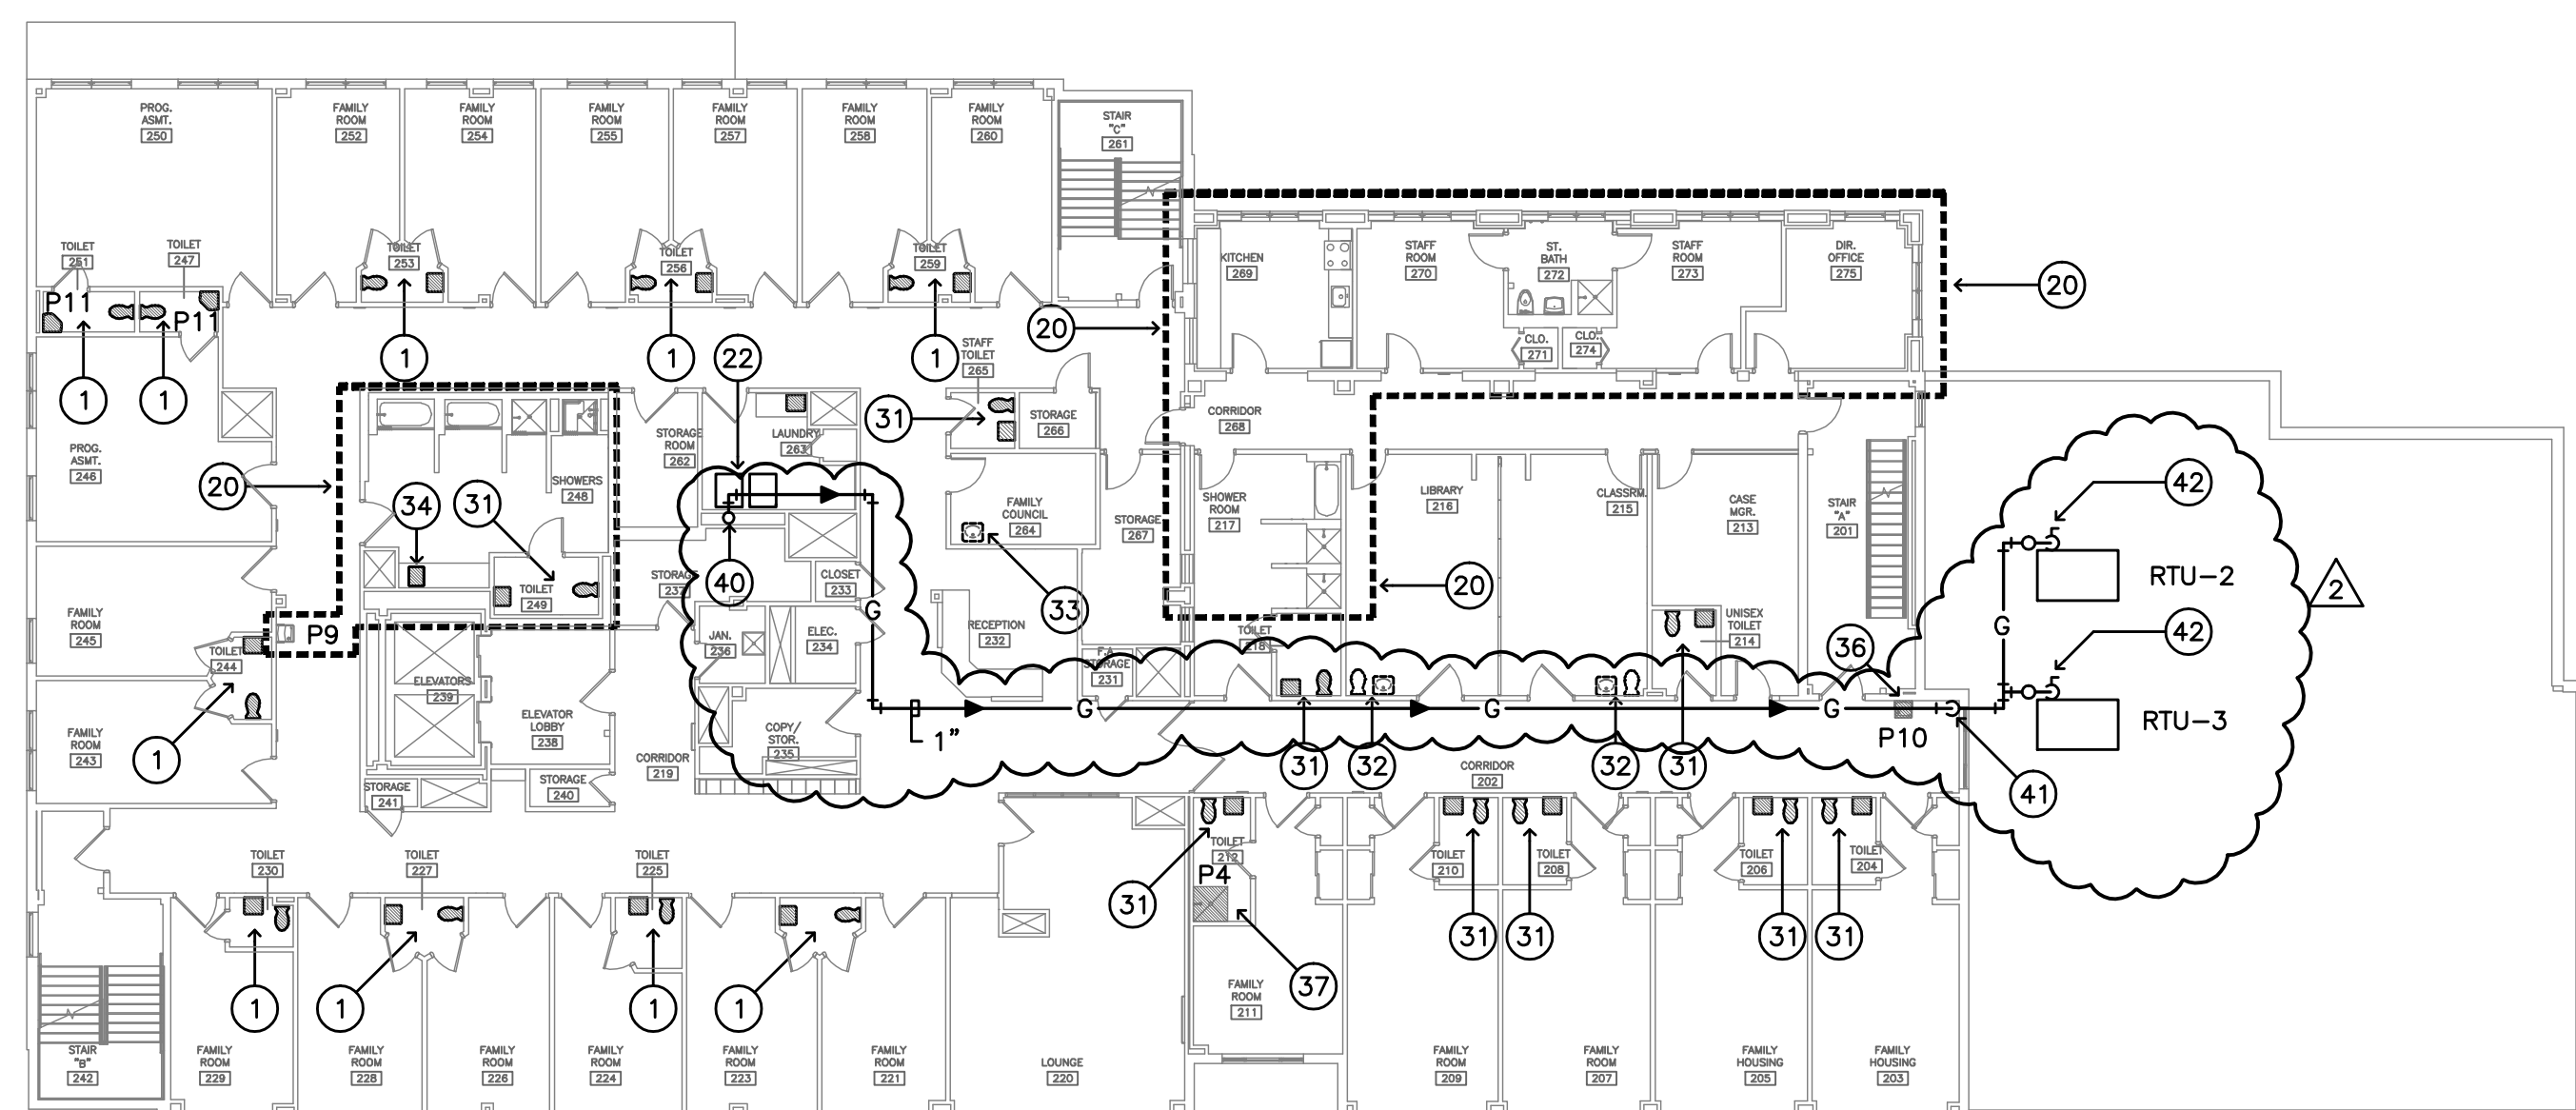

SECOND FLOOR PLAN - PLUMBING  
SCALE: 1/16" = 1'-0"

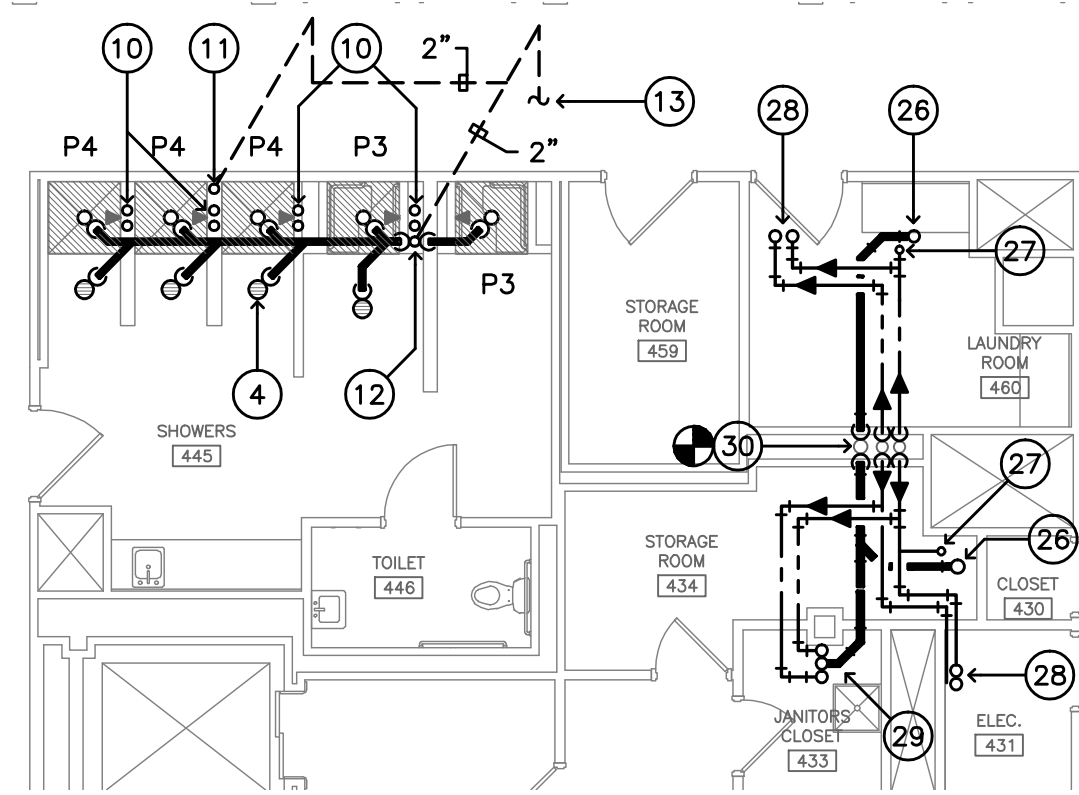


PARTIAL FOURTH FLOOR PLAN - PLUMBING  
SCALE: 1/8" = 1'-0"

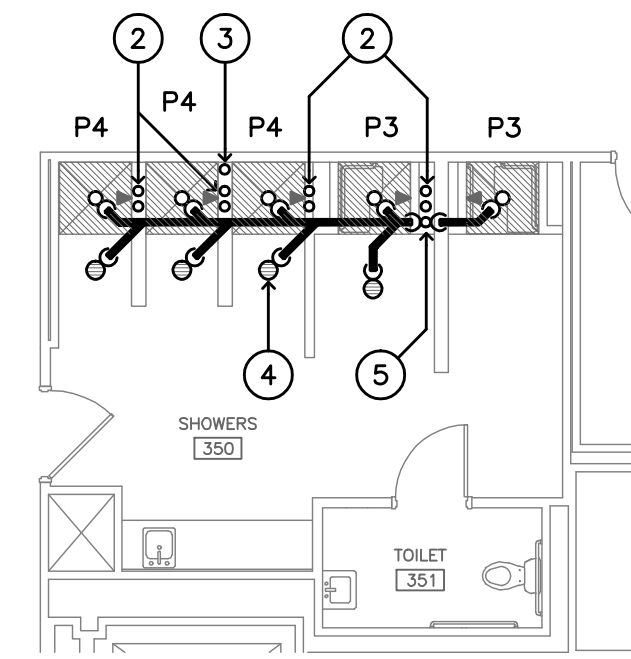


PARTIAL THIRD FLOOR PLAN - PLUMBING  
SCALE: 1/8" = 1'-0"

**LEGEND - M-9**

- 1 IN EXISTING TOILET ROOM WATER CLOSET, FLUSH VALVE, LAVATORY, FAUCET, TRAP, SUPPLIES AND STOPS TO BE REMOVED AND REPLACED WITH NEW. NEW WATER CLOSET SHALL BE EQUAL TO "KOHLER" HIGHCLIFF ULTRA #K-96057, FLOOR SET, TOP SPUD, WHITE VITREOUS CHINA WITH ELONGATED BOWL AND WHITE "KOHLER" STRONGHOLD COMMERCIAL TOILET SEAT #K-4731-C. FLUSH VALVE SHALL BE SLOAN ROYAL MODEL #111-1.28. PROVIDE LEFT OR RIGHT TRIP LEVER AS REQUIRED.
- 2 NEW LAVATORY SHALL BE EQUAL TO "KOHLER" HUDSON #K-2861, 19"x17" PORCELAIN-CAST IRON, WALL HUNG WITH 4" FAUCET CENTERS. FAUCET SHALL BE "SYMMONS" SYMMETREX #S-20-G-FR-VP-W. SUPPLIES SHALL BE FLEXIBLE WITH ANGLE STOPS, TRAP SHALL BE SEMI-CAST, CHROME PLATED.
- 3 IN TOILET ROOMS #251, 247, 353, 349, 448, & 444 NEW LAVATORY SHALL BE "KOHLER" MARSTON #K-2766 WITH FACTORY INSTALLED TRITON #KB040-2A FAUCET. SUPPLIES AND TRAP SHALL BE SAME AS NOTED ABOVE.
- 4 1/2" HOT AND COLD WATER FROM BELOW AND 1/2" HOT AND COLD WATER UP.
- 5 2" VENT FROM BELOW AND 2" VENT UP.
- 6 2" FLOOR DRAIN (IN DRYING AREA) TYPICAL FOR ALL SHOWERS. ALL FLOOR DRAINS TO BE PROVIDED WITH "SURE SEAL" TRAP SEALER.
- 7 3" WASTE FROM ABOVE, 3" WASTE DOWN AND 2" VENT UP.
- 8 1/2" COLD WATER AND 1-1/2" WASTE AND VENT TO WATER COOLER CONNECT TO EXISTING SERVICES AT EXISTING LAVATORY.
- 9 1/2" HOT AND COLD WATER UP FROM BELOW AND 1/2" HOT AND COLD WATER UP. 2" WASTE STACK AND 1-1/2" VENT STACK.
- 10 3" SANITARY FROM ABOVE AND 3" SANITARY STACK DOWN. 2" VENT STACK FROM BELOW.
- 11 1/2" HOT AND 1-1/2" COLD WATER RISERS.
- 12 1/2" HOT AND COLD WATER FROM BELOW.
- 13 2" VENT UP.
- 14 2" VENT UP AND 3" WASTE PIPING DOWN.
- 15 CONNECT NEW VENT LINE TO EXISTING VENT STACK.
- 16 CONNECT NEW SHOWER STALL TO EXISTING SERVICES AT TOILET ROOM PLUMBING FIXTURES, 1/2" HOT AND COLD WATER, 2" WASTE AND 1-1/2" VENT.
- 17 1/2" HOT AND COLD WATER FROM BELOW, 2" WASTE DOWN, 1-1/2" VENT FROM BELOW AND 1-1/2" VENT UP TO ABOVE SUSPENDED CEILING.
- 18 RUN ABOVE SUSPENDED CEILING.
- 19 3" VENT UP AND 3" VENT THROUGH ROOF.
- 20 3" SANITARY DOWN, 2" VENT FROM BELOW AND 3" VENT UP.
- 21 1/2" HOT AND 1-1/2" COLD WATER FROM BELOW.
- 22 FOR PLUMBING PIPING ON SECOND FLOOR SEE DRAWING M-8.
- 23 FOR PLUMBING PIPING ON THIRD & FOURTH FLOOR SEE 1/8" SCALE DRAWING THIS SHEET.
- 24 FOR PLUMBING IN LAUNDRY ROOM SEE DRAWING M-8.
- 25 EXISTING 2-1/2" GAS LINE FROM BELOW.
- 26 CONNECT NEW 1" GAS LINE TO EXISTING 2-1/2" GAS LINE ABOVE 4TH. FLOOR CEILING.
- 27 NEW 1" GAS LINE UP THROUGH 5TH. FLOOR.
- 28 3" SANITARY FROM WATER CLOSET ON 5TH. FL. ABOVE SEE DRAWING M-13.

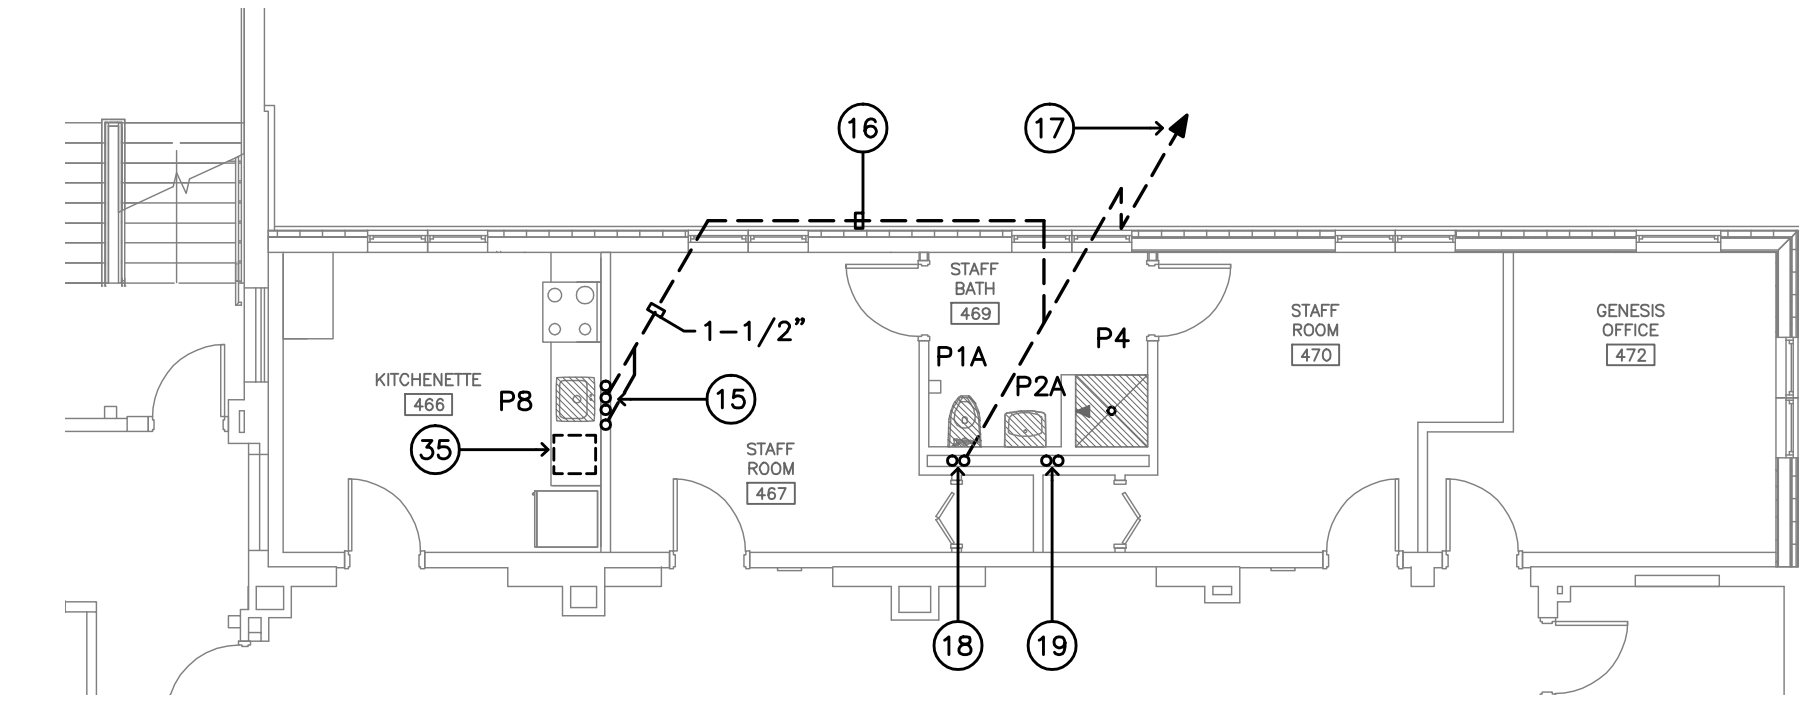

PARTIAL FOURTH FLOOR PLAN - PLUMBING  
SCALE: 1/8" = 1'-0"

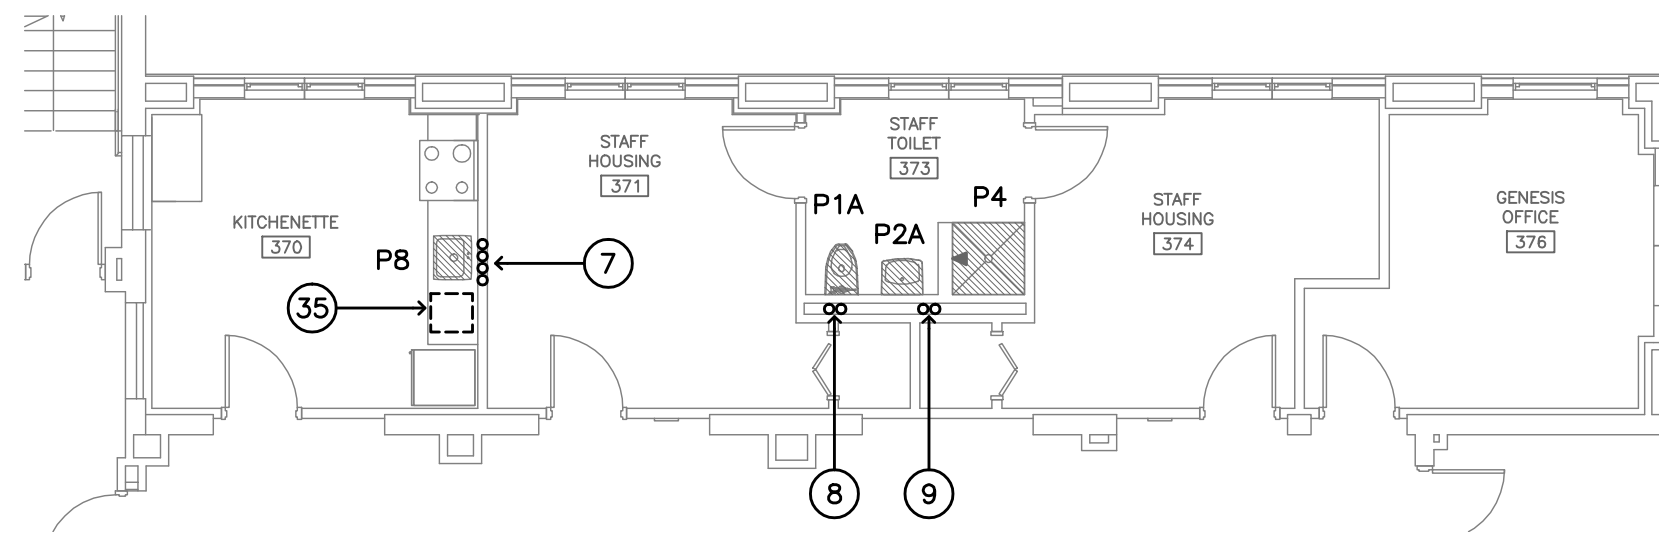

PARTIAL THIRD FLOOR PLAN - PLUMBING  
SCALE: 1/8" = 1'-0"

- 29 1/2" COLD WATER UP TO WATER CLOSET ON 5th. FL. ABOVE SEE DRAWING M-13.
  - 30 1/2" HOT AND COLD WATER UP TO LAVATORY ON 5TH. FL. ABOVE SEE DRAWING M-13.
  - 31 1/2" HOT AND COLD WATER UP AND 1-1/2" DOWN FROM SINK ON 5TH. FL. ABOVE SEE DRAWING M-13.
  - 32 CONNECT HOT AND COLD WATER AND SANITARY PIPING TO EXISTING HOT & COLD WATER RISERS AND SANITARY STACK IN CHASE.
  - 33 IN EXISTING TOILET ROOM REMOVE AND DISCARD EXISTING TANK TYPE WATER CLOSET, LAVATORY, FAUCET, TRAP, SUPPLIES AND STOPS. REPLACE WITH NEW WATER CLOSET, LAVATORY AND TRIM AND CONNECT TO EXISTING SERVICES IN FULL WORKING ORDER.
  - 34 NEW TANK TYPE WATER CLOSET SHALL BE "KOHLER" HIGHLINE MODEL #K-3493, VITREOUS CHINA, TANK TYPE WITH 1.6 GALLON FLUSH, CLOSE-COUPLED DESIGN, FLOOR MOUNTED WITH 17" HIGH ELONGATED BOWL. WATER CLOSET SHALL BE COMPLETE WITH BOLT CAPS, ANGLE SUPPLY WITH STOP AND "KOHLER" STRONGHOLD WHITE SOLID PLASTIC OPEN FRONT SEAT.
  - 35 LAVATORY SHALL BE "KOHLER" GREENWICH VITREOUS CHINA MODEL #K-2032, 20"x18" WALL MOUNTED WITH 4" FAUCET CENTERS, FAUCET SHALL BE "SYMMONS" SYMMETREX #S-20-G-FR-VP-W. SUPPLIES SHALL BE FLEXIBLE WITH STOPS, TRAP SHALL BE CHROME PLATED SEMI-CAST LAVATORY SHALL BE SUPPORTED ON PROPER BLOCKING IN WALL.
  - 36 REMOVE AND DISCARD EXISTING WATER CLOSET, LAVATORY TRIM AND ALL ASSOCIATED HOT, COLD, WASTE AND VENT PIPING. REMOVE ALL UNUSED EXISTING PIPING AND CAP BACK AT ACTIVE MAINS.
  - 37 REMOVE AND DISCARD EXISTING COUNTER SINK, TRIM AND ALL ASSOCIATED HOT, COLD, WASTE AND VENT PIPING. REMOVE ALL UNUSED EXISTING PIPING AND CAP BACK AT ACTIVE MAINS.
  - 38 REMOVE AND DISCARD EXISTING COUNTER SINK AND TRIM AND REPLACE WITH NEW STAINLESS STEEL SINK AND ACCESSORIES AND CONNECT TO EXISTING SERVICES IN FULL WORKING ORDER.
  - 39 NEW COUNTER SINK SHALL BE EQUAL TO "ELKAY" LUSTERTONE MODEL #LR-2219 SINGLE COMPARTMENT, 18 GAUGE, TYPE 304 SELF-RIM STAINLESS STEEL. SINK DEPTH SHALL BE 7-1/2". SINK SHALL BE COMPLETE WITH "ELKAY" MODEL #LKD-2423-BHC FAUCET WITH THREE HOLE INSTALLATION, PROVIDE CHROME PLATED DELUXE DRAIN OUTLET, SEMI-CAST C.P. TRAP AND FLEX SUPPLIES WITH STOPS. COUNTER NOT IN THIS DIVISION.
- NOTE: IN SHOWER ROOMS 248, 350 & 445 COUNTER SINKS SHALL BE ADA ACCESSIBLE "ELKAY" MODEL #LRAD-2219 WITH 6" SINK DEPTH. TRIM SAME NOTED ABOVE.
- 40 UNDER COUNTER DISHWASHER, 1/2" HOT WATER CONNECT TO SINK RISER AND FLEX WASTE TO DISHWASHER TAIL PIECE AT ADJACENT SINK. VALVE HOT WATER TO DISHWASHER INDEPENDENTLY BELOW COUNTER.
  - 41 REMOVE EXISTING WALL HUNG ECLECTIC COOLER AND REPLACE WITH NEW. RECONNECT TO EXISTING UTILITIES IN FULL OPERATING ORDER.
  - 42 EXISTING TILED SHOWER PREVIOUSLY REMOVED. INSTALL NEW PREFABRICATED SHOWER STALL IN SAME LOCATION. UTILIZE EXISTING SERVICES AND MODIFY AS REQUIRED.
  - 43 REMOVE EXISTING COUNTER SINK, HOT, COLD WASTE AND VENT PIPING AND ALL ACCESSORIES. CAP SERVICES BEHIND FINISHED WALL AND MAKE SAFE.
  - 44 REMOVE EXISTING TILED SHOWER. INSTALL NEW PREFABRICATED SHOWER STALL IN SAME LOCATION. UTILIZE EXISTING SERVICES AND MODIFY AS REQUIRED.
- △ APPROXIMATE LOCATION OF EXISTING GAS LINE RISER. CONNECT NEW 1" GAS LINE ABOVE CEILING OF SECOND FLOOR AND RUN TO NEW ROOF TOP UNITS #2 & 3.  
DROP DOWN TO ROOF OF NORTH ADDITION.  
3/4" GAS LINE TO ROOF TOP UNIT WITH GAS PRESSURE REGULATOR, BALL VALVE, DIRT LEG AND UNION AT CONNECTION.



DATE	DESCRIPTION
02.21.20	FAN COIL UNIT AND PLUMBING FIXTURE REVISIONS


JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
SECOND FLOOR PLAN  
- HVAC

SCALE: 1/8"=1'-0"  
DRAWN BY: BIC  
REVIEWED BY: GDD

DRAWING NO.:  
**M-10**  
04.16.2020 - CM BID

DATE: 05 MARCH 2020  
GDD JOB NUMBER: 19469

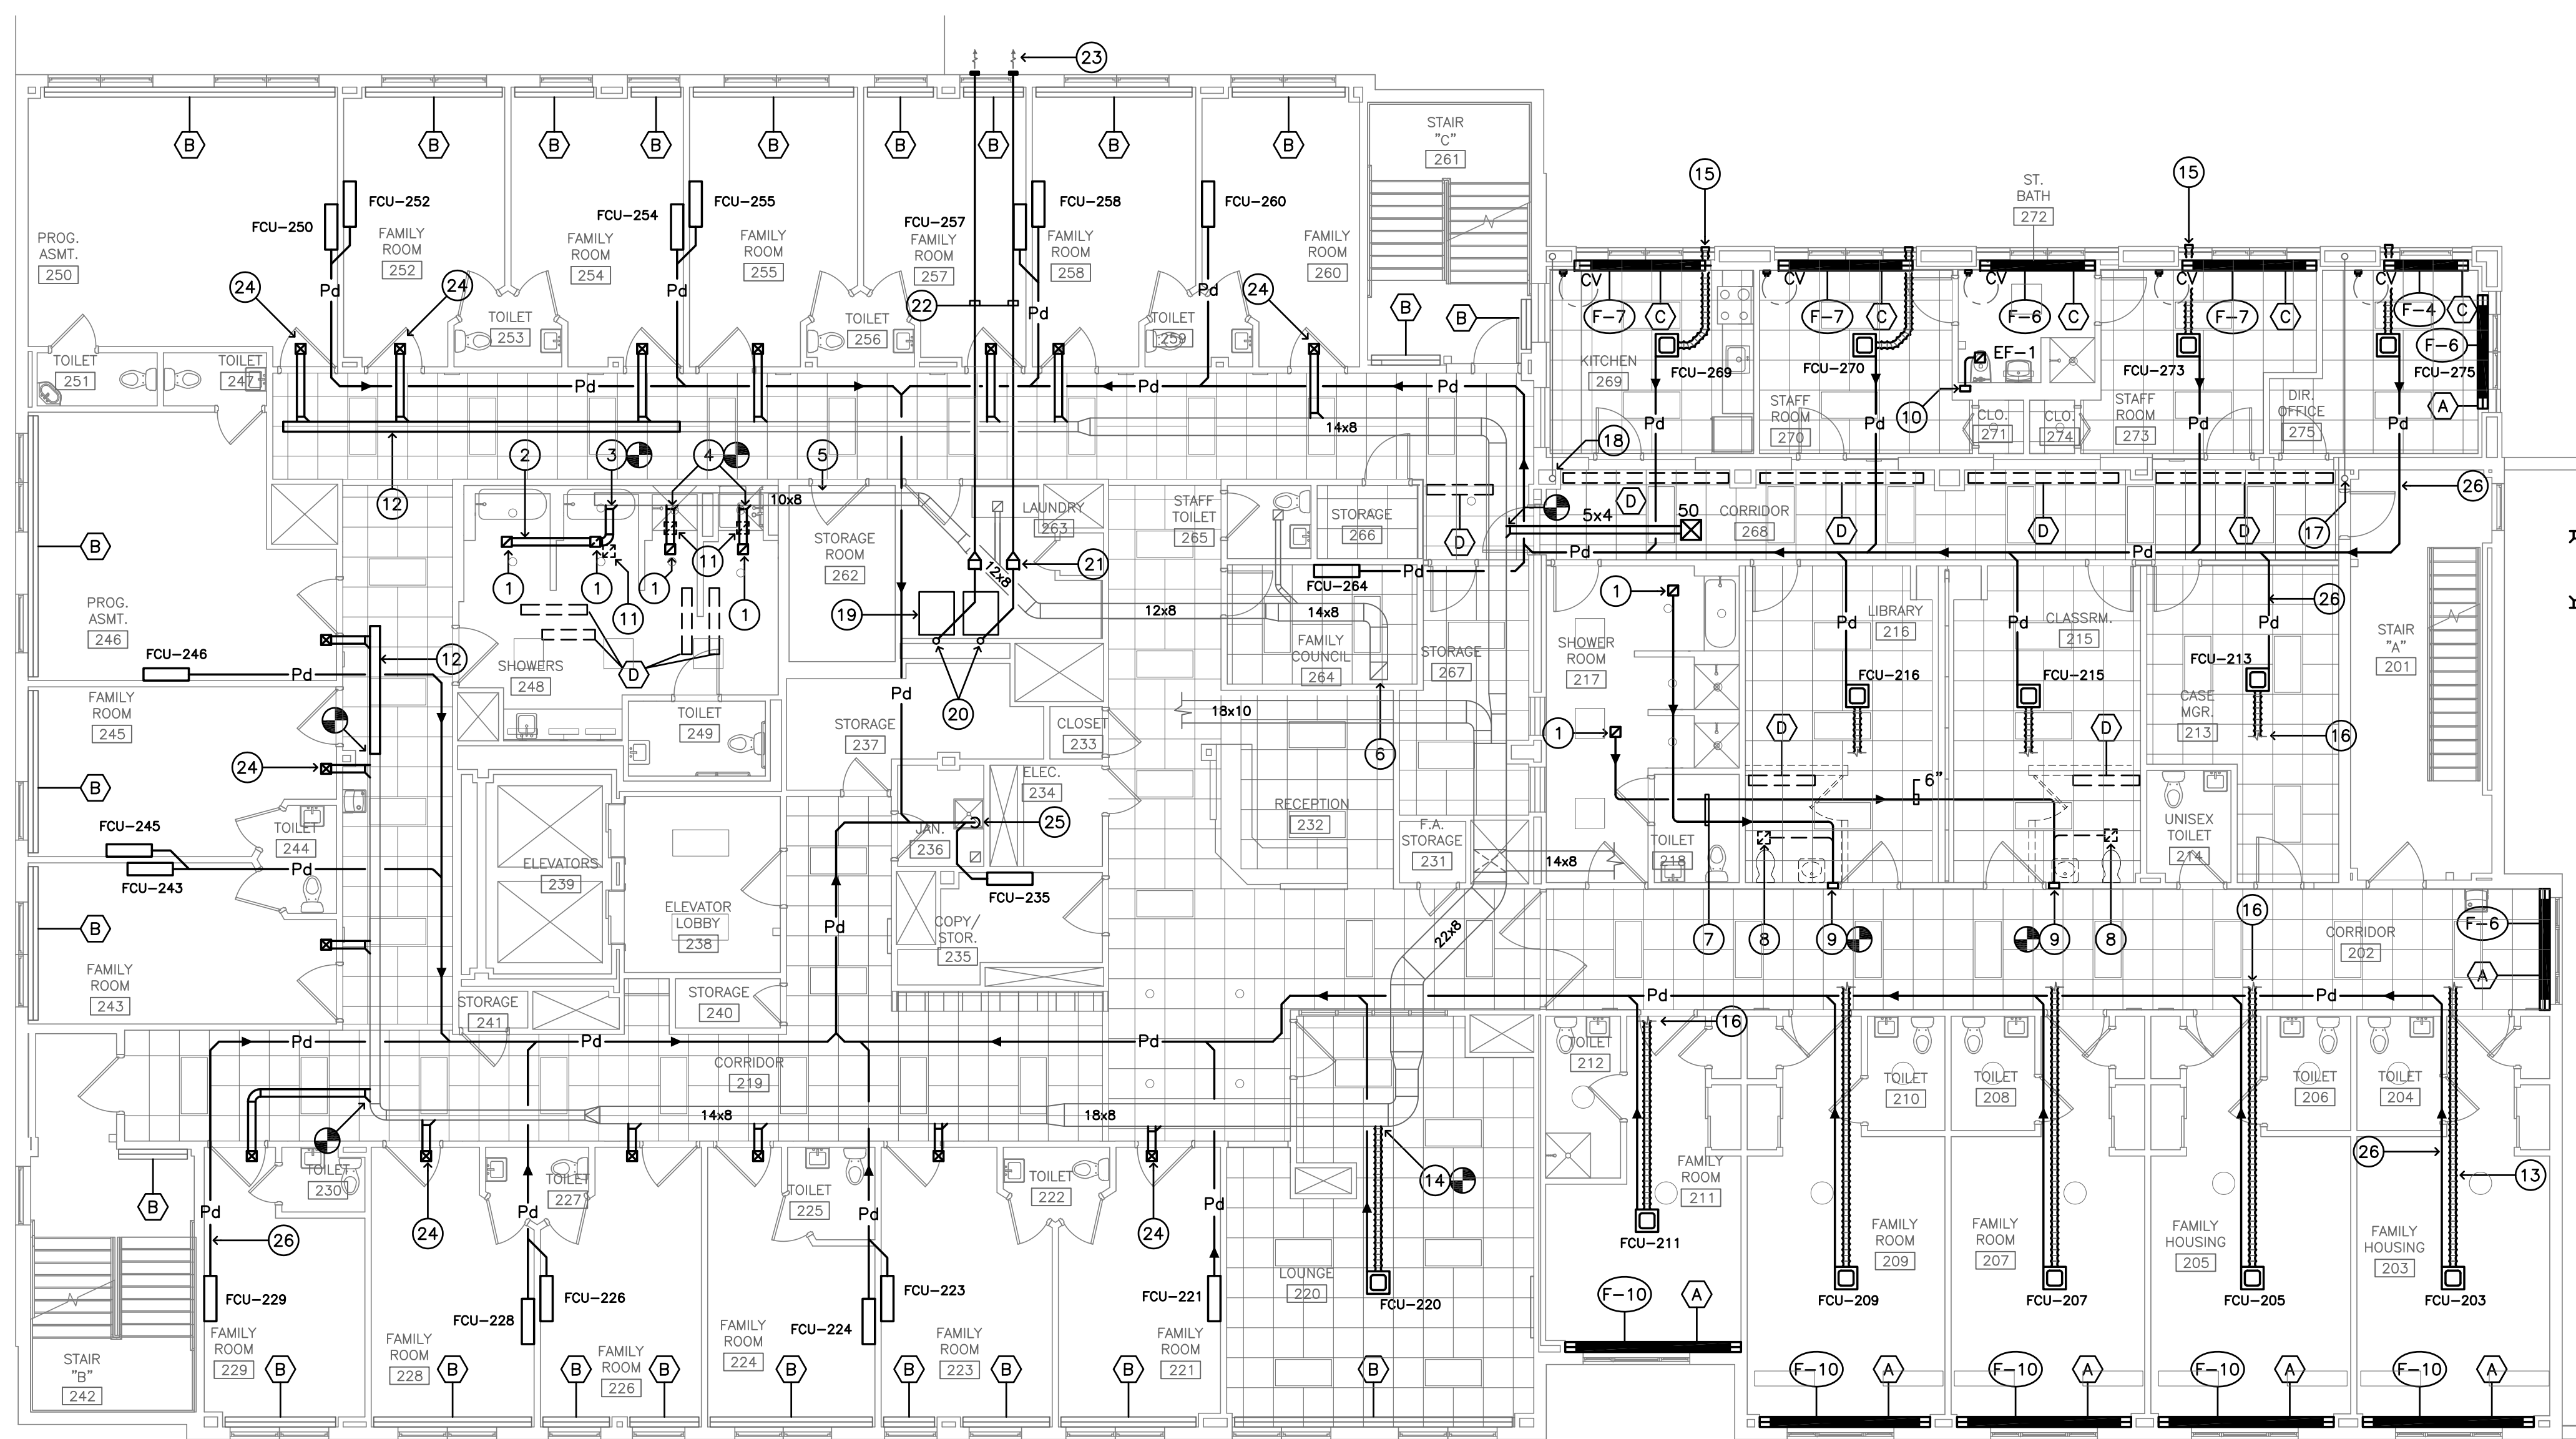

SECOND FLOOR PLAN - HVAC  
SCALE: 1/8" = 1'-0"



**RADIATION LEGEND**

- (A) REMOVE EXISTING RADIATION INCLUDING BACKPLATE, COVERS, FINNED-TUBE, ISOLATION VALVES, MANUAL AIR VENTS AND CONTROLS. IN IT'S PLACE INSTALL NEW RADIATION (COVER TO BE WALL TO WALL WHERE SHOWN) WITH END CAPS AND SPLICE PLATES AS REQUIRED, NEW ISOLATION VALVES, MANUAL AIR VENTS AND CONTROLS.
- RADIATION BASE BID SHALL BE "SLANT/FIN" OR EQUAL MULTI/PAK 80 HEAVY DUTY, HIGH OUTPUT BASEBOARD RADIATION WITH 18-GAUGE ONE PIECE FRONT PANEL, 16 GAUGE BRACKETS AND 22 GAUGE BACK AND TOP PANEL. RADIATION SHALL CONTAIN A HEATING ELEMENT TO PROVIDE A MINIMUM OF 700 B.T.U./FT. WITH 170°F. HOT WATER SUPPLY TEMPERATURE, PIPE SIZE TO MATCH EXISTING. ALL COVER COMPONENTS SHALL BE FACTORY PAINTED IN NU-WHITE OVEN BAKED CROSS-LINKED POLYESTER ENAMEL.
- RADIATION ADD ALTERNATE SHALL BE "SLANT/FIN" OR EQUAL 350 L SERIES HEAVY DUTY HIGH OUTPUT, SLOPE-TOP BASEBOARD RADIATION WITH 16 GAUGE STEEL ONE PIECE FRONT COVER, 17 GAUGE BRACKETS. PIPE SIZE TO MATCH EXISTING. RADIATION SHALL CONTAIN A HEATING ELEMENT TO PROVIDE A MINIMUM OF 700 B.T.U./FT. WITH 170°F. HOT WATER SUPPLY TEMPERATURE, PIPE SIZE TO MATCH EXISTING. ALL COVER COMPONENTS SHALL BE FACTORY PAINTED IN NU-WHITE OVEN BAKED CROSS-LINKED POLYESTER ENAMEL.
- (B) EXISTING WALL MOUNTED FINNED-TUB RADIATION TO REMAIN. THE FINNED-TUBE ELEMENT MUST BE THOROUGHLY CLEANED, COVERS AND TRIM ARE TO BE REMOVED, CLEANED, PRIMED, PAINTED AND REINSTALLED (COLOR TO BE SELECTED BY ARCHITECT). SEQUENCE AS NOTED ABOVE SHALL BE THE RESPONSIBILITY OF THE MECHANICAL CONTRACTOR.
- (C) NEW HOT WATER BASEBOARD RADIATION SHALL BE THE SAME AS NOTED IN "BASE BID" RADIATION ABOVE, COMPLETE WITH ISOLATION VALVES, MANUAL AIR VENTS AND CONTROLS.
- (D) EXISTING RADIATION TO BE REMOVED IN IT'S ENTIRETY INCLUDING ALL ASSOCIATED PIPING, VALVES AND ACCESSORIES.
- (F-10) SYMBOL INDICATES LENGTH OF RADIATION ELEMENT.

**RADIATION CONTROLS**

1. NEW RADIATION NOTED (A) SHALL BE INDIVIDUALLY CONTROLLED UTILIZING "TACO" RADIATION CONTROL VALVES.  
NEW RADIATION NOTED (C) SHALL BE INDIVIDUALLY CONTROLLED UTILIZING "TACO" RADIATION CONTROL VALVE.
2. FOR EXISTING RADIATION THAT REMAINS CONTRACTOR IS TO PROVIDE UNIT PIECES TO REPLACE ISOLATION VALVES, VENT VALVES AND CONTROL VALVES ON AN AS NEEDED BASIS.

ALL RADIATION TO BE EQUIPPED WITH "TACO" RADIATION CONTROL VALVES.

**LEGEND - M-10**

- 1 NEW 8"x8" CEILING EXHAUST GRILLE WITH DAMPER, 70C.F.M. EACH.
- 2 NEW 6"x5" EXHAUST DUCT WORK.
- 3 REMOVE EXISTING 6" DIA EXHAUST DUCTWORK AND CEILING EXHAUST GRILLE AND REPLACE WITH NEW 7"x6" EXHAUST DUCT.
- 4 REMOVE EXISTING 6" DIA. EXHAUST DUCTWORK AND REPLACE WITH NEW, CONNECT TO NEW CEILING EXHAUST GRILLE.
- 5 EXISTING 10"x8" EXHAUST DUCTWORK ABOVE CEILING.
- 6 EXISTING 12"x10" EXHAUST RISER.
- 7 NEW 6" DIA. EXHAUST DUCTWORK ABOVE CEILING.
- 8 REMOVE EXISTING CEILING EXHAUST GRILLE AND ASSOCIATED DUCTWORK.
- 9 CONNECT NEW 6" DIA. EXHAUST DUCTWORK TO EXISTING 6"x4" EXHAUST RISER.
- 10 NEW 6"x4" EXHAUST RISER UP.
- 11 REMOVE EXISTING CEILING EXHAUST GRILLE AND ASSOCIATED DUCTWORK BACK TO MAIN BRANCH.
- 12 EXTEND EXISTING 8"x8" DUCTWORK.
- 13 4" DIA. (INSULATED) FLEX DUCTWORK, TYPICAL.
- 14 CONNECT NEW 4" DIA. DUCTWORK TO EXISTING SUPPLY DUCTWORK ABOVE CEILING AND RUN TO FAN COIL UNIT, TYPICAL.
- 15 4" DIA. OUTSIDE AIR SCREENED INLET TYPICAL FOR (4).
- 16 CONNECT NEW FAN COIL UNIT TO EXISTING SUPPLY DUCTWORK ABOVE CEILING, (NOT SHOWN) TYPICAL.
- 17 EXISTING HOT WATER SUPPLY RISER EXTEND TO NEW PERIMETER RADIATION.
- 18 EXISTING HOT WATER RETURN RISER EXTEND TO NEW PERIMETER RADIATION.
- 19 TWO (2) STACKED WASHER/DRYERS OWNERS EQUIPMENT.
- 20 4" DRYER VENT.
- 21 INLINE DRYER EXHAUST FAN EQUAL TO "FANTECH" MODEL DBF-4XL WITH PRESSURE SENSING SWITCH TO AUTOMATICALLY TURN THE FAN ON WHEN THE DRYER IS ON AND WILL TURN ITSELF OFF WHEN THE DRYER STOPS. 120V. 1PH. (65 WATTS)
- 22 DRYER VENTING REQUIREMENTS
  - DUCTING MUST BE RIGID METAL (GALVANIZED OR ALUMINUM) DUCT.
  - DUCT JOINTS SHALL BE INSTALLED SO THAT THE MALE END OF THE DUCT POINTS IN THE DIRECTION OF THE AIRFLOW.
  - JOINTS SHOULD BE SECURED WITH METAL TAPE (NOT DUCT TAPE). DO NOT USE RIVETS OR SCREWS IN THE JOINTS OR ANYWHERE ELSE IN THE DUCT.
  - DRYER VENTING SHALL BE INDEPENDENT OF ANY OTHER SYSTEMS (CHIMNEYS OR EXHAUST VENTS).
  - TERMINATION OF DRYER VENTING MUST BE TO THE EXTERIOR WITH A PROPER HOOD CAP EQUIPPED WITH A BACKDRAFT DAMPER. SMALL ORIFICE METAL SCREENING SHOULD NOT BE PART OF THE HOOD OR ROOF CAP AS THIS WILL CATCH LINT AND BLOCK OPENING. THE HOOD OPENING SHOULD POINT DOWN.
- 23 WALL TERMINATION.
- 24 6"x6" O.A. SUPPLY GRILLE WITH 4" ROUND DUCT, TYPICAL.
- 25 OPEN END CONDENSATE DRAIN PUMPED DISCHARGE (Pd) LINE OVER JANITORS SERVICE SINK.
- 26 CONDENSATE DRAIN PUMPED DISCHARGE (Pd) LINE FROM FAN COIL UNIT, TYPICAL.


**EXHAUST FAN SCHEDULE**

SYMBOL	MAKE	MODEL	TYPE	CFM	WATTS	VOLTAGE	DRIVE	RPM	SONES
EF-1	PANASONIC	FV-0511VK2	CEILING	70	4.3	120V. 1PH	DIRECT	760	0.3
EF-2	PANASONIC	FV-0511VK2	CEILING	70	4.3	120V. 1PH	DIRECT	760	0.3
EF-3	PANASONIC	FV-0511VK2	CEILING	70	4.3	120V. 1PH	DIRECT	760	0.3
EF-4	PANASONIC	FV-0511VK2	CEILING	70	4.3	120V. 1PH	DIRECT	760	0.3
EF-5	PANASONIC	FV-0511VK2	CEILING	70	4.3	120V. 1PH	DIRECT	760	0.3
EF-1-EF-4 WIRE TO WALL LIGHT SWITCH. E-5 ON CONTINUOUS.									

**FAN COIL UNIT SCHEDULE - SECOND FLOOR**

SYMBOL	ROOM	DAIKIN FAN COIL UNIT MODEL	OUTDOOR UNIT	C.F.M.	O.A. C.F.M.	MOUNTING LOCATION	VOLTAGE	MCA	MOP
FUC-203	203	FXZQ09TAVJU	ACCU-5	317	15	CEILING	208-230V, 1PH	0.3	15A
FUC-205	205	FXZQ09TAVJU	ACCU-5	317	15	CEILING	208-230V, 1PH	0.3	15A
FUC-207	207	FXZQ09TAVJU	ACCU-5	317	15	CEILING	208-230V, 1PH	0.3	15A
FUC-209	209	FXZQ09TAVJU	ACCU-5	317	15	CEILING	208-230V, 1PH	0.3	15A
FUC-211	211	FXZQ07TAVJU	ACCU-5	307	15	CEILING	208-230V, 1PH	0.3	15A
FUC-213	213	FXZQ07TAVJU	ACCU-4	307	20	CEILING	208-230V, 1PH	0.3	15A
FUC-215	215	FXZQ09TAVJU	ACCU-4	317	50	CEILING	208-230V, 1PH	0.3	15A
FUC-216	216	FXZQ09TAVJU	ACCU-4	317	30	CEILING	208-230V, 1PH	0.3	15A
FUC-235	235	FXAQ05PVJU	ACCU-4	260	-	WALL	208-230V, 1PH	0.3	15A
FUC-264	264	FXAQ07PVJU	ACCU-4	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-220	220	FXAQ18PVJU	ACCU-3	500	50	WALL	208-230V, 1PH	0.4	15A
FUC-221	221	FXAQ07PVJU	ACCU-3	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-223	223	FXAQ07PVJU	ACCU-3	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-224	224	FXAQ07PVJU	ACCU-3	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-226	226	FXAQ07PVJU	ACCU-3	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-228	228	FXAQ07PVJU	ACCU-3	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-229	229	FXAQ07PVJU	ACCU-3	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-243	243	FXAQ07PVJU	ACCU-2	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-245	245	FXAQ07PVJU	ACCU-2	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-246	246	FXAQ09PVJU	ACCU-2	280	30	WALL	208-230V, 1PH	0.3	15A
FUC-250	250	FXAQ12PVJU	ACCU-2	290	30	WALL	208-230V, 1PH	0.4	15A
FUC-252	252	FXAQ07PVJU	ACCU-1	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-254	254	FXAQ07PVJU	ACCU-1	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-255	255	FXAQ07PVJU	ACCU-1	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-257	257	FXAQ07PVJU	ACCU-1	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-258	258	FXAQ07PVJU	ACCU-1	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-260	260	FXAQ07PVJU	ACCU-1	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-269	236	FXZQ05TAVJU	ACCU-6	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-270	270	FXZQ05TAVJU	ACCU-6	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-273	273	FXZQ05TAVJU	ACCU-6	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-275	275	FXZQ05TAVJU	ACCU-6	300	15	CEILING	208-230V, 1PH	0.3	15A

ACCESSORIES SHALL INCLUDE: INLINE CONDENSATE PUMP, REFNET BRANCH PIPING KITS, WIRED REMOTE CONTROLLERS, INTERFACE FOR USE IN BACNET, INDIVIDUAL ROOM CONTROL, AND FRESH AIR INTAKE FLANGE.

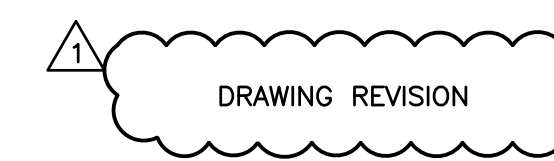






ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:

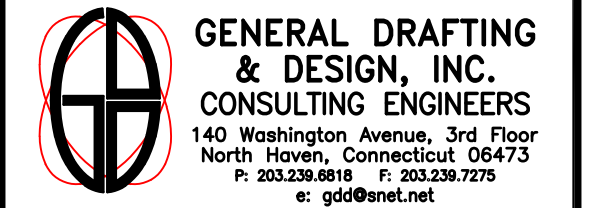


REVISIONS:	DATE	DESCRIPTION
Δ	02.21.20	FAN COIL UNIT AND PLUMBING FIXTURE REVISIONS

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
THIRD FLOOR PLAN  
- HVAC

SCALE: 1/8"=1'-0"  
DRAWN BY: BIC  
REVIEWED BY: GDD

DRAWING NO.:  
M-11  
04.16.2020 - CM BID  
DATE: 05 MARCH 2020  
GDD JOB NUMBER: 19469

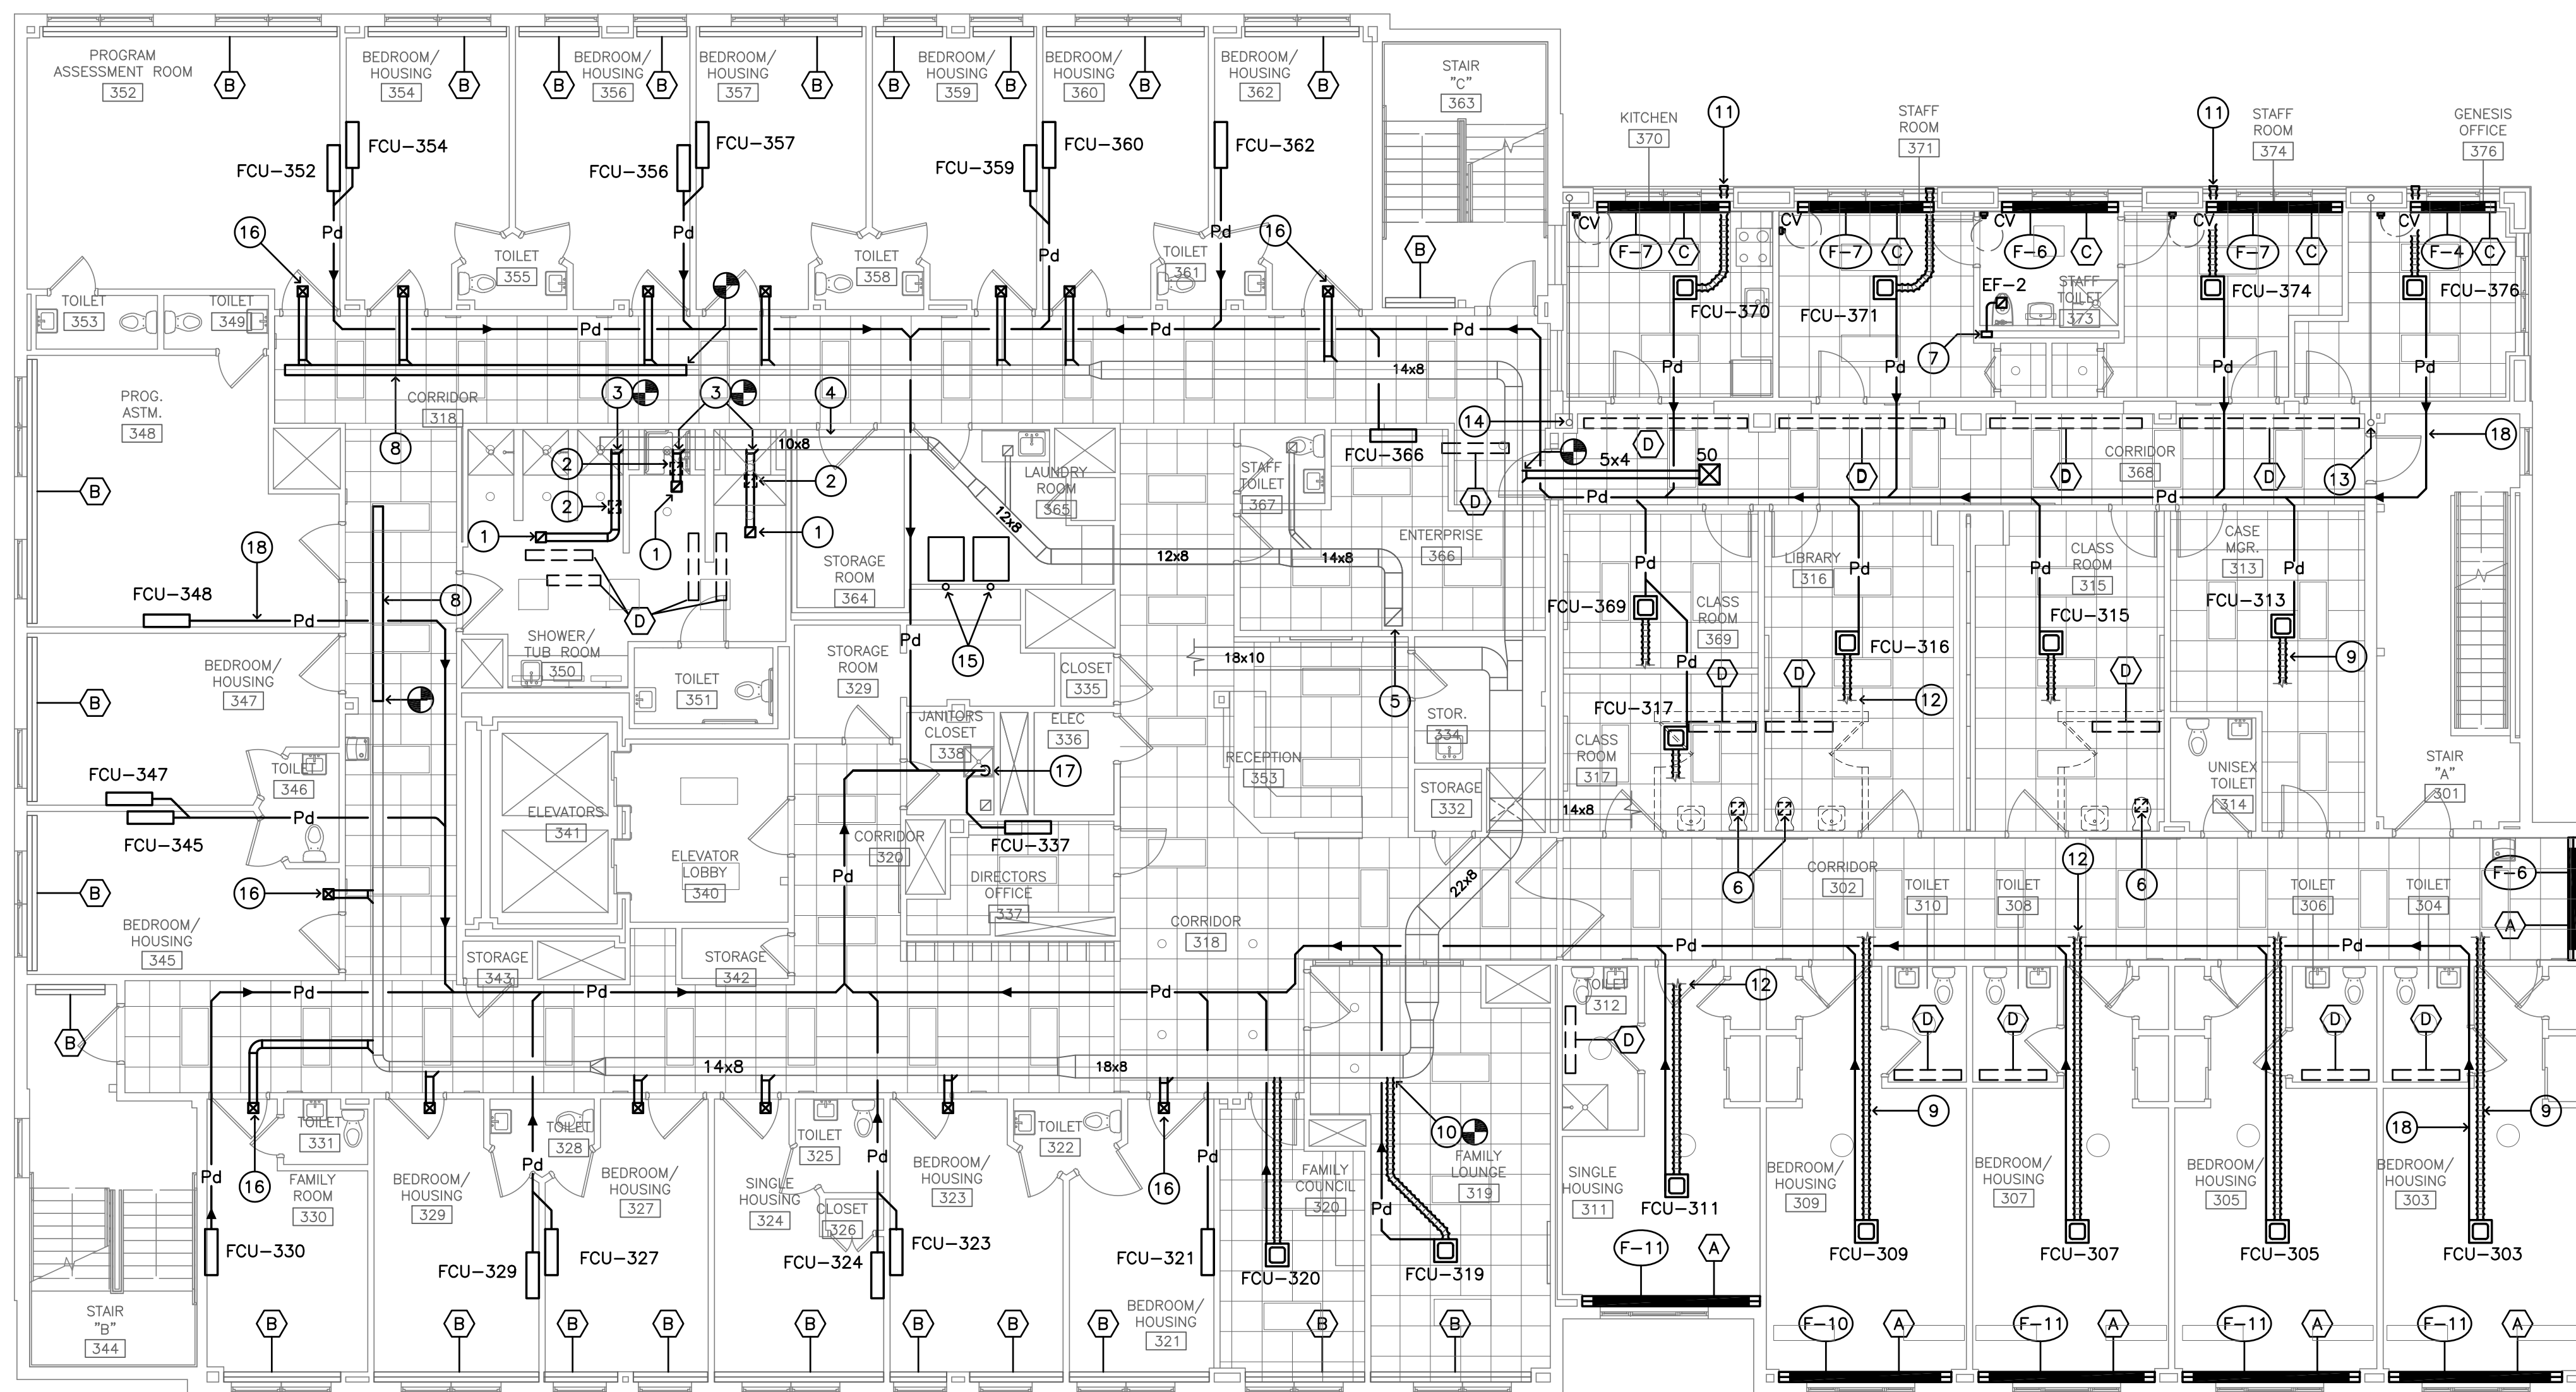

THIRD FLOOR PLAN - HVAC  
SCALE: 1/8" = 1'-0"

**RADIATION LEGEND**

- (A) REMOVE EXISTING RADIATION INCLUDING BACKPLATE, COVERS, FINNED-TUBE, ISOLATION VALVES, MANUAL AIR VENTS AND CONTROLS. IN ITS PLACE INSTALL NEW RADIATION (COVER TO BE WALL TO WALL WHERE SHOWN) WITH END CAPS AND SPLICE PLATES AS REQUIRED, NEW ISOLATION VALVES, MANUAL AIR VENTS AND CONTROLS.
- RADIATION BASE BID SHALL BE "SLANT/FIN" OR EQUAL MULTI/PAK 80 HEAVY DUTY, HIGH OUTPUT BASEBOARD RADIATION WITH 18-GAUGE ONE PIECE FRONT PANEL, 16 GAUGE BRACKETS AND 22 GAUGE BACK AND TOP PANEL. RADIATION SHALL CONTAIN A HEATING ELEMENT TO PROVIDE A MINIMUM OF 700 B.T.U./FT. WITH 170°F. HOT WATER SUPPLY TEMPERATURE, PIPE SIZE TO MATCH EXISTING. ALL COVER COMPONENTS SHALL BE FACTORY PAINTED IN NU-WHITE OVEN BAKED CROSS-LINKED POLYESTER ENAMEL.
- RADIATION ADD ALTERNATE SHALL BE "SLANT/FIN" OR EQUAL 350 L SERIES HEAVY DUTY HIGH OUTPUT, SLOPE-TOP BASEBOARD RADIATION WITH 16 GAUGE STEEL ONE PIECE FRONT COVER, 17 GAUGE BRACKETS. PIPE SIZE TO MATCH EXISTING. RADIATION SHALL CONTAIN A HEATING ELEMENT TO PROVIDE A MINIMUM OF 700 B.T.U./FT. WITH 170°F. HOT WATER SUPPLY TEMPERATURE, PIPE SIZE TO MATCH EXISTING. ALL COVER COMPONENTS SHALL BE FACTORY PAINTED IN NU-WHITE OVEN BAKED CROSS-LINKED POLYESTER ENAMEL.
- (B) EXISTING WALL MOUNTED FINNED-TUB RADIATION TO REMAIN. THE FINNED-TUBE ELEMENT MUST BE THOROUGHLY CLEANED, COVERS AND TRIM ARE TO BE REMOVED, CLEANED, PRIMED, PAINTED AND REINSTALLED (COLOR TO BE SELECTED BY ARCHITECT). SEQUENCE AS NOTED ABOVE SHALL BE THE RESPONSIBILITY OF THE MECHANICAL CONTRACTOR.
- (C) NEW HOT WATER BASEBOARD RADIATION SHALL BE THE SAME AS NOTED IN "BASE BID" RADIATION ABOVE, COMPLETE WITH ISOLATION VALVES, MANUAL AIR VENTS AND CONTROLS.
- (D) EXISTING RADIATION TO BE REMOVED IN ITS ENTIRETY INCLUDING ALL ASSOCIATED PIPING, VALVES AND ACCESSORIES.
- (F-10) SYMBOL INDICATES LENGTH OF RADIATION ELEMENT.

**RADIATION CONTROLS**

1. NEW RADIATION NOTED (A) SHALL BE INDIVIDUALLY CONTROLLED UTILIZING "TACO" RADIATION CONTROL VALVES.  
NEW RADIATION NOTED (C) SHALL BE INDIVIDUALLY CONTROLLED UTILIZING "TACO" RADIATION CONTROL VALVES.
2. FOR EXISTING RADIATION THAT REMAINS CONTRACTOR IS TO PROVIDE UNIT PIECES TO REPLACE ISOLATION VALVES, VENT VALVES AND CONTROL VALVES ON AN AS NEEDED BASIS.

ALL RADIATION TO BE EQUIPPED WITH "TACO" RADIATION CONTROL VALVES.

**LEGEND - M-11**

- 1 NEW 8"x8" CEILING EXHAUST GRILLE WITH DAMPER, 70 C.F.M. EACH.
- 2 REMOVE EXISTING CEILING EXHAUST GRILLE AND ASSOCIATED DUCTWORK BACK TO MAIN BRANCH.
- 3 CONNECT NEW 6" DIA. EXHAUST DUCTWORK TO EXISTING AND EXTEND TO NEW EXHAUST GRILLE LOCATION.
- 4 EXISTING 10"x8" EXHAUST DUCTWORK ABOVE CEILING.
- 5 EXISTING EXHAUST RISER.
- 6 REMOVE EXISTING CEILING EXHAUST GRILLE AND ASSOCIATED DUCTWORK BACK TO RISER LOCATION, BLANK OFF AT EXISTING RISER AIR-TIGHT.
- 7 4"x6" FROM BELOW AND 7"x6" EXHAUST RISER UP.
- 8 EXTEND EXISTING 8"x8" DUCTWORK.
- 9 4" DIA. (INSULATED) FLEX DUCTWORK, TYPICAL.
- 10 CONNECT NEW 4" DIA. DUCTWORK TO EXISTING SUPPLY DUCTWORK ABOVE CEILING AND RUN TO FAN COIL UNIT, TYPICAL.
- 11 4" DIA. OUTSIDE AIR SCREENED INLET TYPICAL FOR (4).
- 12 CONNECT NEW FAN COIL UNIT TO EXISTING SUPPLY DUCTWORK ABOVE CEILING (NOT SHOWN) TYPICAL.
- 13 EXISTING HOT WATER SUPPLY RISER EXTEND TO NEW PERIMETER RADIATION.
- 14 EXISTING HOT WATER RETURN RISER EXTEND TO NEW PERIMETER RADIATION.
- 15 SEE SECOND FLOOR PLAN DWG. M-10 FOR DUCTING OF CLOTHES DRYERS.
- 16 6"x6" O.A. SUPPLY GRILLE WITH 4" ROUND DUCT, TYPICAL.
- 17 OPEN END CONDENSATE DRAIN PUMPED DISCHARGE (PD) LINE OVER JANITORS SERVICE SINK.
- 18 CONDENSATE DRAIN PUMPED DISCHARGE (PD) LINE FROM FAN COIL UNIT, TYPICAL.

FAN COIL UNIT SCHEDULE - THIRD FLOOR									
SYMBOL	ROOM	DAIKIN FAN COIL UNIT MODEL	OUTDOOR UNIT	C.F.M.	O.A. C.F.M.	MOUNTING LOCATION	VOLTAGE	MCA	MOP
FUC-303	303	FXZQ09TAWJU	ACCU-5	317	7.5	CEILING	208-230V, 1PH	0.3	15A
FUC-305	305	FXZQ09TAWJU	ACCU-5	317	15	CEILING	208-230V, 1PH	0.3	15A
FUC-307	307	FXZQ09TAWJU	ACCU-5	317	15	CEILING	208-230V, 1PH	0.3	15A
FUC-309	309	FXZQ12TAWJU	ACCU-5	353	15	CEILING	208-230V, 1PH	0.4	15A
FUC-311	311	FXZQ07TAWJU	ACCU-5	307	15	CEILING	208-230V, 1PH	0.3	15A
FUC-313	313	FXZQ09TAWJU	ACCU-4	317	20	CEILING	208-230V, 1PH	0.3	15A
FUC-315	315	FXZQ09TAWJU	ACCU-4	317	50	CEILING	208-230V, 1PH	0.3	15A
FUC-316	316	FXZQ09TAWJU	ACCU-4	317	30	CEILING	208-230V, 1PH	0.3	15A
FUC-317	317	FXZQ05TAWJU	ACCU-4	300	30	CEILING	208-230V, 1PH	0.3	15A
FUC-369	369	FXZQ05TAWJU	ACCU-4	300	30	CEILING	208-230V, 1PH	0.3	15A
FUC-366	366	FXAQ07PWJU	ACCU-4	260	20	WALL	208-230V, 1PH	0.3	15A
FUC-337	337	FXAQ05PWJU	ACCU-4	260	7.5	WALL	208-230V, 1PH	0.3	15A
FUC-319	319	FXAQ12PWJU	ACCU-3	290	30	WALL	208-230V, 1PH	0.4	15A
FUC-320	320	FXAQ07PWJU	ACCU-3	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-321	321	FXAQ07PWJU	ACCU-3	260	7.5	WALL	208-230V, 1PH	0.3	15A
FUC-323	323	FXAQ07PWJU	ACCU-3	260	7.5	WALL	208-230V, 1PH	0.3	15A
FUC-324	324	FXAQ07PWJU	ACCU-3	260	7.5	WALL	208-230V, 1PH	0.3	15A
FUC-327	327	FXAQ07PWJU	ACCU-3	260	7.5	WALL	208-230V, 1PH	0.3	15A
FUC-329	329	FXAQ07PWJU	ACCU-3	260	7.5	WALL	208-230V, 1PH	0.3	15A
FUC-330	330	FXAQ07PWJU	ACCU-3	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-345	345	FXAQ07PWJU	ACCU-2	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-347	347	FXAQ07PWJU	ACCU-2	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-348	348	FXAQ12PWJU	ACCU-2	290	20	WALL	208-230V, 1PH	0.4	15A
FUC-352	352	FXAQ12PWJU	ACCU-2	290	20	WALL	208-230V, 1PH	0.4	15A
FUC-354	354	FXAQ07PWJU	ACCU-1	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-356	356	FXAQ07PWJU	ACCU-1	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-357	357	FXAQ07PWJU	ACCU-1	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-359	359	FXAQ07PWJU	ACCU-1	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-360	360	FXAQ07PWJU	ACCU-1	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-362	362	FXAQ07PWJU	ACCU-1	260	15	WALL	208-230V, 1PH	0.3	15A
FUC-370	370	FXZQ05TAWJU	ACCU-6	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-371	371	FXZQ05TAWJU	ACCU-6	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-374	374	FXZQ05TAWJU	ACCU-6	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-376	376	FXZQ05TAWJU	ACCU-6	300	15	CEILING	208-230V, 1PH	0.3	15A

ACCESSORIES SHALL INCLUDE: INLINE CONDENSATE PUMP, REFINET BRANCH PIPING KITS, WIRED REMOTE CONTROLLERS, INTERFACE FOR USE IN BACNET, INDIVIDUAL ROOM CONTROL, AND FRESH AIR INTAKE FLANGE.

DRAWING REVISION



ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:




REVISIONS:	DATE	DESCRIPTION
Δ	02.21.20	FAN COIL UNIT AND PLUMBING FIXTURE REVISIONS

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
FOURTH FLOOR PLAN  
- HVAC

SCALE: 1/8"=1'-0"  
DRAWN BY: BIC  
REVIEWED BY: GDD

DRAWING NO.:  
**M-12**  
04.16.2020 - CM BID  
DATE: 05 MARCH 2020  
GDD JOB NUMBER: 19469

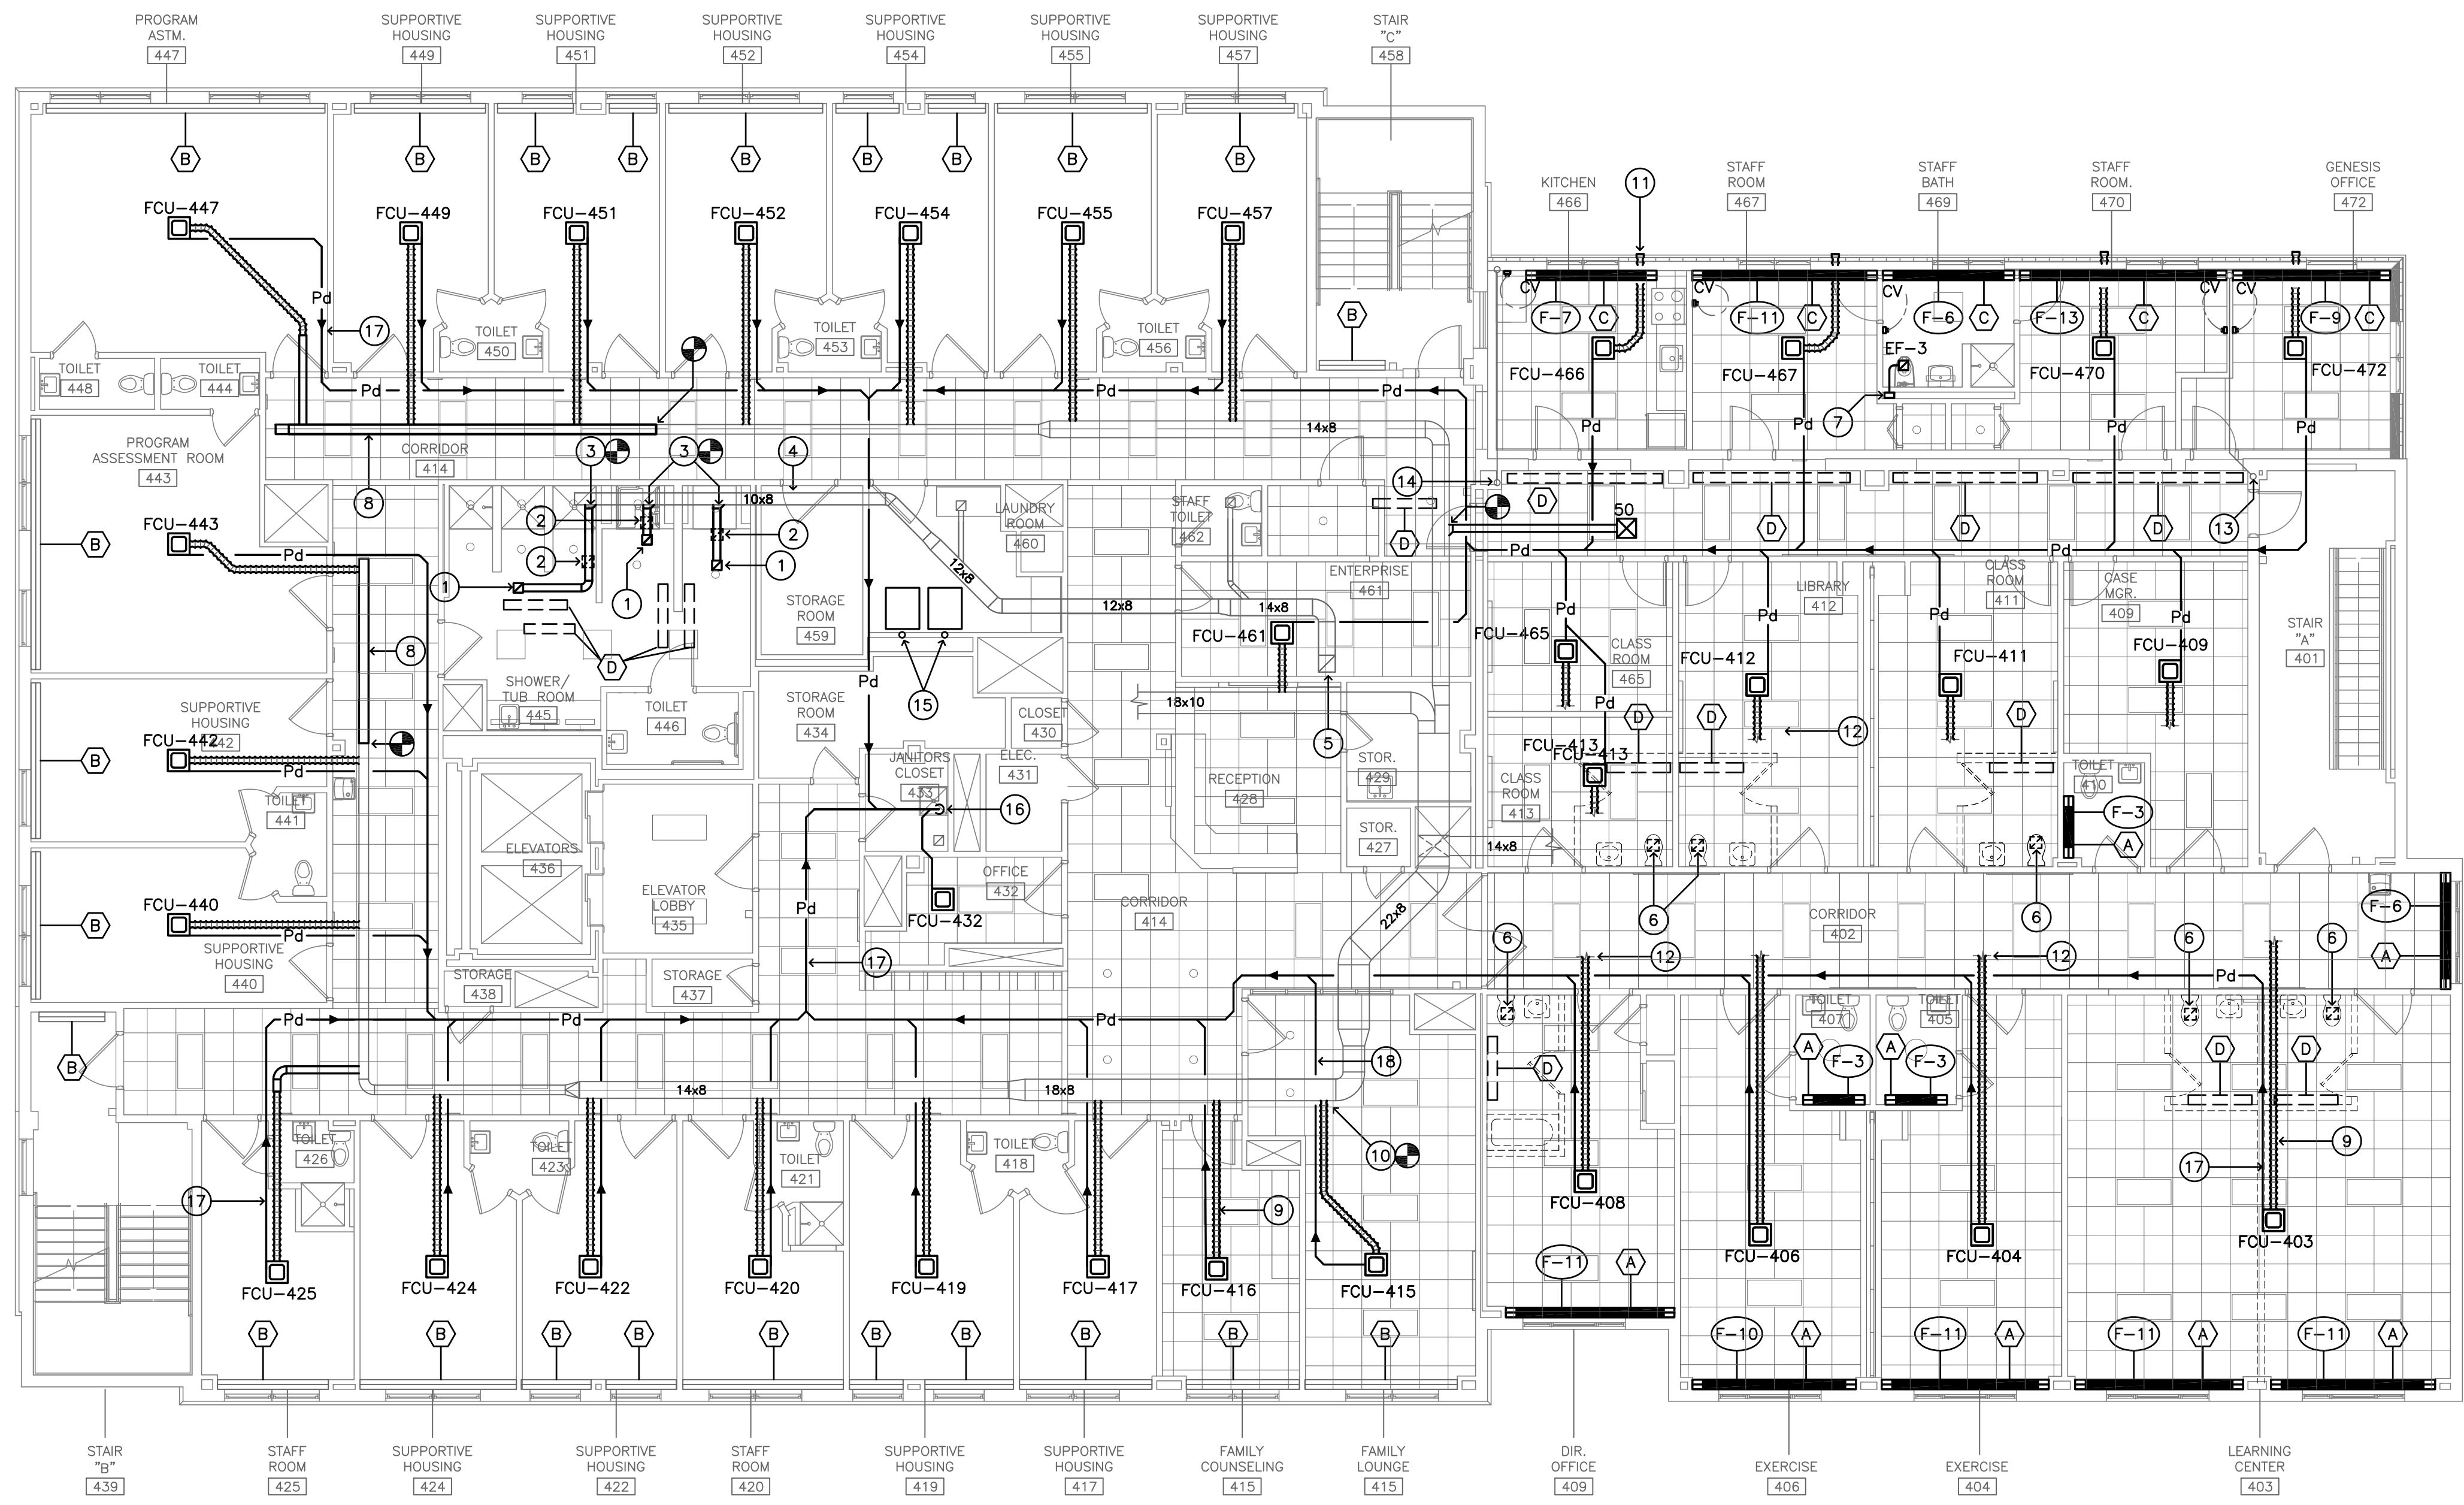

FOURTH FLOOR PLAN - HVAC  
SCALE: 1/8" = 1'-0"

FAN COIL UNIT SCHEDULE - FOURTH FLOOR									
SYMBOL	ROOM	DAIKIN FAN COIL UNIT MODEL	OUTDOOR UNIT	C.F.M.	O.A. C.F.M.	MOUNTING LOCATION	VOLTAGE	MCA	MOP
FUC-403	403	FXZQ024TAVJ	ACCU-5	777	150	CEILING	208-230V, 1PH	0.7	15A
FUC-404	404	FXZQ09TAVJ	ACCU-5	317	60	CEILING	208-230V, 1PH	0.3	15A
FUC-406	406	FXZQ09TAVJ	ACCU-5	317	60	CEILING	208-230V, 1PH	0.3	15A
FUC-408	408	FXZQ09TAVJ	ACCU-5	317	15	CEILING	208-230V, 1PH	0.3	15A
FUC-409	409	FXZQ09TAVJ	ACCU-4	317	20	CEILING	208-230V, 1PH	0.3	15A
FUC-411	411	FXZQ12TAVJ	ACCU-4	317	50	CEILING	208-230V, 1PH	0.4	15A
FUC-412	412	FXZQ12TAVJ	ACCU-4	317	30	CEILING	208-230V, 1PH	0.4	15A
FUC-413	413	FXZQ05TAVJ	ACCU-4	300	30	CEILING	208-230V, 1PH	0.3	15A
FUC-432	432	FXZQ05TAVJ	ACCU-4	300	7.5	CEILING	208-230V, 1PH	0.3	15A
FUC-461	461	FXZQ05TAVJ	ACCU-4	300	20	CEILING	208-230V, 1PH	0.3	15A
FUC-465	465	FXZQ05TAVJ	ACCU-4	300	30	CEILING	208-230V, 1PH	0.4	15A
FUC-415	415	FXZQ12TAVJ	ACCU-3	353	30	CEILING	208-230V, 1PH	0.3	15A
FUC-416	416	FXZQ05TAVJ	ACCU-3	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-417	417	FXZQ05TAVJ	ACCU-3	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-419	419	FXZQ05TAVJ	ACCU-3	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-420	420	FXZQ05TAVJ	ACCU-3	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-422	422	FXZQ05TAVJ	ACCU-3	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-424	424	FXZQ05TAVJ	ACCU-3	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-425	425	FXZQ05TAVJ	ACCU-3	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-440	440	FXZQ07TAVJ	ACCU-2	307	15	CEILING	208-230V, 1PH	0.3	15A
FUC-442	442	FXZQ07TAVJ	ACCU-2	307	15	CEILING	208-230V, 1PH	0.3	15A
FUC-443	443	FXZQ12TAVJ	ACCU-2	353	20	CEILING	208-230V, 1PH	0.4	15A
FUC-447	447	FXZQ12TAVJ	ACCU-2	353	20	CEILING	208-230V, 1PH	0.4	15A
FUC-449	449	FXZQ05TAVJ	ACCU-1	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-451	451	FXZQ05TAVJ	ACCU-1	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-452	452	FXZQ05TAVJ	ACCU-1	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-454	454	FXZQ05TAVJ	ACCU-1	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-455	455	FXZQ05TAVJ	ACCU-1	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-457	457	FXZQ05TAVJ	ACCU-1	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-466	466	FXZQ05TAVJ	ACCU-6	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-467	467	FXZQ05TAVJ	ACCU-6	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-470	470	FXZQ05TAVJ	ACCU-6	300	15	CEILING	208-230V, 1PH	0.3	15A
FUC-472	472	FXZQ05TAVJ	ACCU-6	300	15	CEILING	208-230V, 1PH	0.3	15A

ACCESSORIES SHALL INCLUDE: INLINE CONDENSATE PUMP, REFINET BRANCH PIPING KITS, WIRED REMOTE CONTROLLERS, INTERFACE FOR USE IN BACNET, INDIVIDUAL ROOM CONTROL, AND FRESH AIR INTAKE FLANGE.

**RADIATION LEGEND**

- (A) REMOVE EXISTING RADIATION INCLUDING BACKPLATE, COVERS, FINNED-TUBE, ISOLATION VALVES, MANUAL AIR VENTS AND CONTROLS. IN ITS PLACE INSTALL NEW RADIATION (COVER TO BE WALL TO WALL WHERE SHOWN) WITH END CAPS AND SPLICE PLATES AS REQUIRED, NEW ISOLATION VALVES, MANUAL AIR VENTS AND CONTROLS.
- RADIATION BASE BID**  
SHALL BE "SLANT/FIN" OR EQUAL MULTI/PAK 80 HEAVY DUTY, HIGH OUTPUT BASEBOARD RADIATION WITH 18-GAUGE ONE PIECE FRONT PANEL, 16 GAUGE BRACKETS AND 22 GAUGE BACK AND TOP PANEL. RADIATION SHALL CONTAIN A HEATING ELEMENT TO PROVIDE A MINIMUM OF 700 B.T.U./FT. WITH 170°F. HOT WATER SUPPLY TEMPERATURE, PIPE SIZE TO MATCH EXISTING. ALL COVER COMPONENTS SHALL BE FACTORY PAINTED IN NU-WHITE OVEN BAKED CROSS-LINKED POLYESTER ENAMEL.
- RADIATION ADD ALTERNATE**  
SHALL BE "SLANT/FIN" OR EQUAL 350 L SERIES HEAVY DUTY HIGH OUTPUT, SLOPE-TOP BASEBOARD RADIATION WITH 16 GAUGE STEEL ONE PIECE FRONT COVER, 17 GAUGE BRACKETS. PIPE SIZE TO MATCH EXISTING. RADIATION SHALL CONTAIN A HEATING ELEMENT TO PROVIDE A MINIMUM OF 700 B.T.U./FT. WITH 170°F. HOT WATER SUPPLY TEMPERATURE, PIPE SIZE TO MATCH EXISTING. ALL COVER COMPONENTS SHALL BE FACTORY PAINTED IN NU-WHITE OVEN BAKED CROSS-LINKED POLYESTER ENAMEL.
- (B) EXISTING WALL MOUNTED FINNED-TUB RADIATION TO REMAIN. THE FINNED-TUBE ELEMENT MUST BE THOROUGHLY CLEANED, COVERS AND TRIM ARE TO BE REMOVED, CLEANED, PRIMED, PAINTED AND REINSTALLED (COLOR TO BE SELECTED BY ARCHITECT). SEQUENCE AS NOTED ABOVE SHALL BE THE RESPONSIBILITY OF THE MECHANICAL CONTRACTOR.
- (C) NEW HOT WATER BASEBOARD RADIATION SHALL BE THE SAME AS NOTED IN "BASE BID" RADIATION ABOVE, COMPLETE WITH ISOLATION VALVES, MANUAL AIR VENTS AND CONTROLS.
- (D) EXISTING RADIATION TO BE REMOVED IN ITS ENTIRETY INCLUDING ALL ASSOCIATED PIPING, VALVES AND ACCESSORIES.
- (F-10) SYMBOL INDICATES LENGTH OF RADIATION ELEMENT.


**RADIATION CONTROLS**

1. NEW RADIATION NOTED (A) SHALL BE INDIVIDUALLY CONTROLLED UTILIZING "TACO" RADIATION CONTROL VALVES.  
NEW RADIATION NOTED (C) SHALL BE INDIVIDUALLY CONTROLLED UTILIZING "TACO" RADIATION CONTROL VALVE.
2. FOR EXISTING RADIATION THAT REMAINS CONTRACTOR IS TO PROVIDE UNIT PIECES TO REPLACE ISOLATION VALVES, VENT VALVES AND CONTROL VALVES ON AN AS NEEDED BASIS.

ALL RADIATION TO BE EQUIPPED WITH "TACO" RADIATION CONTROL VALVES.

**LEGEND - M-12**

- 1 NEW 8"x8" CEILING EXHAUST GRILLE WITH DAMPER, 70 C.F.M. EACH.
- 2 REMOVE EXISTING CEILING EXHAUST GRILLE AND ASSOCIATED DUCTWORK BACK TO MAIN BRANCH.
- 3 CONNECT NEW 6" DIA. EXHAUST DUCTWORK TO EXISTING AND EXTEND TO NEW EXHAUST GRILLE LOCATION.
- 4 EXISTING 10"x8" EXHAUST DUCTWORK ABOVE CEILING.
- 5 EXISTING EXHAUST RISER.
- 6 REMOVE EXISTING CEILING EXHAUST GRILLE AND ASSOCIATED DUCTWORK BACK TO RISER LOCATION, BLANK OFF AT EXISTING RISER AIR-TIGHT.
- 7 7"x6" FROM BELOW AND 9"x6" UP THROUGH ROOF CURB AND TERMINATE WITH ROOF CAP.
- 8 EXTEND EXISTING 8"x8" DUCTWORK.
- 9 4" DIA. (INSULATED) FLEX DUCTWORK, TYPICAL.
- 10 CONNECT NEW 4" DIA. DUCTWORK TO EXISTING SUPPLY DUCTWORK ABOVE CEILING AND RUN TO FAN COIL UNIT, TYPICAL.
- 11 4" DIA. OUTSIDE AIR SCREENED INLET TYPICAL FOR (4).
- 12 CONNECT NEW FAN COIL UNIT TO EXISTING SUPPLY DUCTWORK ABOVE CEILING (NOT SHOWN).
- 13 EXISTING HOT WATER SUPPLY RISER EXTEND TO NEW PERIMETER RADIATION.
- 14 EXISTING HOT WATER RETURN RISER EXTEND TO NEW PERIMETER RADIATION.
- 15 SEE SECOND FLOOR PLAN DWG. M-10 FOR DUCTING OF CLOTHES DRYERS.
- 16 OPEN END CONDENSATE DRAIN PUMPED DISCHARGE (PD) LINE OVER JANITORS SERVICE SINK.
- 17 CONDENSATE DRAIN PUMPED DISCHARGE (PD) LINE FROM FAN COIL UNIT, TYPICAL.

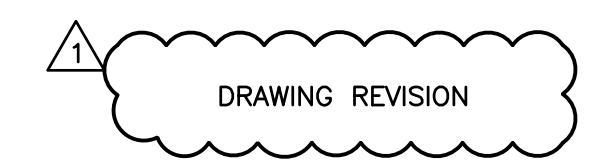



**ANTINOZZI ASSOCIATES**  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:

**GENERAL DRAFTING & DESIGN, INC.**  
CONSULTING ENGINEERS  
140 Washington Avenue, 3rd Floor  
North Haven, Connecticut 06473  
P: 203.239.8115 F: 203.239.2276  
G: gdd@net.net

REVISIONS:

DATE	DESCRIPTION
04.16.20	DRAWING REVISION

**JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION**  
**PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION**  
**725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT**

DRAWING TITLE:

**ROOF AND FIFTH FLOOR PLAN -  
PLUMBING & HVAC**

SCALE: 1/8"=1'-0" DRAWN BY: BJC REVIEWED BY: GDD


DRAWING NO.:

**M-13**  
04.16.2020 - CM BID

DATE: 05 MARCH 2020 GDD JOB NUMBER: 19469

**ROOF TOP EQUIPMENT ZONES**

ZONE - 1	WEST	(SOUTH BLDG.)
ZONE - 2	SOUTH	(SOUTH BLDG.)
ZONE - 3	EAST	(SOUTH BLDG.)
ZONE - 4	INTERIOR	(NORTH & SOUTH BLDG.)
ZONE - 5	EAST	(NORTH BLDG.)
ZONE - 6	WEST	(NORTH BLDG.)
RTU-7	5th. FLOOR	

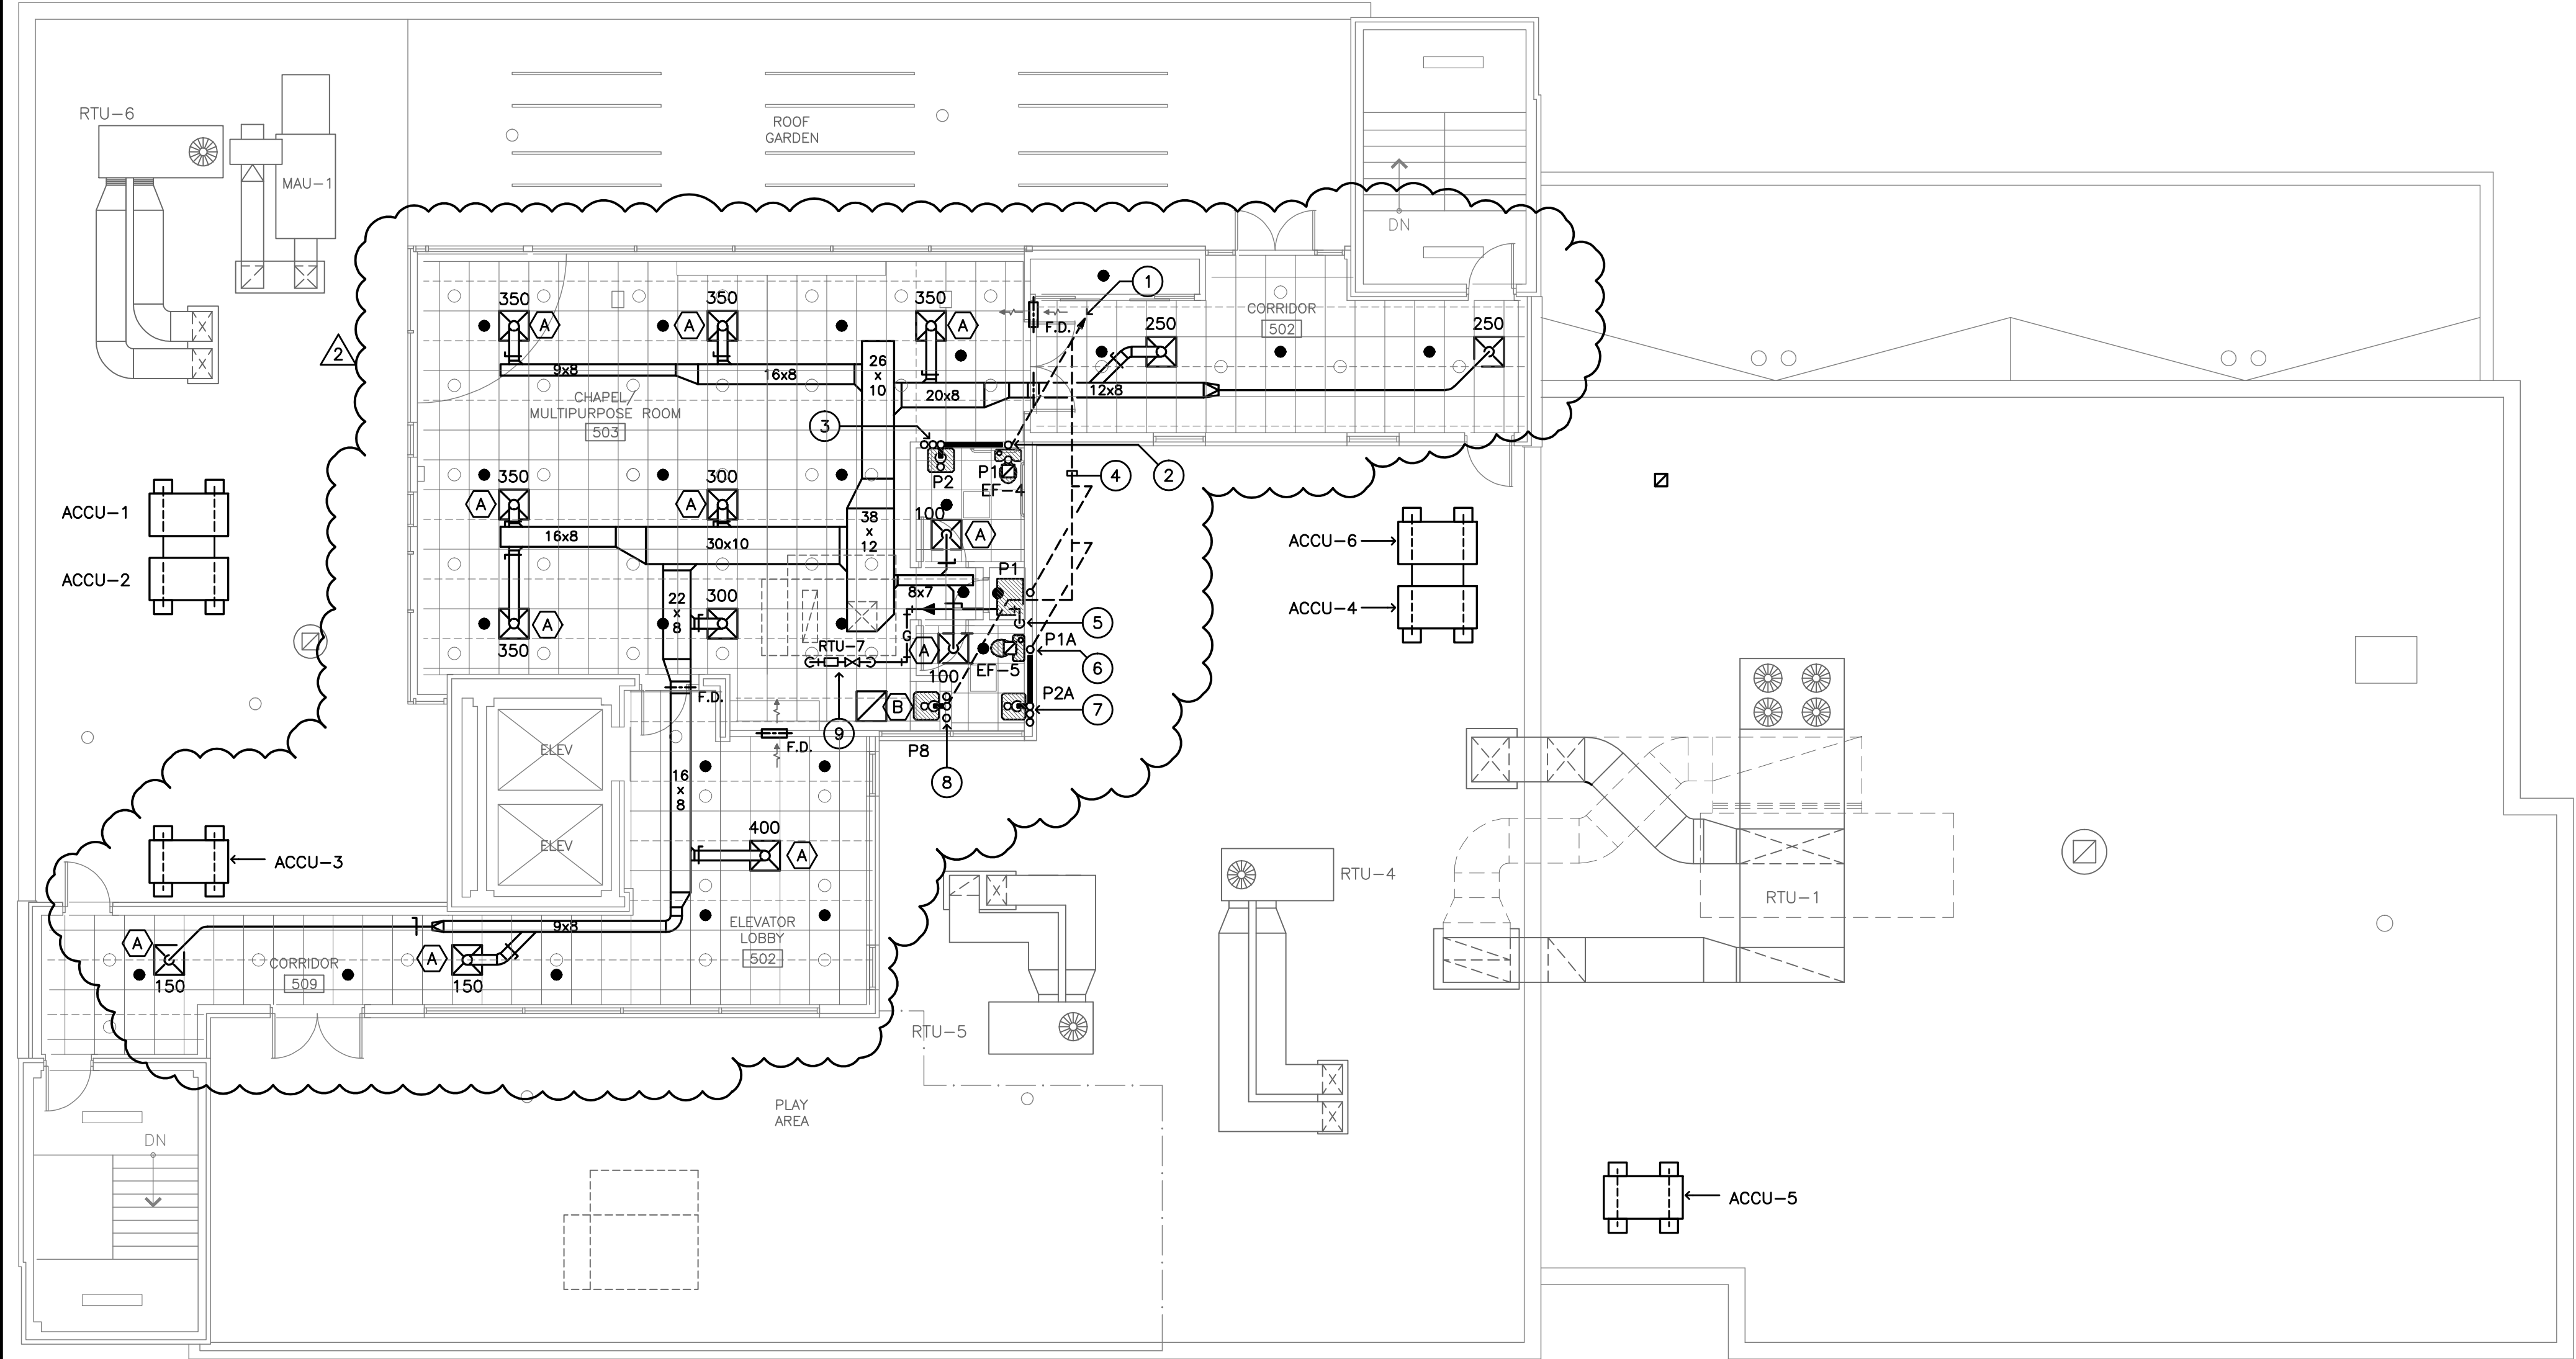


**ROOF AND FIFTH FLOOR PLAN - PLUMBING & HVAC**  
SCALE: 1/8" = 1'-0"



**LEGEND - M-13**

- ① 2" VENT UP AND 3" VENT THROUGH ROOF.
- ② WATER CLOSET - TANK TYPE, HANDICAP ACCESSIBLE, 1/2" COLD WATER FROM BELOW, 3" SANITARY DOWN AND 2" VENT UP.
- ③ LAVATORY - WALL HUNG, HANDICAP ACCESSIBLE, 1/2" HOT AND COLD WATER FROM BELOW, 1-1/2" WASTE TO WATER CLOSET WET VENT.
- ④ RUN ABOVE SUSPENDED CEILING.
- ⑤ 1" GAS LINE FROM BELOW, EXTEND TO ROOF TOP UNIT #7.
- ⑥ WATER CLOSET - TANK TYPE, 1/2" COLD WATER FROM BELOW, 3" SANITARY DOWN AND 2" VENT UP.
- ⑦ LAVATORY - WALL HUNG, 1/2" HOT AND COLD WATER FROM BELOW, 1-1/2" WASTE TO WATER CLOSET WET VENT.
- ⑧ STAINLESS STEEL COUNTER SINK - HANDICAP ACCESSIBLE, 1/2" HOT AND COLD WATER FROM BELOW, 2" WASTE DOWN AND 1-1/2" VENT UP.
- ⑨ 1" GAS LINE UP THROUGH PITCH BOX AT ROOF. PROVIDE BALL VALVE, GAS PRESSURE REGULATOR (2lb. INLET AND 9" W.C. OUTLET), DIRT LEG AND UNION AT CONNECTION TO ROOF TOP UNIT.
- ⑩ TYPICAL CHROME PENDENT "SEMI-RECESSED SPRINKLER HEAD.



**CONDENSING UNIT SCHEDULE**

SYMBOL	DAIKIN MODEL	REFRIGERANT	LOCATION	COOLING BTUH	HEATING BTUH	VOLTAGE	MCA	MOP	WEIGHT LBS
ACCU-1	RXYQ144TAYDU	R-410A	ROOF MOUNTED	132,914	88,988	460V, 3PH	25.9	35	710
ACCU-2	RXYQ144TAYDU	R-410A	ROOF MOUNTED	132,914	88,988	460V, 3PH	25.9	35	710
ACCU-3	RXYQ168TAYDU	R-410A	ROOF MOUNTED	154,560	95,895	460V, 3PH	25.9	35	710
ACCU-4	RXYQ168TAYDU	R-410A	ROOF MOUNTED	154,560	95,895	460V, 3PH	25.9	35	710
ACCU-5	RXYQ168TAYDU	R-410A	ROOF MOUNTED	154,560	95,895	460V, 3PH	25.9	35	710
ACCU-6	RXYQ96TAYDU	R-410A	ROOF MOUNTED	77,589	67,589	460V, 3PH	20.6	25	554

ACCESSORIES SHALL INCLUDE: DRAIN PAN HEATERS, AIR ADJUSTMENT GRILLE, LOW AMBIENT WIND BAFFLES AND QUICK-SLING 18" HIGH MODEL QSSS ROOF SUPPORT SYSTEM

**DIFFUSER/REGISTER/GRILLE SCHEDULE**

SYMBOL	MAKE	MODEL	TYPE	FACE SIZE	NECK SIZE	OPTIONS
(A)	TITUS	PSS	SQUARE SUPPLY DIFFUSER	24" x 24"	SAME AS BRANCH DUCT	BORDER TYPE 3 (LAY-IN) FLUSH W/CEILING TILE
(B)	TITUS	350RL	RETURN GRILLE	24" x 24"	22" x 22"	BORDER TYPE 3 (LAY-IN) FLUSH W/CEILING TILE


**GENERAL NOTES:**

- SEAL ALL NEW SUPPLY DUCTWORK AIRTIGHT.
- FLEXIBLE DUCTWORK MAY BE USED TO MAKE FINAL CONNECTION TO DIFFUSERS, MAXIMUM LENGTH SHALL BE 3'-0".
- PROVIDE A VOLUME DAMPER IN EACH NEW BRANCH DUCT TO EACH NEW DIFFUSER.
- ALL DUCT RUNOUTS TO INDIVIDUAL DIFFUSERS SHALL BE AS LISTED BELOW, UNLESS NOTED OTHERWISE:  
 TO 120 CFM 6" DIA.  
 125-210 CFM 8" DIA.  
 215-325 CFM 10" DIA.  
 330-470 CFM 12" DIA.
- AFTER WORK IS COMPLETED, TEST AND BALANCE SUPPLY AIR SYSTEMS TO CFM VALUES INDICATED.

**ROOFTOP UNIT SCHEDULE**


SYMBOL	MAKE	MODEL	NOMINAL TONS	ARRANGEMENT	SUPPLY AIR FAN				GAS HEAT				DX COOLING - R410A REFRIGERANT				OUTDOOR AIR		ELECTRICAL DATA			APPROX. WEIGHT INCLUDING ACCESSORIES LBS.	
					CFM	E.S.P.	DRIVE/SPEEDS	MOTOR HP	TOTAL CAPACITY OUTPUT MBH	TOTAL CAPACITY INPUT MBH	NO. OF STAGES	AFUE %	TOTAL CAPACITY NET BTUH	SENSIBLE CAPACITY NET BTUH	E.A.T. °F EDB/EWB	AMBIENT TEMP °F	COMPRESSOR QUALITY	OUTDOOR AIR MINIMUM CFM	OUTDOOR AIR CODE CFM	UNIT VOLTAGE	MCA		MOP
RTU-7	DAIKIN	DPS010A	10	DOWNFLOW	3,500	2.0	VARIABLE	4.0	160,000	200,000	MODULATING	80	125,204	98,322	80/67	95	2/INVERTED SCROLL	VAV MATCHES LOAD	100 PEOPLE 500	480V.-3PH	20.2	25	2313

UNIT SHALL BE COMPLETE WITH 0-100% ECONOMIZER, WITH COMPARATIVE ENTHALPH CONTROL, HOT GAS REHEAT WITH FIELD PROVIDE HUMIDITY SENSOR, CO2 SENSOR (SPACE MOUNTED) BRACKET/MSTP CORD, UNIT MOUNTED NON-FUSED DISCONNECT, SUPPLY MOUNTED SMOKE DETECTOR, THROUGH THE CURB ELECTRICAL SUPPLY, MERV-8 FILTERS, STAINLESS STEEL HEAT EXCHANGER, STAINLESS STEEL DRAIN PAN AND 14" HIGH FULL PERIMETER ROOF CURB.

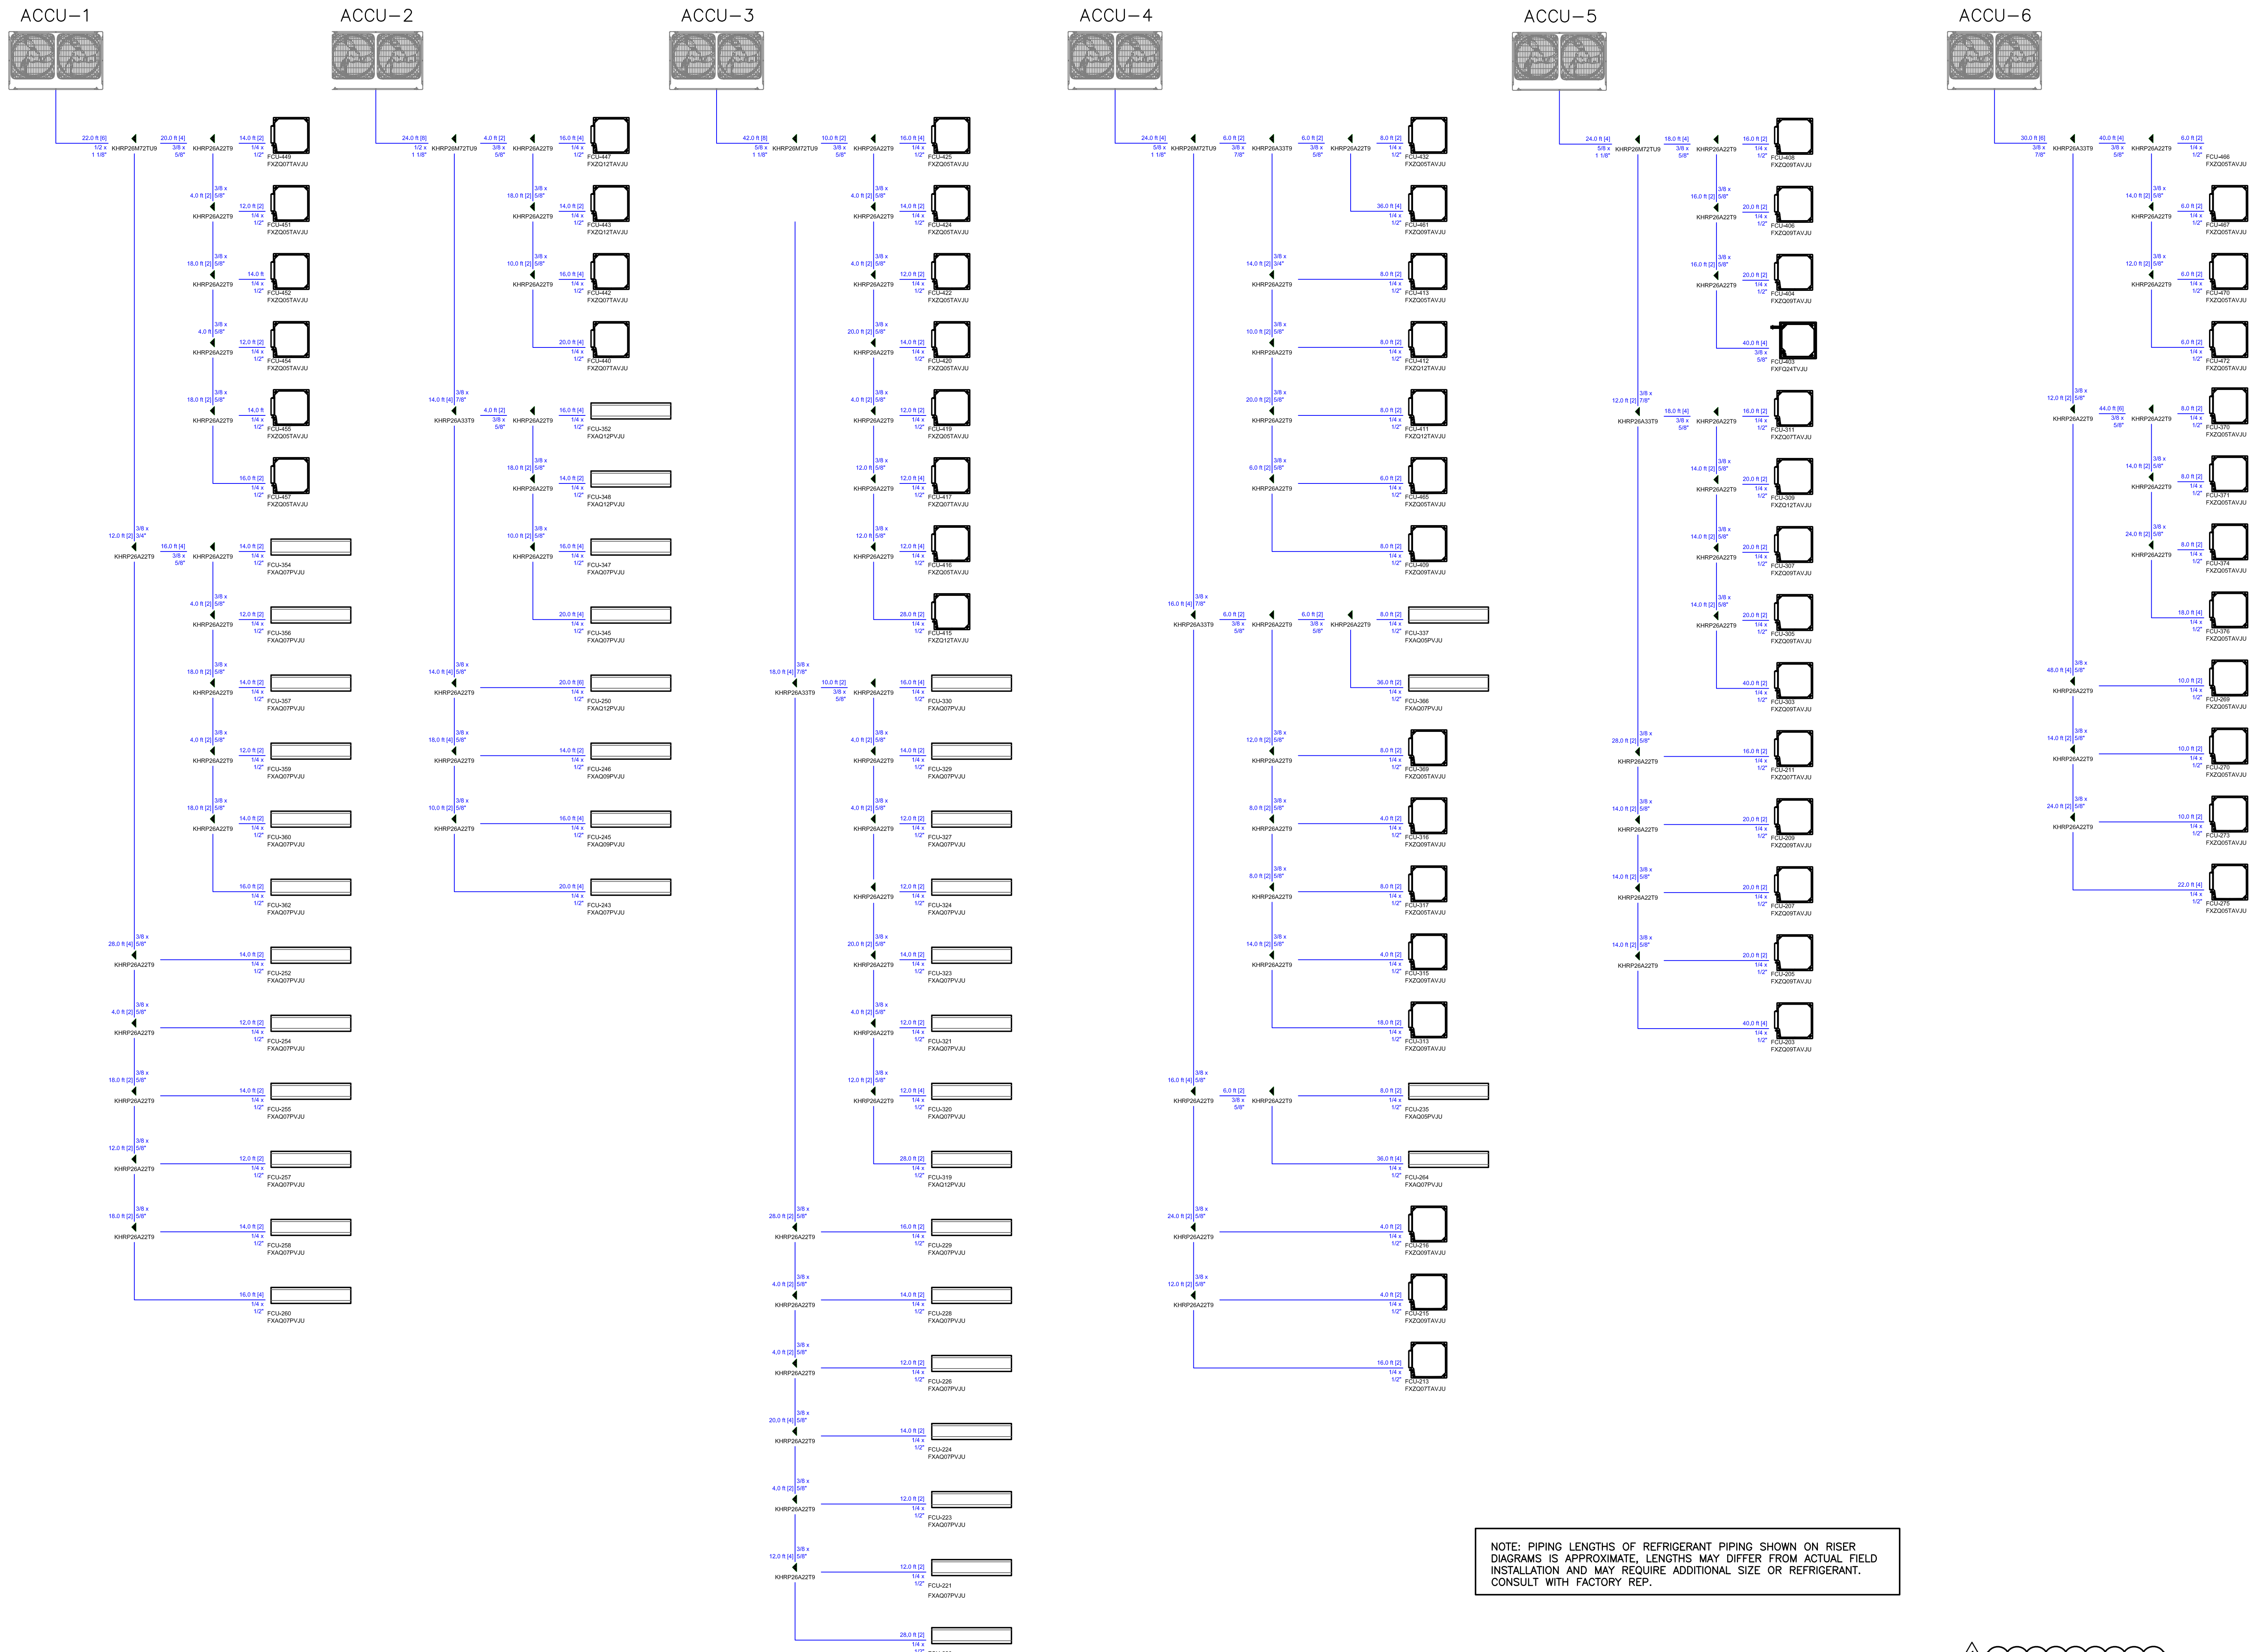

NOTE: PIPING LENGTHS OF REFRIGERANT PIPING SHOWN ON RISER DIAGRAMS IS APPROXIMATE. LENGTHS MAY DIFFER FROM ACTUAL. FIELD INSTALLATION AND MAY REQUIRE ADDITIONAL SIZE OR REFRIGERANT. CONSULT WITH FACTORY REP.

DRAWING REVISION

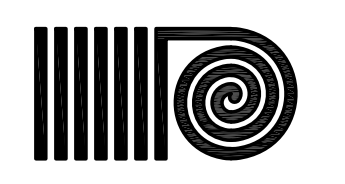

ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:



140 Washington Avenue, 3rd Floor  
North Haven, Connecticut 06473  
P: 203.338.8818 F: 203.338.7275  
e: gdd@aol.net

REVISIONS:	DATE	DESCRIPTION
02.21.20		FAN COIL UNIT AND PLUMBING FIXTURE REVISIONS

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
REFRIGERANT  
RISER DIAGRAM

SCALE: NONE DRAWN BY: BIC REVIEWED BY:

DRAWING NO.:

M-14  
04.16.2020 - CM BID

DATE: 05 MARCH 2020 GDD JOB NUMBER: 19469





**ANTINOZZI ASSOCIATES**  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460  
www.antinozzi.com


These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:

**GENERAL DRAFTING & DESIGN, INC.**  
CONSULTING ENGINEERS  
140 Washington Avenue, 3rd Floor  
North Haven, Connecticut 06473  
P: 203.239.2275  
E: gdd@net.net

REVISION	DATE	DESCRIPTION
1	02.21.20	FAN COIL UNIT AND PLUMBING FIXTURE REVISIONS

**JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION**  
**PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION**  
**725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT**

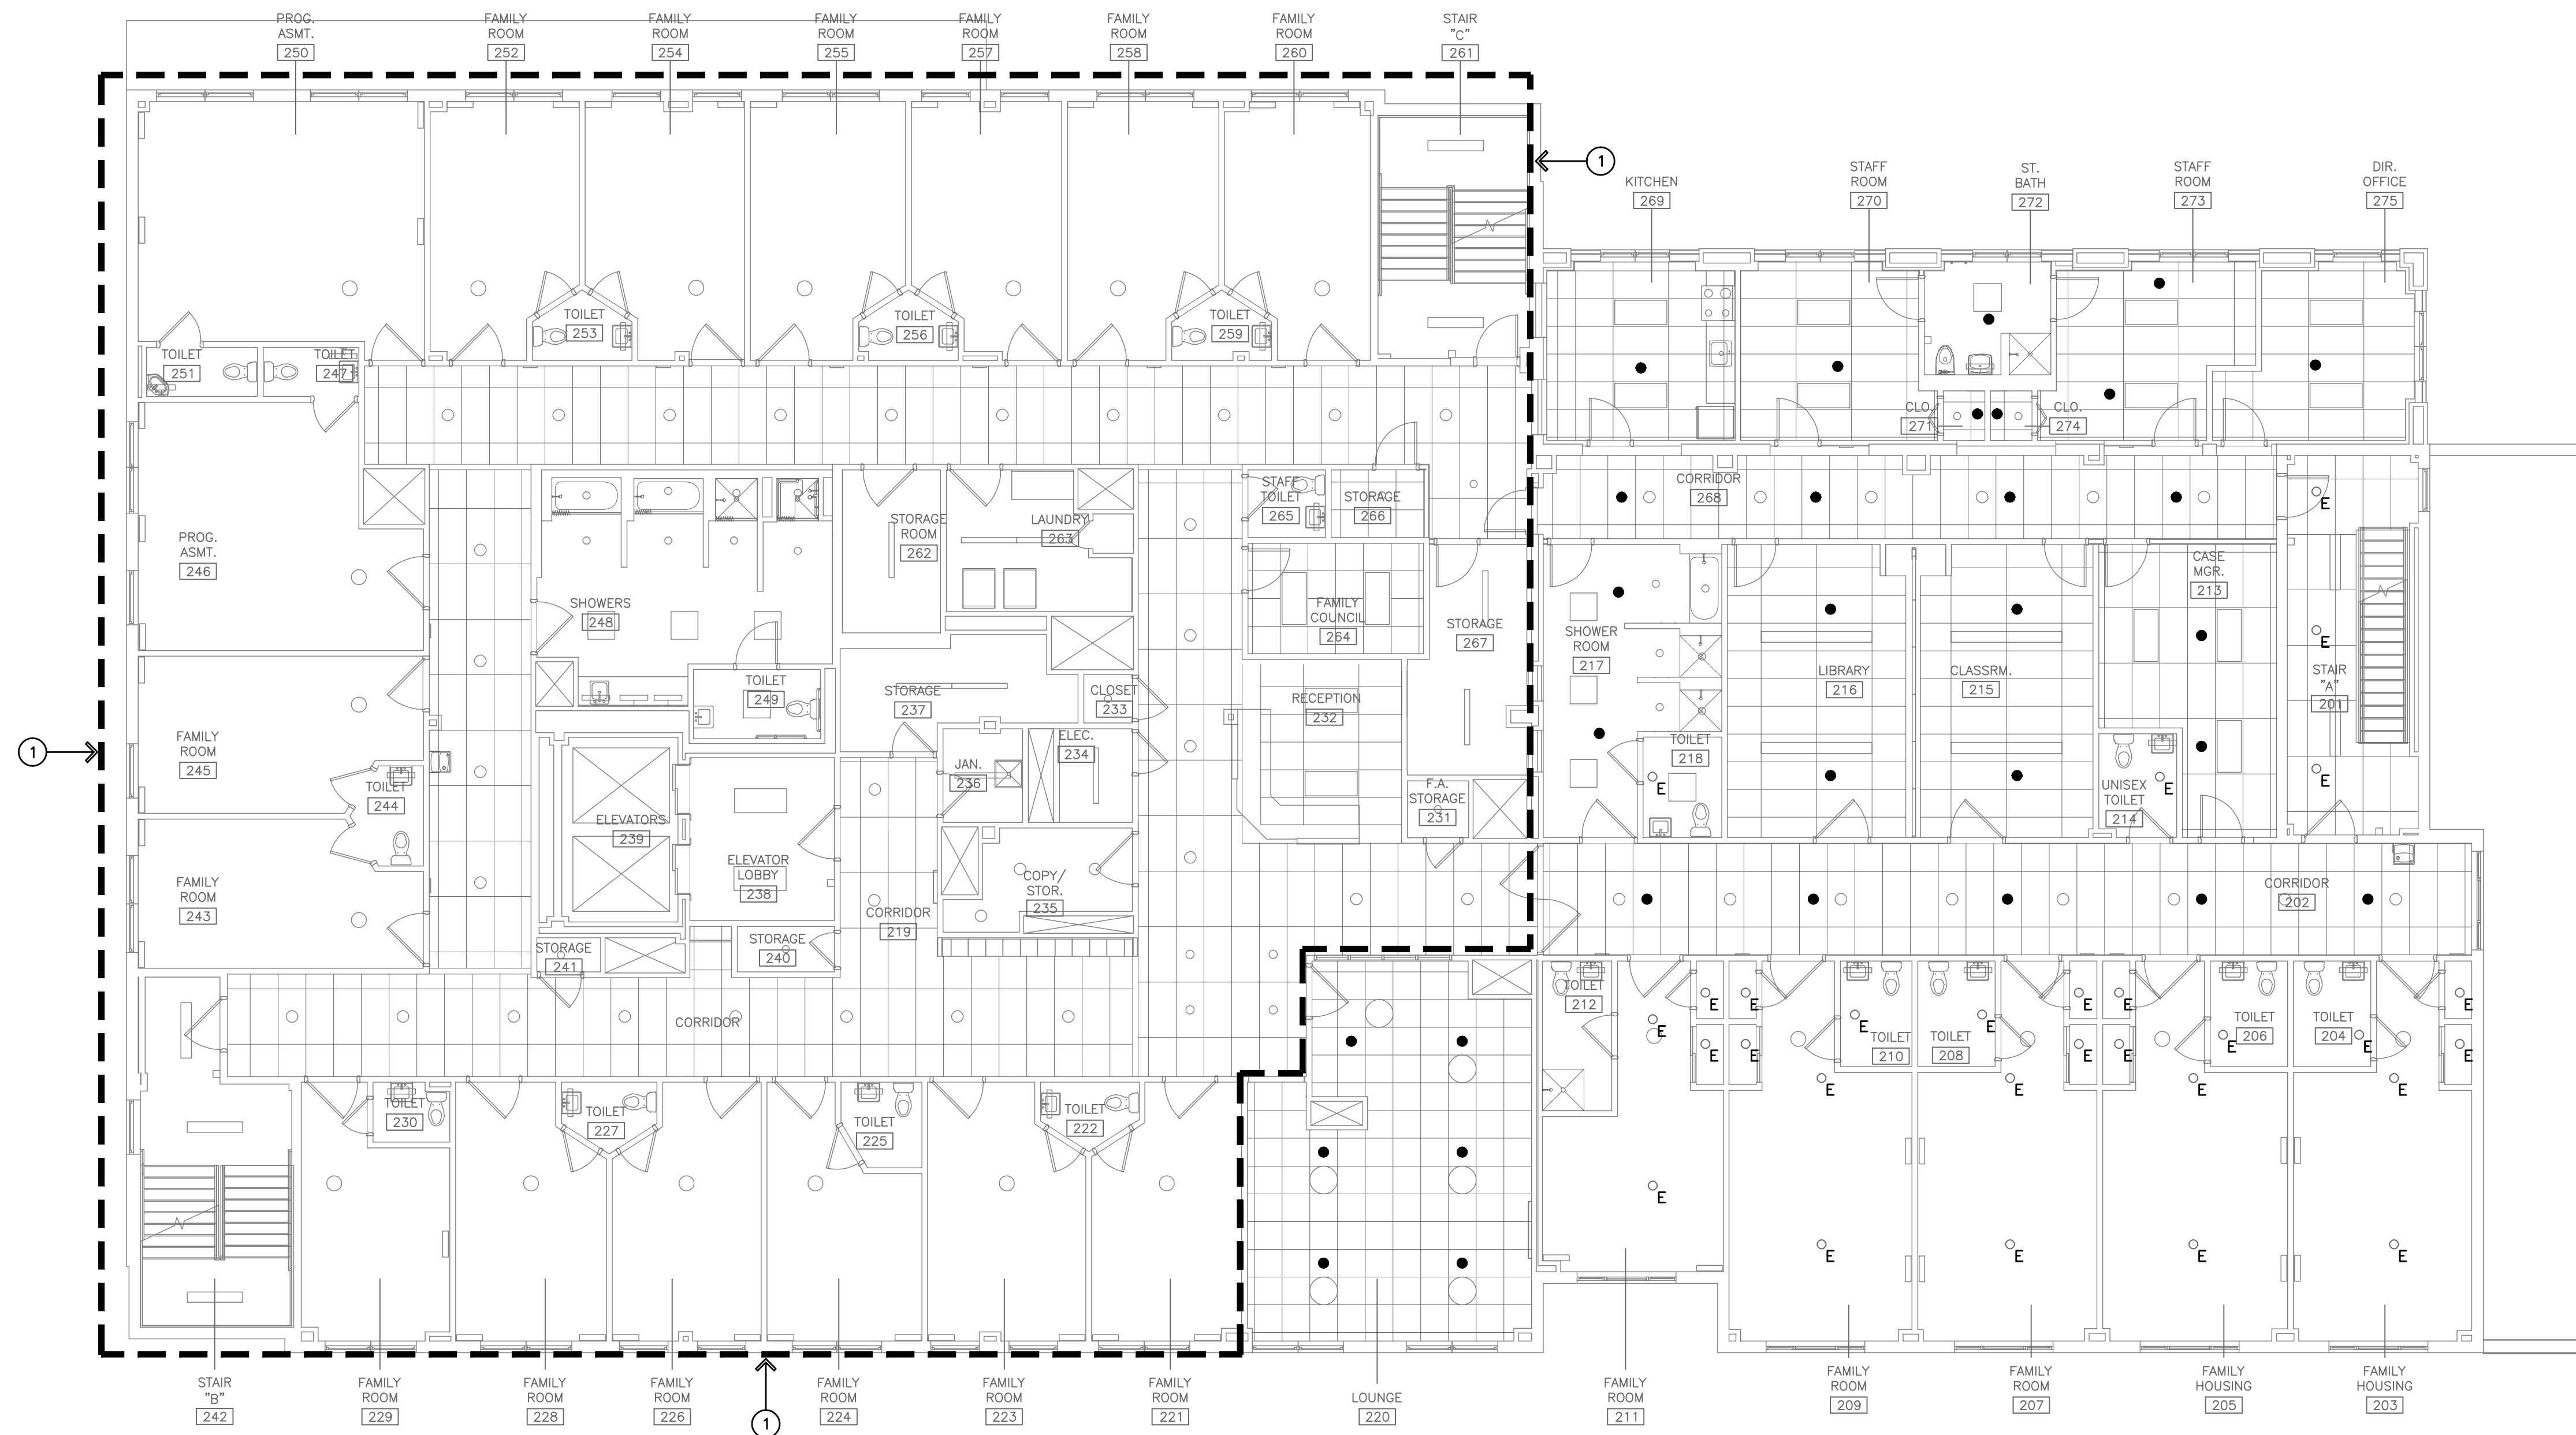

**SECOND FLOOR PLAN – FIRE PROTECTION**  
SCALE: 1/8" = 1'-0"



**LEGEND**

- ① AREA INSIDE DASHED LINES PROTECTED BY EXISTING SPRINKLER SYSTEM TO REMAIN IN SERVICE. EXISTING SPRINKLER HEADS NOT SHOWN

**FIRE PROTECTION SYMBOLS**

- - EXISTING SPRINKLER HEAD TO REMAIN.
- - NEW CHROME PENDENT SEMI-RECESSED SPRINKLER HEAD. CONNECT TO EXISTING PIPING. EXTEND BRANCH PIPING OR CROSS MAIN AS NECESSARY TO SUIT NEW LAYOUT. MODIFY AS REQUIRED.

DRAWING TITLE:  
**SECOND FLOOR PLAN  
- FIRE PROTECTION**

SCALE: 1/8"=1'-0"  
DRAWN BY: BJC  
REVIEWED BY: GDD

DRAWING NO.:

**M-16**

04.16.2020 - CM BID

DATE: 05 MARCH 2020  
GDD JOB NUMBER: 19469




**ANTINOZZI ASSOCIATES**  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460  
www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:

 **GENERAL DRAFTING & DESIGN, INC.**  
CONSULTING ENGINEERS  
140 Washington Avenue, 3rd Floor  
North Haven, Connecticut 06473  
P: 203.239.8100 F: 203.239.2276  
E: gdd@net.net

REVISIONS:

NO.	DATE	DESCRIPTION
1	02.21.20	FAN COIL UNIT AND PLUMBING FIXTURE REVISIONS


**JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION**  
**PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION**  
**725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT**

DRAWING TITLE:  
**THIRD FLOOR PLAN  
- FIRE PROTECTION**

SCALE: 1/8"=1'-0"  
DRAWN BY: BJC  
REVIEWED BY: GDD

DRAWING NO.:  
**M-17**  
04.16.2020 - CM BID

DATE: 05 MARCH 2020  
GDD JOB NUMBER: 19469

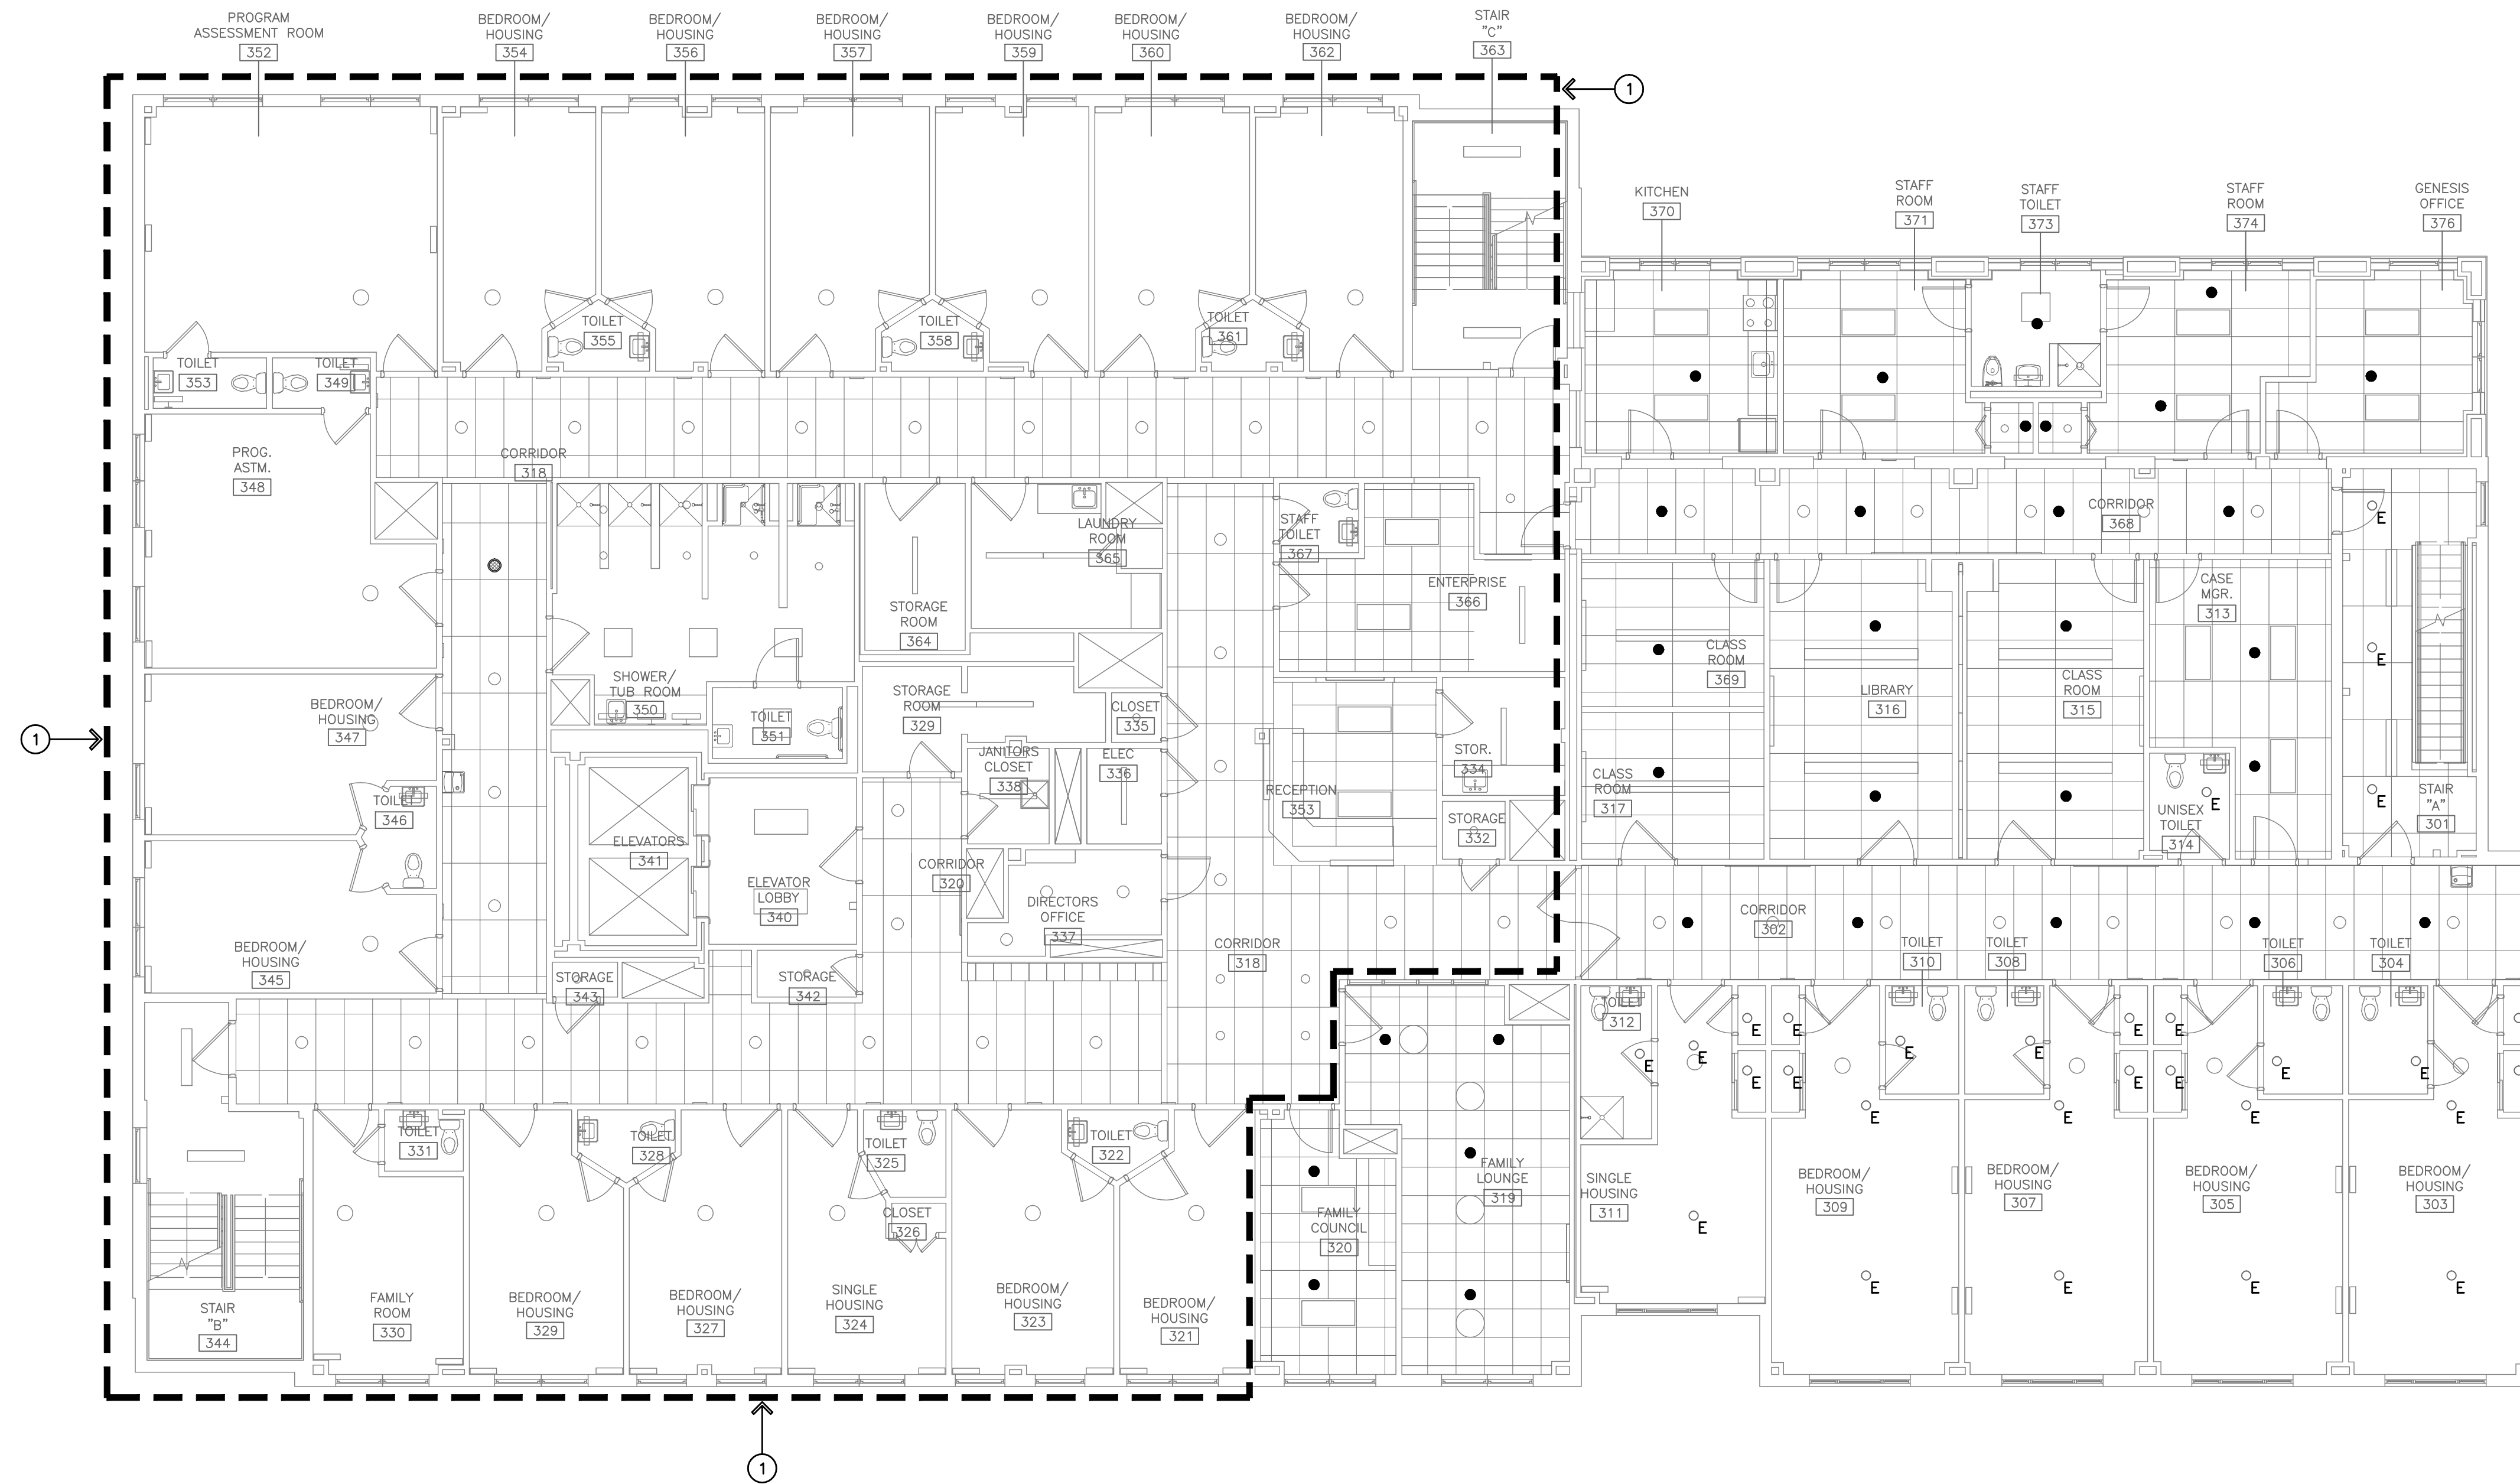

**THIRD FLOOR PLAN - FIRE PROTECTION**  
SCALE: 1/8" = 1'-0"



**LEGEND**

- ① AREA INSIDE DASHED LINES PROTECTED BY EXISTING SPRINKLER SYSTEM TO REMAIN IN SERVICE. EXISTING SPRINKLER HEADS NOT SHOWN




**ANTINOZZI ASSOCIATES**  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460  
www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:

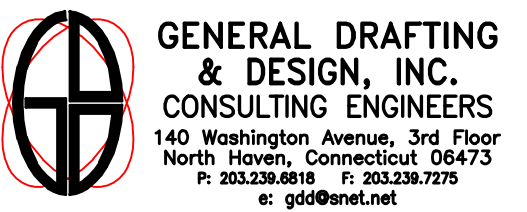

REVISIONS:

DATE	DESCRIPTION
02.21.20	FAN COIL UNIT AND PLUMBING FIXTURE REVISIONS

**JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION**  
**PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION**  
**725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT**


**FOURTH FLOOR PLAN  
- FIRE PROTECTION**

SCALE: 1/8" = 1'-0" DRAWN BY: BJC REVIEWED BY: GDD

DRAWING NO.:

**M-18**  
04.16.2020 - CM BID

DATE: 05 MARCH 2020 GDD JOB NUMBER: 19469

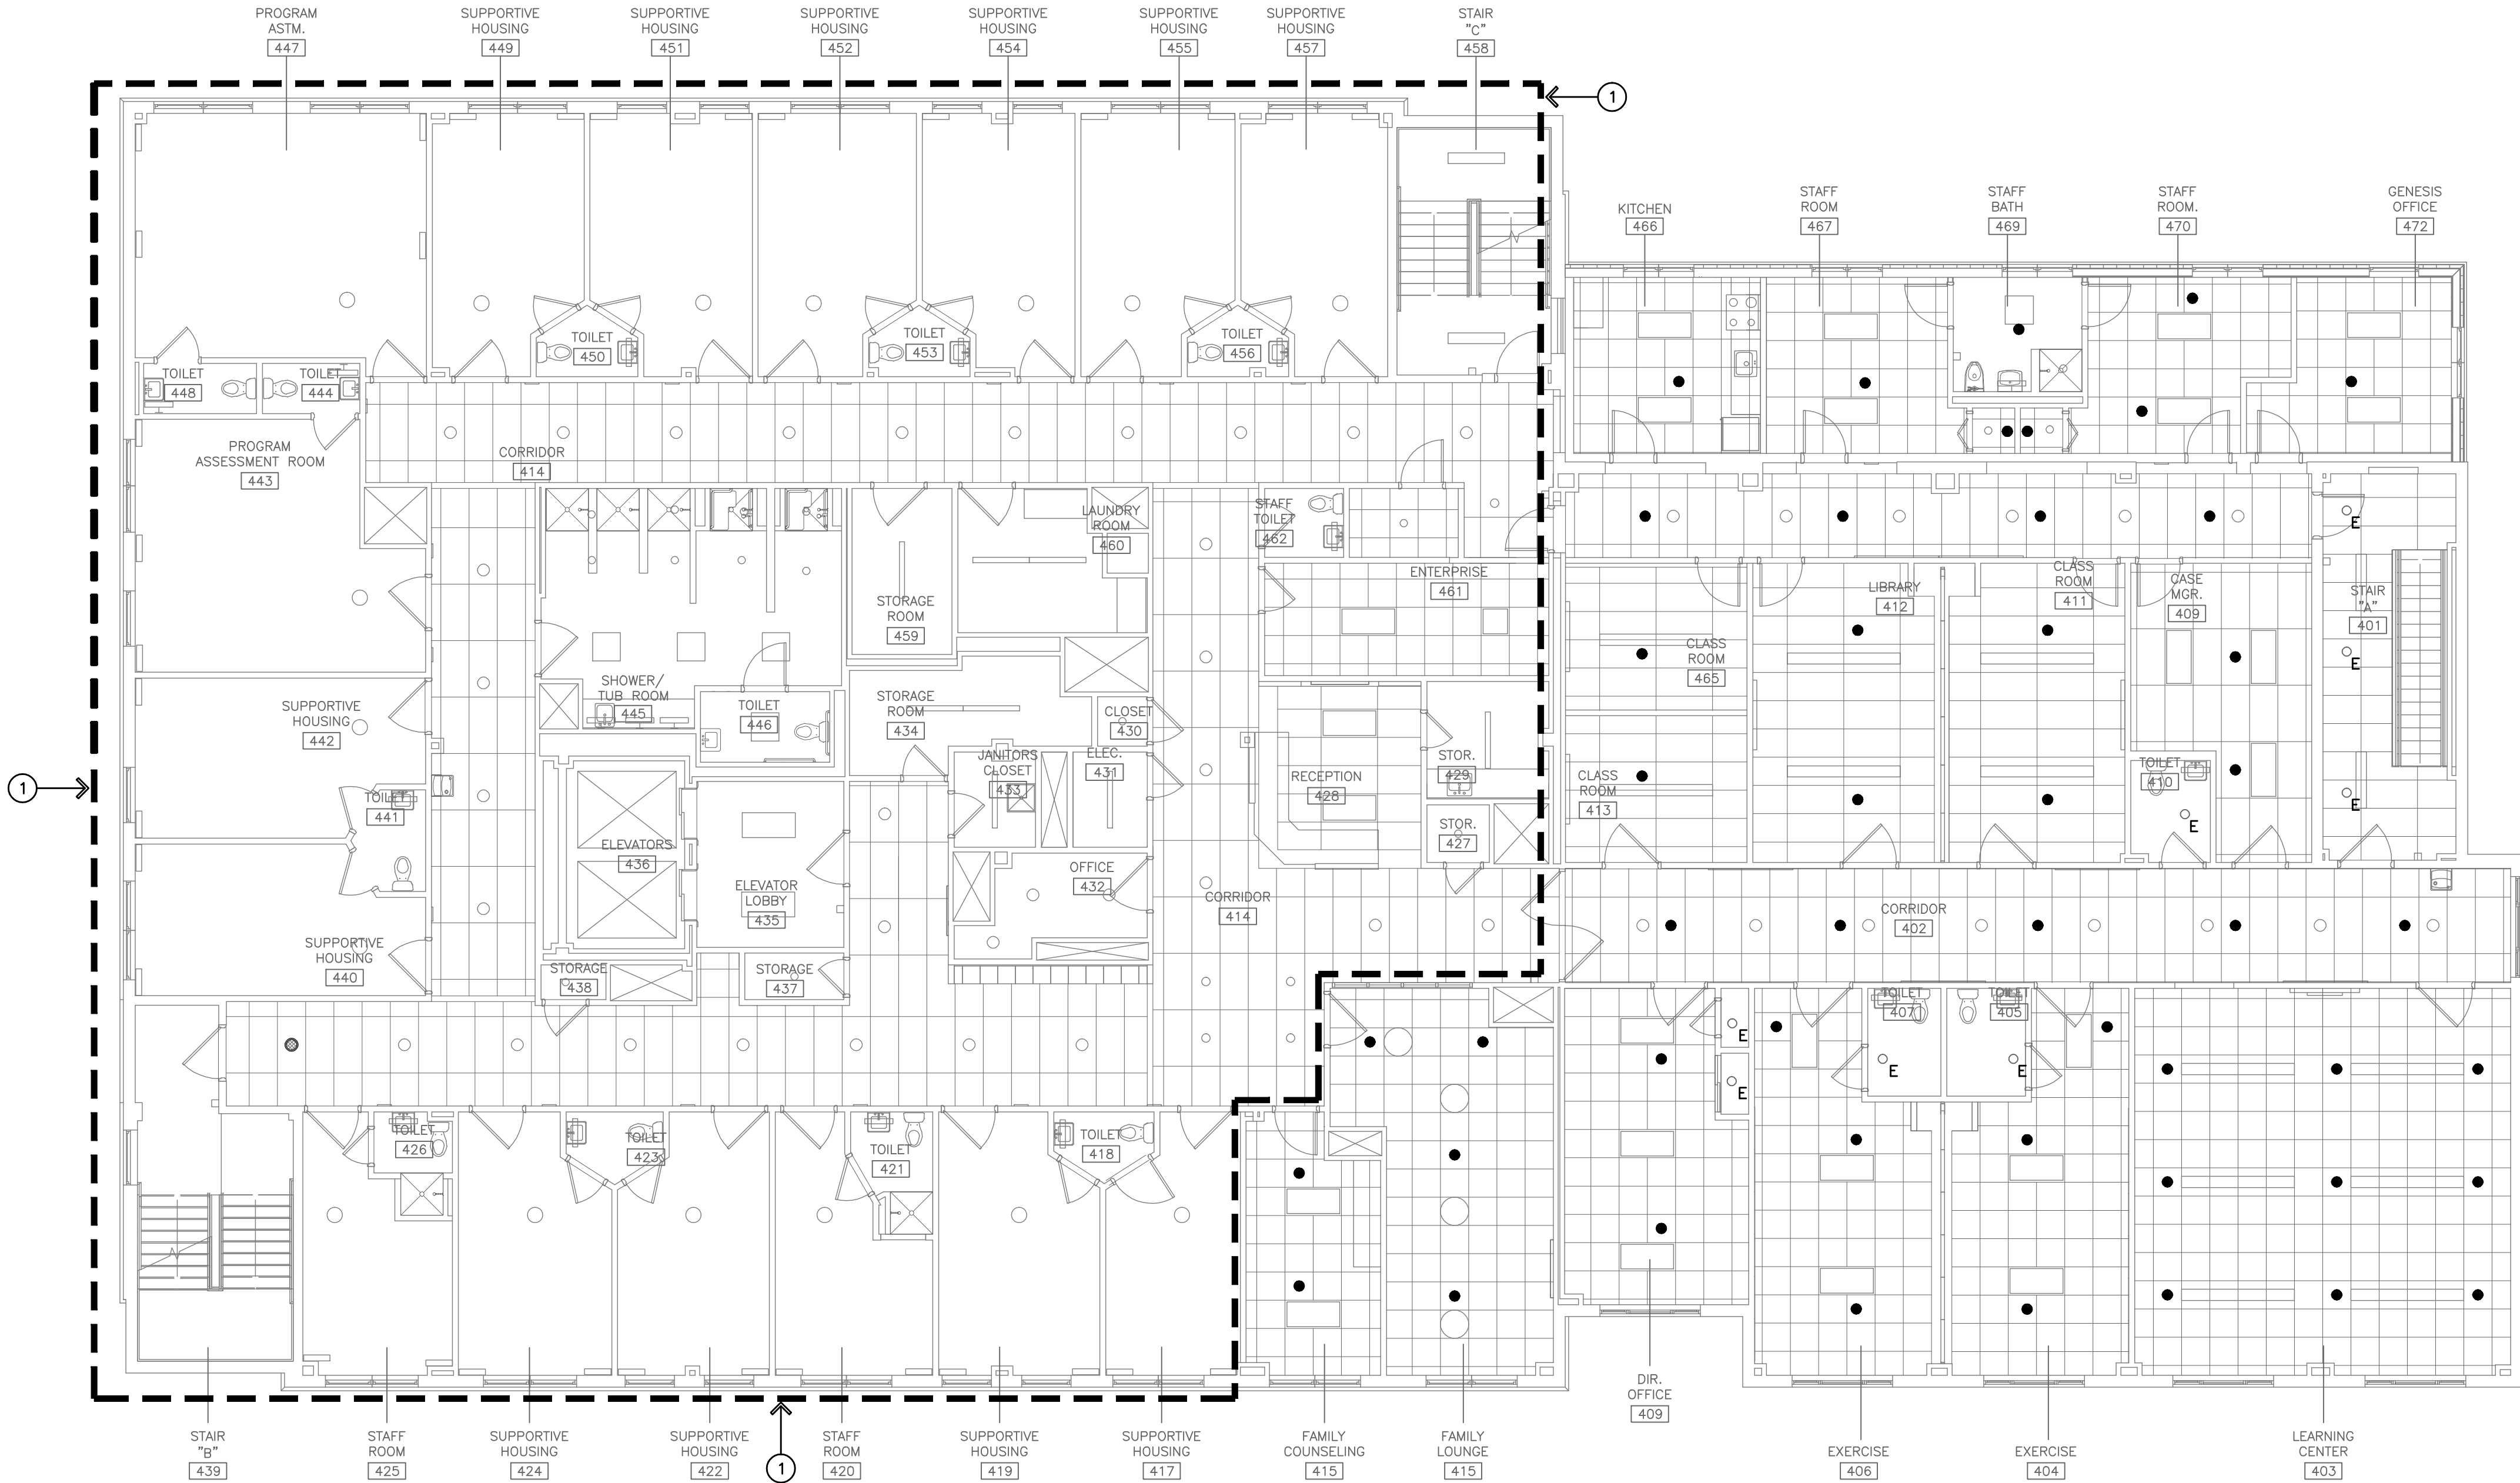

**FOURTH FLOOR PLAN - FIRE PROTECTION**  
SCALE: 1/8" = 1'-0"



**LEGEND**

- ① AREA INSIDE DASHED LINES PROTECTED BY EXISTING SPRINKLER SYSTEM TO REMAIN IN SERVICE. EXISTING SPRINKLER HEADS NOT SHOWN







REVISIONS:	DATE	DESCRIPTION

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
SECOND, THIRD AND  
FOURTH FLOOR  
REMOVAL PLANS

SCALE:	DRAWN BY:	REVIEWED BY:
NONE	MMV	MMV

DRAWING NO.  
**ED.2**  
04.16.2020 - CM BID  
DATE: 05 MARCH 2020 GDD JOB NUMBER: 19469

REMOVALS LEGEND

DISCONNECT & REMOVE (UNLESS OTHERWISE INDICATED), THE FOLLOWING:

- A - LIGHTING FIXTURES
- B - EXIT SIGNS
- C - TOGGLE SWITCHES AND COVER PLATES
- D - RECEPTACLES AND COVER PLATES
- E - VOICE/DATA OUTLET AND ASSOCIATED CABLING
- F - CATV OUTLET AND ASSOCIATED CABLING
- G - NURSE CALL DEVICES AND ASSOCIATED WIRING
- H - CALL-FOR-AID DEVICES AND ASSOCIATED WIRING
- J - FIRE ALARM DEVICES AND ASSOCIATED CABLING
- K - GENERATOR ANNUNCIATOR BACKBOX AND WIRING, AND NURSE CALL CONTROL AND DOOR ACCESS EQUIPMENT

REMOVAL NOTES


THE CONTRACTOR SHALL DISCONNECT AND REMOVE ALL ELECTRICAL WORK AS SHOWN AND NOTED ON DRAWINGS, AND ALSO ALL EQUIPMENT AND ELECTRICAL WORK NOT BEING USED.

BEFORE SUBMITTING HIS BID, THE CONTRACTOR SHALL VISIT THE SITE AND SURVEY THE EXISTING CONDITIONS UNDER WHICH HIS WORK WILL BE INSTALLED. FULL EXTENT OF DEMOLITION SHALL BE DETERMINED BY THE CONTRACTOR DURING HIS SITE VISIT. ALL NEW AND EXISTING EQUIPMENT AND SYSTEMS SHALL BE FULLY OPERATIONAL UNDER THIS CONTRACT BEFORE THE JOB IS CONSIDERED COMPLETE.

THE CONTRACTOR SHALL REMOVE AND/OR RELOCATE ALL EXISTING ELECTRICAL WORK WHICH INTERFERES WITH THE NEW ELECTRICAL LAYOUT. ALL DEVICES WHICH ARE NO LONGER REQUIRED TO FUNCTION SHALL BE DE-ENERGIZED, DISCONNECTED AND REMOVED BACK TO THE SOURCE OF SUPPLY. ALL EXISTING ACTIVE CIRCUITS WHICH FEED DEVICES THAT ARE TO REMAIN SHALL BE MAINTAINED IN SERVICE AND SHALL BE REFEED.


ALL ITEMS BEING REMOVED SHALL REMAIN THE PROPERTY OF THE OWNER. EQUIPMENT AND DEVICES THE OWNER DOES NOT WISH TO RETAIN SHALL BECOME THE PROPERTY OF THIS CONTRACTOR AND REMOVED FROM THE SITE. MATERIALS CHOSEN TO BE RETAINED BY THE OWNER SHALL BE DELIVERED BY THE CONTRACTOR TO A LOCATION DESIGNATED BY THE OWNER.

DISCONNECT AND COMPLETELY REMOVE ALL UNUSED CONDUIT, WIRING, BOXES, SUPPORTS, ETC. ASSOCIATED WITH ELECTRICAL EQUIPMENT BEING REMOVED.

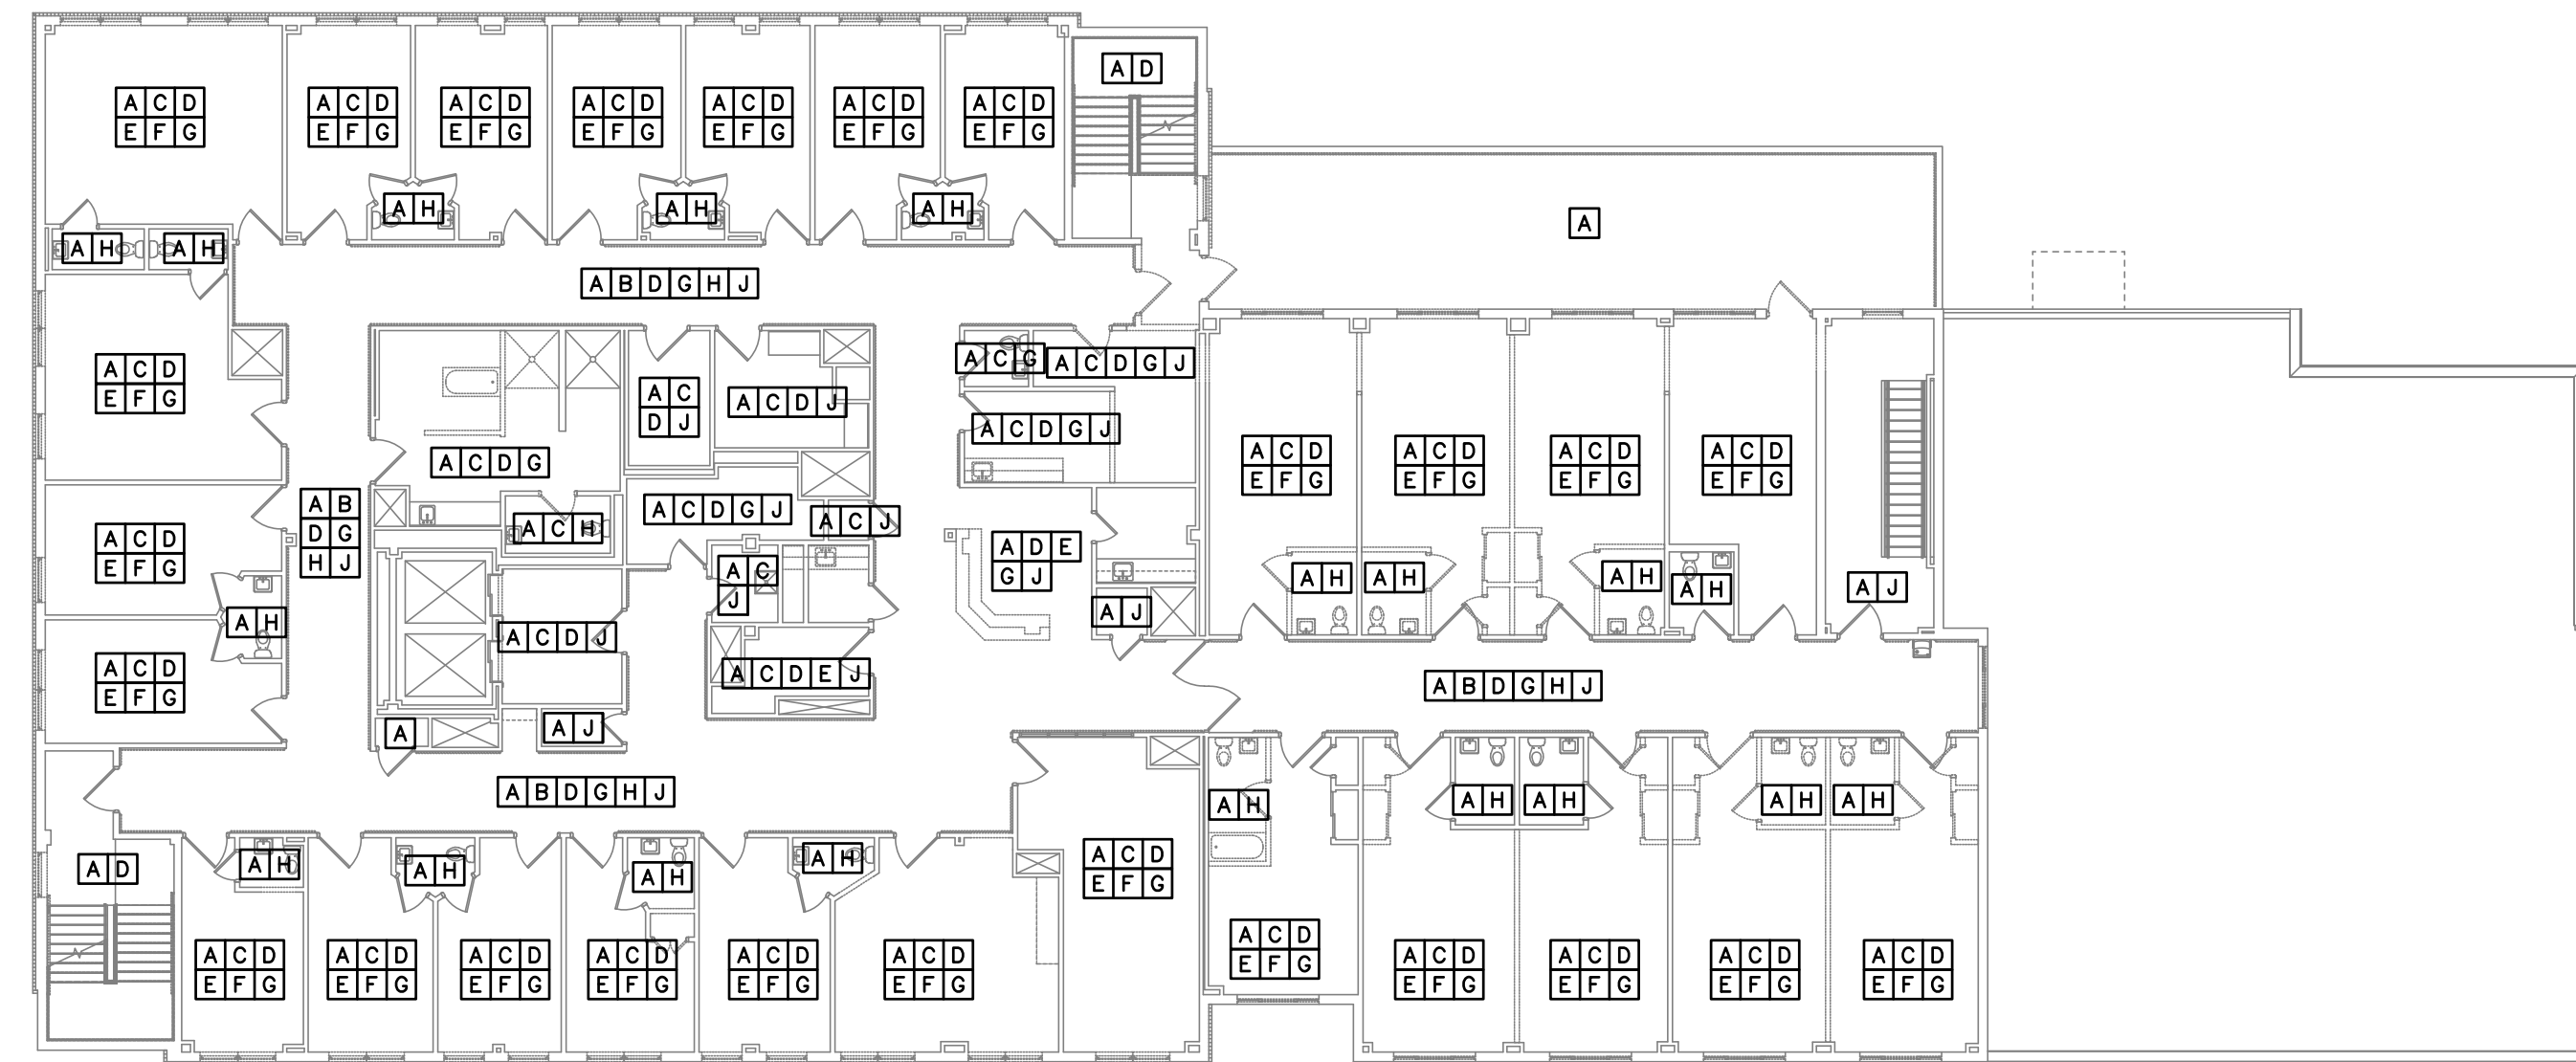


FOURTH FLOOR REMOVALS PLAN

SCALE: 1/16" = 1'-0"

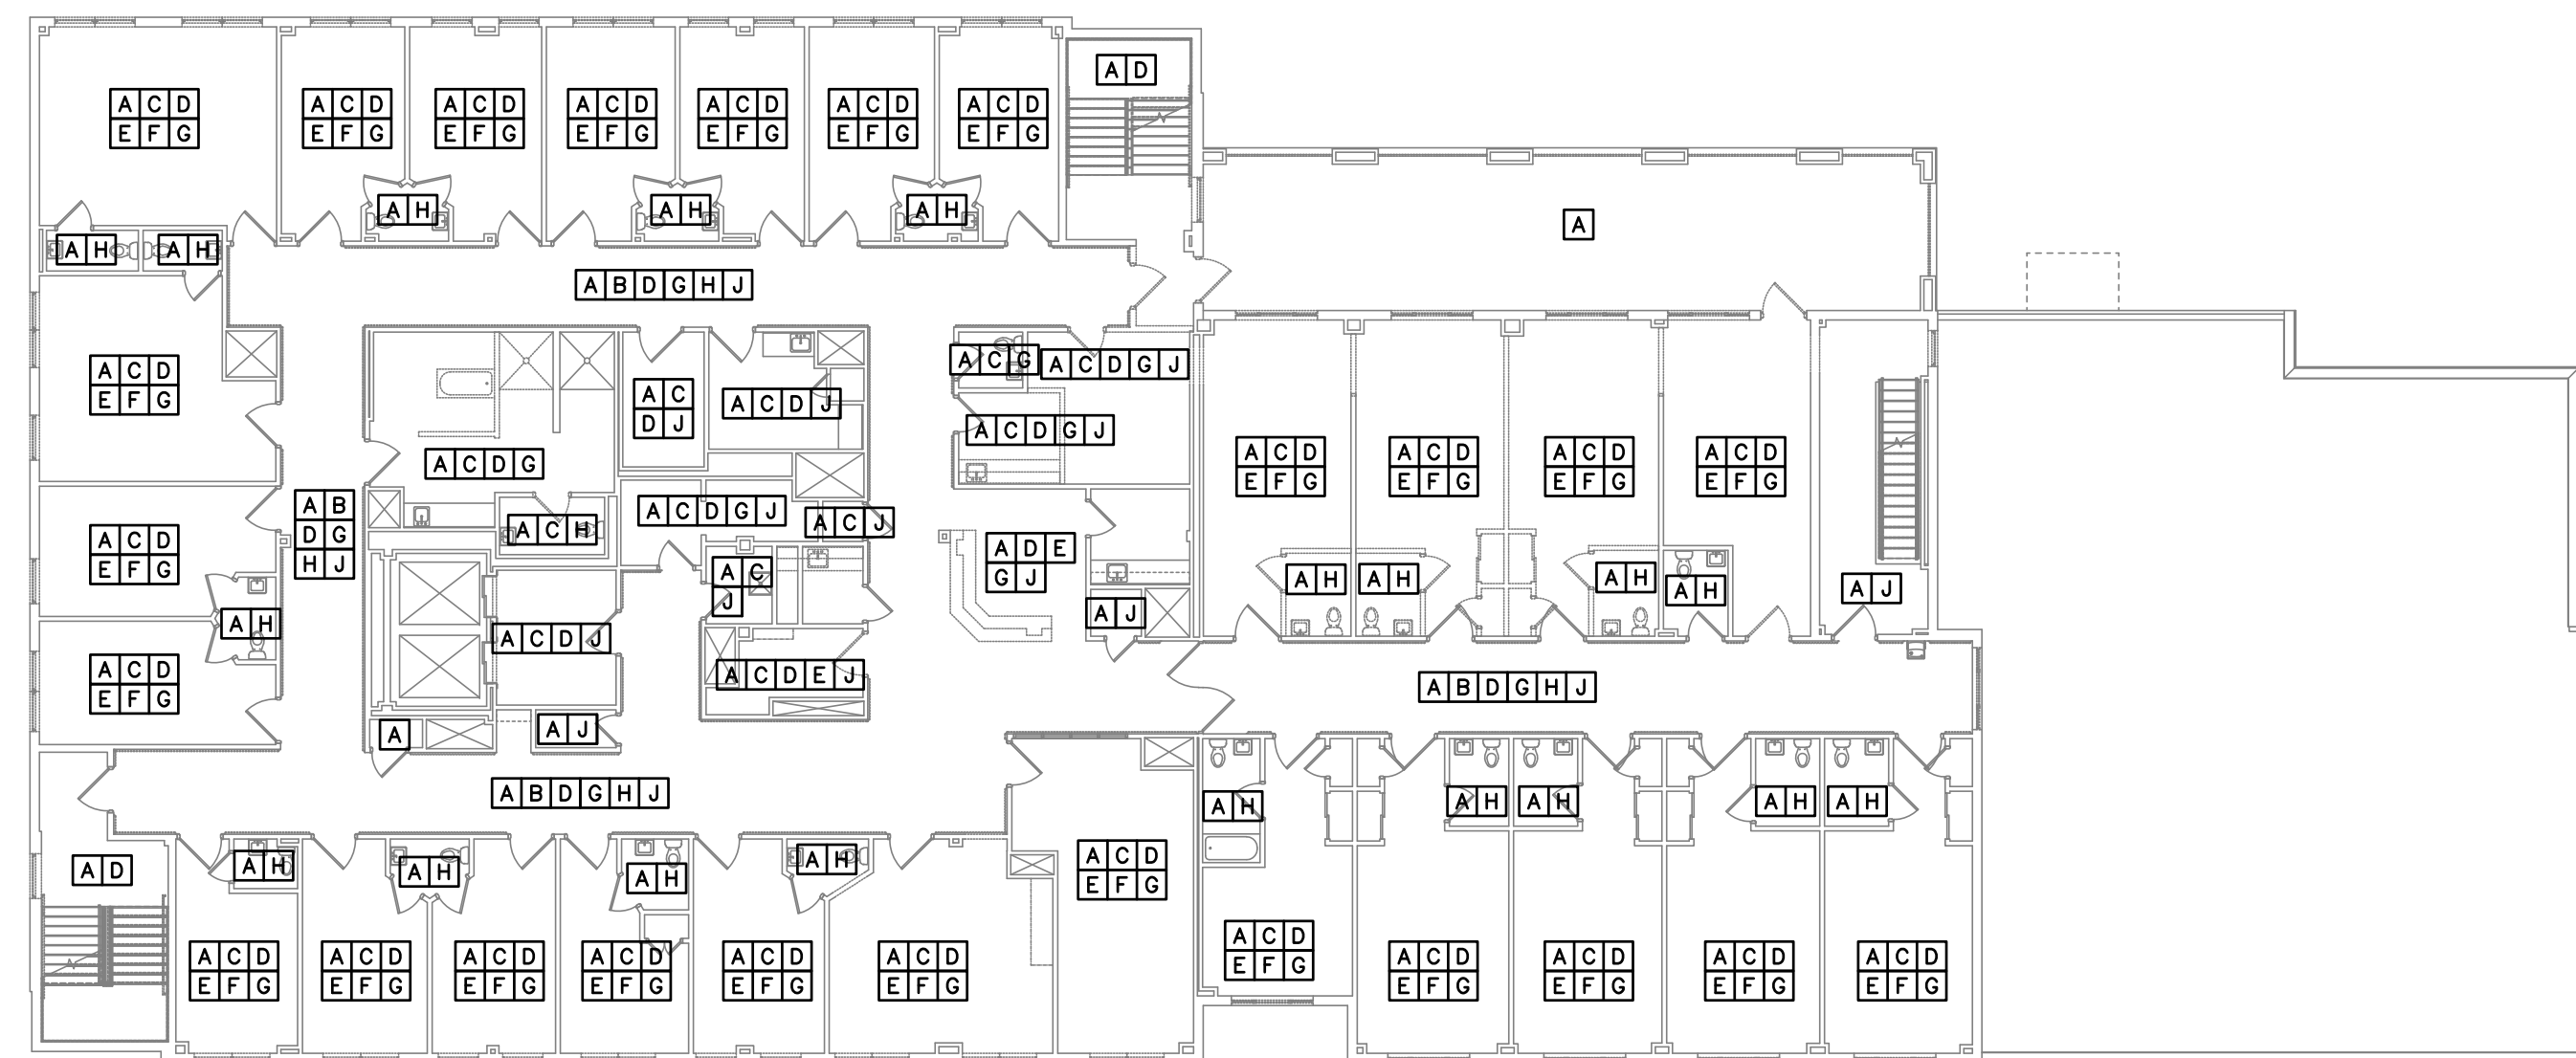


THIRD FLOOR REMOVALS PLAN

SCALE: 1/16" = 1'-0"

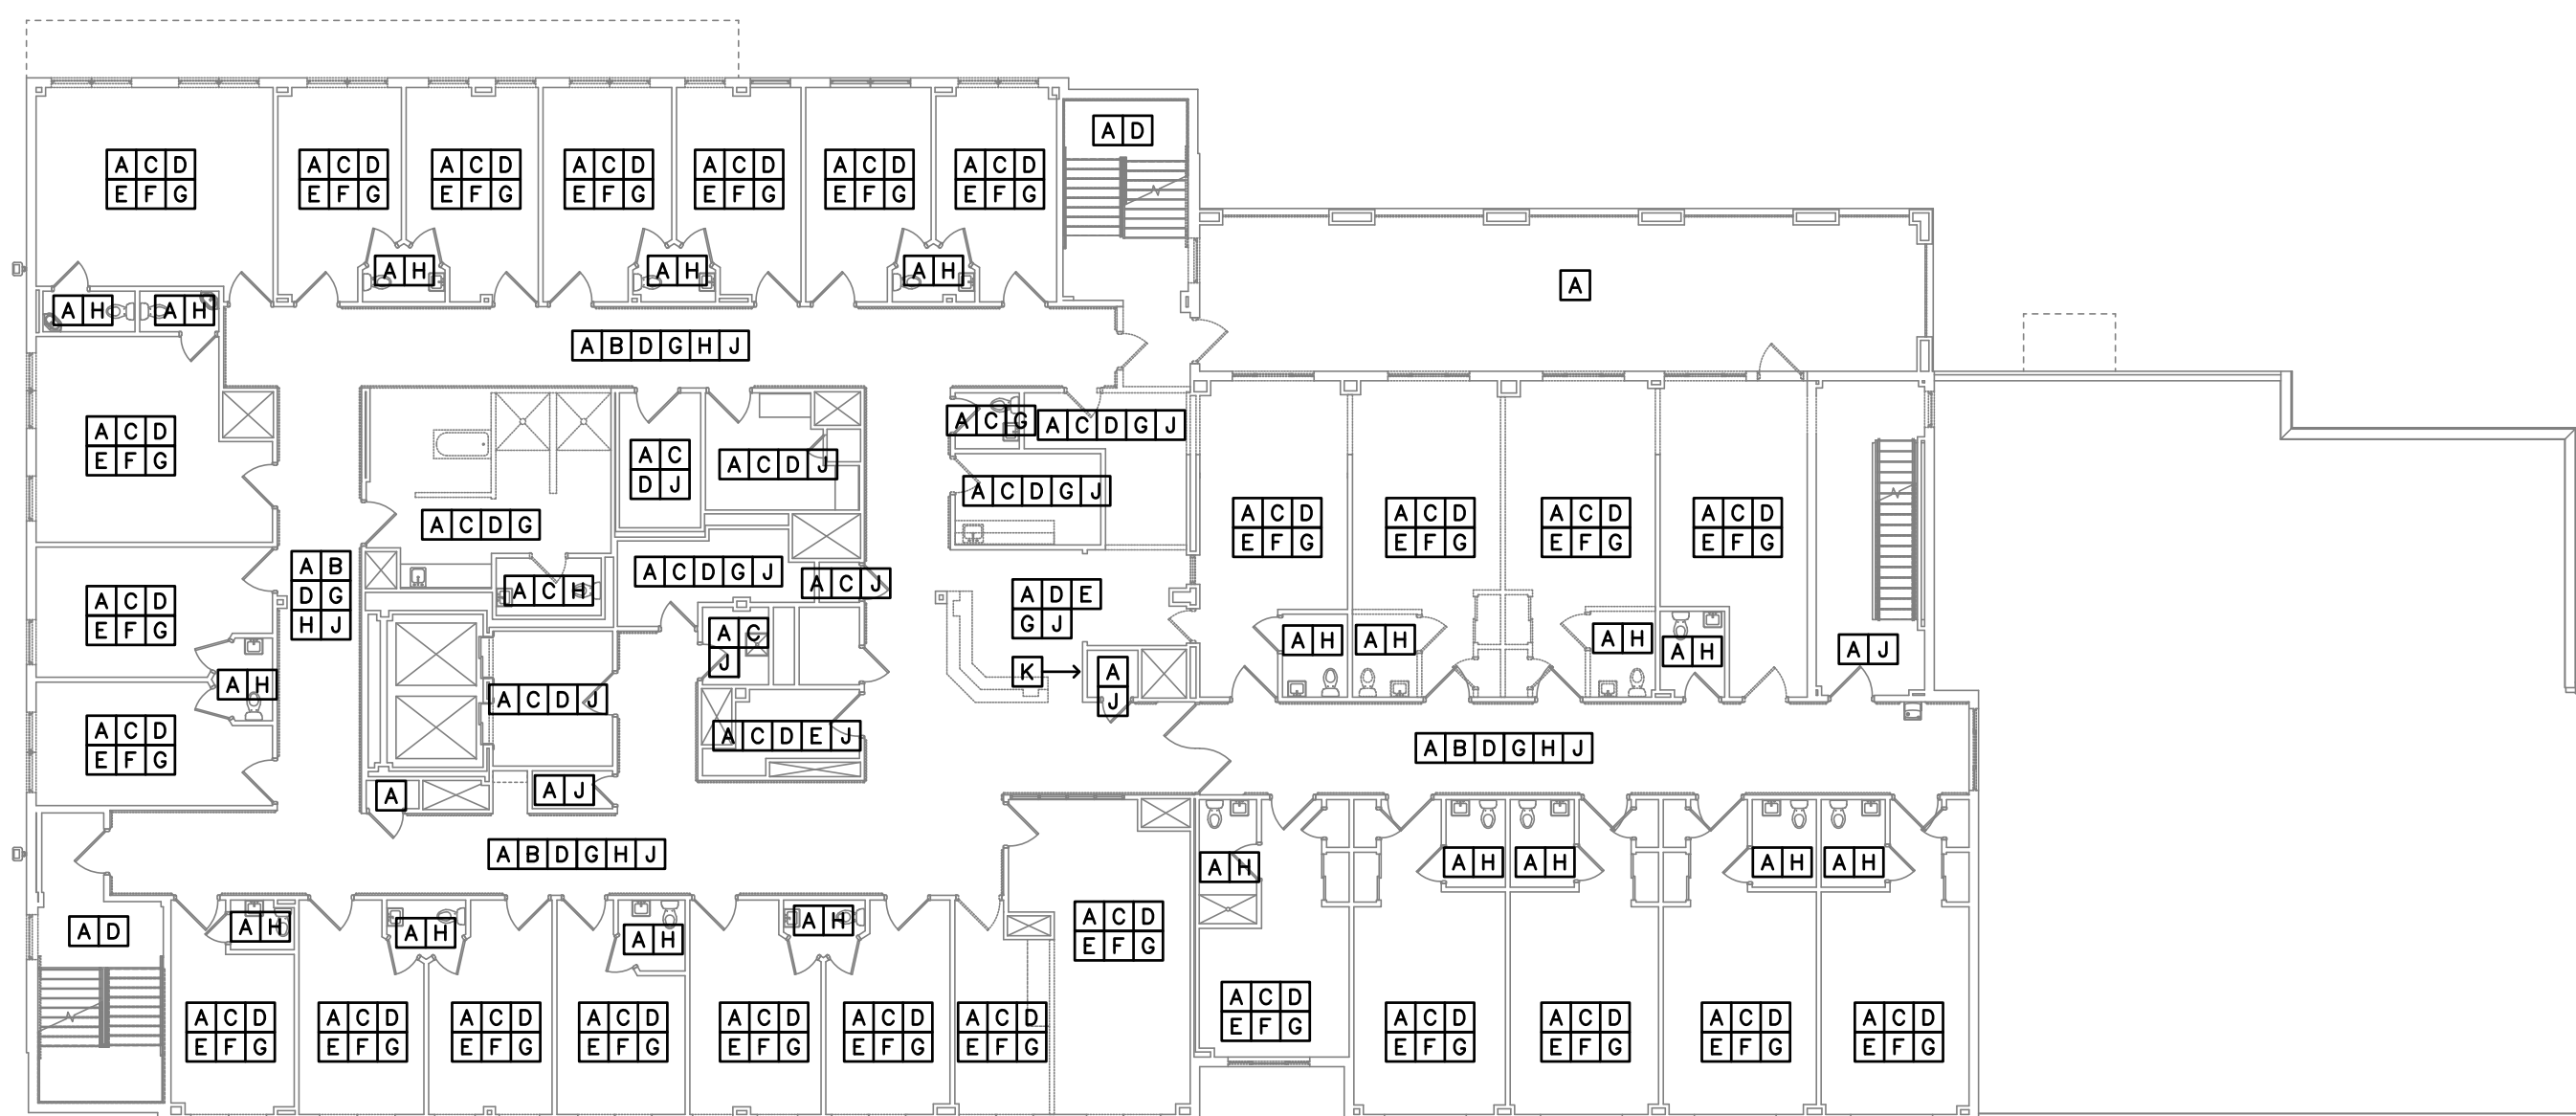

SECOND FLOOR REMOVALS PLAN

SCALE: 1/16" = 1'-0"

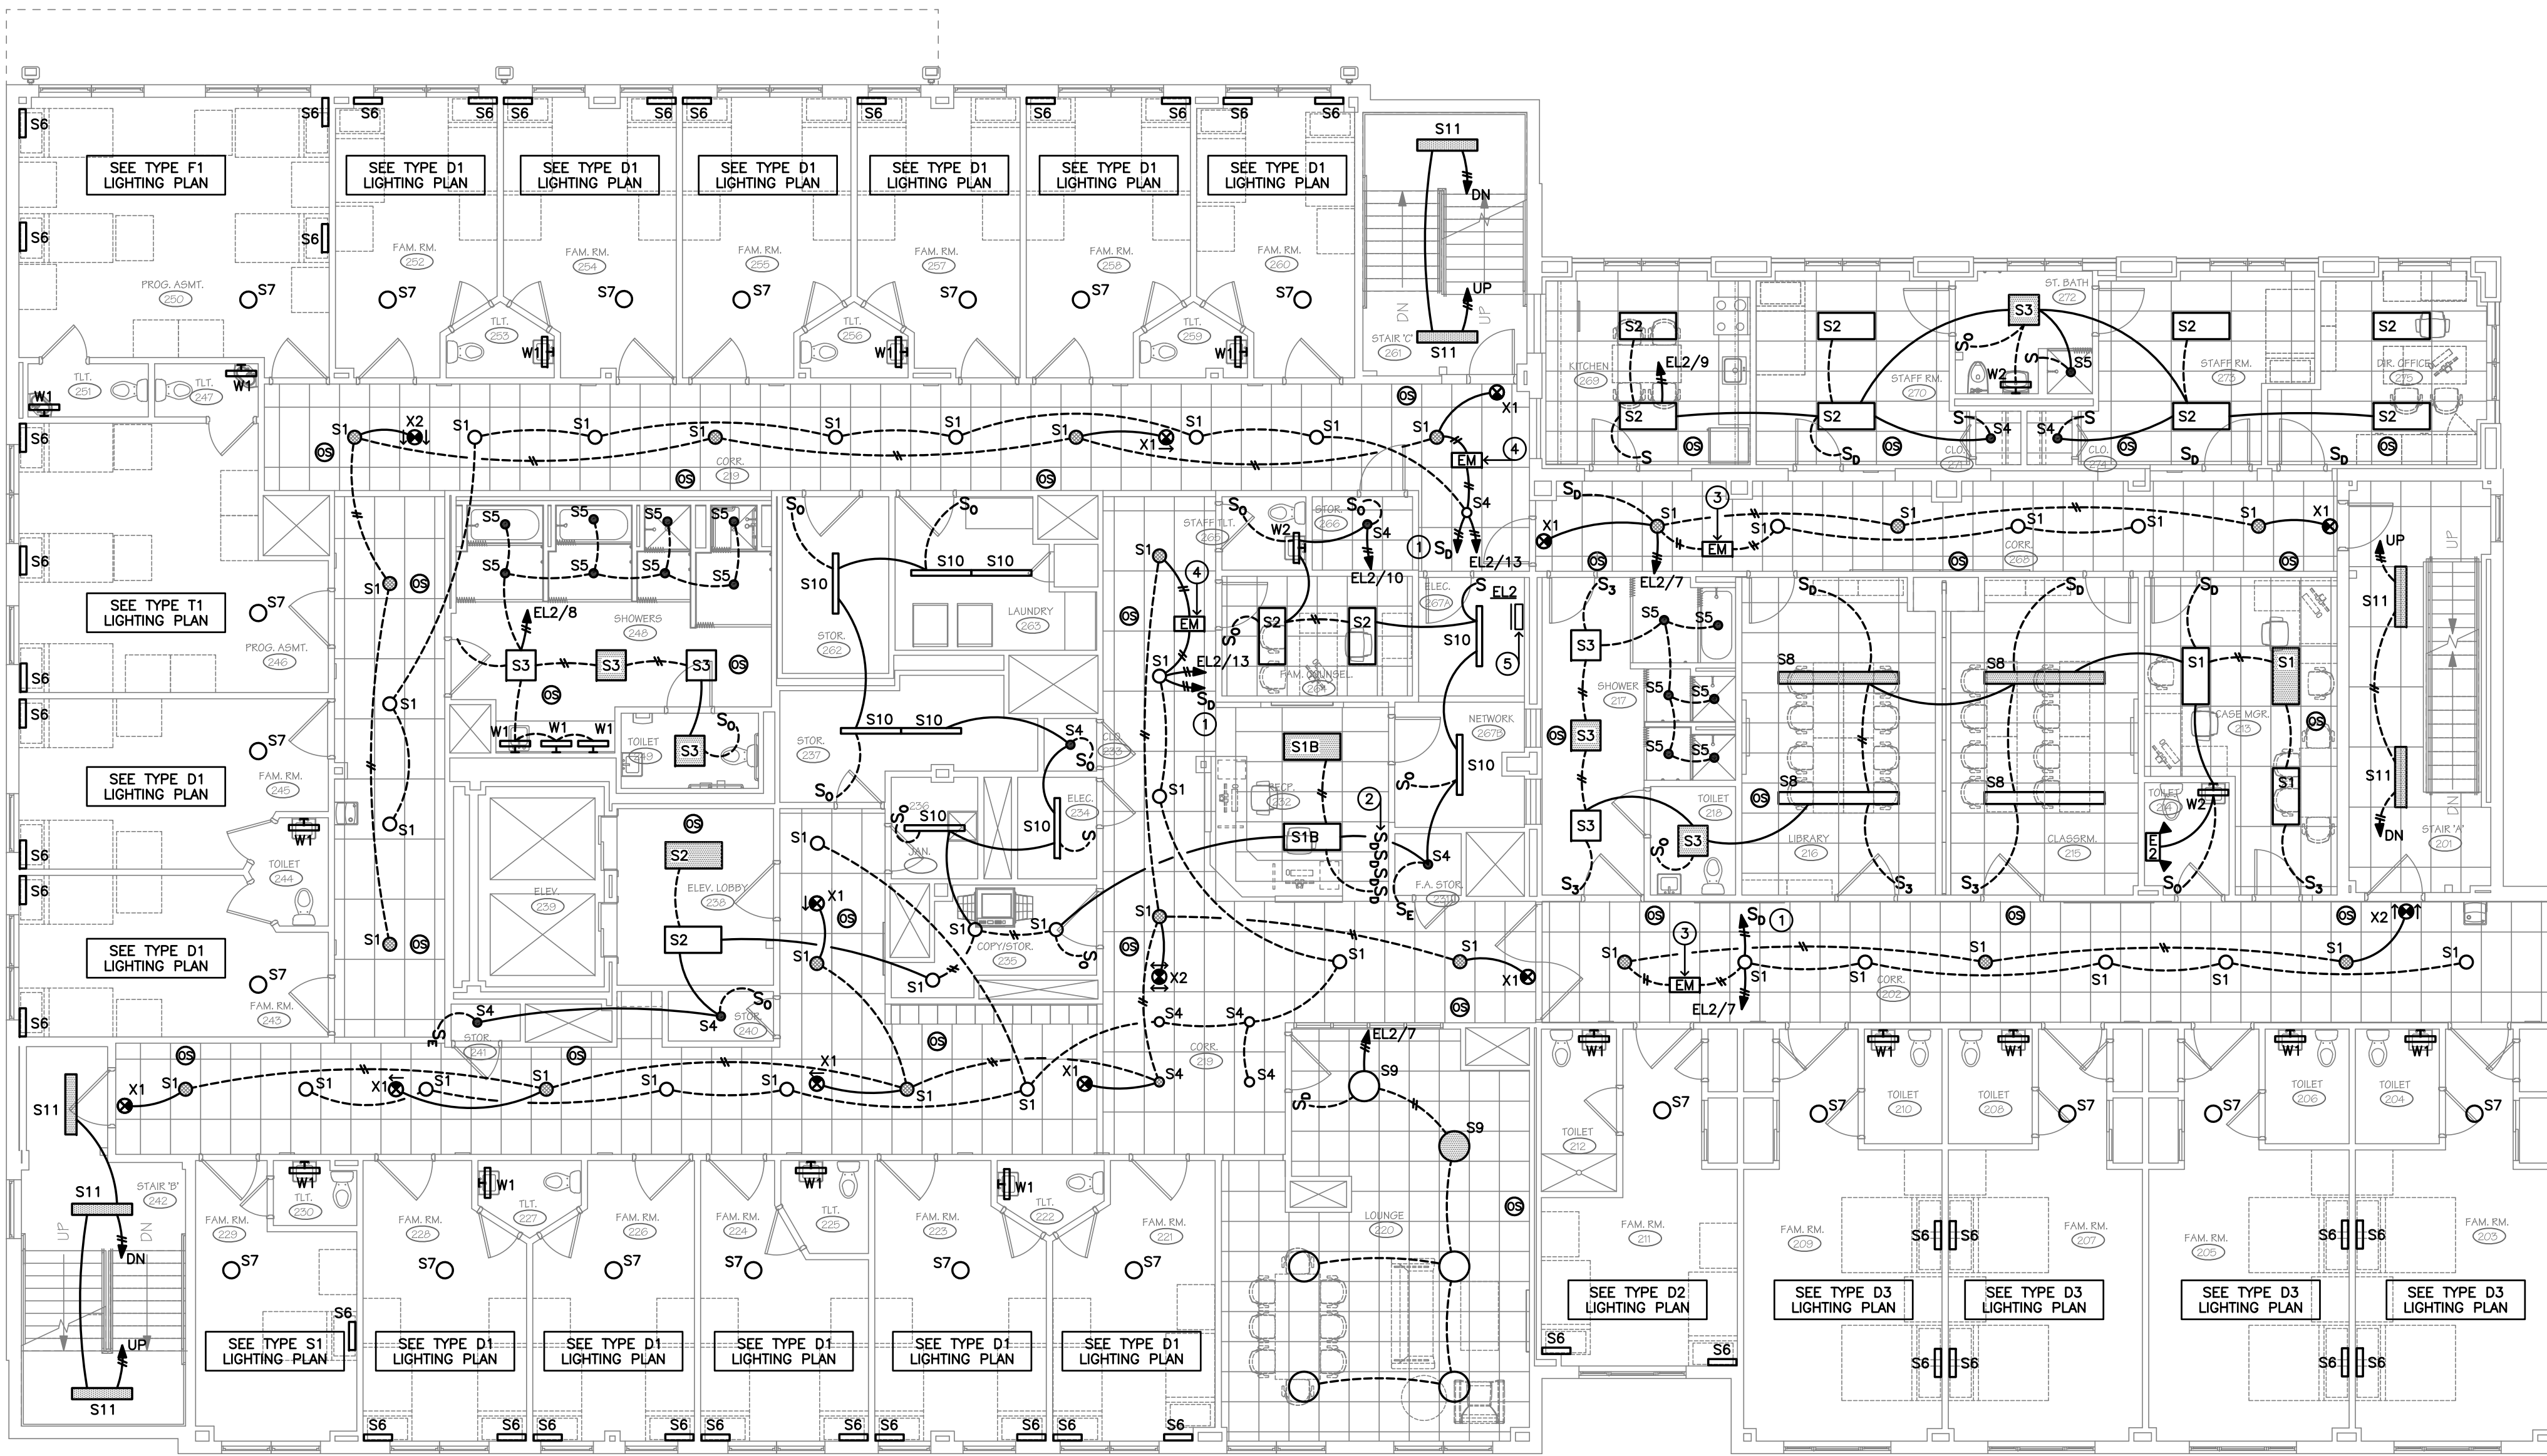

SECOND FLOOR LIGHTING PLAN

SCALE: 1/8" = 1'-0"

LEGEND

- 1 TO SINGLE POLE PRESET DIMMER SWITCH AT RECEPTION 232 DIMMER BANK.
- 2 CORRIDOR LIGHTING DIMMER BANK, 48" AFF. QUANTITY OF DIMMER SWITCHES AS INDICATED. DIMMERS SHALL BE LINEAR SLIDE-TO-OFF PRESET TYPE. VERIFY DIMMER COMPATIBILITY WITH SUPPLIED LIGHTING FIXTURE DRIVERS. PROVIDE ALL DIMMER RELAYS AND/OR POWER PACKS AS REQUIRED TO ACHIEVE PROPER ON-OFF AND DIMMING FUNCTIONS.
- 3 NEW EMERGENCY LIGHTING INVERTER MOUNTED IN ELECTRICAL ROOM (SHOWN IN CORRIDOR FOR CLARITY). 100VA-120V INPUT, 120V OUTPUT, CHLORIDE Z1S100W OR EQUAL.
- 4 NEW EMERGENCY LIGHTING INVERTER MOUNTED IN ELECTRICAL ROOM (SHOWN IN CORRIDOR FOR CLARITY). 250VA-120V INPUT, 120V OUTPUT, CHLORIDE Z1S250W OR EQUAL.
- 5 EXISTING PANEL 'EL2', 120/208V-3ø.

BEDROOM ELECTRICAL SCOPE OF WORK

SCOPE OF WORK IN EXISTING BEDROOMS SHALL INCLUDE PROVIDING NEW LIGHTING FIXTURES, SWITCHES AND RECEPTACLES, REUSING EXISTING BRANCH CIRCUIT WIRING WHERE POSSIBLE.

INTENT IS FOR EACH BEDROOM BE SERVED BY A DEDICATED BRANCH CIRCUIT. ELECTRICAL CONTRACTOR VERIFY DEVICES ON EACH ROOM CIRCUIT AND PROVIDE AFCI RECEPTACLE AT FIRST DEVICE ON CIRCUIT TO PROVIDE DOWNSTREAM PROTECTION.


EXISTING BUILDING PLANS AND PANEL SCHEDULES WERE REVIEWED TO TRY TO DETERMINE CURRENT ROOM WIRING PLANS FOR THE ADDITION AREA. INDICATE EACH ROOM AND BATHROOM WERE WIRED ON ONE CIRCUIT, NO EXISTING CIRCUITING PLANS EXIST FOR ORIGINAL PORTION OF BUILDING. EXISTING PANEL SCHEDULES INDICATE MULTIPLE CIRCUITS FEEDING SEVERAL ROOMS AND SOME ROOMS PROVIDED WITH DEDICATED CIRCUITS. REUSE EXISTING BRANCH CIRCUITS HOMERUNS WHERE POSSIBLE AND PROVIDE NEW BRANCH CIRCUIT HOMERUNS WHERE NO EXISTING HOMERUN IS AVAILABLE FOR REUSE.

ALL EXISTING ROOM RECEPTACLES SHALL BE REMOVED AND REPLACED WITH NEW 15A @ 125V TAMPER-RESISTANT DUPLEX RECEPTACLES. ALL RECEPTACLES INSTALLED IN BEDROOM AND BATHROOMS SHALL BE TAMPER-RESISTANT.

ALL EXISTING SINGLE POLE AND THREE-WAY TOGGLE SWITCHES SHALL BE REMOVED AND REPLACED WITH NEW 20A TOGGLE SWITCHES AND COVER PLATES.


WIRING FOR NEW LIGHTING FIXTURES AND SWITCHES SHALL BE RUN IN EXISTING CONDUITS AND ABOVE ACCESSIBLE CEILINGS WHEREVER POSSIBLE. ANY SURFACE WIRING FOR LIGHTING FIXTURES AND BEDROOM SWITCHES SHALL BE RUN IN WIREMOLD SURFACE RACEWAY AND BOXES, ROUTED TIGHT TO CORNERS OF ROOM WHEREVER POSSIBLE.

ALL EXISTING/UNUSED TELEPHONE, CATV AND NURSE CALL SYSTEM DEVICES AND WIRING SHALL BE DISCONNECTED AND COMPLETELY REMOVED.

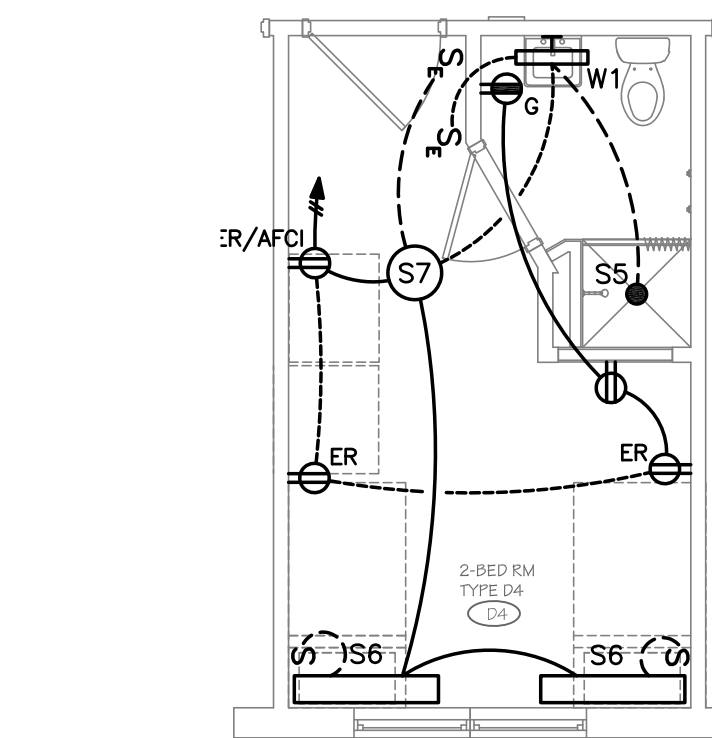


ROOM TYPE D4 ELECTRICAL PLAN

SCALE: 3/16" = 1'-0"

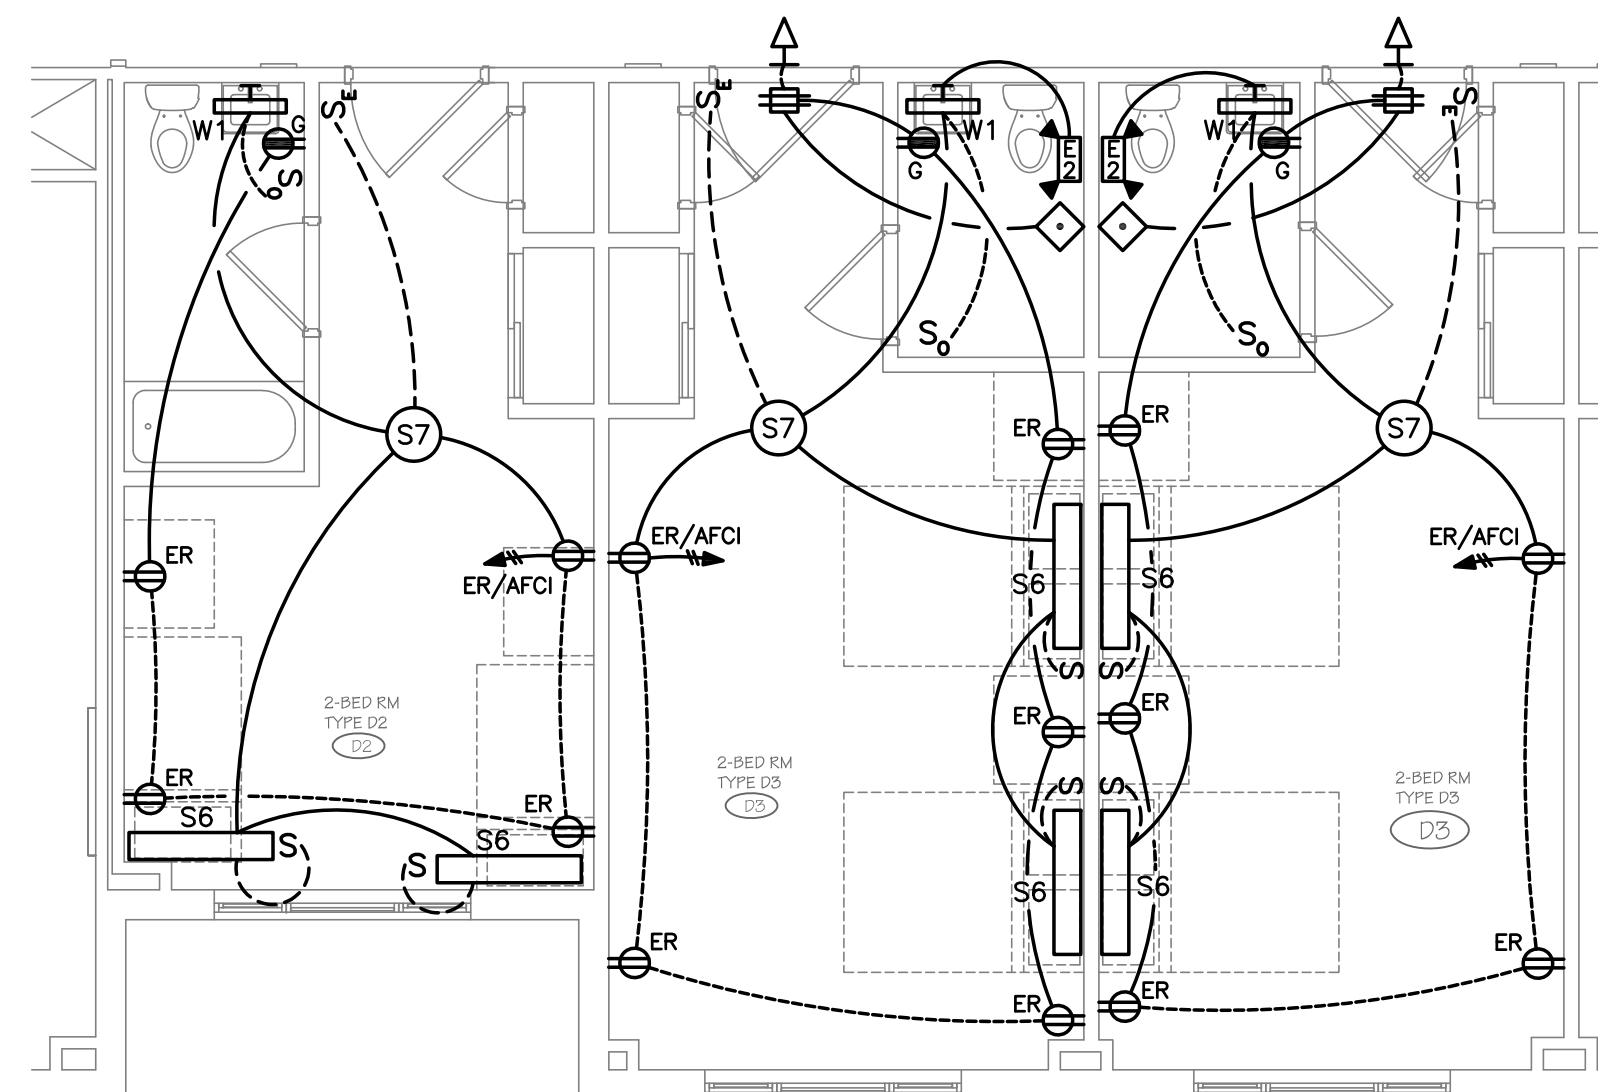


ROOM TYPE D2/D3 ELECTRICAL PLAN

SCALE: 3/16" = 1'-0"

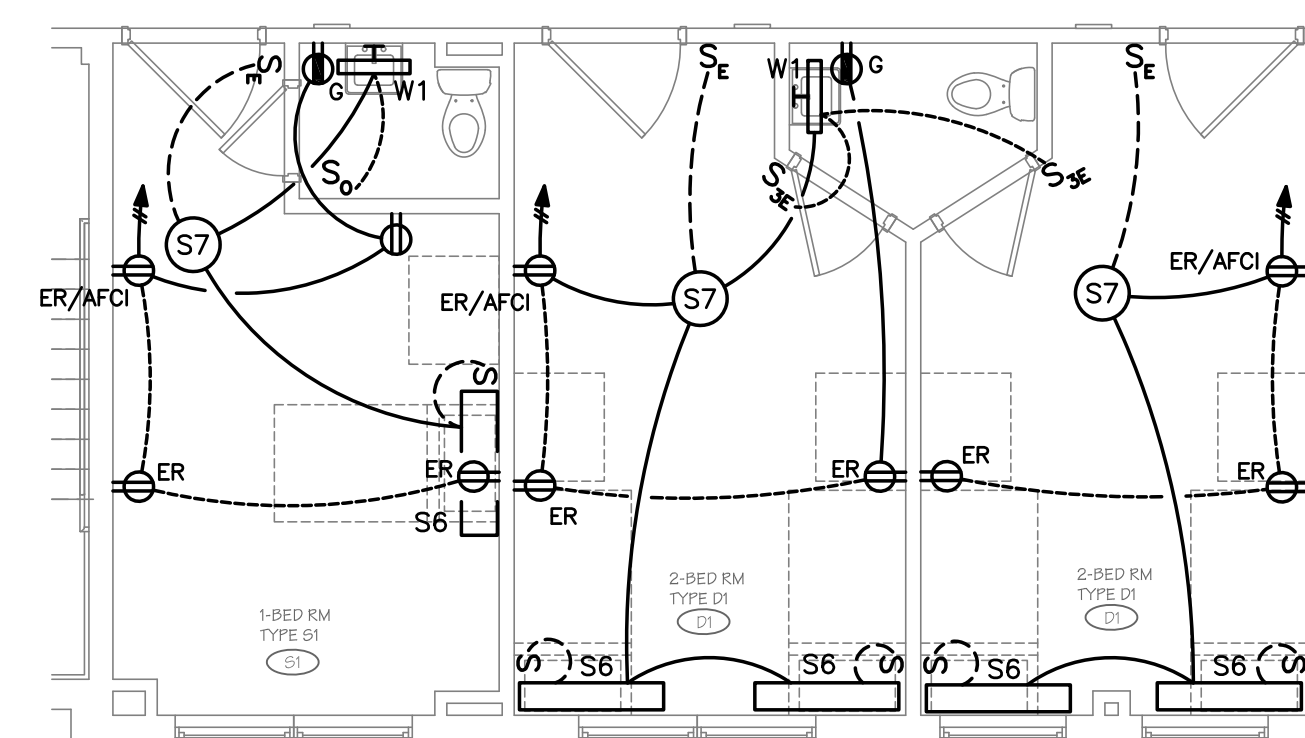

ROOM TYPE S1/D1 ELECTRICAL PLAN

SCALE: 3/16" = 1'-0"

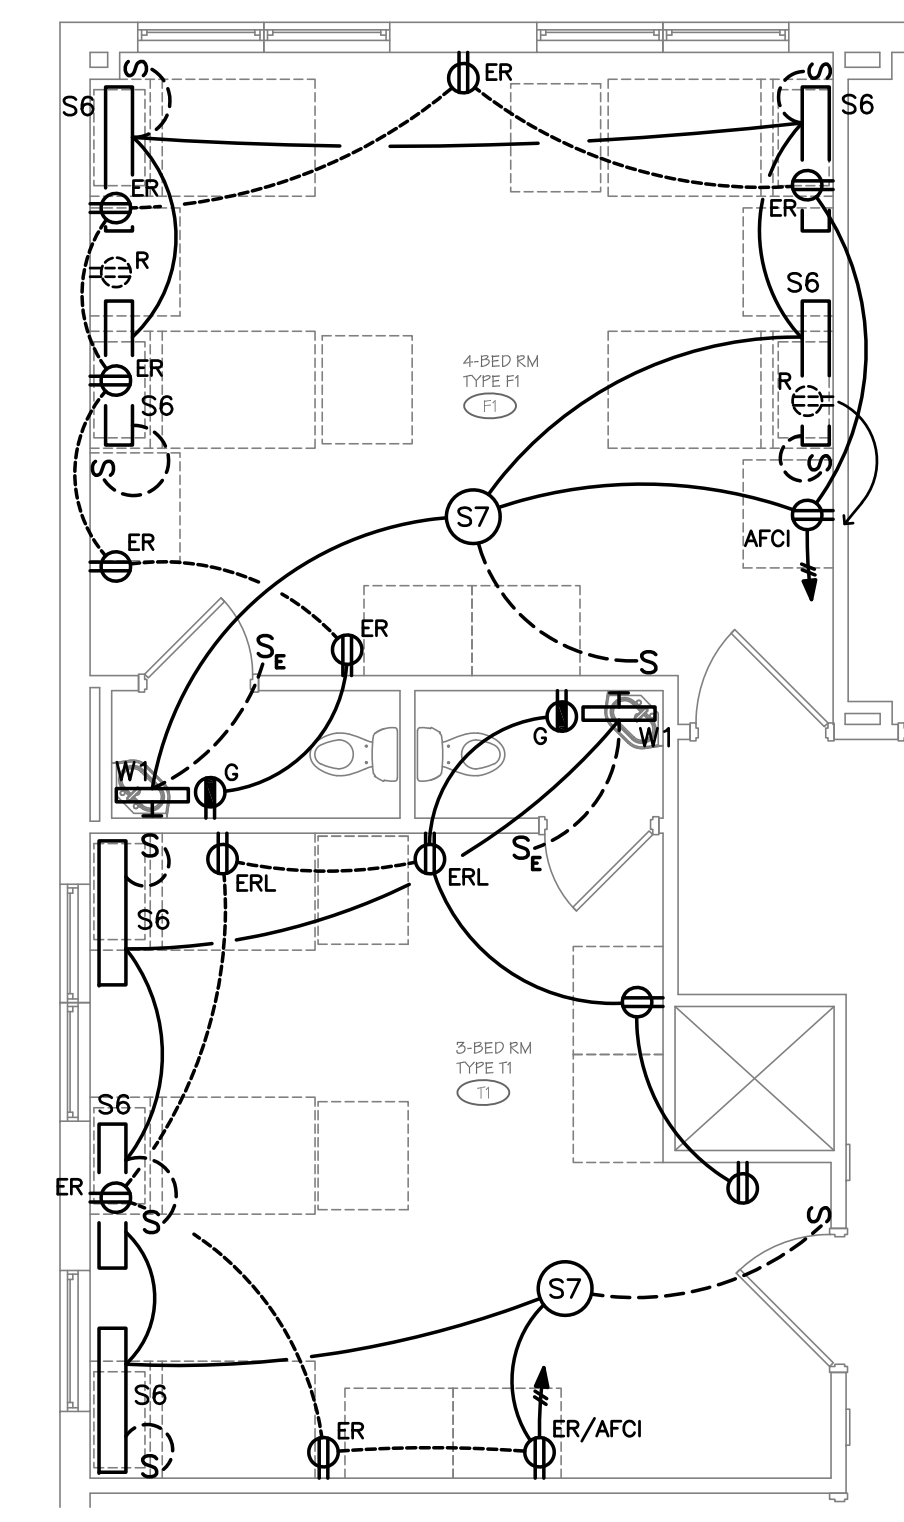

ROOM TYPE T1/F1 ELECTRICAL PLAN

SCALE: 3/16" = 1'-0"

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:



GENERAL DRAFTING & DESIGN, INC.  
CONSULTING ENGINEERS  
140 Washington Avenue, 3rd Floor  
North Haven, Connecticut 06473  
P: 203.238.8818 F: 203.238.7275  
gdd@aol.com

REVISIONS:

NO.	DATE	DESCRIPTION

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:

SECOND FLOOR  
LIGHTING PLAN


SCALE: 1/8" = 1'-0" DRAWN BY: MMV REVIEWED BY: MMV

DRAWING NO.:

E1.2

04.16.2020 - CM BID

DATE: 05 MARCH 2020 GDD JOB NUMBER: 19469

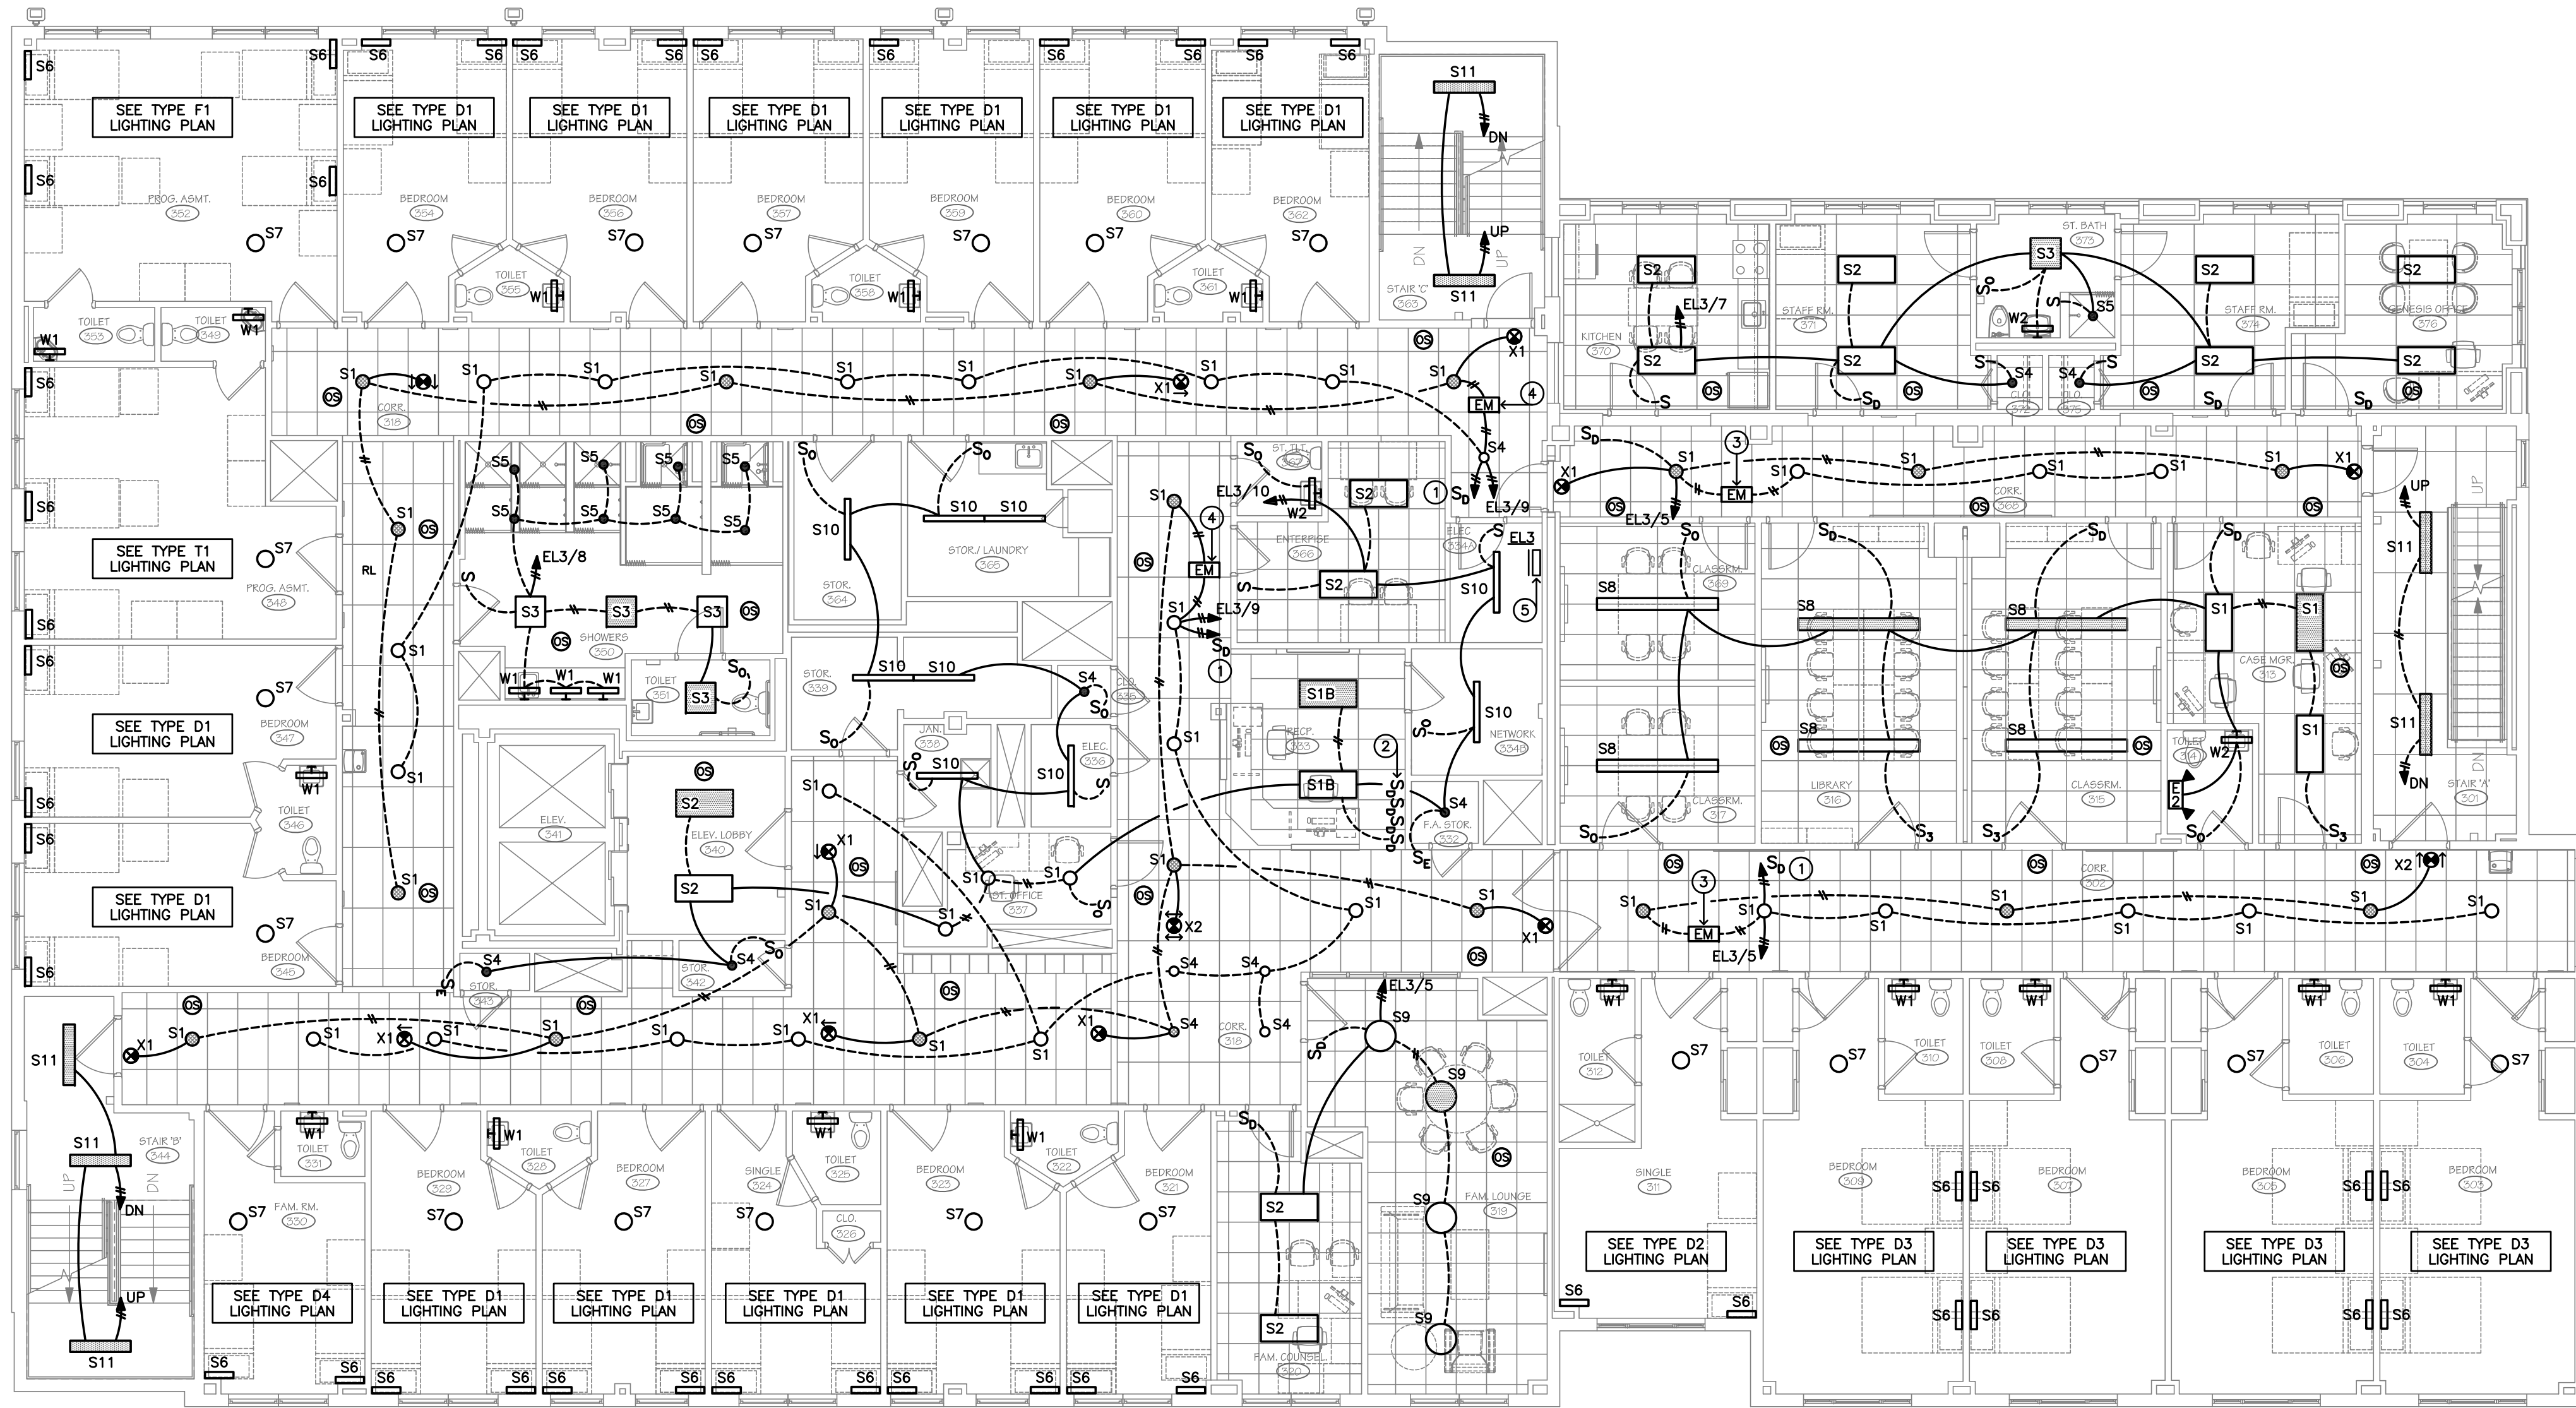

THIRD FLOOR LIGHTING PLAN  
SCALE: 1/8" = 1'-0"

LEGEND

- 1 TO SINGLE POLE PRESET DIMMER SWITCH AT RECEPTION 333 DIMMER BANK.
- 2 CORRIDOR LIGHTING DIMMER BANK, 48" AFF. QUANTITY OF DIMMER SWITCHES AS INDICATED. DIMMERS SHALL BE LINEAR SLIDE-TO-OFF PRESET TYPE. VERIFY DIMMER COMPATIBILITY WITH SUPPLIED LIGHTING FIXTURE DRIVERS. PROVIDE ALL DIMMER RELAYS AND/OR POWER PACKS AS REQUIRED TO ACHIEVE PROPER ON-OFF AND DIMMING FUNCTIONS.
- 3 NEW EMERGENCY LIGHTING INVERTER MOUNTED IN ELECTRICAL ROOM (SHOWN IN CORRIDOR FOR CLARITY). 100VA-120V INPUT, 120V OUTPUT, CHLORIDE ZIS100W OR EQUAL.
- 4 NEW EMERGENCY LIGHTING INVERTER MOUNTED IN ELECTRICAL ROOM (SHOWN IN CORRIDOR FOR CLARITY). 250VA-120V INPUT, 120V OUTPUT, CHLORIDE ZIS250W OR EQUAL.
- 5 EXISTING PANEL 'EL3', 120/208V-3ø.

GENERAL NOTES


- A SEE DRAWING E1.2 FOR LARGE SCALE ROOM BEDROOM ELECTRICAL PLANS.

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:

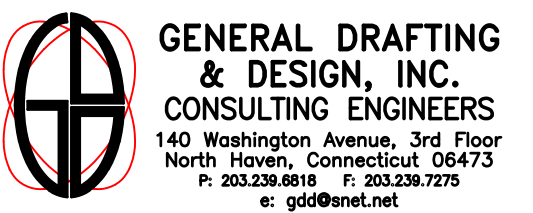

REVISIONS:

DATE	DESCRIPTION

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
THIRD FLOOR  
LIGHTING PLAN


SCALE: 1/8" = 1'-0" DRAWN BY: MMV REVIEWED BY: MMV

DRAWING NO.:

E1.3

04.16.2020 - CM BID

DATE: 05 MARCH 2020 GDD JOB NUMBER: 19469

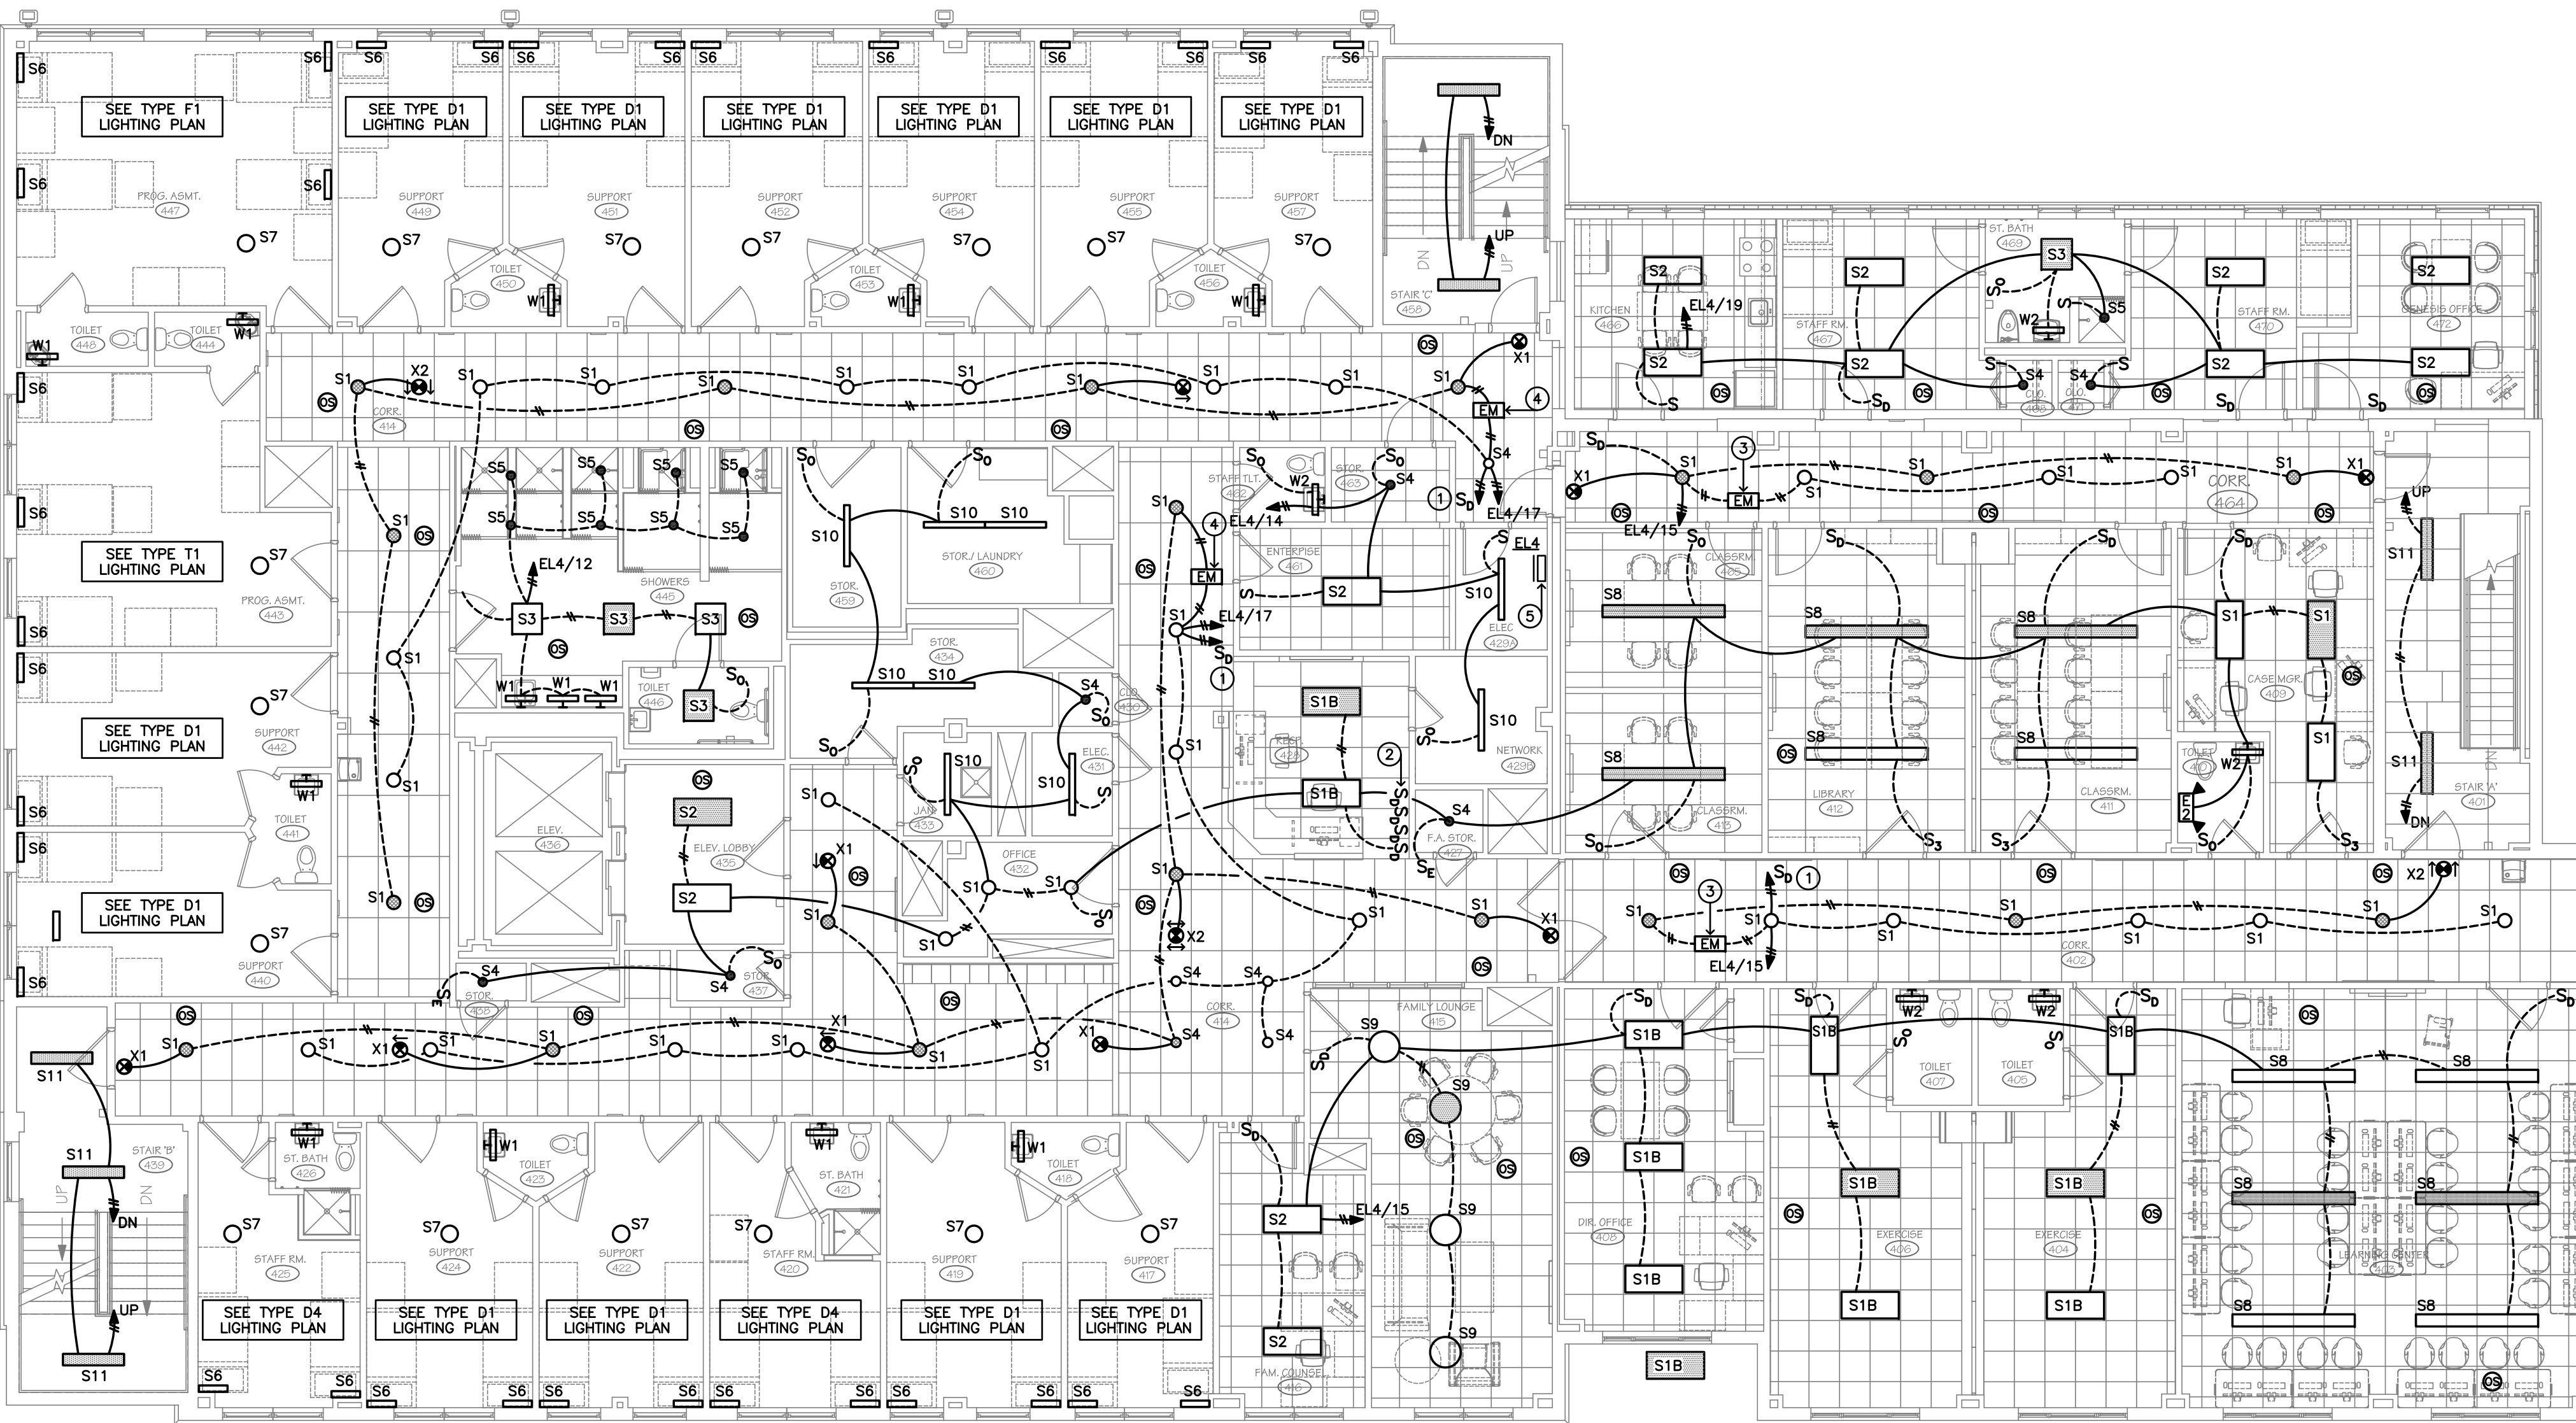

- LEGEND**
- TO SINGLE POLE PRESET DIMMER SWITCH AT RECEPTION 428 DIMMER BANK.
  - CORRIDOR LIGHTING DIMMER BANK, 48" AFF. QUANTITY OF DIMMER SWITCHES AS INDICATED. DIMMERS SHALL BE LINEAR SLIDE-TO OFF PRESET TYPE. VERIFY DIMMER COMPATIBILITY WITH SUPPLIED LIGHTING FIXTURE DRIVERS, PROVIDE ALL DIMMER RELAYS AND/OR POWER PACKS AS REQUIRED TO ACHIEVE PROPER ON-OFF AND DIMMING FUNCTIONS.
  - NEW EMERGENCY LIGHTING INVERTER MOUNTED IN ELECTRICAL ROOM (SHOWN IN CORRIDOR FOR CLARITY). 100VA-120V INPUT, 120V OUTPUT, CHLORIDE ZIS100W OR EQUAL.
  - NEW EMERGENCY LIGHTING INVERTER MOUNTED IN ELECTRICAL ROOM (SHOWN IN CORRIDOR FOR CLARITY). 250VA-120V INPUT, 120V OUTPUT, CHLORIDE ZIS250W OR EQUAL.
  - EXISTING PANEL 'EL4', 120/208V-3ø.

**GENERAL NOTES**

A SEE DRAWING E1.2 FOR LARGE SCALE ROOM BEDROOM ELECTRICAL PLANS.

**FOURTH FLOOR LIGHTING PLAN**  
SCALE: 1/8" = 1'-0"

**LIGHTING FIXTURE SCHEDULE**

LIGHTING FIXTURE TYPE	MANUFACTURER	CATALOG NO.	FIXTURE DESCRIPTION	VOLTAGE	LAMP & DESIGNATION	DRIVER	INPUT WATTAGE	MOUNTING	HOUSING	LENS/LOUVER	REMARKS
S1	LIGHTOLIER	S10R-8-30K-22-W-210U	10" DIA. SURFACE LED DOWNLIGHT	120	LED, 2,200 LUMENS, 3000K	ELECTRONIC, 0-10V DIMMING	15	SURFACE - CEILING	ALUMINUM FRAME	FLAT OPAL ACRYLIC	WHITE FINISH
S2	DAYBRITE	2FXP43L830-4-DS-UNV-DIM-IP-FSF24	2' x 4' LED GRID TROFFER - EMERGENCY	277	LED, 4,300 LUMENS, 3000K	ELECTRONIC, 0-10V DIMMING	37	SURFACE - CEILING	ALUMINUM FRAME	DIFFUSE RIBBED ACRYLIC	SURFACE MOUNTING KIT, INTEGRAL INTERACT ProRF SENSOR FOR LIGHTING NETWORKING, EMERGENCY BATTERY PACK, 1100 LUMENS, 90 MINUTE OPERATION.
S3	DAYBRITE	2FXP30L830-2-DS-UNV-DIM-FSFSS	2' x 2' LED FLAT PANEL	277	LED, 2,400 LUMENS, 3000K	ELECTRONIC, 0-10V DIMMING	15	SURFACE - CEILING	ALUMINUM FRAME	FLAT OPAL ACRYLIC	SURFACE MOUNTING KIT
S4	LIGHTOLIER	S10R-8-30K-10-W-210U	10" DIA. SURFACE LED DOWNLIGHT	120	LED, 1,000 LUMENS, 3000K	ELECTRONIC, 0-10V DIMMING	15	SURFACE - CEILING	ALUMINUM FRAME	FLAT OPAL ACRYLIC	WHITE FINISH
S5	LIGHTOLIER	S10R-8-30K-10-W-210U	10" DIA. SURFACE LED DOWNLIGHT	120	LED, 1,000 LUMENS, 3000K	ELECTRONIC, 0-10V DIMMING	15	SURFACE - CEILING	ALUMINUM FRAME	FLAT OPAL ACRYLIC	WHITE FINISH, NON-CONDUCTIVE DEADFRONT
S6	LA LIGHTING	ANG950-2-HE-2L-FFA-DRDM-UNV-1-830	2" CORNER WALL LUMINAIRE	120	LED, 1,673 LUMENS, 3000K	ELECTRONIC, 0-10V DIMMING	18	SURFACE - WALL/CEILING	STEEL - WHITE	FROSTED ACRYLIC	REMARKS
S7	SUNPARK ELECTRONICS	10100-3000K-62	SURFACE LED LUMINAIRE	120	LED, 1,400 LUMENS, 3000K	ELECTRONIC, 0-10V DIMMING	18	SURFACE - CEILING	STEEL HOUSING - SATIN NICKEL FINISH	ALABASTER GLASS SHADE	REMARKS
S8	LEDALITE	7806-1-C-C-C-0-08-N-D-E-W-A2-XX	LINEAR PENDANT LUMINAIRE - EMERGENCY	277	LED, 4,600 LUMENS/4', 80% DOWNLIT KIT, 3500K	ELECTRONIC, 0-10V DIMMING	35	SURFACE - CEILING	STEEL - WHITE FINISH	FROSTED ACRYLIC	ALUMINUM END CAPS, AIRCRAFT CABLE SUSPENSION, VERIFY MOUNTING HEIGHT IN FIELD. EMERGENCY BATTERY PACK WITH TEST SWITCH, 90 MINUTE OPERATION.
S9	HE WILLIAMS	RNDS-2-L45-8-30-FXA-DIM-UNV	SURFACE LED LUMINAIRE	277	LED, 4,530 LUMENS, 3000K	ELECTRONIC, 0-10V DIMMING	46	SURFACE - CEILING	ALUMINUM FRAME	FROSTED ACRYLIC 0.125" THICK	REMARKS
S10	DAY-BRITE CFI	4" SURFACE STRIP LUMINAIRE	4" SURFACE STRIP LUMINAIRE	277	LED, 4,000 LUMENS, 3000K	ELECTRONIC, 0-10V DIMMING	31	SURFACE - CEILING	STEEL	FROSTED ACRYLIC LENS	EMERGENCY BATTERY PACK, 90 MINUTE OPERATION, INTEGRAL OCCUPANCY SENSOR
S11	CHLORIDE	CLXNRW	SINGLE FACE EMERGENCY EXIT SIGN	120/277	LED	ELECTRONIC	15	SURFACE - WALL	THERMOPLASTIC - WHITE	RED LETTERS - WHITE FACE	SHADED AREA INDICATES FACE. NICAD BATTERY, 90 MINUTE EMERGENCY OPERATION. HIGH-CAPACITY BATTERY FOR REMOTE HEADS.
W1	HE WILLIAMS	WMA-2-L20-830-AF-OCC-DRV-UNV-TP	2' LED UP/DOWN LIGHT WALL BRACKET	277	LED, 2,069 LUMENS, 3000K	ELECTRONIC	16	SURFACE - WALL	EXTRUDED ALUMINUM, CAST END CAPS	FROSTED ACRYLIC 0.125" THICK	TAMPER RESISTANT HARDWARE
X2	CHLORIDE	CLXNRW	DOUBLE FACE EMERGENCY EXIT SIGN	120/277	LED	ELECTRONIC	15	SURFACE - CEILING	THERMOPLASTIC - WHITE	RED LETTERS - WHITE FACE	SHADED AREA INDICATES FACE. NICAD BATTERY, 90 MINUTE EMERGENCY OPERATION. HIGH-CAPACITY BATTERY FOR REMOTE HEADS.

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460  
www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:



REVISIONS:

DATE	DESCRIPTION

**JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION**

**PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION**

**725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT**

DRAWING TITLE:  
**FOURTH FLOOR  
LIGHTING PLAN**

SCALE: 1/8" = 1'-0"  
DRAWN BY: MMV  
REVIEWED BY: MMV

DRAWING NO.:

**E1.4**  
04.16.2020 - CM BID

DATE: 05 MARCH 2020  
GDD JOB NUMBER: 19469




ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:

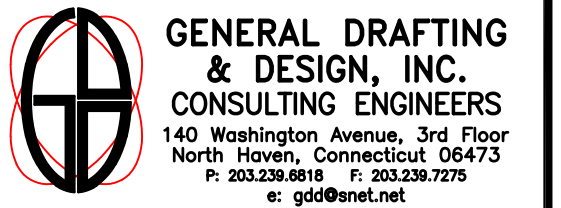

REVISIONS:

DATE	DESCRIPTION

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT


DRAWING TITLE:  
FIFTH FLOOR LIGHTING PLAN

SCALE: 1/8" = 1'-0" DRAWN BY: MMV REVIEWED BY: MMV

DRAWING NO.:

E1.5  
04.16.2020 - CM BID

DATE: 05 MARCH 2020 GDD JOB NUMBER: 19469

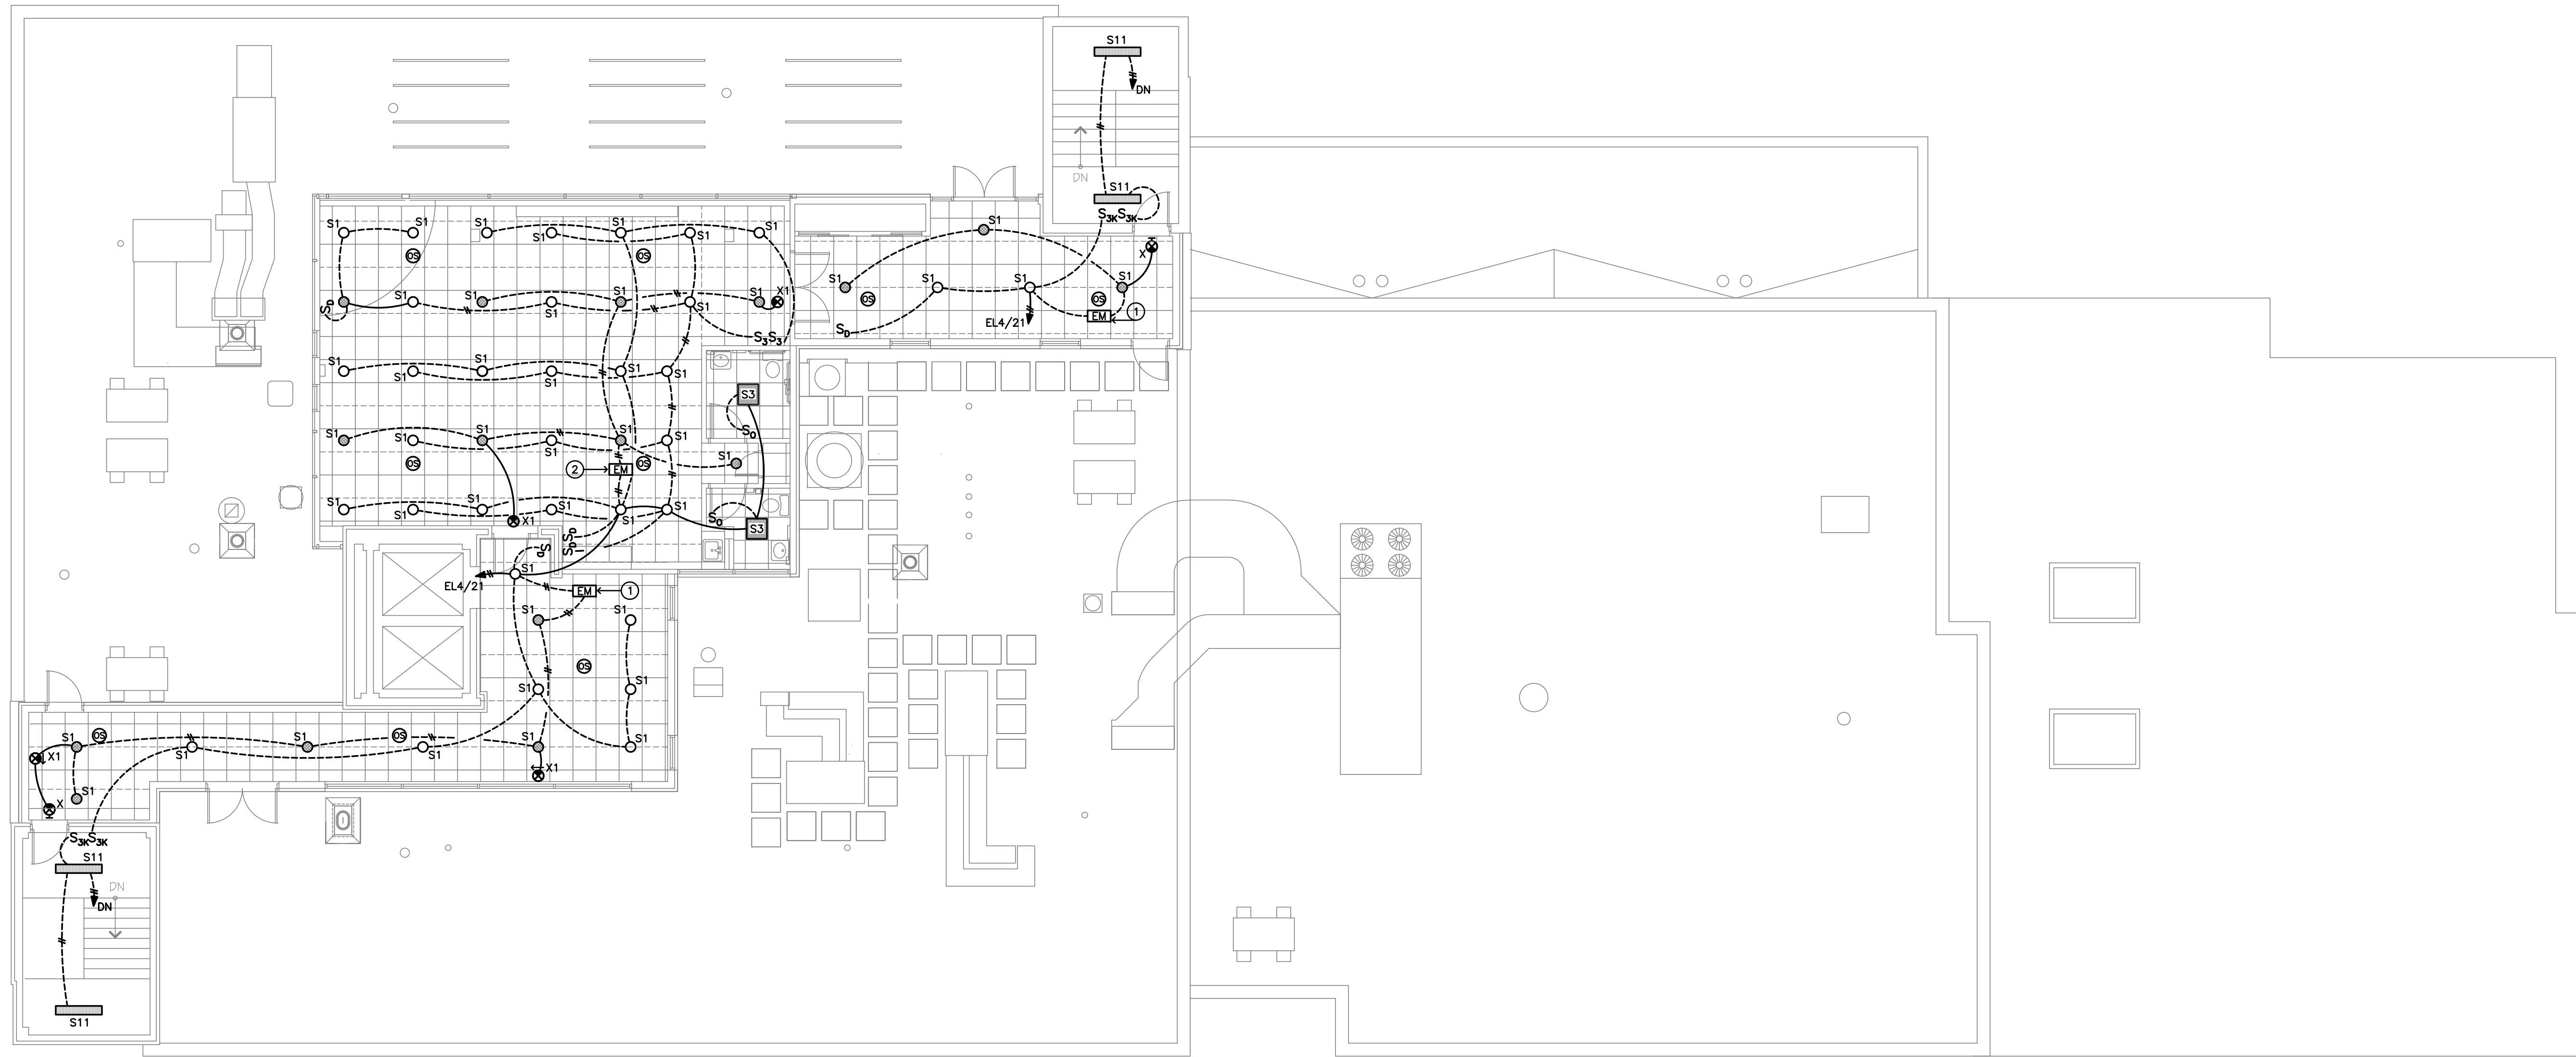

FIFTH FLOOR LIGHTING PLAN  
SCALE: 1/8" = 1'-0"

LEGEND

- ① NEW EMERGENCY LIGHTING INVERTER RECESSED MOUNTED IN CEILING GRID, 100VA-120V INPUT, 120V OUTPUT, 0-10V DIMMING. MYERS #1-LVM-1-G.
- ② NEW EMERGENCY LIGHTING INVERTER RECESSED MOUNTED IN CEILING GRID, 225VA-120V INPUT, 120V OUTPUT, 0-10V DIMMING. MYERS #1-LVM-2-G.




ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:

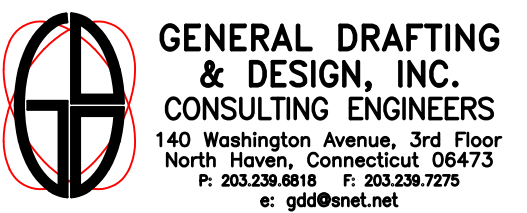

REVISIONS:

NO.	DATE	DESCRIPTION


JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
SECOND FLOOR POWER AND SYSTEMS PLAN

SCALE: 1/8" = 1'-0"  
DRAWN BY: MMV  
REVIEWED BY: MMV

DRAWING NO.:  
**E2.2**  
04.16.2020 - CM BID

DATE: 05 MARCH 2020  
GDD JOB NUMBER: 19469

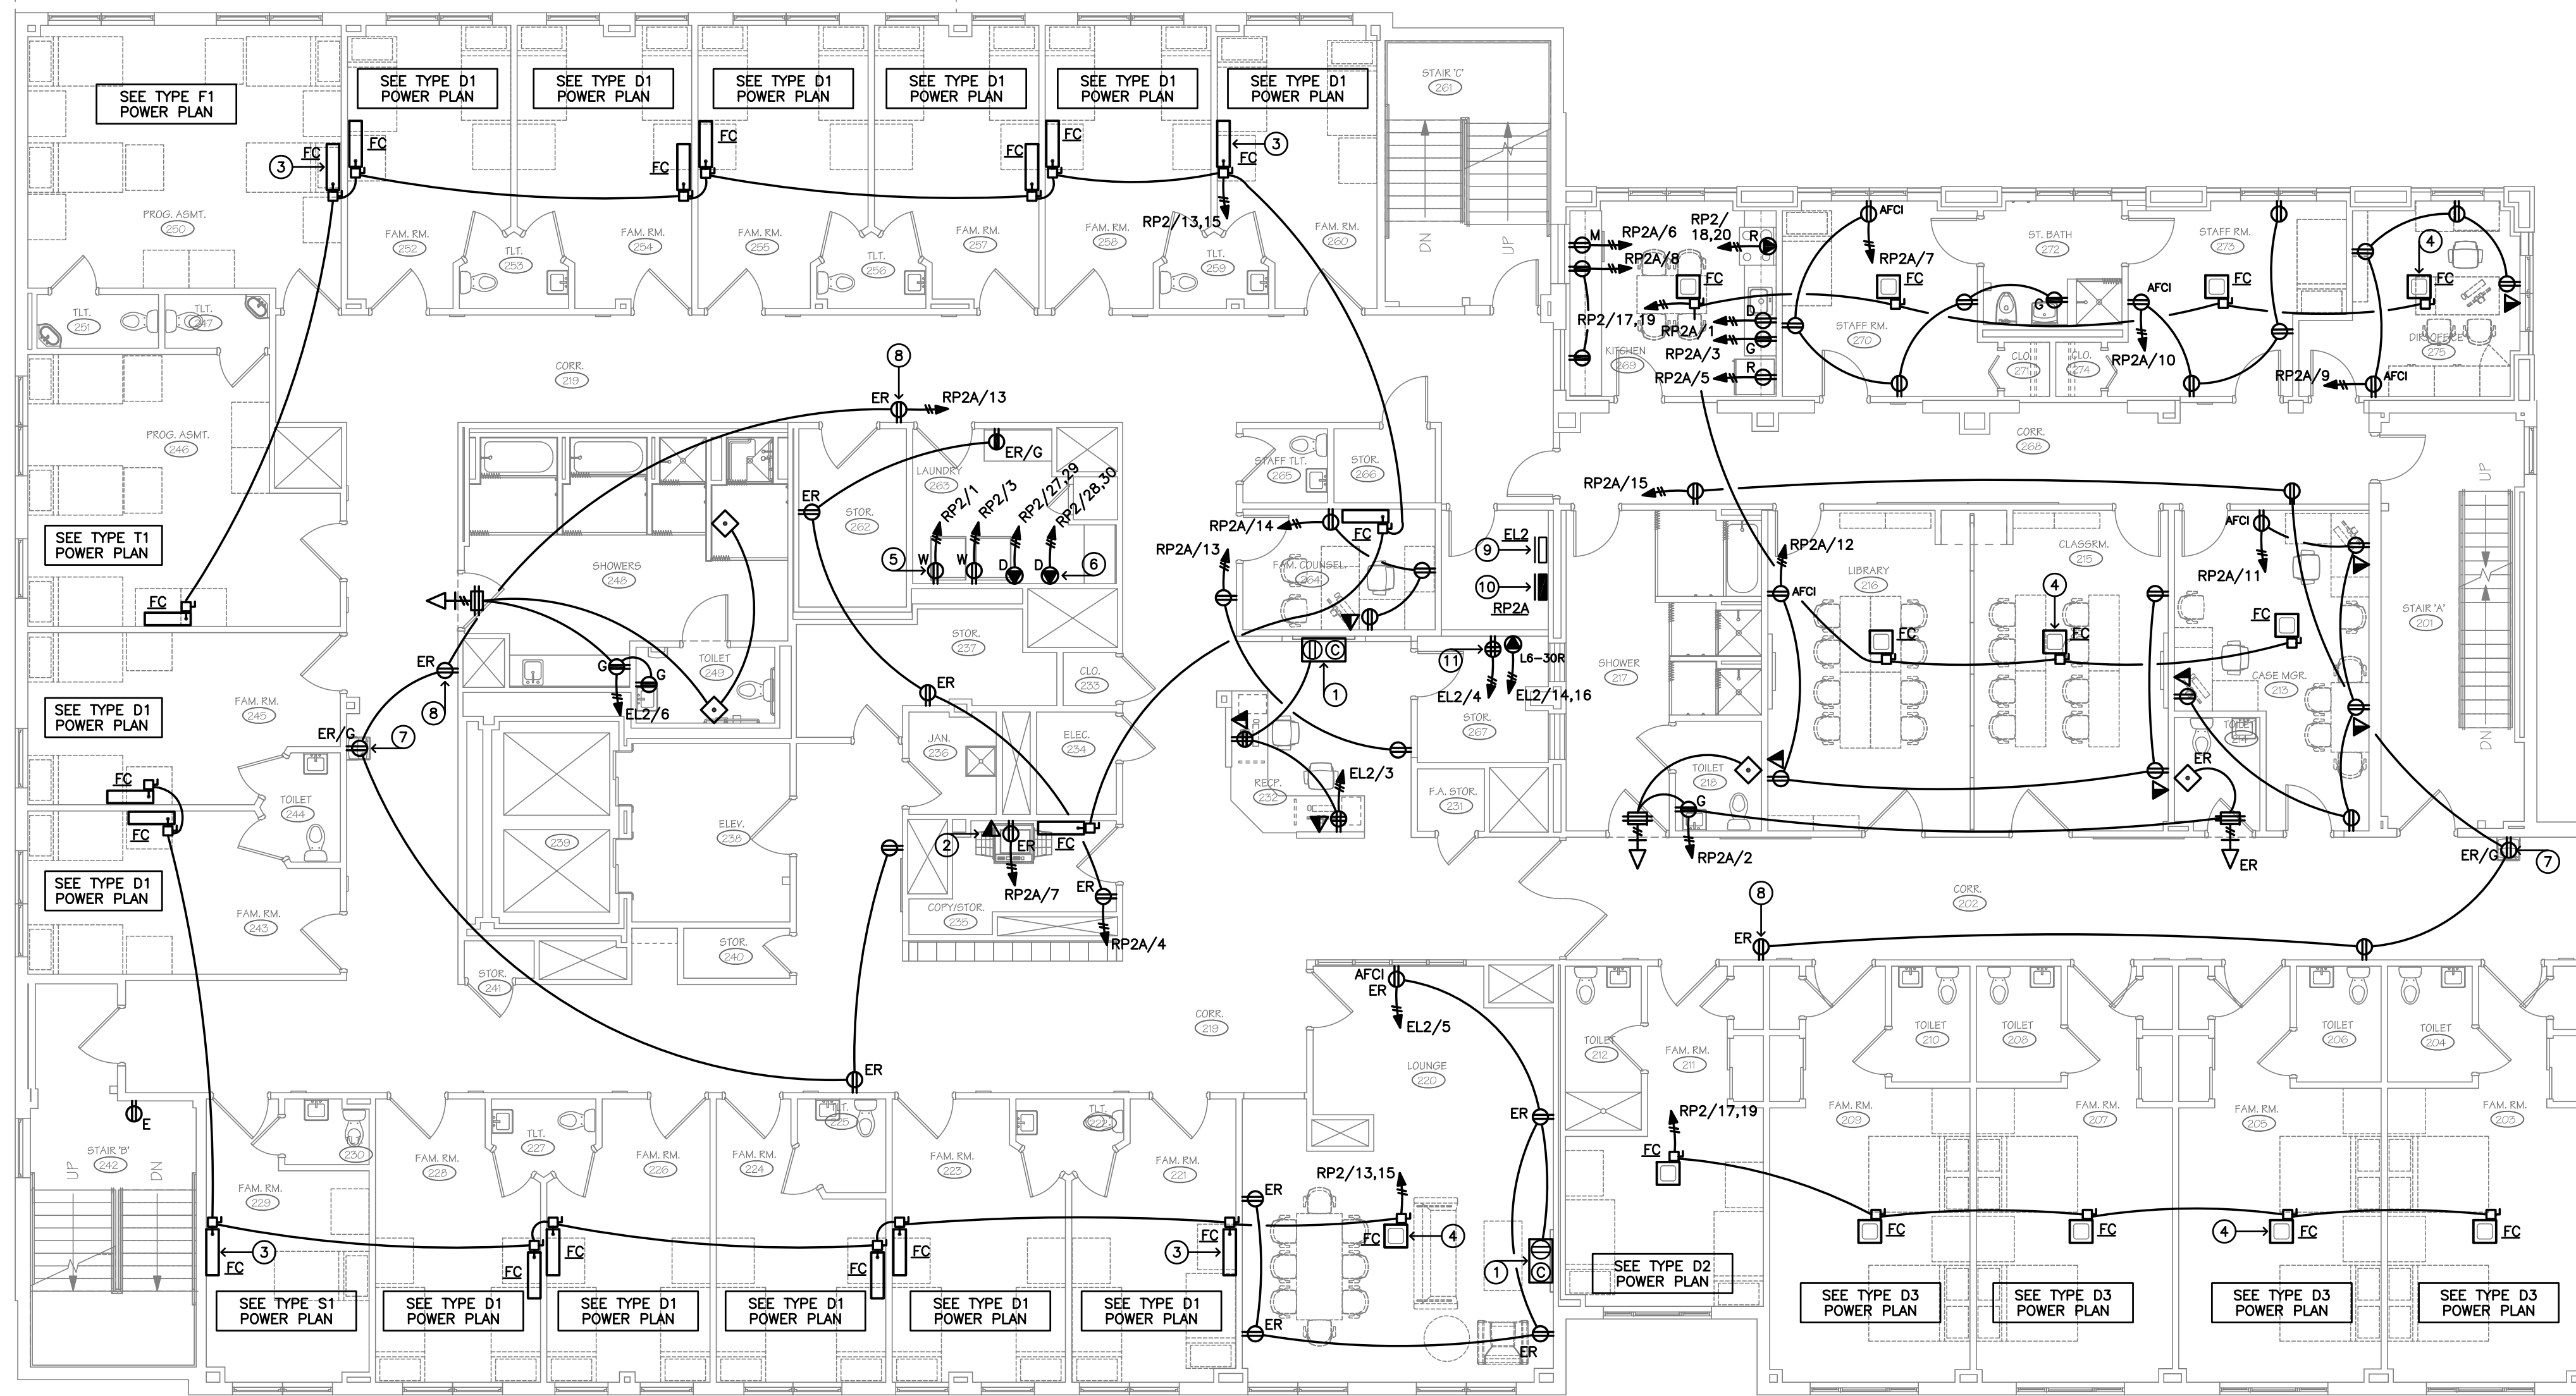


SECOND FLOOR POWER AND SYSTEMS PLAN  
SCALE: 1/8" = 1'-0"

**LEGEND**


- ① NEW FLAT PANEL DISPLAY SERVICE BOX. TWO-GANG RECESSED MOUNT TV BOX AND FRAME WITH DUPLEX RECEPTACLE, 20A @ 125V AND DATA OUTLET. BOX MOUNTING HEIGHT BY ARCHITECT, VERIFY LOCATIONS IN FIELD. PASS & SEYMOUR #TV1WMTVSSWCC2.
- ② COPIER, 120V-1ø.
- ③ NEW WALL MOUNTED SPLIT SYSTEM AC UNIT, 0.4MCA-208V-1ø. 2 #12 + 1 #12 GND. TO 15A-2P BRANCH CIRCUIT BREAKER.
- ④ NEW CEILING MOUNTED SPLIT SYSTEM AC UNIT, 0.4MCA-208V-1ø. 2 #12 + 1 #12 GND. TO 15A-2P BRANCH CIRCUIT BREAKER.
- ⑤ WASHER, 120V-1ø, RECEPTACLE MOUNTED 36" AFF, BRANCH CIRCUIT PROTECTED BY GFCI BRANCH CIRCUIT BREAKER.
- ⑥ DRYER, 208V-1ø, OUTLET MOUNTED 36" AFF, 2 #10 + 1 #10 GND. TO 30A-2P BRANCH CIRCUIT BREAKER.
- ⑦ DRINKING FOUNTAIN, 120V-1ø, PROVIDE NEW GFCI DUPLEX RECEPTACLE AT EXISTING LOCATION.
- ⑧ EXISTING DUPLEX RECEPTACLE TO BE REMOVED AND REPLACED WITH NEW TAMPER RESISTANT DUPLEX RECEPTACLE AT EXISTING LOCATION, "TYPICAL".
- ⑨ EXISTING PANEL "EL2", 120/208V-3ø.
- ⑩ NEW PANEL "RP2A", 120/208V-3ø.
- ⑪ DATA RACK, ONE (1) DEDICATED CIRCUIT DOUBLE DUPLEX RECEPTACLE AND ONE (1) 30A-208V-1ø TWIST-LOCK RECEPTACLE. VERIFY MOUNTING LOCATIONS AND REQUIREMENTS WITH VENDOR IN FIELD.

**GENERAL NOTES**

- Ⓐ SEE DRAWING E2.2 FOR LARGE SCALE BEDROOM ELECTRICAL PLANS.

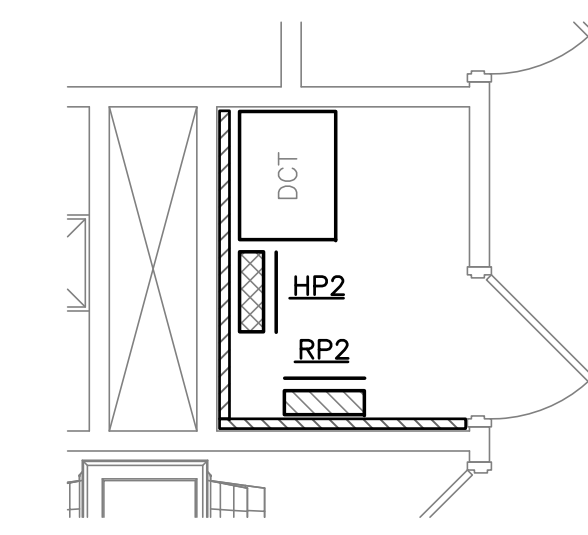

ELECTRIC ROOM PLAN  
SCALE: 1/4" = 1'-0"

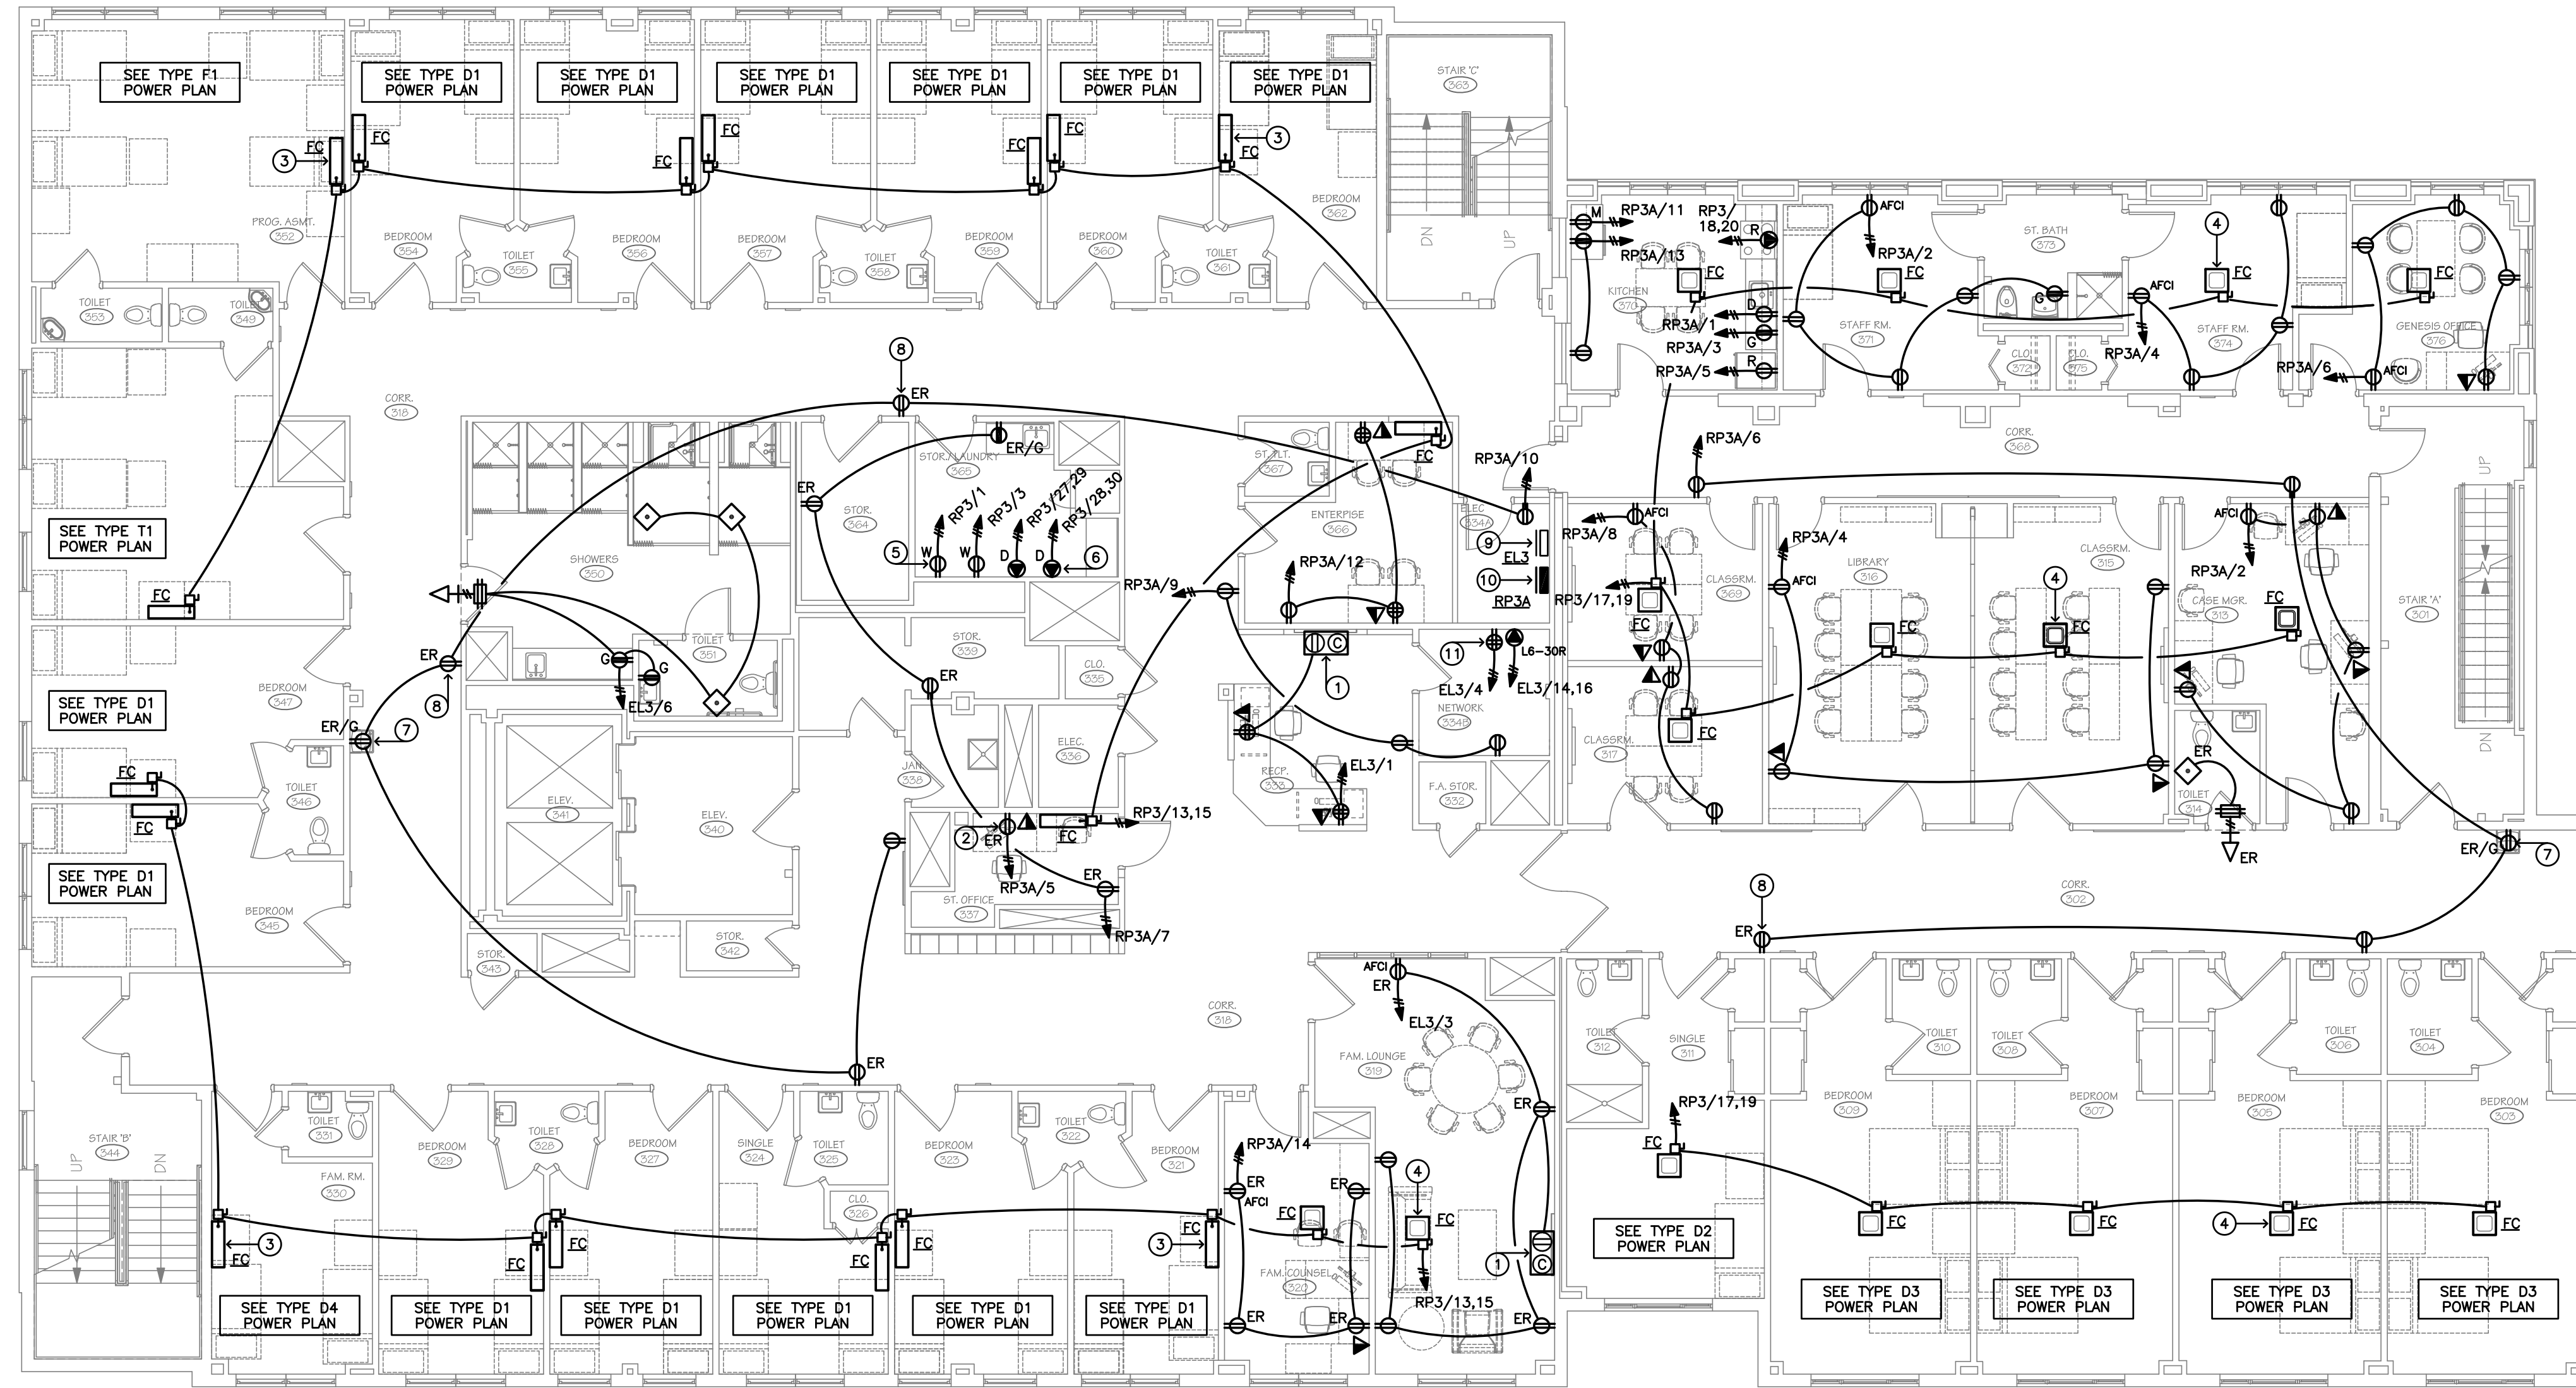


THIRD FLOOR POWER AND SYSTEMS PLAN  
SCALE: 1/8" = 1'-0"

LEGEND




- ① NEW FLAT PANEL DISPLAY SERVICE BOX. TWO-GANG RECESSED MOUNT TV BOX AND FRAME WITH DUPLEX RECEPTACLE, 20A @ 125V AND DATA OUTLET. BOX MOUNTING HEIGHT BY ARCHITECT, VERIFY LOCATIONS IN FIELD. PASS & SEYMOUR #TV1WMTVSSWCC2.
- ② COPIER, 120V-1Ø.
- ③ NEW WALL MOUNTED SPLIT SYSTEM AC UNIT, 0.4MCA-208V-1Ø. 2 #12 + 1 #12 GND. TO 15A-2P BRANCH CIRCUIT BREAKER.
- ④ NEW CEILING MOUNTED SPLIT SYSTEM AC UNIT, 0.4MCA-208V-1Ø. 2 #12 + 1 #12 GND. TO 15A-2P BRANCH CIRCUIT BREAKER.
- ⑤ WASHER, 120V-1Ø, RECEPTACLE MOUNTED 36" AFF, BRANCH CIRCUIT PROTECTED BY GFCI BRANCH CIRCUIT BREAKER.
- ⑥ DRYER, 208V-1Ø, OUTLET MOUNTED 36" AFF, 2 #10 + 1 #10 GND. TO 30A-2P BRANCH CIRCUIT BREAKER.
- ⑦ DRINKING FOUNTAIN, 120V-1Ø, PROVIDE NEW GFCI DUPLEX RECEPTACLE AT EXISTING LOCATION.
- ⑧ EXISTING DUPLEX RECEPTACLE TO BE REMOVED AND REPLACED WITH NEW TAMPER RESISTANT DUPLEX RECEPTACLE AT EXISTING LOCATION, "TYPICAL".
- ⑨ EXISTING PANEL "EL3", 120/208V-3Ø.
- ⑩ NEW PANEL "RP3A", 120/208V-3Ø.
- ⑪ DATA RACK, ONE (1) DEDICATED CIRCUIT DOUBLE DUPLEX RECEPTACLE AND ONE (1) 30A-208V-1Ø TWIST-LOCK RECEPTACLE. VERIFY MOUNTING LOCATIONS AND REQUIREMENTS WITH VENDOR IN FIELD.

GENERAL NOTES

- Ⓐ SEE DRAWING E2.2 FOR LARGE SCALE BEDROOM ELECTRICAL PLANS.

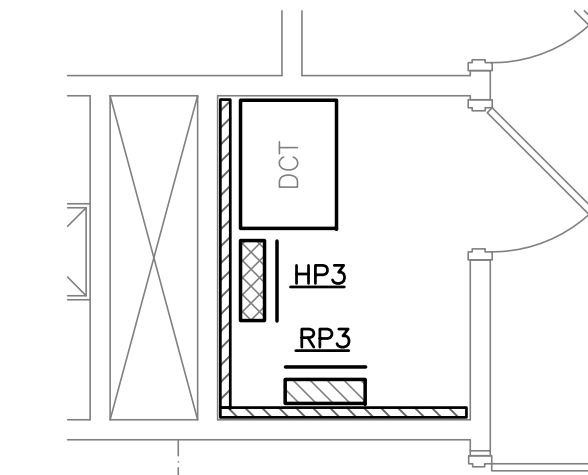

ELECTRIC ROOM PLAN  
SCALE: 1/4" = 1'-0"

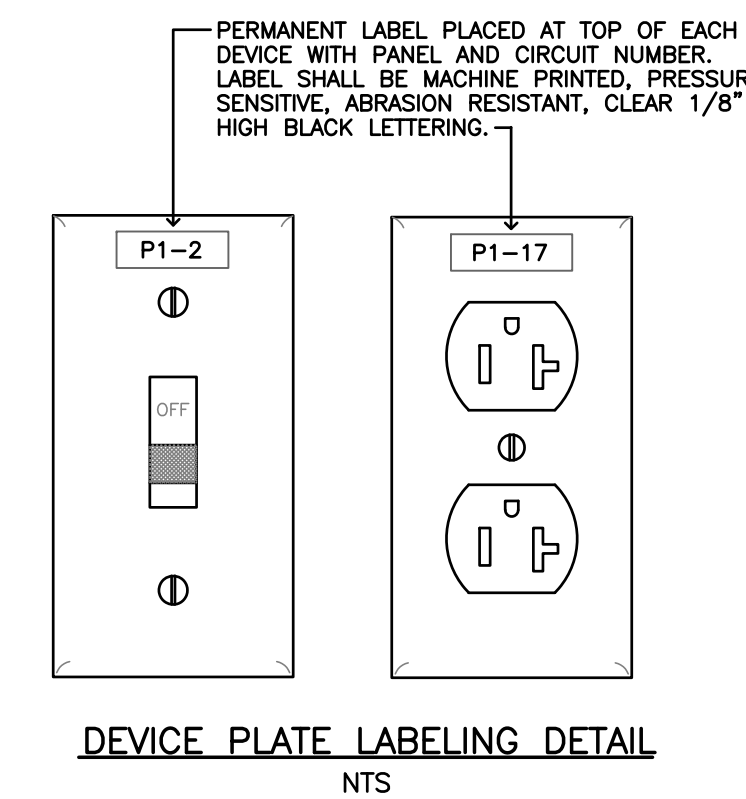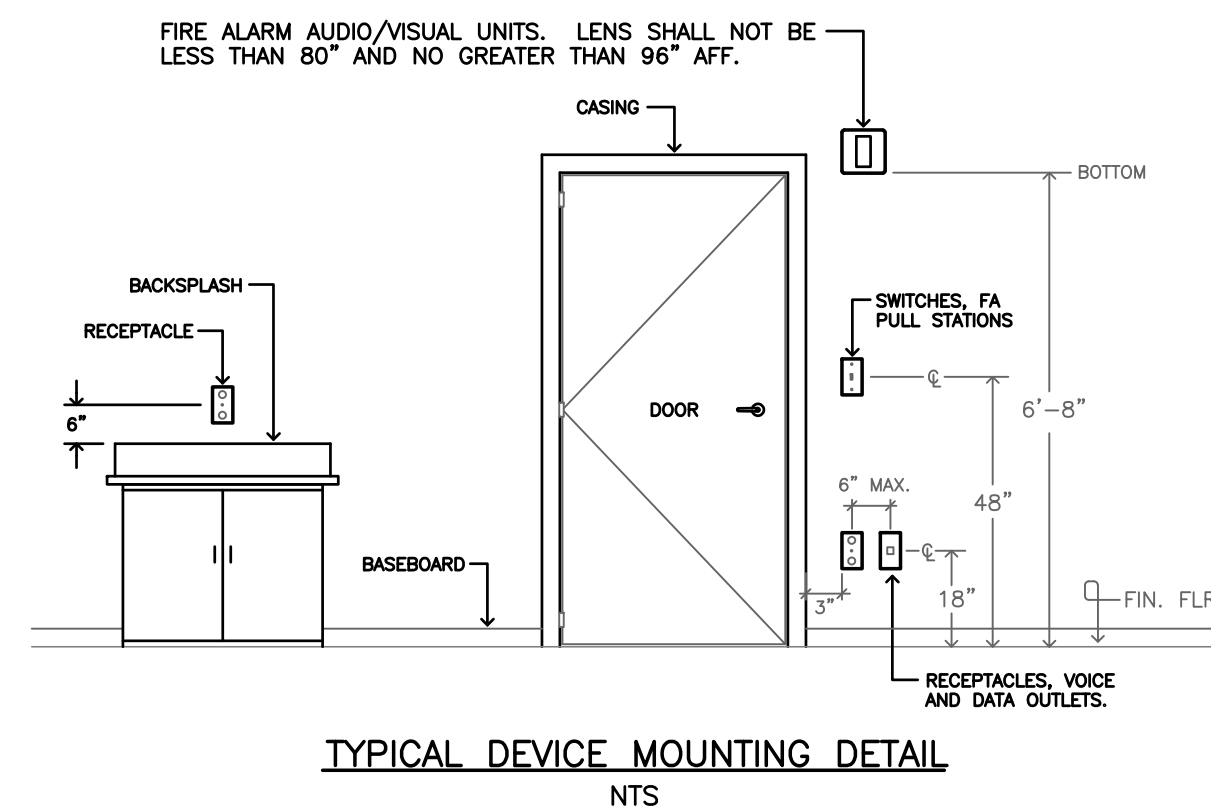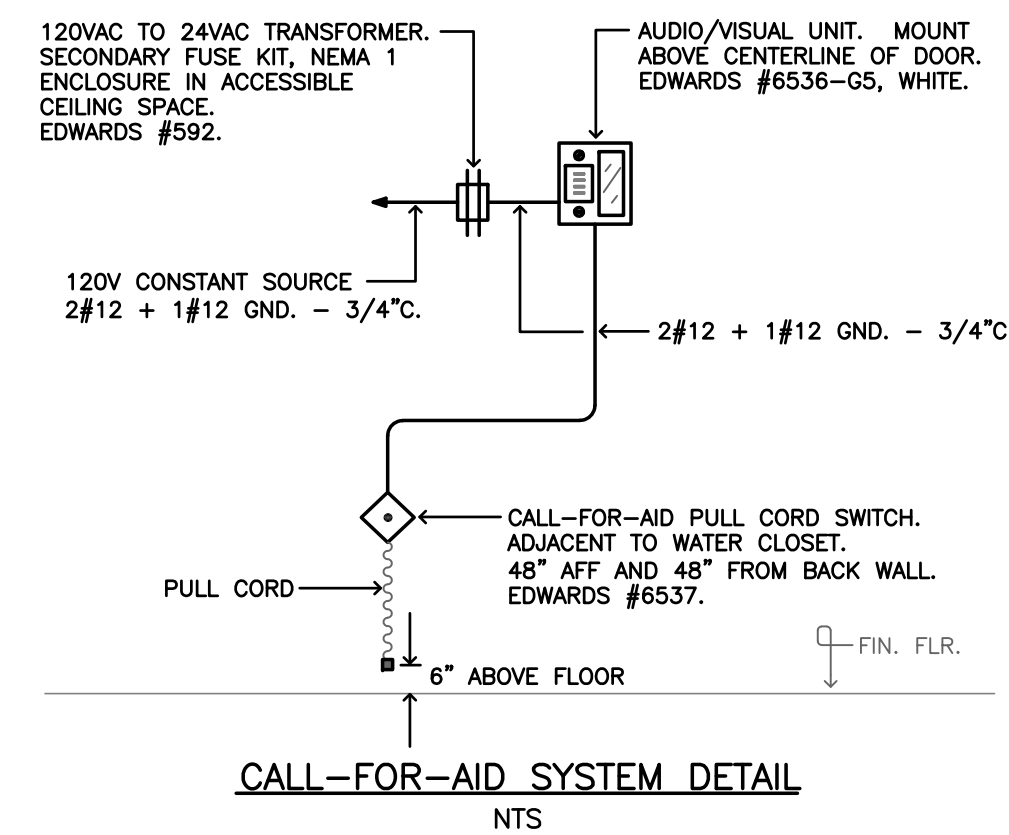

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:



REVISIONS:

DATE	DESCRIPTION


JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
THIRD FLOOR POWER AND SYSTEMS PLAN

SCALE: 1/8" = 1'-0" DRAWN BY: MMV REVIEWED BY: MMV  
DRAWING NO.:

E2.3  
04.16.2020 - CM BID  
DATE: 05 MARCH 2020 GDD JOB NUMBER: 19469



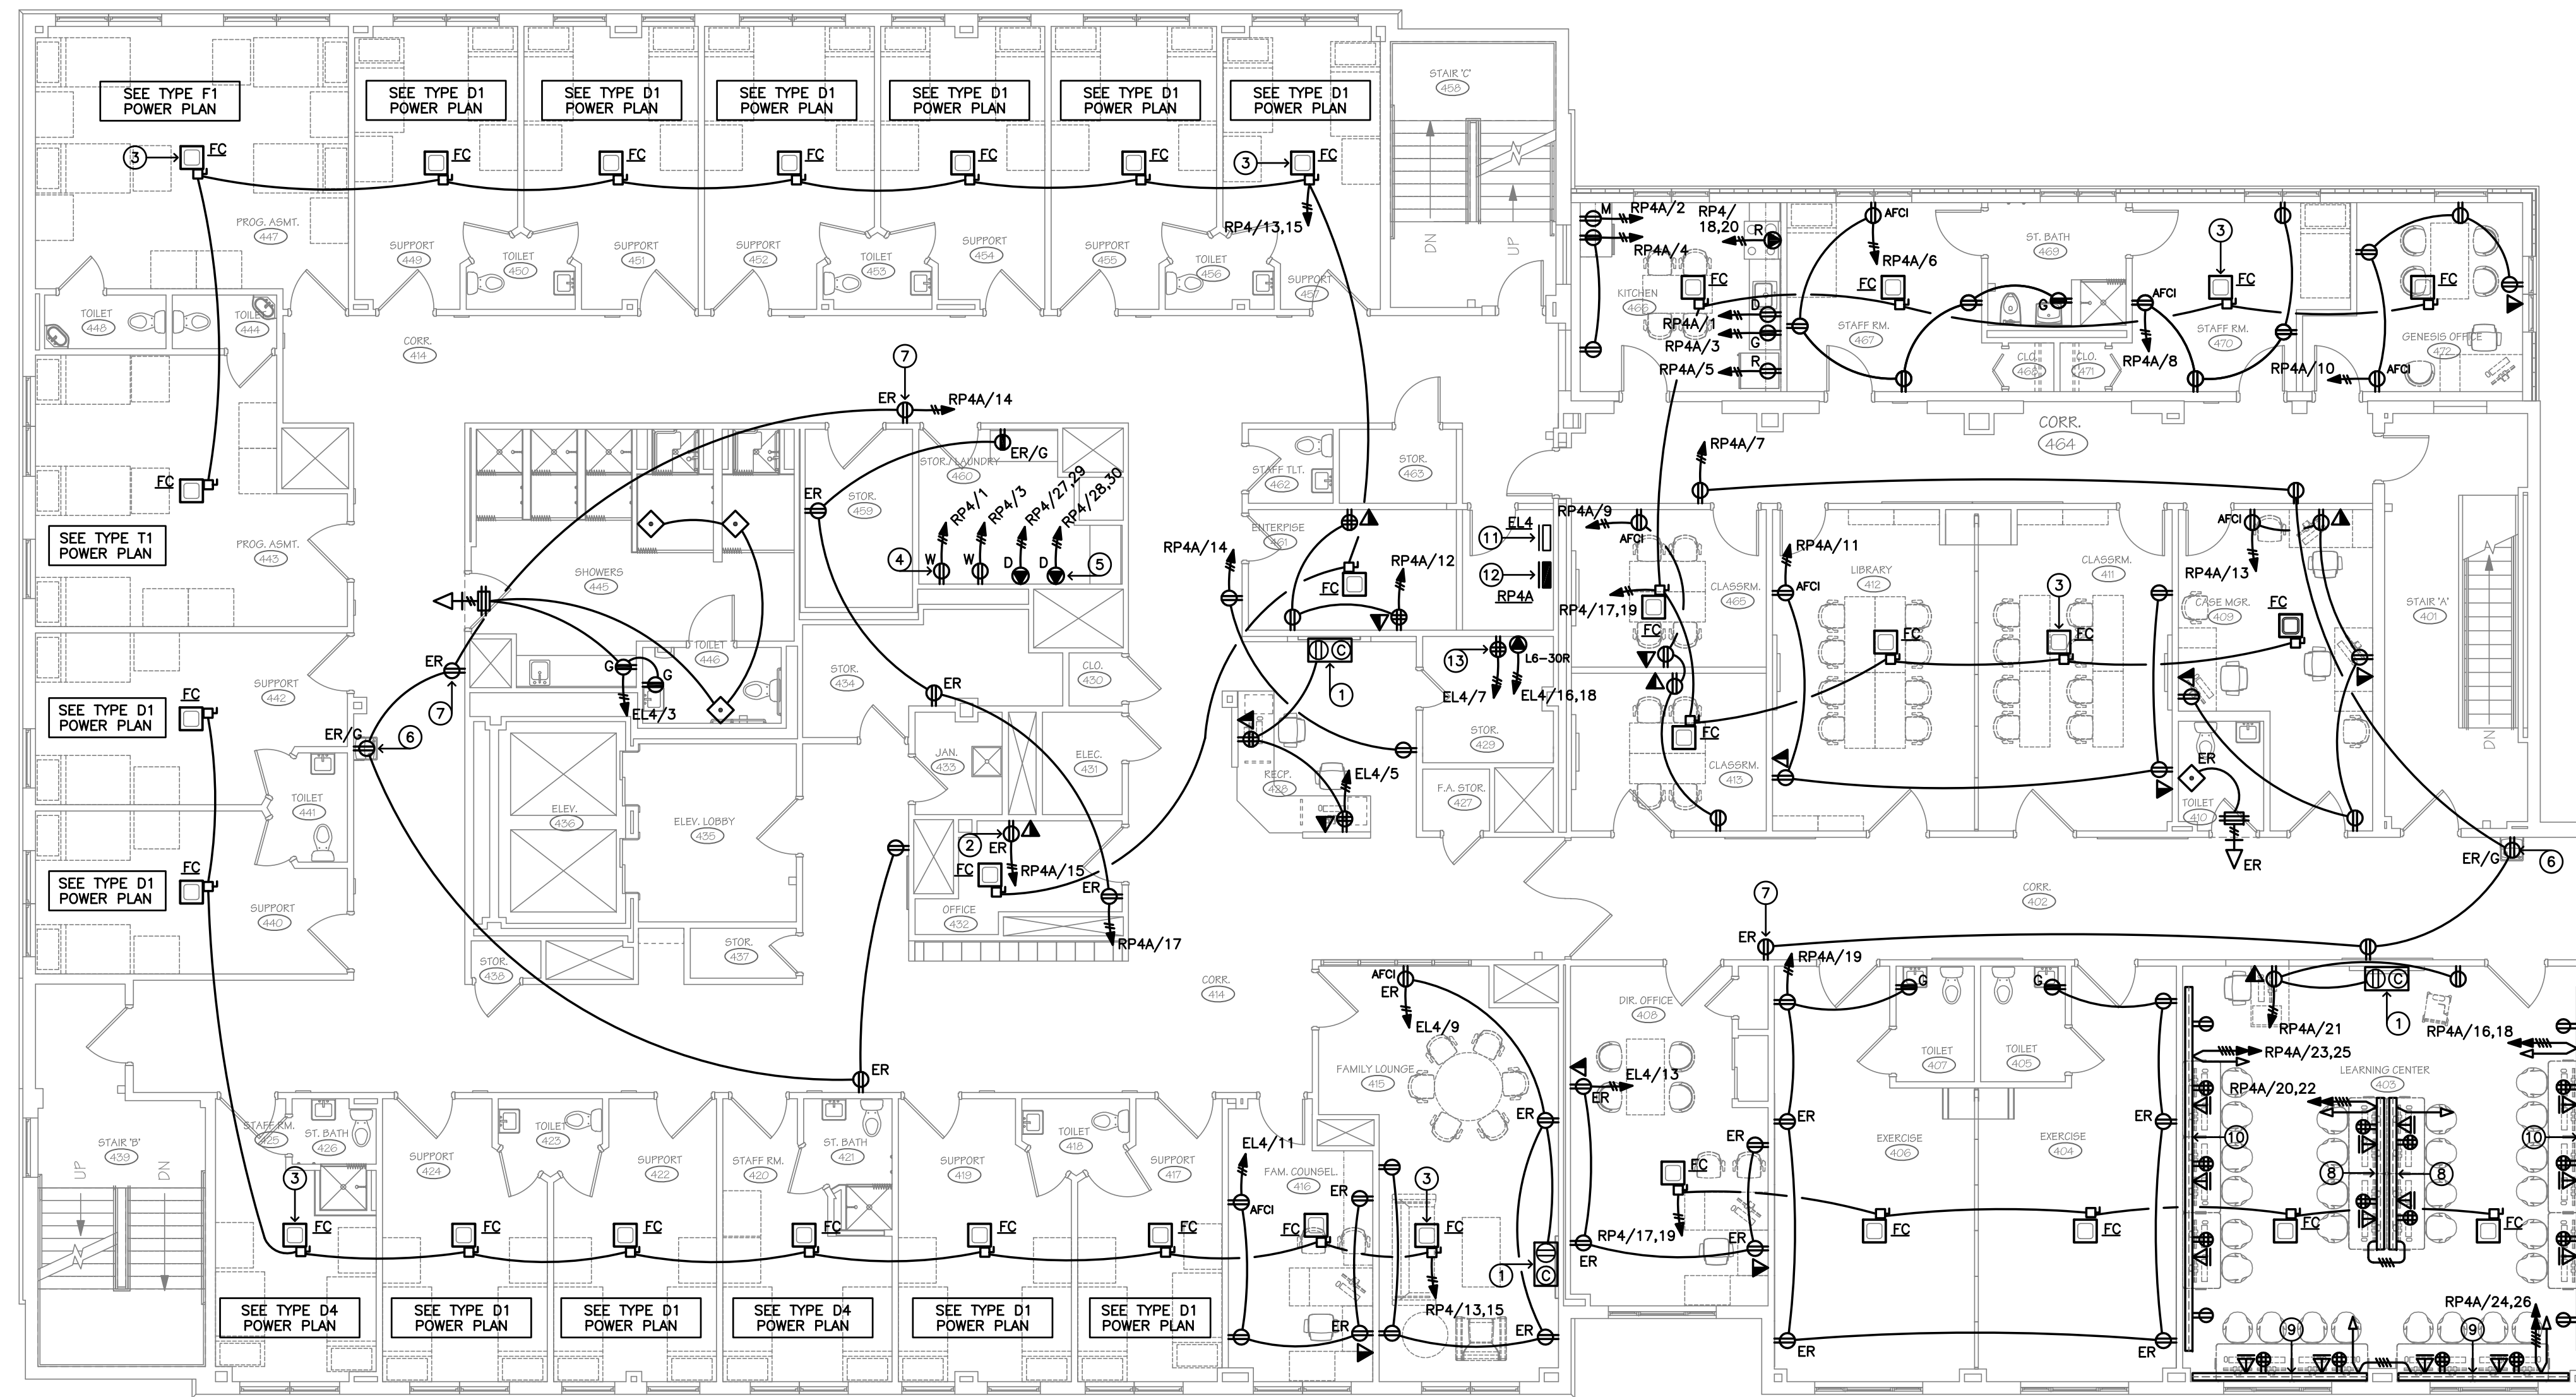


FOURTH FLOOR POWER AND SYSTEMS PLAN  
SCALE: 1/8" = 1'-0"

LEGEND

- 1 NEW FLAT PANEL DISPLAY SERVICE BOX. TWO-GANG RECESSED MOUNT TV BOX AND FRAME WITH DUPLEX RECEPTACLE, 20A @ 125V AND DATA OUTLET. BOX MOUNTING HEIGHT BY ARCHITECT. VERIFY LOCATIONS IN FIELD. PASS & SEMOUR #TV1WMTVSSWCC2.
- 2 COPIER, 120V-1Ø.
- 3 NEW CEILING MOUNTED SPLIT SYSTEM AC UNIT, 0.4MCA-208V-1Ø. 2 #12 + 1 #12 GND. TO 15A-2P BRANCH CIRCUIT BREAKER.
- 4 WASHER, 120V-1Ø, RECEPTACLE MOUNTED 36" AFF, BRANCH CIRCUIT PROTECTED BY GFCI BRANCH CIRCUIT BREAKER.
- 5 DRYER, 208V-1Ø, OUTLET MOUNTED 36" AFF, 2 #10 + 1 #10 GND. TO 30A-2P BRANCH CIRCUIT BREAKER.
- 6 DRINKING FOUNTAIN, 120V-1Ø, PROVIDE NEW GFCI DUPLEX RECEPTACLE AT EXISTING LOCATION.
- 7 EXISTING DUPLEX RECEPTACLE TO BE REMOVED AND REPLACED WITH NEW TAMPER RESISTANT DUPLEX RECEPTACLE AT EXISTING LOCATION, TYPICAL.
- 8 10'-0" WIREMOLD V4000 SURFACE RACEWAY, QUANTITY OF DOUBLE DUPLEX RECEPTACLES AND VOICE/DATA OUTLETS AS INDICATED. TWO (2) CIRCUITS, 4 #12 + 1 #12 GND. - 3/4"C. TO 2-20A-1P BRANCH CIRCUIT BREAKERS. ALTERNATELY CIRCUIT RECEPTACLES. 1 - 1 1/4" CONDUIT RISER WITH PULL CORD UP TO ACCESSIBLE CEILING SPACE FOR VOICE/DATA CABLING. TERMINATE CONDUIT WITH INSULATING BUSHINGS. COORDINATE MOUNTING HEIGHT AND LOCATION WITH OWNER.
- 9 11'-0" WIREMOLD V4000 SURFACE RACEWAY, QUANTITY OF DOUBLE DUPLEX RECEPTACLES AND VOICE/DATA OUTLETS AS INDICATED. TWO (2) CIRCUITS, 4 #12 + 1 #12 GND. - 3/4"C. TO 2-20A-1P BRANCH CIRCUIT BREAKERS. ALTERNATELY CIRCUIT RECEPTACLES. 1 - 1 1/4" CONDUIT RISER WITH PULL CORD UP TO ACCESSIBLE CEILING SPACE FOR VOICE/DATA CABLING. TERMINATE CONDUIT WITH INSULATING BUSHINGS. COORDINATE MOUNTING HEIGHT AND LOCATION WITH OWNER.
- 10 24'-0" WIREMOLD V4000 SURFACE RACEWAY, QUANTITY OF DOUBLE DUPLEX RECEPTACLES AND VOICE/DATA OUTLETS AS INDICATED. TWO (2) CIRCUITS, 4 #12 + 1 #12 GND. - 3/4"C. TO 2-20A-1P BRANCH CIRCUIT BREAKERS. ALTERNATELY CIRCUIT RECEPTACLES. 1 - 1 1/4" CONDUIT RISER WITH PULL CORD UP TO ACCESSIBLE CEILING SPACE FOR VOICE/DATA CABLING. TERMINATE CONDUIT WITH INSULATING BUSHINGS. COORDINATE MOUNTING HEIGHT AND LOCATION WITH OWNER.
- 11 EXISTING PANEL 'EL4', 120/208V-3Ø.
- 12 NEW PANEL 'RP4A', 120/208V-3Ø.
- 13 DATA RACK, ONE (1) DEDICATED CIRCUIT DOUBLE DUPLEX RECEPTACLE AND ONE (1) 30A-208V-1Ø TWIST-LOCK RECEPTACLE. VERIFY MOUNTING LOCATIONS AND REQUIREMENTS WITH VENDOR IN FIELD.

GENERAL NOTES

- A SEE DRAWING E2.2 FOR LARGE SCALE BEDROOM ELECTRICAL PLANS.

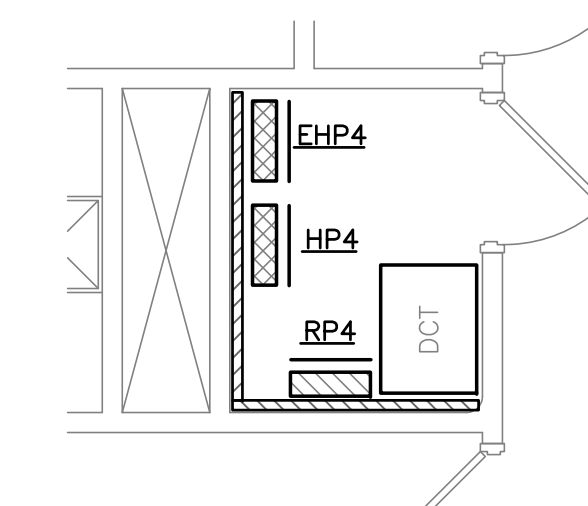

ELECTRIC ROOM PLAN  
SCALE: 1/4" = 1'-0"

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:



REVISIONS:

NO.	DATE	DESCRIPTION

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
FOURTH FLOOR POWER AND SYSTEMS PLAN

SCALE: 1/8" = 1'-0" DRAWN BY: MMV REVIEWED BY: MMV  
DRAWING NO.:

E2.4  
04.16.2020 - CM BID  
DATE: 05 MARCH 2020 GDD JOB NUMBER: 19469




ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com


These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:

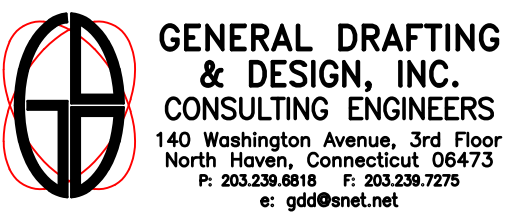

REVISIONS:

DATE	DESCRIPTION
06.07.19	ADDENDUM No.1
10.23.19	BULLETIN

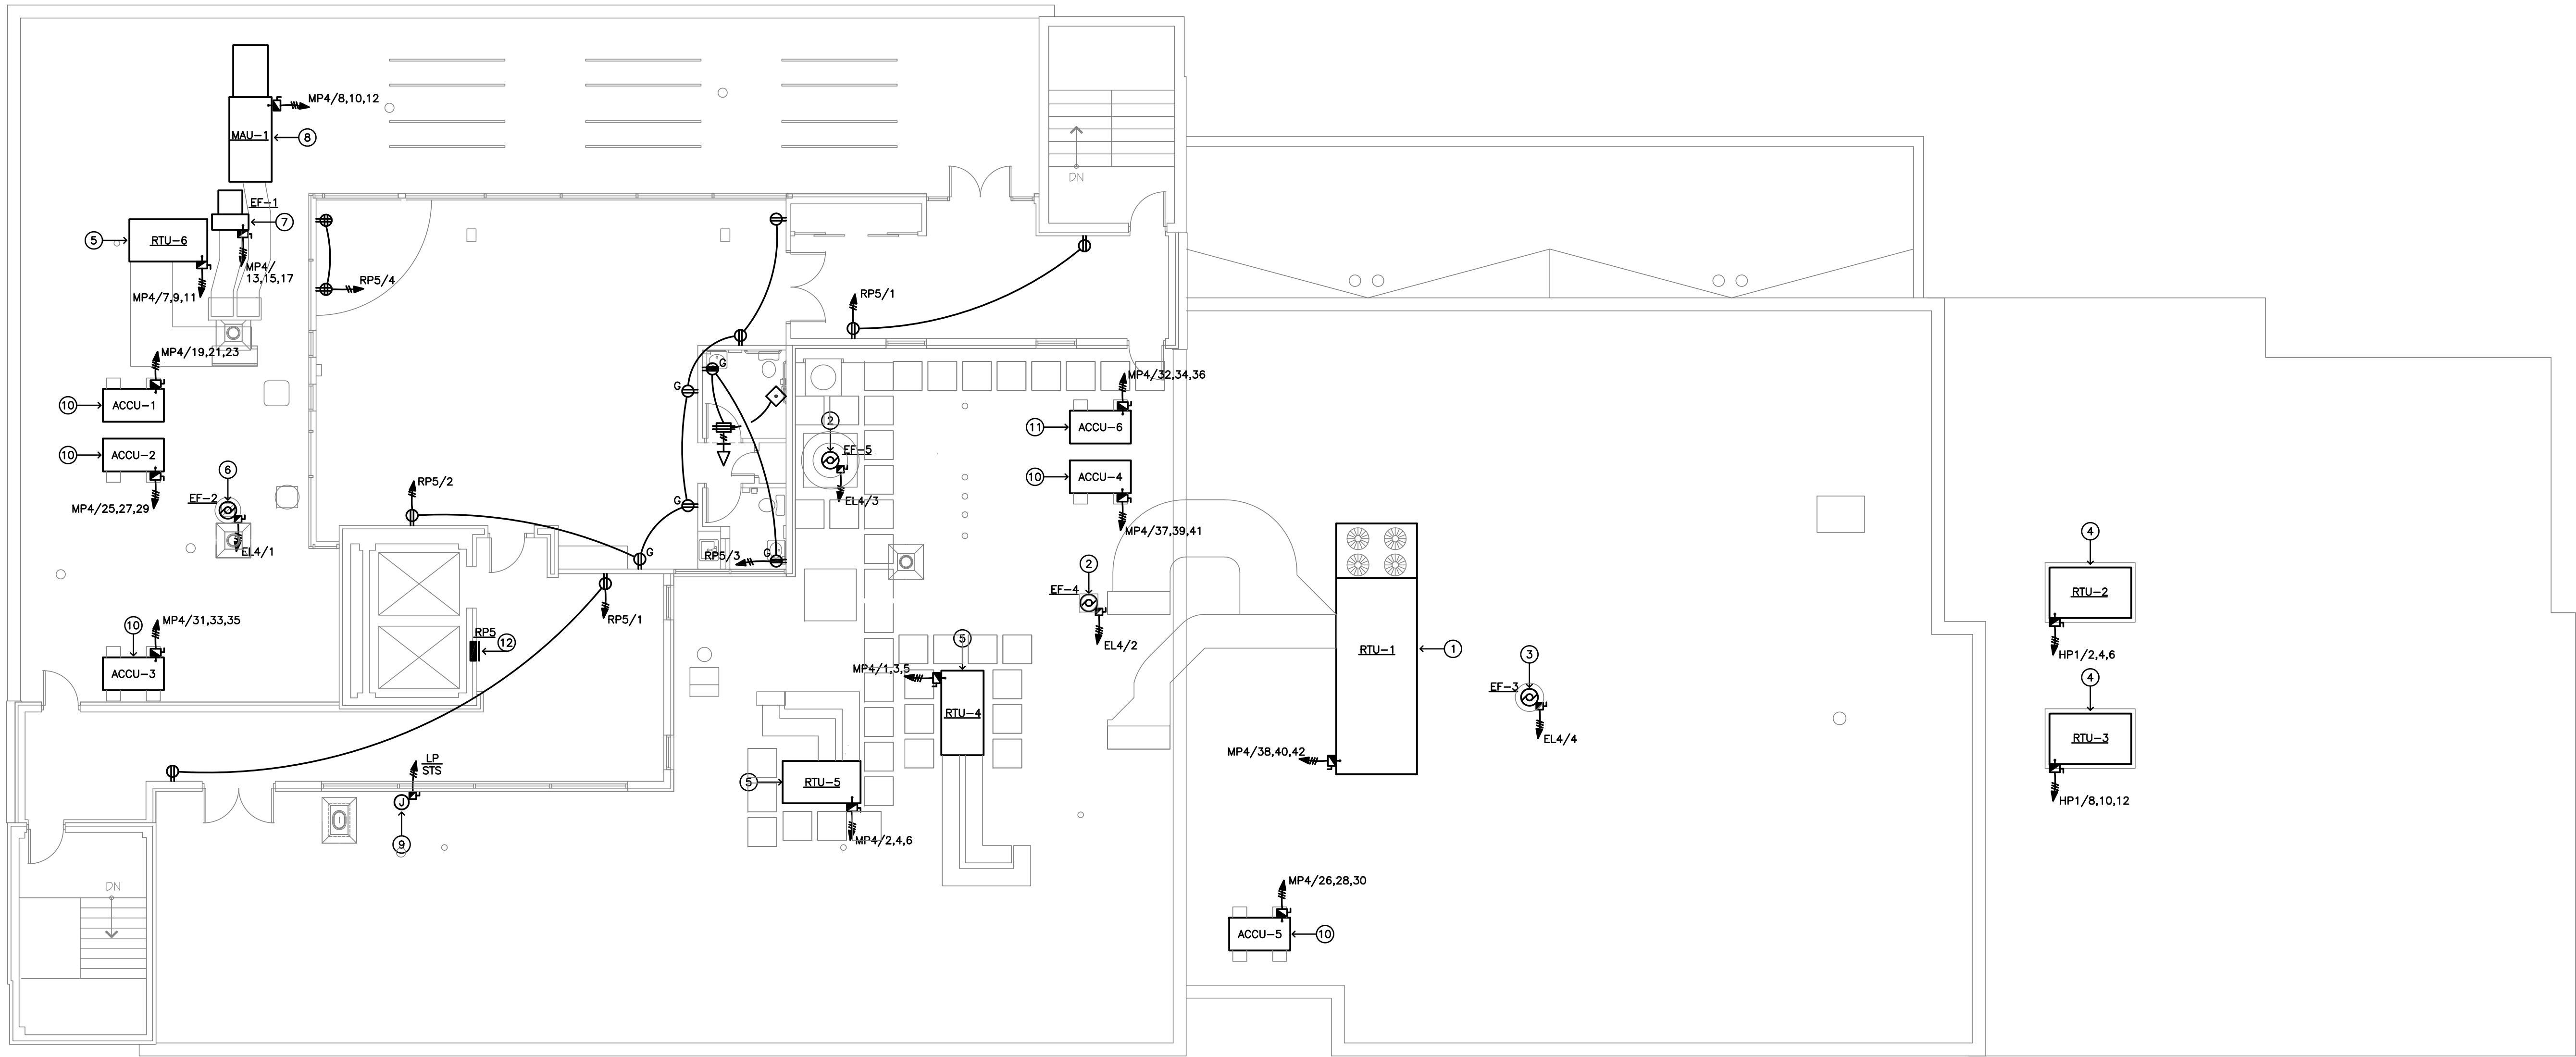

FIFTH FLOOR ELECTRICAL PLAN  
SCALE: 1/8" = 1'-0"

LEGEND

- ① NEW AIR HANDLING UNIT, 113MCA-460V-3Ø. 3 #1 + 1 #6 GND. - 1 1/2°C. TO 125A-3P BRANCH CIRCUIT BREAKER.
- ② NEW EXHAUST FAN, VERIFY HORSEPOWER AND VOLTAGE WITH MECHANICAL CONTRACTOR IN FIELD. (PHASE 1)
- ③ NEW EXHAUST FAN, 1/4HP-120V-1Ø. (PHASE 1)
- ④ NEW ROOFTOP UNIT, 18.8MCA-460V-3Ø. 3 #12 + 1 #12 GND. - 3/4°C. TO 20A-3P BRANCH CIRCUIT BREAKER. (PHASE 1)
- ⑤ NEW ROOFTOP UNIT, 13.0MCA-460V-3Ø. 3 #12 + 1 #12 GND. - 3/4°C. TO 20A-3P BRANCH CIRCUIT BREAKER. (PHASE 1)
- ⑥ NEW EXHAUST FAN, 1/6HP-120V-1Ø. (PHASE 1)
- ⑦ NEW KITCHEN HOOD EXHAUST FAN, 3HP-4.8A-460V-3Ø. 3 #12 + 1 #12 GND. - 3/4°C. TO 15A-3P BRANCH CIRCUIT BREAKER. (PHASE 1)
- ⑧ NEW KITCHEN HOOD MAKEUP AIR UNIT, 2HP-3.5A-460V-3Ø. 3 #12 + 1 #12 GND. - 3/4°C. TO 15A-3P SHUN-TRIP BRANCH CB. (PHASE 1)
- ⑨ ILLUMINATED SIGN, 277V-1Ø. PROVIDE WEATHER-PROOF JUNCTION BOX AND SAFETY DISCONNECT SWITCH AT SIGN. CIRCUIT TO PANEL THRU SIGN LIGHTING CONTACTOR AND TIMESWITCH. (PHASE 1)
- ⑩ NEW CONDENSING UNIT, 25.9MCA-460V-3Ø. 3 #10 + 1 #10 GND. - 3/4°C. TO 35A-3P BRANCH CIRCUIT BREAKER.
- ⑪ NEW CONDENSING UNIT, 20.6MCA-460V-3Ø. 3 #10 + 1 #10 GND. - 3/4°C. TO 25A-3P BRANCH CIRCUIT BREAKER.
- ⑫ NEW PANEL 'RPS', 120/208V-3Ø.

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:

FIFTH FLOOR  
ELECTRICAL PLAN

SCALE: 1/8" = 1'-0" DRAWN BY: MMV REVIEWED BY: MMV

DRAWING NO.:

E2.5  
04.16.2020 - CM BID

DATE: 05 MARCH 2020 GDD JOB NUMBER: 19469




ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:

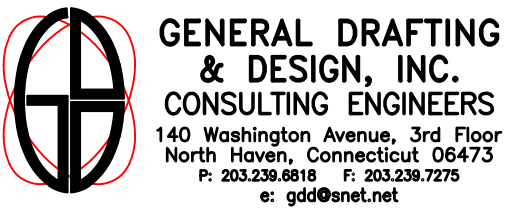

REVISIONS:

DATE	DESCRIPTION

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:

SECOND FLOOR  
FIRE ALARM PLAN

SCALE: 1/8" = 1'-0" DRAWN BY: MMV REVIEWED BY: MMV

DRAWING NO.:

**E3.2**

04.16.2020 - CM BID


DATE: 05 MARCH 2020 GDD JOB NUMBER: 19469

**FIRE ALARM SYMBOLS**

- NEW FIRE ALARM 4-CIRCUIT NAC POWER BOOSTER PANEL, SURFACE MOUNTED
- NEW ADDRESSABLE MANUAL PULL STATION, 48" AFF
- NEW ADDRESSABLE FIRE ALARM SMOKE DETECTOR
- NEW ADDRESSABLE ELEVATOR RECALL SMOKE DETECTOR
- NEW ADDRESSABLE FIRE ALARM HEAT DETECTOR
- NEW ADDRESSABLE MONITOR MODULE
- NEW ADDRESSABLE RELAY MODULE
- NEW HORN/ADA STROBE UNIT, 80" AFF TO BOTTOM
- NEW ADA STROBE UNIT, 80" AFF TO BOTTOM
- FIRE ALARM MAGNETIC DOOR HOLDER, 120V AC
- EXISTING SPRINKLER SYSTEM TAMPER SWITCH
- EXISTING SPRINKLER SYSTEM WATER FLOW SWITCH

**LEGEND**

- ① FIRE ALARM NAC POWER PANEL, 120V-16. CIRCUIT BREAKER TO BE RED WITH HANDLE LOCK TAB, LABEL "FIRE ALARM - DO NOT TURN OFF". PROVIDE ADDRESSABLE MODULES AS REQUIRED FOR PANEL MONITORING AND CONTROL.

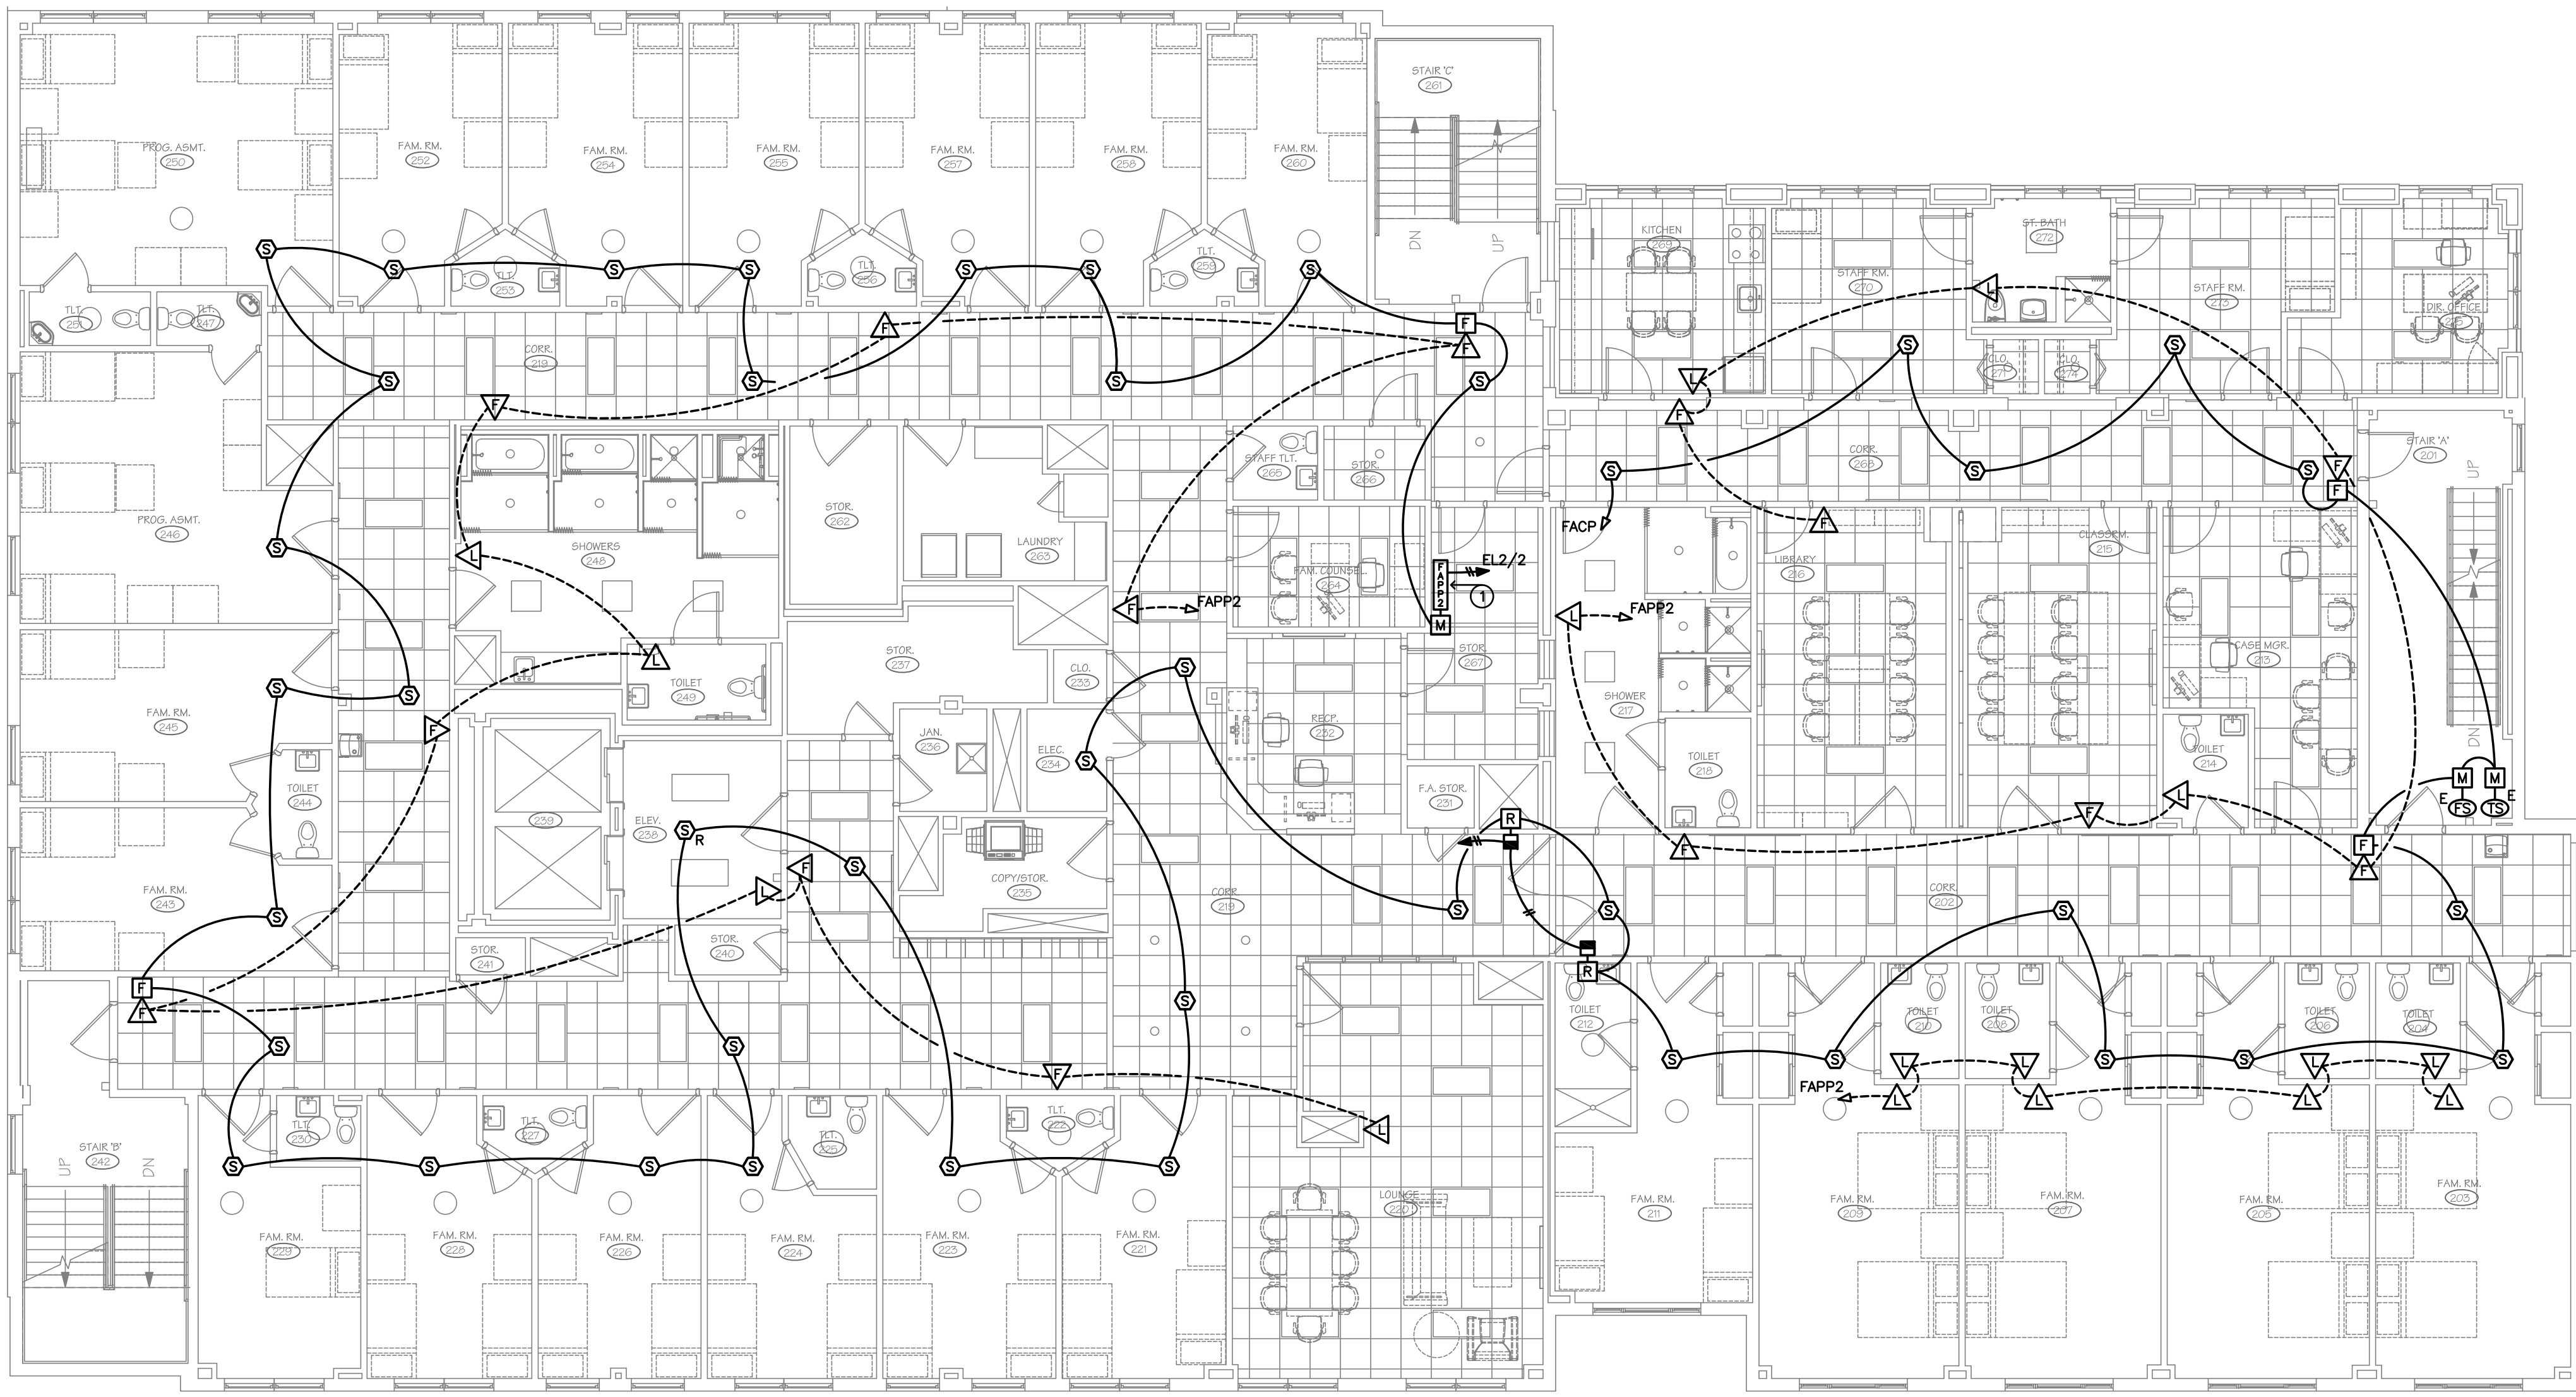


**SECOND FLOOR FIRE ALARM PLAN**

SCALE: 1/8" = 1'-0"



ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

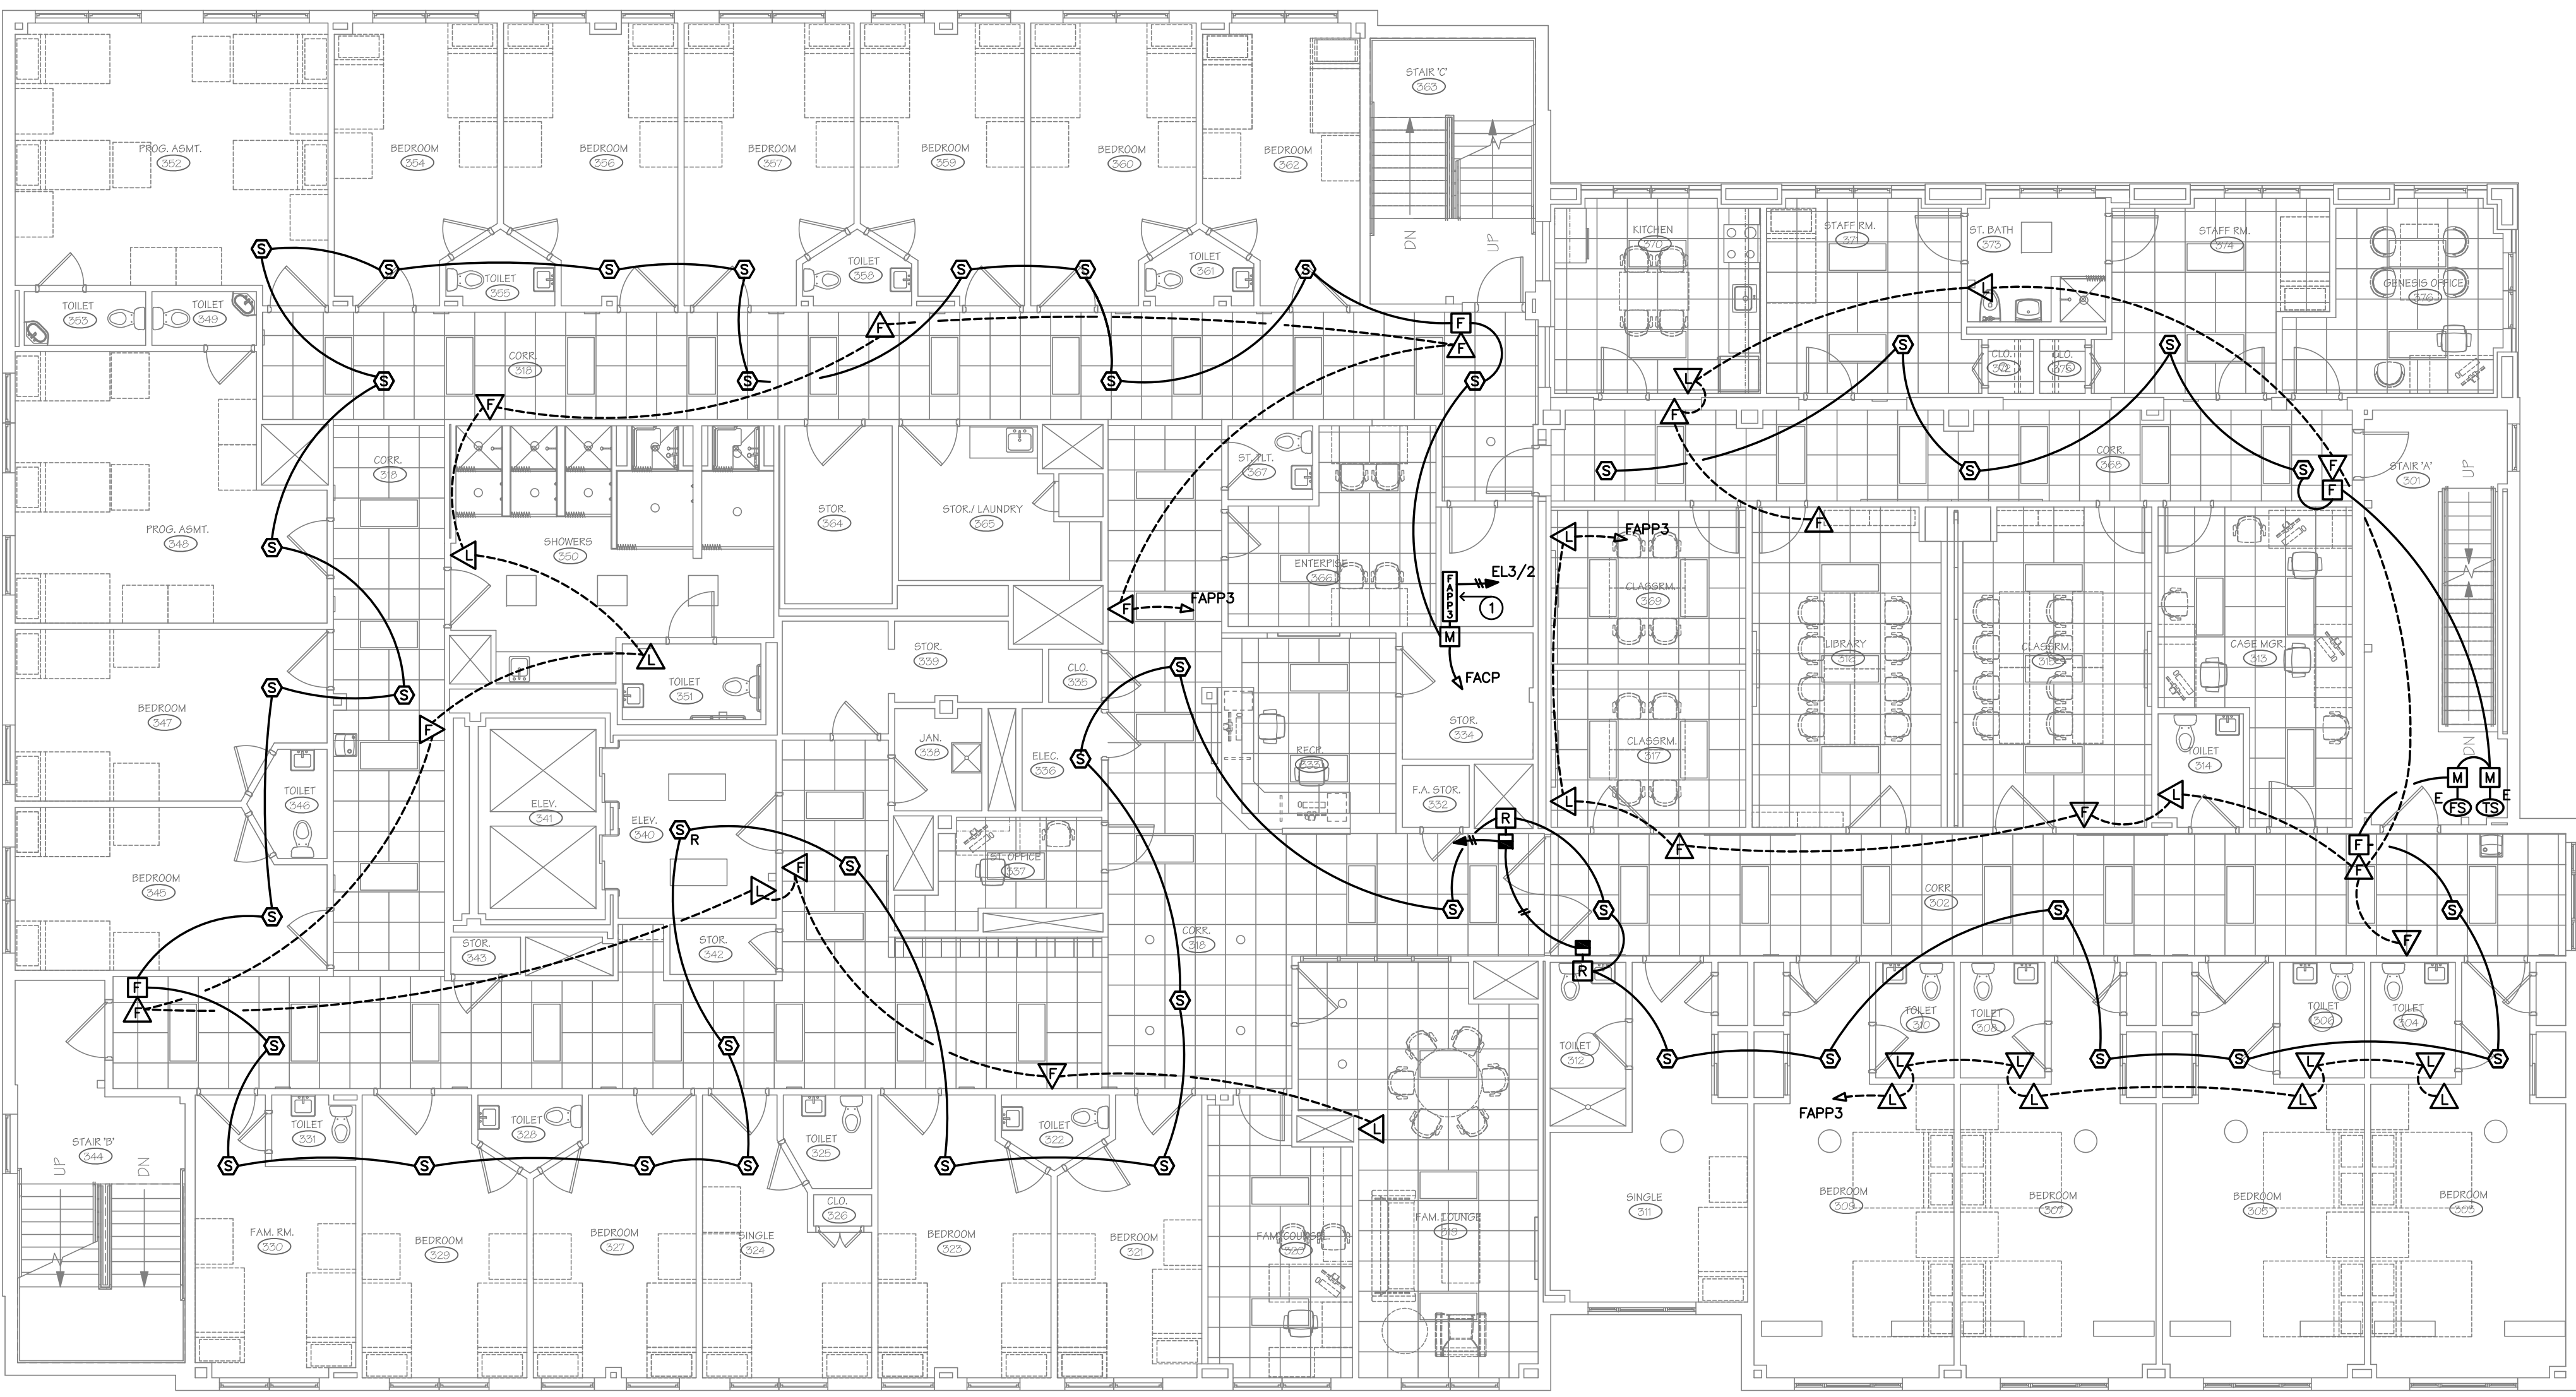

**LEGEND**  
① FIRE ALARM NAC POWER PANEL, 120V-1ϕ. CIRCUIT BREAKER TO BE RED WITH HANDLE LOCK TAB, LABEL "FIRE ALARM - DO NOT TURN OFF". PROVIDE ADDRESSABLE MODULES AS REQUIRED FOR PANEL MONITORING AND CONTROL.

**GENERAL NOTES**  
A SEE DRAWING E3.2 FOR FIRE ALARM SYMBOLS AND SPECIFICATIONS.

THIRD FLOOR FIRE ALARM PLAN  
SCALE: 1/8" = 1'-0"

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:



REVISIONS:

Δ	DATE	DESCRIPTION

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
THIRD FLOOR  
FIRE ALARM PLAN

SCALE: 1/8" = 1'-0" DRAWN BY: MMV REVIEWED BY: MMV


DRAWING NO.:

**E3.3**  
04.16.2020 - CM BID

DATE: 05 MARCH 2020 GDD JOB NUMBER: 19469



**ANTINOZZI ASSOCIATES**  
ARCHITECTURE & INTERIORS

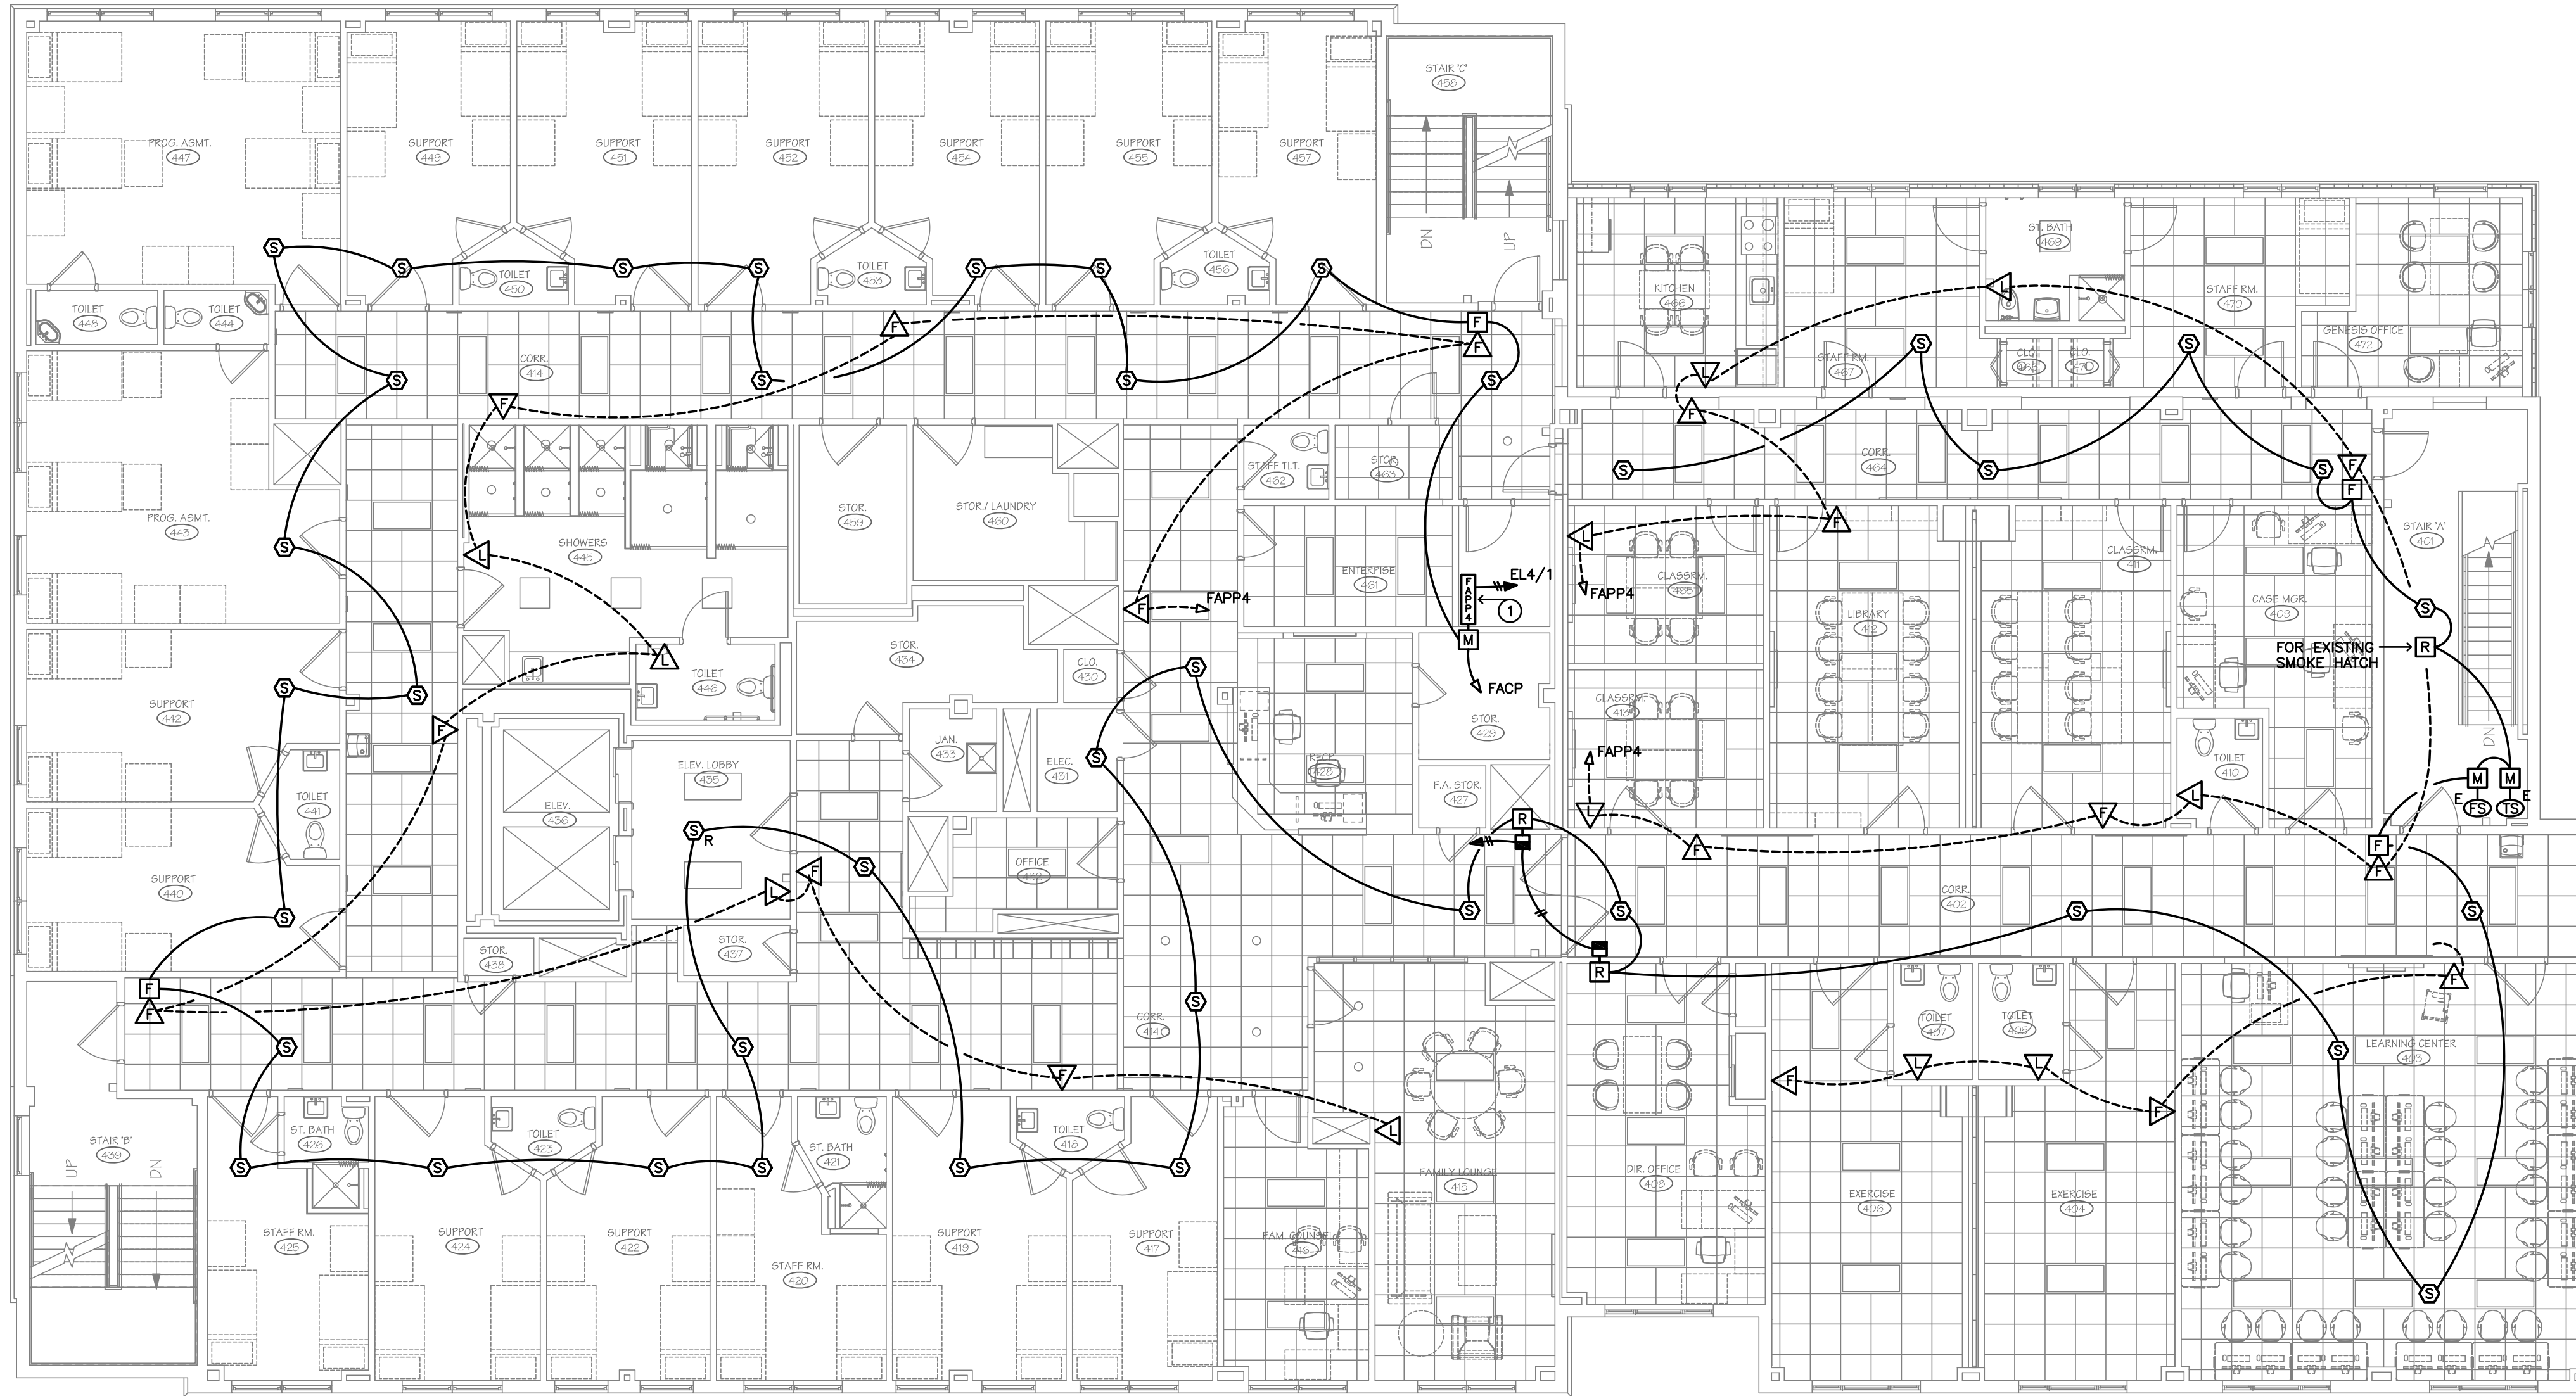

**LEGEND**

- ① FIRE ALARM NAC POWER PANEL, 120V-1Ø. CIRCUIT BREAKER TO BE RED WITH HANDLE LOCK TAB, LABEL "FIRE ALARM - DO NOT TURN OFF". PROVIDE ADDRESSABLE MODULES AS REQUIRED FOR PANEL MONITORING AND CONTROL.

**GENERAL NOTES**

- Ⓐ SEE DRAWING E3.2 FOR FIRE ALARM SYMBOLS AND SPECIFICATIONS.

**FOURTH FLOOR FIRE ALARM PLAN**


SCALE: 1/8" = 1'-0"

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:

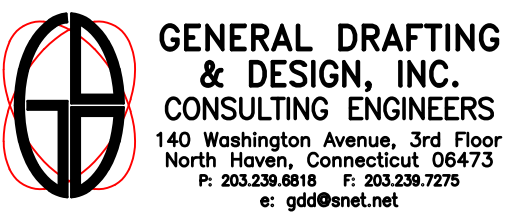

REVISIONS:

Δ	DATE	DESCRIPTION

**JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION**  
**PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION**  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
**FOURTH FLOOR  
FIRE ALARM PLAN**

SCALE: 1/8" = 1'-0" DRAWN BY: MMV REVIEWED BY: MMV

DRAWING NO.:

**E3.4**

04.16.2020 - CM BID

DATE: 05 MARCH 2020 GDD JOB NUMBER: 19469




ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

COPYRIGHT 2017 BY:  
ANTINOZZI ASSOCIATES, P.C.  
271 Fairfield Avenue  
Bridgeport, Connecticut 06604  
Tel: (203) 377-1300  
Fax: (203) 378-3002

301 Merritt 7  
Norwalk, Connecticut 06851  
Tel: (203) 956-5460 www.antinozzi.com

These documents have been prepared specifically for this project. Reproduction or other use of these documents is prohibited without the approval of the Engineer.

CONSULTANT:

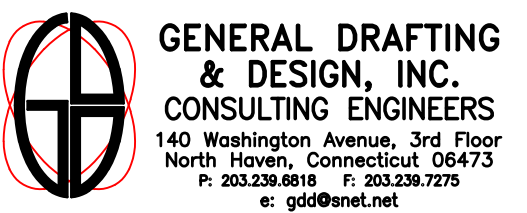

REVISIONS:  
DATE DESCRIPTION

DATE	DESCRIPTION

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT


DRAWING TITLE:  
FIFTH FLOOR  
FIRE ALARM PLAN

SCALE: 1/8" = 1'-0" DRAWN BY: MMV REVIEWED BY: MMV

DRAWING NO.:

**E3.5**  
04.16.2020 - CM BID

DATE: 05 MARCH 2020 GDD JOB NUMBER: 19469

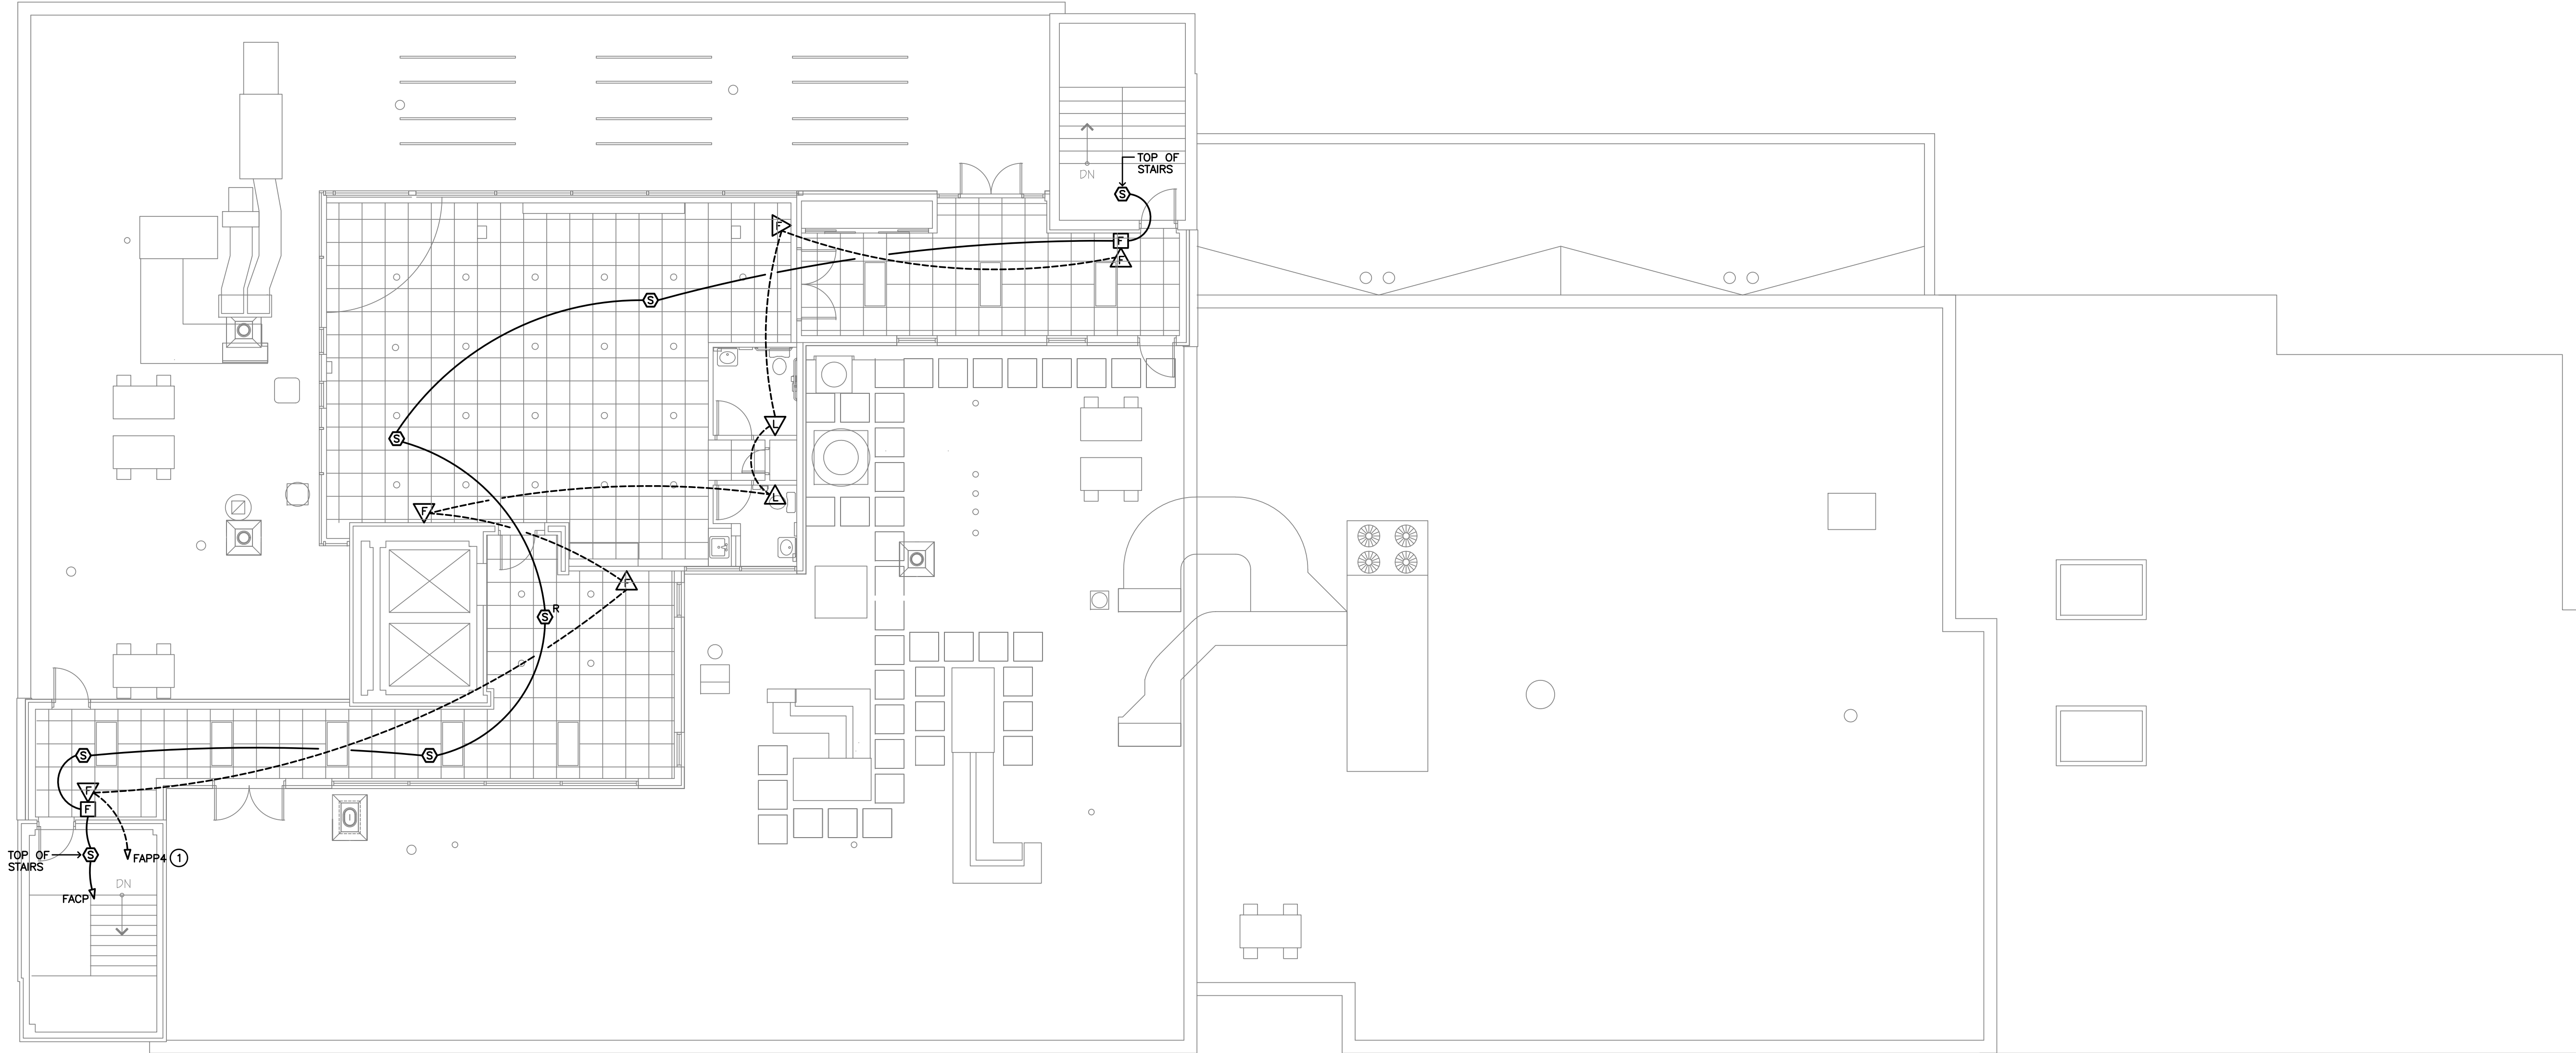

FIFTH FLOOR FIRE ALARM PLAN  
SCALE: 1/8" = 1'-0"

LEGEND

① DOWN TO FIRE ALARM NAC POWER PANEL LOCATED IN 4TH FLOOR ELECTRICAL ROOM.

GENERAL NOTES

Ⓐ SEE DRAWING E3.2 FOR FIRE ALARM SYMBOLS AND SPECIFICATIONS.




CONSULTANT:



REVISIONS:	DATE	DESCRIPTION
Δ	03.05.20	REISSUE WITH PHASE 2 DOCS

REVISIONS:	DATE	DESCRIPTION
Δ	03.05.20	REISSUE WITH PHASE 2 DOCS

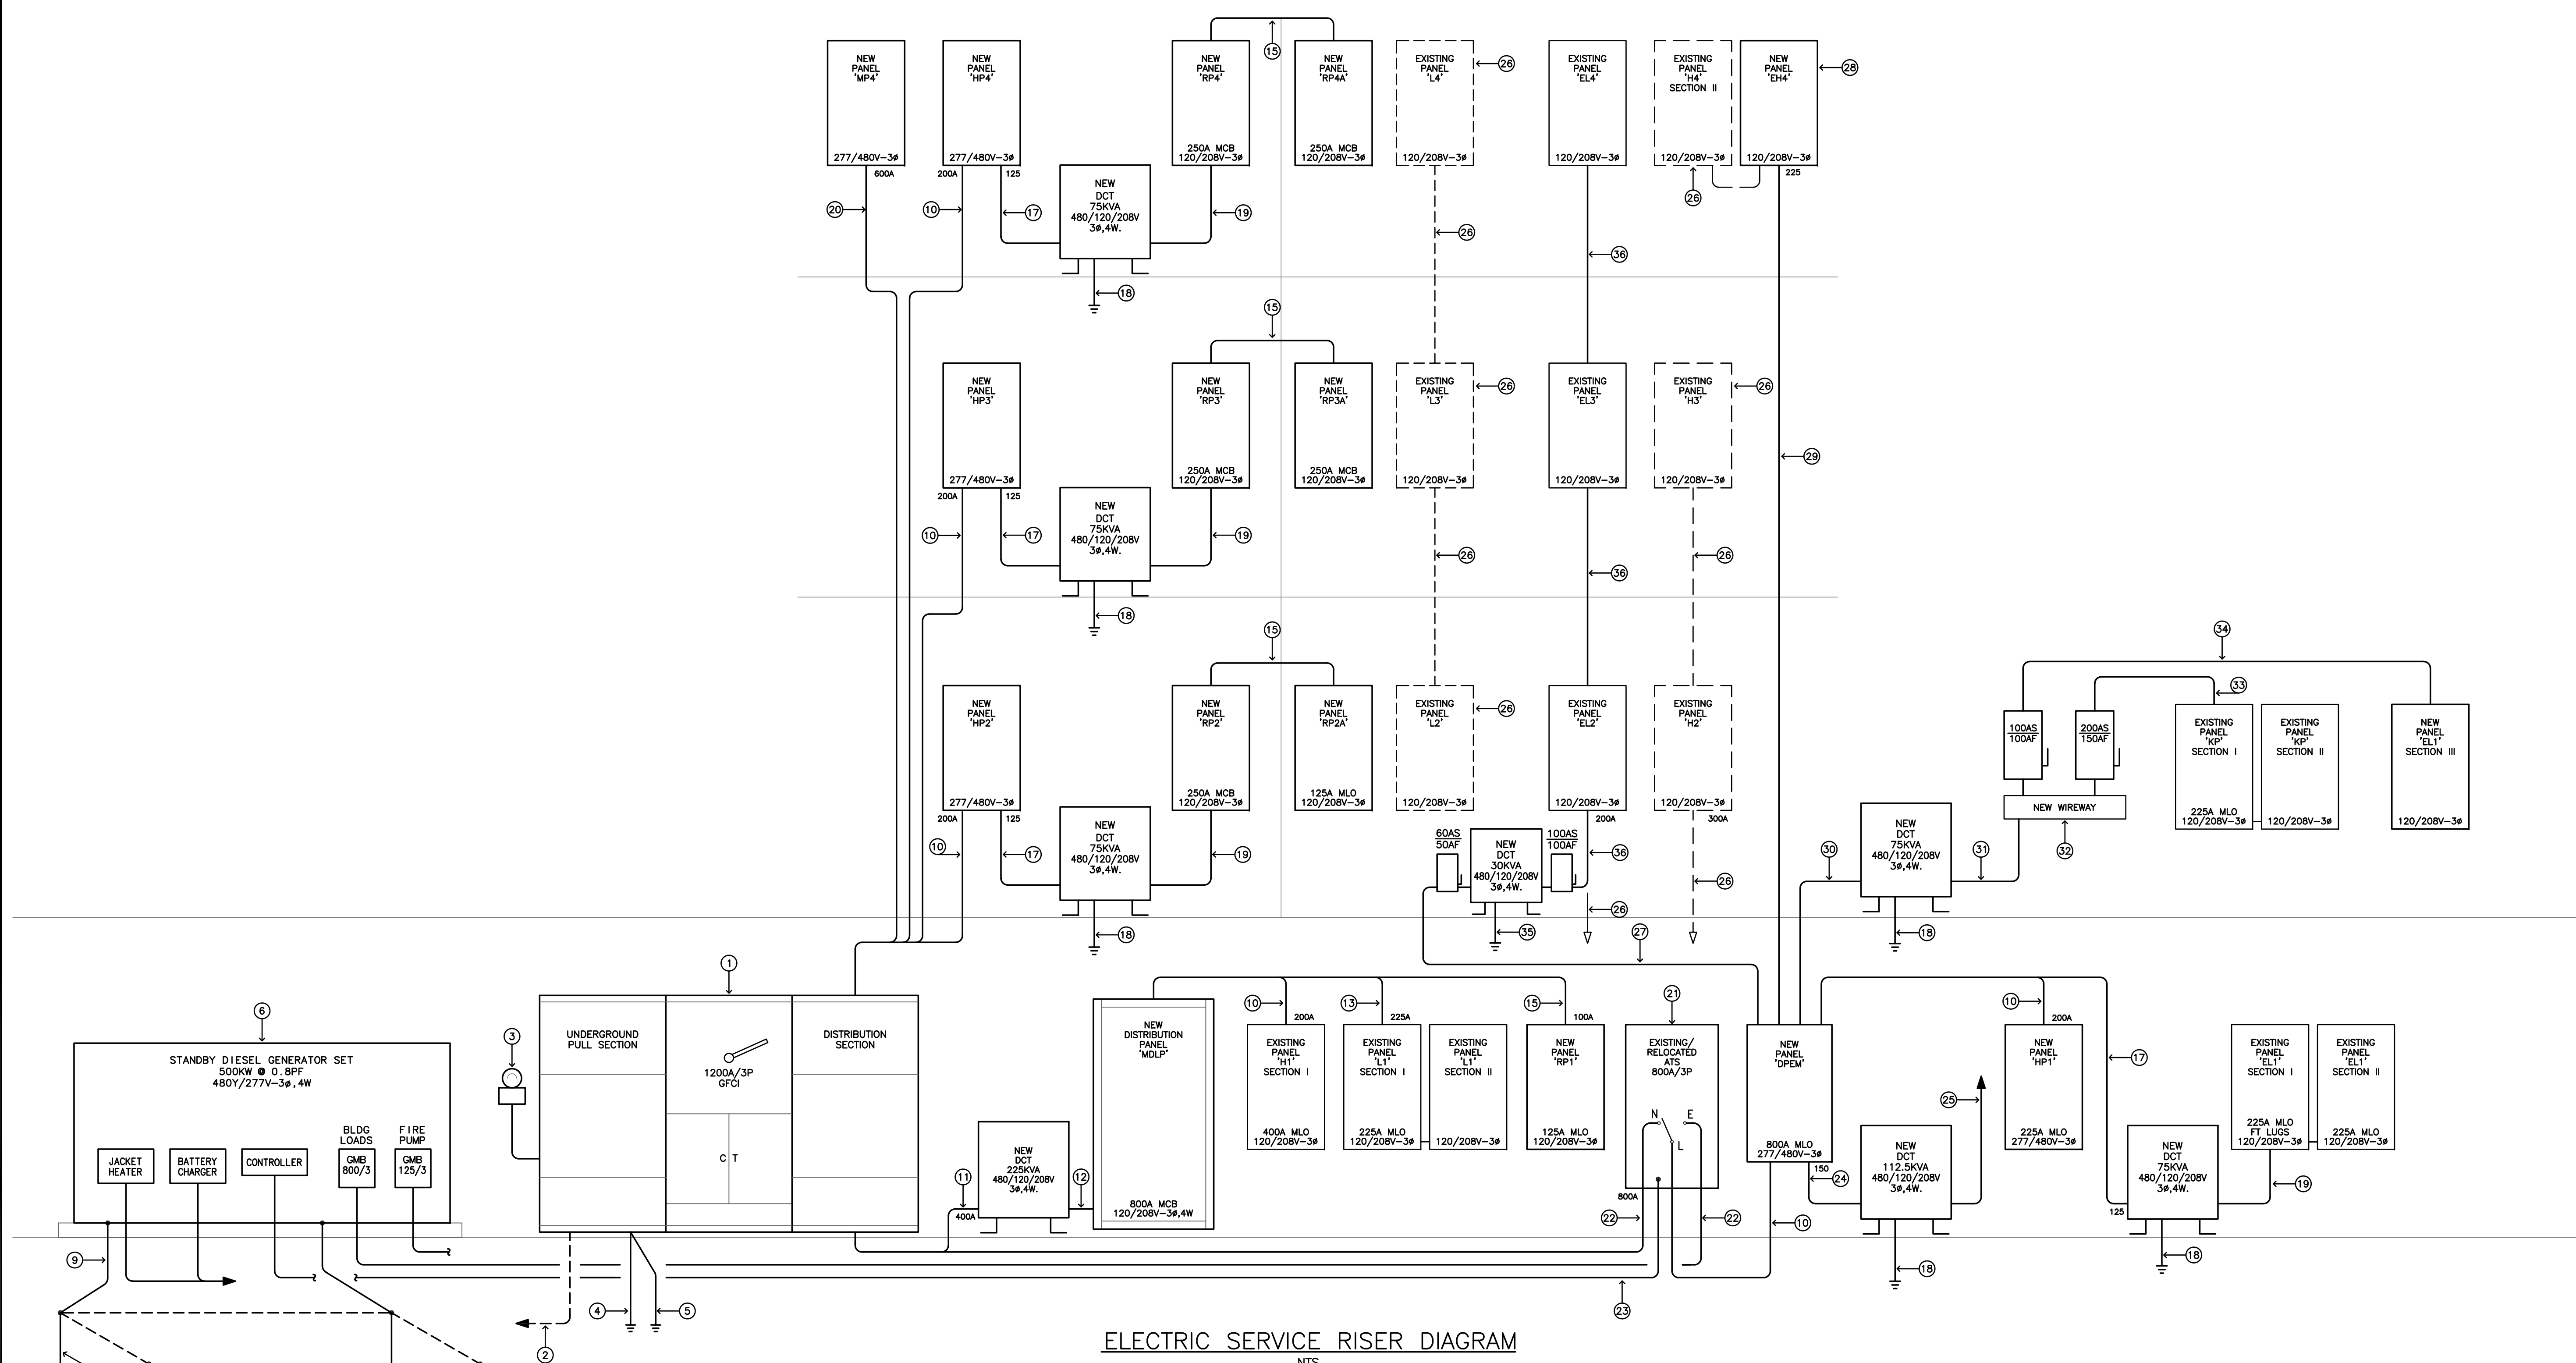

ELECTRIC SERVICE RISER DIAGRAM  
NTS

- LEGEND**
- ① NEW SERVICE ENTRANCE SWITCHBOARD, 1200A-277/480V-3Φ, 4W, 65K AIC, MOUNTED ON MOUNTED ON 4" HIGH CONCRETE HOUSEKEEPING PAD.
  - ② NEW UNDERGROUND CONCRETE ENCASED SECONDARY ELECTRIC SERVICE CONDUITS TO PAD MOUNT UTILITY TRANSFORMER: THREE (3) SETS: 4 #600Kcmil - 4" PVC SCH.40 CONDUIT WITH ONE (1) SPARE 4" PVC SCH.40 CONDUIT.
  - ③ NEW UTILITY REVENUE METER SOCKET WITH 1 1/2" RGS CONDUIT FOR METER CABLING, REVENUE METER FURNISHED AND INSTALLED BY UNITED ILLUMINATING COMPANY.
  - ④ NEW 1 #6 STRANDED Cu GROUND TO (2) 5/8" DIA. x 8' GROUND RODS WITH EXOTHERMIC CONNECTIONS.
  - ⑤ NEW 1 #3/0 Cu - 1°C. TO GROUND CLAMP ON COLD WATER SERVICE AND BUILDING STRUCTURAL STEEL. PROVIDE NEW 1 #250Kcmil Cu - 1°C. SPRINKLER PIPING BOND AND 1 #3/0 Cu - 1°C. GAS PIPING BOND.
  - ⑥ EXISTING /RELOCATED STANDBY GENERATOR SET, 500KW-277/480V-3Φ, 4W, MOUNTED ON NEW CONCRETE HOUSEKEEPING PAD. PROVIDE NEW 200A/3P CIRCUIT BREAKER FOR FIRE PUMP.
  - ⑦ NEW #3/0 BARE STRANDED Cu GROUND GRID.
  - ⑧ NEW 5/8" DIA. x 8' LONG COPPERCLAD GROUND ROD (4).
  - ⑨ NEW 1 #3/0 Cu BOND TO GENERATOR DUNNAGE, "TYPICAL".
  - ⑩ NEW 4 #4/0 + 1 #6 GND. - 2 1/2°C. TO 200A-3P BRANCH CIRCUIT BREAKER.
  - ⑪ NEW 4 #500Kcmil + 1 #3 GND. - 4°C. TO 400A-3P CB.
  - ⑫ NEW 4 #500Kcmil + 1 #3 GND. - 4°C.
  - ⑬ NEW 4 #4/0 + 1 #6 GND. - 2 1/2°C. TO 225A-3P BRANCH CIRCUIT BREAKER.
  - ⑭ NEW 4 #1/0 + 1 #6 GND. - 1 1/2°C. TO 150A-3P BRANCH CIRCUIT BREAKER.
  - ⑮ NEW 4 #2 + 1 #8 GND. - 1 1/4°C. TO 100A-3P BRANCH CIRCUIT BREAKER.
  - ⑯ EXISTING FEEDERS TO BE DISCONNECTED FROM SWITCHBOARD OR PANELBOARD CURRENTLY SERVING PANEL. REFEED EXISTING PANEL BRANCH CIRCUITS TO REMAIN, SEE DRAWING E2.5.
  - ⑰ NEW 3 #1/0 + 1 #6 GND. - 1 1/2°C. TO 125A-3P BRANCH CIRCUIT BREAKER.
  - ⑱ NEW 1 #2 GND. - 1°C. TO BUILDING GROUNDING ELECTRODE SYSTEM
  - ⑲ NEW 4 #250Kcmil + 1 #2 GND. - 2 1/2°C.
  - ⑳ NEW TWO (2) SETS: 4 #350Kcmil + 1 #1 GND. - 2 1/2°C. TO 600A-3P CB.
  - ㉑ AUTOMATIC TRANSFER SWITCH, 800A-3P, 277/480V-3Φ.
  - ㉒ NEW TWO (2) SETS: 4 #600Kcmil - 4" PVC SCH.40 CONDUIT TO 800A-3P BRANCH CIRCUIT BREAKER.
  - ㉓ NEW 6 #12 + 1 #12 GND. GENERATOR CONTROL WIRING RUN IN NEW 1" UNDERGROUND CONDUIT, VERIFY REQUIREMENTS WITH GENERATOR VENDOR.
  - ㉔ NEW 3 #1/0 + 1 #6 GND. - 1 1/2°C. TO 150A-3P BRANCH CIRCUIT BREAKER.
  - ㉕ NEW 4 #250Kcmil + 1 #2 GND. - 2 1/2°C. TO EXISTING ELEVATOR WIREWAY.
  - ㉖ EXISTING PANELBOARD AND FEEDER TO BE DISCONNECT AND COMPLETELY REMOVED.
  - ㉗ NEW 3 #6 + 1 #10 GND. - 3/4°C. TO 50A-3P BRANCH CIRCUIT BREAKER.
  - ㉘ EXISTING PANEL TO BE REMOVED AND REPLACED WITH NEW, SEE PANE SCHEDULE.
  - ㉙ NEW 4 #3/0 + 1 #6 GND. TO 200A-3P BRANCH CIRCUIT BREAKER, REUSE EXISTING 4" CONDUIT RISER, EXTEND TO NEW EMERGENCY DISTRIBUTION PANEL.
  - ㉚ NEW 3 #2 + 1 #8 GND. - 1 1/4°C. TO 100A-3P BRANCH CIRCUIT BREAKER.
  - ㉛ NEW 4 #4/0 + 1 #6 GND. - 2 1/2°C.
  - ㉜ NEW 8" x 8" WIREWAY.
  - ㉝ NEW 4 #1/0 + 1 #6 GND.
  - ㉞ NEW 4 #2 + 1 #8 GND. - 1 1/4°C.
  - ㉟ NEW 1 #6 GND. - 3/4°C. TO BUILDING GROUNDING ELECTRODE SYSTEM
  - ㊱ EXISTING ALUMINUM FEEDERS TO BE REMOVED AND REPLACED WITH NEW 4 #2 + 1 #8 GND. IN EXISTING 4" CONDUIT RISER.

JOEL SMILOW CARE CENTER  
BRIDGEPORT RESCUE MISSION  
PHASE II: INTERIOR RENOVATIONS  
& NEW CONSTRUCTION  
725 PARK AVENUE  
BRIDGEPORT, CONNECTICUT

DRAWING TITLE:  
ELECTRIC SERVICE  
RISER DIAGRAM

SCALE:	DRAWN BY:	REVIEWED BY:
NONE	MMV	MMV

DRAWING NO.:

E4.1  
04.16.2020 - CM BID

DATE:	GDD JOB NUMBER:
05 MARCH 2020	19469



ANTINOZZI ASSOCIATES  
ARCHITECTURE & INTERIORS

Name: EL2 (EXIST)		10K AIC FULLY RATED				AFCI - ARC FAULT CIRCUIT INTERRUPTER CB				
Voltage: 120/208V-3ø,4W		MOUNTING: SURFACE								
WIRE NO	LOAD DESCRIPTION	LOAD VA	BREAKER P	PHASE VA A	BREAKER P	LOAD VA	BREAKER P	LOAD DESCRIPTION	WIRE NO	
1	24V XFMR ZONE VALVE (E)	100	1	20	600	20	1	500	FIRE ALARM PAPP2	12 2
3	REC - RECEPTION DESK	900	1	20	1260	20	1	360	REC - DATA RACK	12 4
5	REC - LOUNGE 220	1080	1	20		20	1	360	REC - SHOWER 245	12 8
7	LTG - CORR 202,268, LNG 230	628	1	20	902	20	1	276	LTG - SHOWER 245	12 8
9	LTG - KIT, STAFF, LIB	897	1	20	1451	20	1	554	LTG - STORE, JAN, UTILITY	12 10
11	LTG - CORR 219	825	1	20		20	1		SPARE	12 12
13	SPARE	1	20	1500		30	2	1500		10 14
15	SPARE	1	20	1500					DATA RACK	10 16
17	SPARE	1	20			20	2		SPARE	18
19	SPARE	1	20						SPARE	20
21	SPARE	1	20			20	1		SPARE	22
23	SPARE	1	20			20	1		SPARE	24
25	SPARE	1	20			20	1		SPARE	26
27	SPARE	1	20			20	1		SPARE	28
29	SPARE	1	20			20	1		SPARE	30
CONNECTED PHASE LOADS:		3,002	4,211	2,265	TOTAL PANEL DEMAND: 11,053VA / 360V = 31A					

Name: RP2A (NEW)		10K AIC FULLY RATED				GFCI - GROUND FAULT CIRCUIT INTERRUPTER CB				
Voltage: 120/208V-3ø,4W		MOUNTING:								
WIRE NO	LOAD DESCRIPTION	LOAD VA	BREAKER P	PHASE VA A	BREAKER P	LOAD VA	BREAKER P	LOAD DESCRIPTION	WIRE NO	
1	REC - DISHWASHER	500	1	20	700	20	1	200	REC - TLT, CALL-FOR-AID	12 2
3	REC - COUNTER KITCH 269	1200	1	20	2000	20	1	600	REC - LAUNDRY, STORE, COPY	12 4
5	REC - REF 269	500	1	20		20	1	1500	REC - MICROWAVE 269	12 6
7	REC - STAFF 270, BATH 272	900	1	20	1260	20	1	360	REC - KITCHEN 269	12 8
9	REC - STAFF 275	720	1	20		20	1	720	REC - STAFF 273	12 10
11	REC - MANAGER 213	900	1	20	1620	20	1	720	REC - LIBRARY 216, CLASSRM 215	12 12
13	REC - CORRIDOR	1260	1	20	1800	20	1	540	REC - FAMILY COUNSEL 264	12 14
15	REC - CORRIDOR	900	1	20		20	1		SPARE	16
17	SPARE	1	20			20	1		SPARE	18
19	SPARE	1	20			20	1		SPARE	20
21	SPARE	1	20			20	1		BEDROOM	12 22
23	BEDROOM	1	20			20	1		BEDROOM	12 24
25	BEDROOM	1	20			20	1		BEDROOM	12 26
27	BEDROOM	1	20			20	1		BEDROOM	12 28
29	BEDROOM	1	20			20	1		BEDROOM	12 30
31	BEDROOM	1	20			20	1		BEDROOM	12 32
33	BEDROOM	1	20			20	1		BEDROOM	12 34
35	BEDROOM	1	20			20	1		BEDROOM	12 36
37	BEDROOM	1	20			20	1		BEDROOM	12 38
39	BEDROOM	1	20			20	1		BEDROOM	12 40
41	BEDROOM	1	20			20	1		BEDROOM	12 42
CONNECTED PHASE LOADS:		3,760	4,340	3,620	TOTAL PANEL DEMAND: 25,473VA / 360V = 71A					

Name: RP2 (EXIST)		10K AIC FULLY RATED				GFCI - GROUND FAULT CIRCUIT INTERRUPTER CB				
Voltage: 120/208V-3ø,4W		MOUNTING: SURFACE								
WIRE NO	LOAD DESCRIPTION	LOAD VA	BREAKER P	PHASE VA A	BREAKER P	LOAD VA	BREAKER P	LOAD DESCRIPTION	WIRE NO	
1	REC - WASHER	1200	1	20	4960	100	3	3760	PANEL RP2A	2 2
3	REC - WASHER	1200	1	20		5540		4340		2 4
5	REC - SHOWER 248	180	1	20				3620	SPARE	2 6
7	REC - COPIER	500	1	20	500				SPARE	8
9	SPARE	1	20						SPARE	10
11	SPARE	1	20						SPARE	12
13	FCU	790	2	20	790				SPARE	14
15	FCU	790	2	20	790				SPARE	16
17	FCU	672	2	20		672	50	2	SPARE	18
19	FCU	672	2	20		672			RANGE	6 20
21	SPARE (E)								SPARE (E)	22
23	SPARE (E)								SPARE (E)	24
25	SPARE (E)								SPARE (E)	26
27	DRYER	2500	2	30		5000	30	2	DRYER	10 28
29	DRYER	2500	2	30		5000			DRYER	10 30
CONNECTED PHASE LOADS:		10,922	11,330	13,472	TOTAL PANEL DEMAND: 42,937VA / 360V = 120A					

Name: EL3 (EXIST)		10K AIC FULLY RATED				AFCI - ARC FAULT CIRCUIT INTERRUPTER CB					
Voltage: 120/208V-3ø,4W		MOUNTING: SURFACE									
WIRE NO	LOAD DESCRIPTION	LOAD VA	BREAKER P	PHASE VA A	BREAKER P	LOAD VA	BREAKER P	LOAD DESCRIPTION	WIRE NO		
1	REC - RECEPTION DESK	900	1	20	1400	20	1	500	FIRE ALARM PAPP3	12 2	
3	REC - LOUNGE 319	1080	1	20	1440	20	1	360	REC - DATA RACK	12 4	
5	LTG - CORR 320,368, LNG 319	612	1	20		972	20	1	360	REC - SHOWER 360	12 6
7	LTG - KIT 370, STAFF, LIB	769	1	20	1045	20	1	276	LTG - SHOWER 360	12 8	
9	LTG - CORR 318	825	1	20	1364	20	1	539	LTG - STORE, JAN, UTILITY	12 10	
11	SPARE	1	20			20	1		SPARE	12	
13	SPARE	1	20	1500		30	2	1500		10 14	
15	SPARE	1	20	1500					DATA RACK	10 16	
17	SPARE	1	20			100	20	1	100	24V XFMR ZONE VALVE (E)	18
19	SPARE	1	20						SPARE	20	
21	SPARE	1	20			20	1		SPARE	22	
23	SPARE	1	20			20	1		SPARE	24	
25	SPARE	1	20			20	1		SPARE	26	
27	SPARE	1	20			20	1		SPACE	28	
29	SPARE	1	20			20	1		SPACE	30	
CONNECTED PHASE LOADS:		3,945	4,304	1,072	TOTAL PANEL DEMAND: 10,851VA / 360V = 30A						

Name: RP3A (NEW)		10K AIC FULLY RATED				GFCI - GROUND FAULT CIRCUIT INTERRUPTER CB					
Voltage: 120/208V-3ø,4W		MOUNTING:									
WIRE NO	LOAD DESCRIPTION	LOAD VA	BREAKER P	PHASE VA A	BREAKER P	LOAD VA	BREAKER P	LOAD DESCRIPTION	WIRE NO		
1	REC - DISHWASHER	500	1	20	1400	20	1	900	REC - MANAGER 313	12 2	
3	REC - COUNTER KITCH 370	1200	1	20	1920	20	1	720	REC - LIB 316, CLASSRM 315	12 4	
5	REC - REF 370	500	1	20		1400	20	1	900	REC - CORRIDOR	12 6
7	LTG - REC - JAN, STORE, UTILITY	720	1	20	1440	20	1	720	REC - CLASSRM 317, 369	12 8	
9	REC - CORRIDOR	540	1	20	1590	20	1	1080	REC - CORRIDOR	12 10	
11	REC - MICROWAVE 370	1500	1	20		2400	20	1	900	REC - ENTERPRISE 362	12 12
13	REC - COUNTER KITCH 370	360	1	20	1080	20	1	720	REC - COUNSEL 320	12 14	
15	SPARE	1	20			20	1		SPARE	16	
17	SPARE	1	20			20	1		SPARE	18	
19	SPARE	1	20			20	1		SPARE	20	
21	SPARE	1	20			20	1		BEDROOM	12 22	
23	BEDROOM	1	20			20	1		BEDROOM	12 24	
25	BEDROOM	1	20			20	1		BEDROOM	12 26	
27	BEDROOM	1	20			20	1		BEDROOM	12 28	
29	BEDROOM	1	20			20	1		BEDROOM	12 30	
31	BEDROOM	1	20			20	1		BEDROOM	12 32	
33	BEDROOM	1	20			20	1		BEDROOM	12 34	
35	BEDROOM	1	20			20	1		BEDROOM	12 36	
37	BEDROOM	1	20			20	1		BEDROOM	12 38	
39	BEDROOM	1	20			20	1		BEDROOM	12 40	
41	BEDROOM	1	20			20	1		BEDROOM	12 42	
CONNECTED PHASE LOADS:		3920	3510	3800	TOTAL PANEL DEMAND: 25,228VA / 360V = 70A						

Name: RP3 (EXIST)		10K AIC FULLY RATED				GFCI - GROUND FAULT CIRCUIT INTERRUPTER CB				
Voltage: 120/208V-3ø,4W		MOUNTING: SURFACE								
WIRE NO	LOAD DESCRIPTION	LOAD VA	BREAKER P	PHASE VA A	BREAKER P	LOAD VA	BREAKER P	LOAD DESCRIPTION	WIRE NO	
1	REC - WASHER	1200	1	20	5120	100	3	3920	PANEL RP3A	2 2
3	REC - WASHER	1200	1	20		4710		3510		2 4
5	REC - COPIER	500	1	20		4300		3900		2 6
7	SPARE	1	20						SPARE	8
9	SPARE	1	20						SPARE	10
11	SPARE	1	20						SPARE	12
13	FCU	790	2	20	790				SPARE	14
15	FCU	790	2	20	790				SPARE	16
17	FCU	672	2	20		672	50	2	SPARE	18
19	FCU	672	2	20		672			RANGE	6 20
21	SPARE (E)								SPARE (E)	22
23	SPARE (E)								SPARE (E)	24
25	SPARE (E)								SPARE (E)	26
27	DRYER	2500	2	30		5000	30	2	DRYER	10 28
29	DRYER	2500	2	30		5000			DRYER	10 30
CONNECTED PHASE LOADS:		10,582	10,500	13,972	TOTAL PANEL DEMAND: 42,602VA / 360V = 118A					

Name: EL4 (EXIST)		10K AIC FULLY RATED				SIEMENS TYPE CDP-7					
Voltage: 120/208V-3ø,4W		MOUNTING: SURFACE									
WIRE NO	LOAD DESCRIPTION	LOAD VA	BREAKER P	PHASE VA A	BREAKER P	LOAD VA	BREAKER P	LOAD DESCRIPTION	WIRE NO		
1	FIRE ALARM PAPP4	500	1	20	1028	20	1	528	EXHAUST FAN EF-2	12 2	
3	REC - SHOWER 445	360	1	20	1536	20	1	1176	EXHAUST FAN EF-5	12 4	
5	REC - RECEPTION DESK	900	1	20		1596	20	1	696	EXHAUST FAN EF-4	12 6
7	REC - DATA RACK	360	1	20	1056	20	1	696	EXHAUST FAN EF-3	12 8	
9	REC - LOUNGE	1080	1	20	1180	20	1	100	24V XFMR ZONE VALVE (E)	12 10	
11	REC - OFFICE 416	720	1	20		996	20	1	276	LTG - STORE, JAN, UTILITY	12 12
13	REC - OFFICE 408	720	1	20	1235	20	1	515	LTG - STORE, JAN, UTILITY	12 14	
15	LTG - CORR 402,464, LNG 415	1185	1	20	2685	30	2	1500		16	
17	LTG - CORR 414	825	1	20		2325			DATA RACK	18	
19	LTG - KITCH, STAFF, CLSRM	684	1	20	684	20	1		SPARE	20	
21	LTG - 5TH FLR	1157	1	20	1157	20	1		SPARE	22	
23	SPARE	1	20			20	1		SPARE	24	
25	SPARE	1	20			20	1		SPARE	26	
27	SPARE	1	20			20	1		SPARE	28	
29	SPARE	1	20			20	1		SPARE	30	
CONNECTED PHASE LOADS:		4,003	6,558	4,917	TOTAL PANEL DEMAND: 14,318VA / 360V = 40A						

Name: RP4A (NEW)		10K AIC FULLY RATED				GFCI - GROUND FAULT CIRCUIT INTERRUPTER CB			
Voltage: 120/208V-3ø,4W		MOUNTING:							
WIRE NO	LOAD DESCRIPTION	LOAD VA	BREAKER P	PHASE VA A	BREAKER P	LOAD VA	BREAKER P	LOAD DESCRIPTION	WIRE NO
1	REC - DISHWASHER	500	1	20	2000	20	1	1500	